
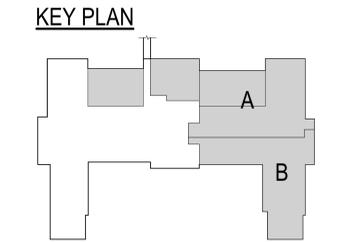


GENERAL NOTES:

- A. BUILDING WILL BE IN USE DURING CONSTRUCTION. SCHEDULE AND CARRY OUT THE WORK IN SUCH A MANNER AS TO CAUSE THE OWNER A MINIMUM OF INCONVENIENCE DUE TO SERVICE INTERRUPTION. TEMPORARY SERVICES (FEEDER, BRANCH CIRCUIT, AND SIGNAL SYSTEMS) SHALL BE INSTALLED IF ONE AREA OR PHASE OF CONSTRUCTION DISRUPTS SERVICE TO ANOTHER AREA OF THE BUILDING(S) OR IF THE EQUIPMENT, CONDUITS, OR FEEDERS HAVE TO BE RELOCATED TO ALLOW CONSTRUCTION TO PROGRESS. SERVICE INTERRUPTIONS SHALL BE CONFINED TO THE SMALLEST AREA POSSIBLE AT ANY ONE TIME AND INTERRUPTIONS SHALL BE SCHEDULED WITH THE OWNER'S SITE REPRESENTATIVE. THERE SHALL BE DESIGNATED AREAS WHERE INTERRUPTIONS LIMITED TO AND SHALL BE CONDUCTED AFTER HOURS (8:00 PM - 4:00 AM) MONDAY THROUGH SATURDAY. AFTER SERVICE HAS BEEN RESTORED FOLLOWING AN INTERRUPTION, INSPECT AREAS AFFECTED BY THE INTERRUPTION AND BE RESPONSIBLE FOR RETURNING AUTOMATICALLY CONTROLLED EQUIPMENT TO THE SAME OPERATING CONDITION WHICH EXISTED PRIOR TO THE INTERRUPTION.
- B. SIGNIFICANT NOISE PRODUCING WORK SHALL BE CONDUCTED AFTER HOURS (8:00 PM - 6:00AM)
- C. REMOVE, REPLACE, RELOCATE, ETC. ANY ELECTRICAL DEVICES AND/OR ANY CONDUIT/WIRING AS REQUIRED TO COMPLETE REMODELING AS INDICATED IN THE CONTRACT DOCUMENTS.
- D. DRAWINGS INDICATE EXISTING CONDITIONS AS THEY WERE INDICATED ON OWNER PROVIDED AS-BUILT DRAWINGS AND SITE VERIFICATION. ACTUAL CONDITIONS MAY VARY FROM THE CONDITIONS INDICATED. THE CONTRACTOR IS RESPONSIBLE TO FIELD VERIFY EXACT CONDITIONS.
- E. ALL DEVICES, EQUIPMENT, CABLING, ETC. INDICATED IN THE CONTRACT DOCUMENTS TO BE REMOVED SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO DISPOSE OF IN ACCORDANCE WITH LOCAL AND FEDERAL REGULATIONS. REFER TO SPECIFICATIONS FOR ADDITIONAL INFORMATION.
- F. DEMOLISH HOME RUN WIRING BACK TO SOURCE UNLESS NOTED OTHERWISE. DO NOT LEAVE CONDUCTORS ABANDONED IN WIREWAY.
- G. TEMPORARILY SUPPORT ELECTRICAL FIXTURES, EQUIPMENT, CONDUCTORS, AND CABLING AS REQUIRED FOR MECHANICAL WORK. REINSTALL AFTER COMPLETION OF WORK.

KEY NOTES:

- ◊ DEMOLISH AHU.

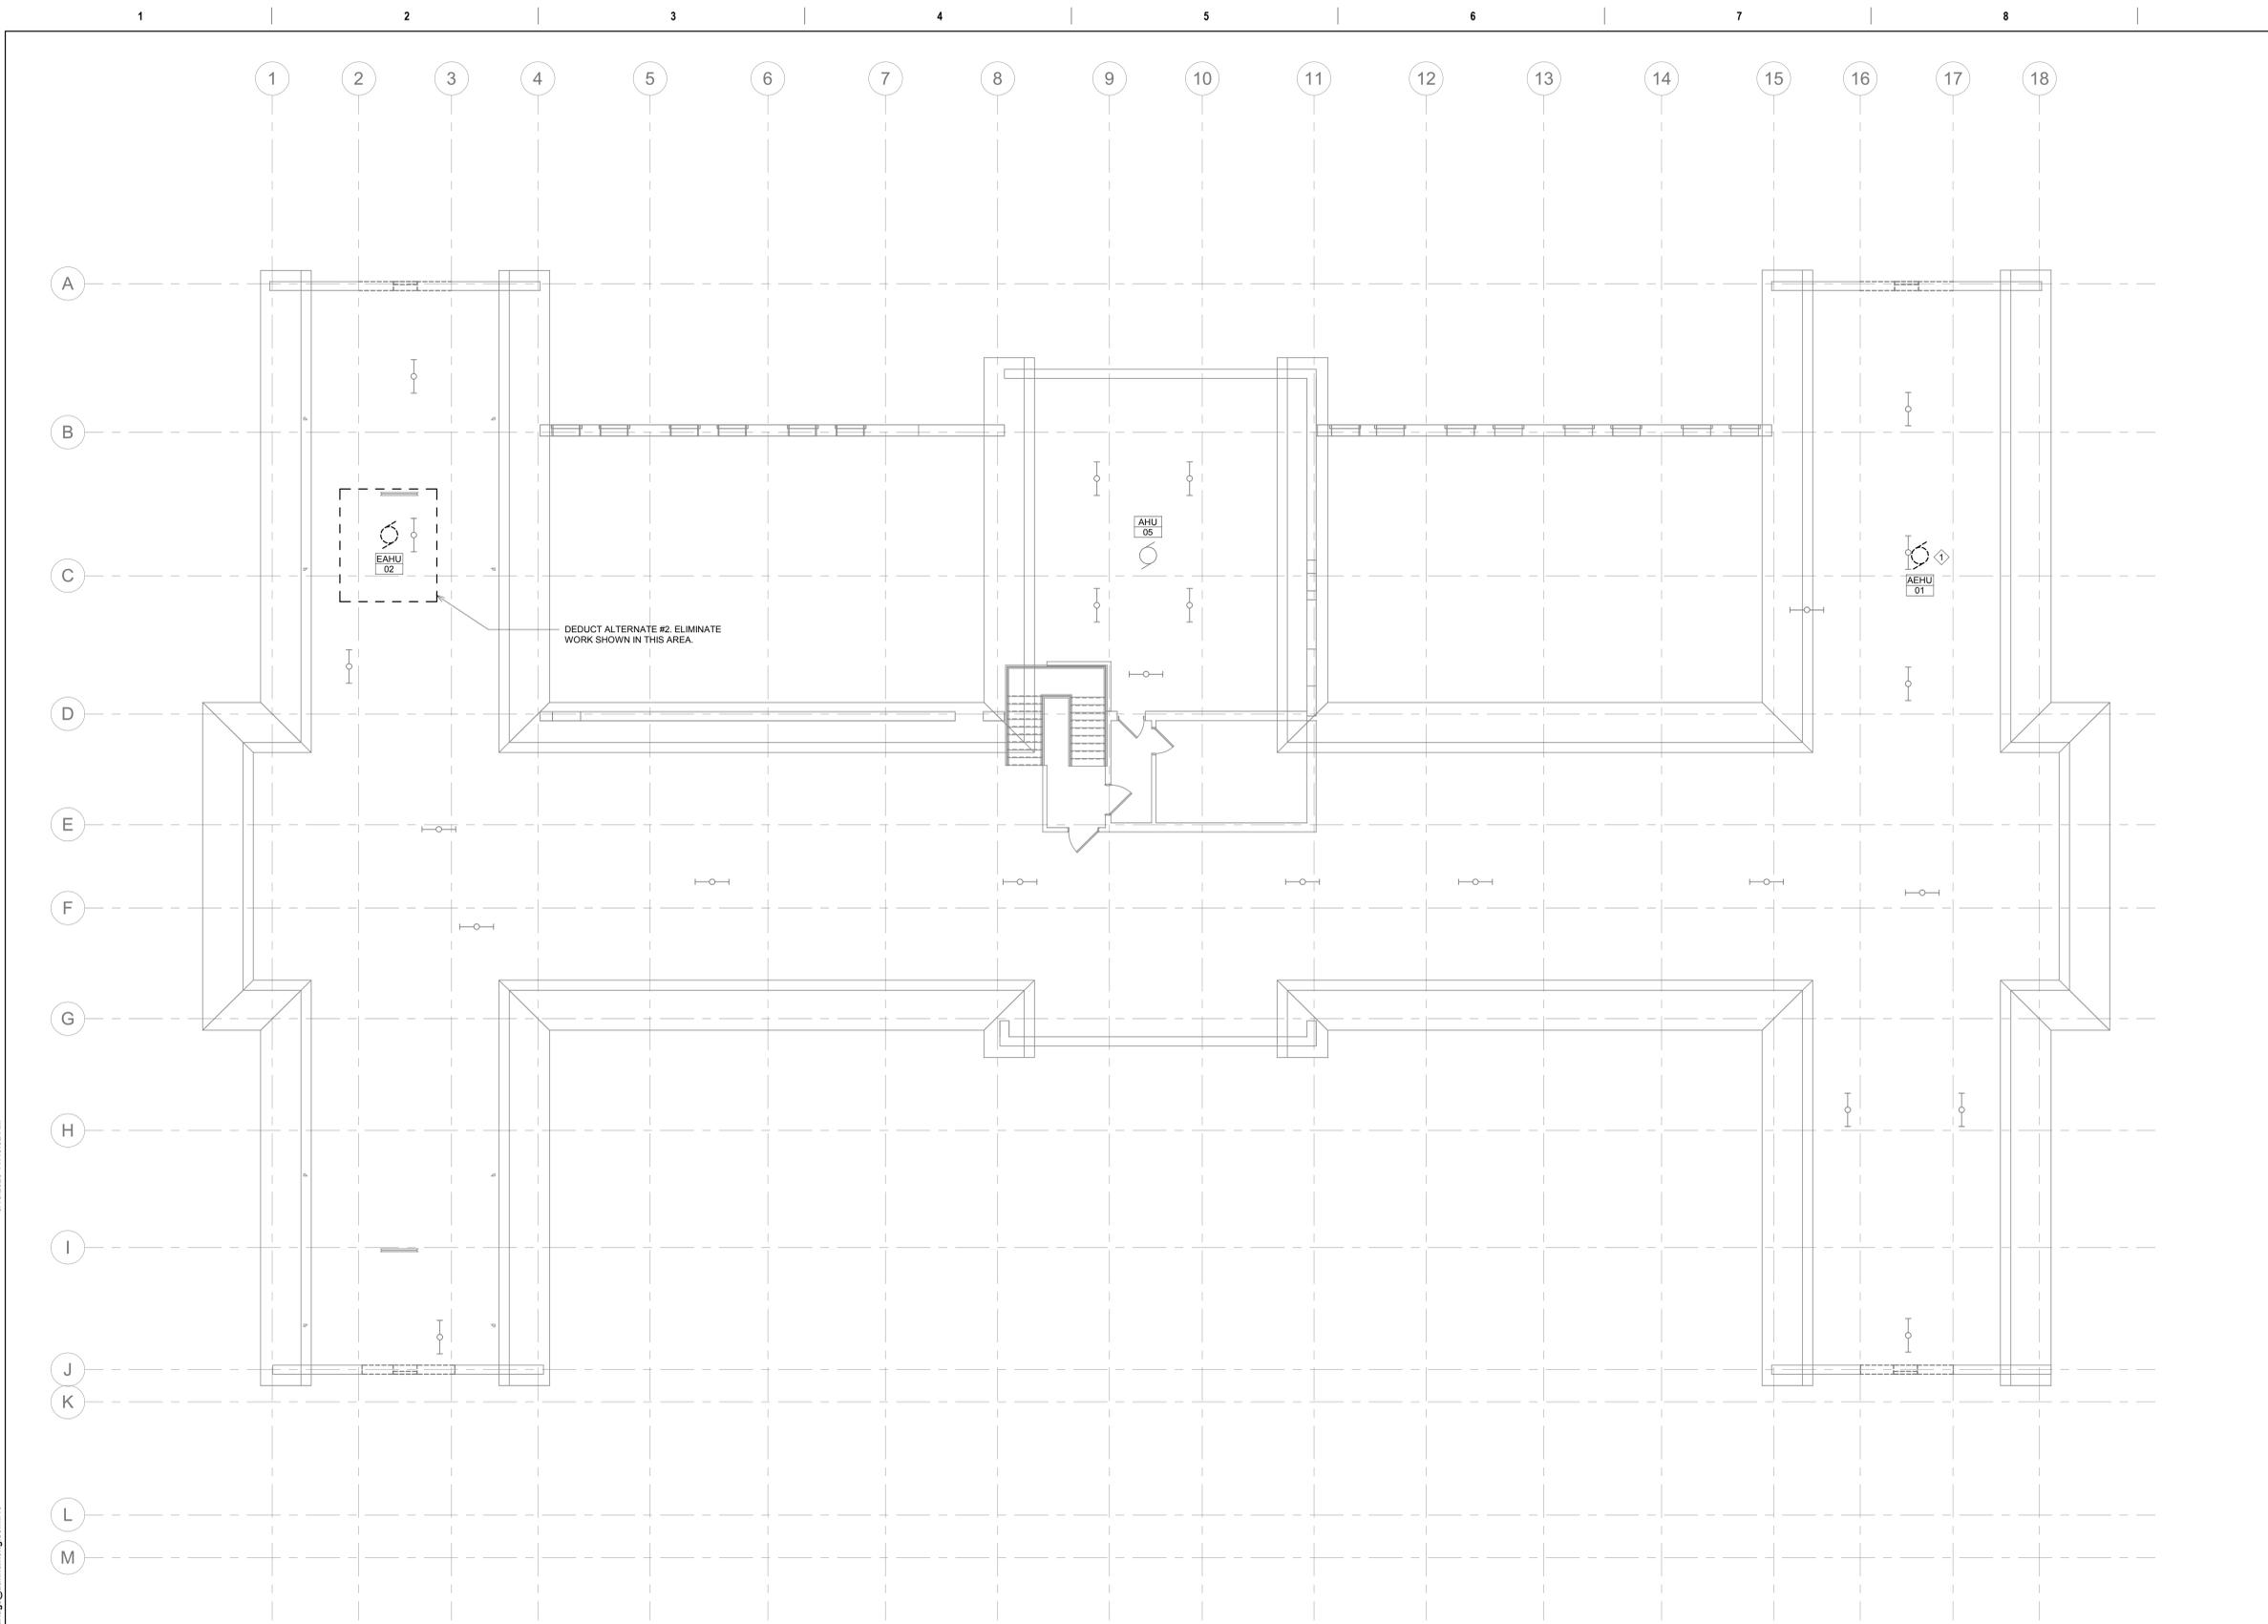

1 ATTIC FLOOR ELECTRICAL DEMOLITION PLAN
1/8" = 1'-0"

Revision#	Description	Date:

CONSULTANT

DUNHAM

50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612.465.7550 Fax: 612.465.7551
 www.dunhaminc.com
 mechanical + electrical consulting engineering
 650950-007-00

ARCHITECT/ENGINEER OF RECORD

ANDERSON

13605 1st Ave. N. #100 Plymouth, MN 55441
 P 763.412.4000 | F 763.412.4090 | ae-mn.com
 Anderson Engineering of Minnesota, LLC | Proj # Project Number

STAMP

I hereby certify that this plan, specification or report was prepared by me or under my direct supervision and that I am a duly licensed Professional Engineer under the laws of the State of Minnesota.

Name: Curtis D. Barlage, P.E.
 Date: 05/22/2020 Reg. No. 45914

Project Title RENOVATE BUILDING 28 FIRST FLOOR EAST RTTP		Project Number 656-19-306	
Location SAINT CLOUD, MN		Building Number 28	
Phase CONSTRUCTION DOCUMENTS		Drawing Number EED131	
Drawing Title ATTIC ELECTRICAL DEMOLITION PLAN		Issue Date MAY 22, 2020	Checked CB
		Drawn BZ	

VA

U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System



GENERAL NOTES:

- A. BUILDING WILL BE IN USE DURING CONSTRUCTION. SCHEDULE AND CARRY OUT THE WORK IN SUCH A MANNER AS TO CAUSE THE OWNER A MINIMUM OF INCONVENIENCE DUE TO SERVICE INTERRUPTION. TEMPORARY SERVICES (FEEDER, BRANCH CIRCUIT, AND SIGNAL SYSTEMS) SHALL BE INSTALLED IF ONE AREA OR PHASE OF CONSTRUCTION DISRUPTS SERVICE TO ANOTHER AREA OF THE BUILDING(S) OR IF THE EQUIPMENT, CONDUITS, OR FEEDERS HAVE TO BE RELOCATED TO ALLOW CONSTRUCTION TO PROGRESS. SERVICE INTERRUPTIONS SHALL BE CONFINED TO THE SMALLEST AREA POSSIBLE AT ANY ONE TIME AND INTERRUPTIONS SHALL BE SCHEDULED WITH THE OWNER'S SITE REPRESENTATIVE. THERE SHALL BE DESIGNATED AREAS WHERE INTERRUPTIONS LIMITED TO AND SHALL BE CONDUCTED AFTER HOURS (8:00 PM - 4:00 AM) MONDAY THROUGH SATURDAY. AFTER SERVICE HAS BEEN RESTORED FOLLOWING AN INTERRUPTION, INSPECT AREAS AFFECTED BY THE INTERRUPTION AND BE RESPONSIBLE FOR RETURNING AUTOMATICALLY CONTROLLED EQUIPMENT TO THE SAME OPERATING CONDITION WHICH EXISTED PRIOR TO THE INTERRUPTION.
- B. SIGNIFICANT NOISE PRODUCING WORK SHALL BE CONDUCTED AFTER HOURS (8:00 PM - 6:00AM)
- C. REMOVE, REPLACE, RELOCATE, ETC. ANY ELECTRICAL DEVICES AND/OR ANY CONDUIT/WIRING AS REQUIRED TO COMPLETE REMODELING AS INDICATED IN THE CONTRACT DOCUMENTS.
- D. DRAWINGS INDICATE EXISTING CONDITIONS AS THEY WERE INDICATED ON OWNER PROVIDED AS-BUILT DRAWINGS AND SITE VERIFICATION. ACTUAL CONDITIONS MAY VARY FROM THE CONDITIONS INDICATED. THE CONTRACTOR IS RESPONSIBLE TO FIELD VERIFY EXACT CONDITIONS.
- E. ALL DEVICES, EQUIPMENT, CABLING, ETC. INDICATED IN THE CONTRACT DOCUMENTS TO BE REMOVED SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO DISPOSE OF IN ACCORDANCE WITH LOCAL AND FEDERAL REGULATIONS. REFER TO SPECIFICATIONS FOR ADDITIONAL INFORMATION.
- F. DEMOLISH HOME RUN WIRING BACK TO SOURCE UNLESS NOTED OTHERWISE. DO NOT LEAVE CONDUCTORS ABANDONED IN WIREWAY.
- G. TEMPORARILY SUPPORT ELECTRICAL FIXTURES, EQUIPMENT, CONDUITS, AND CABLING AS REQUIRED FOR MECHANICAL WORK. REINSTALL AFTER COMPLETION OF WORK.

KEY NOTES:

- ◇ RELOCATE LIGHTING AS REQUIRED FOR MECHANICAL EQUIPMENT.

KEY PLAN

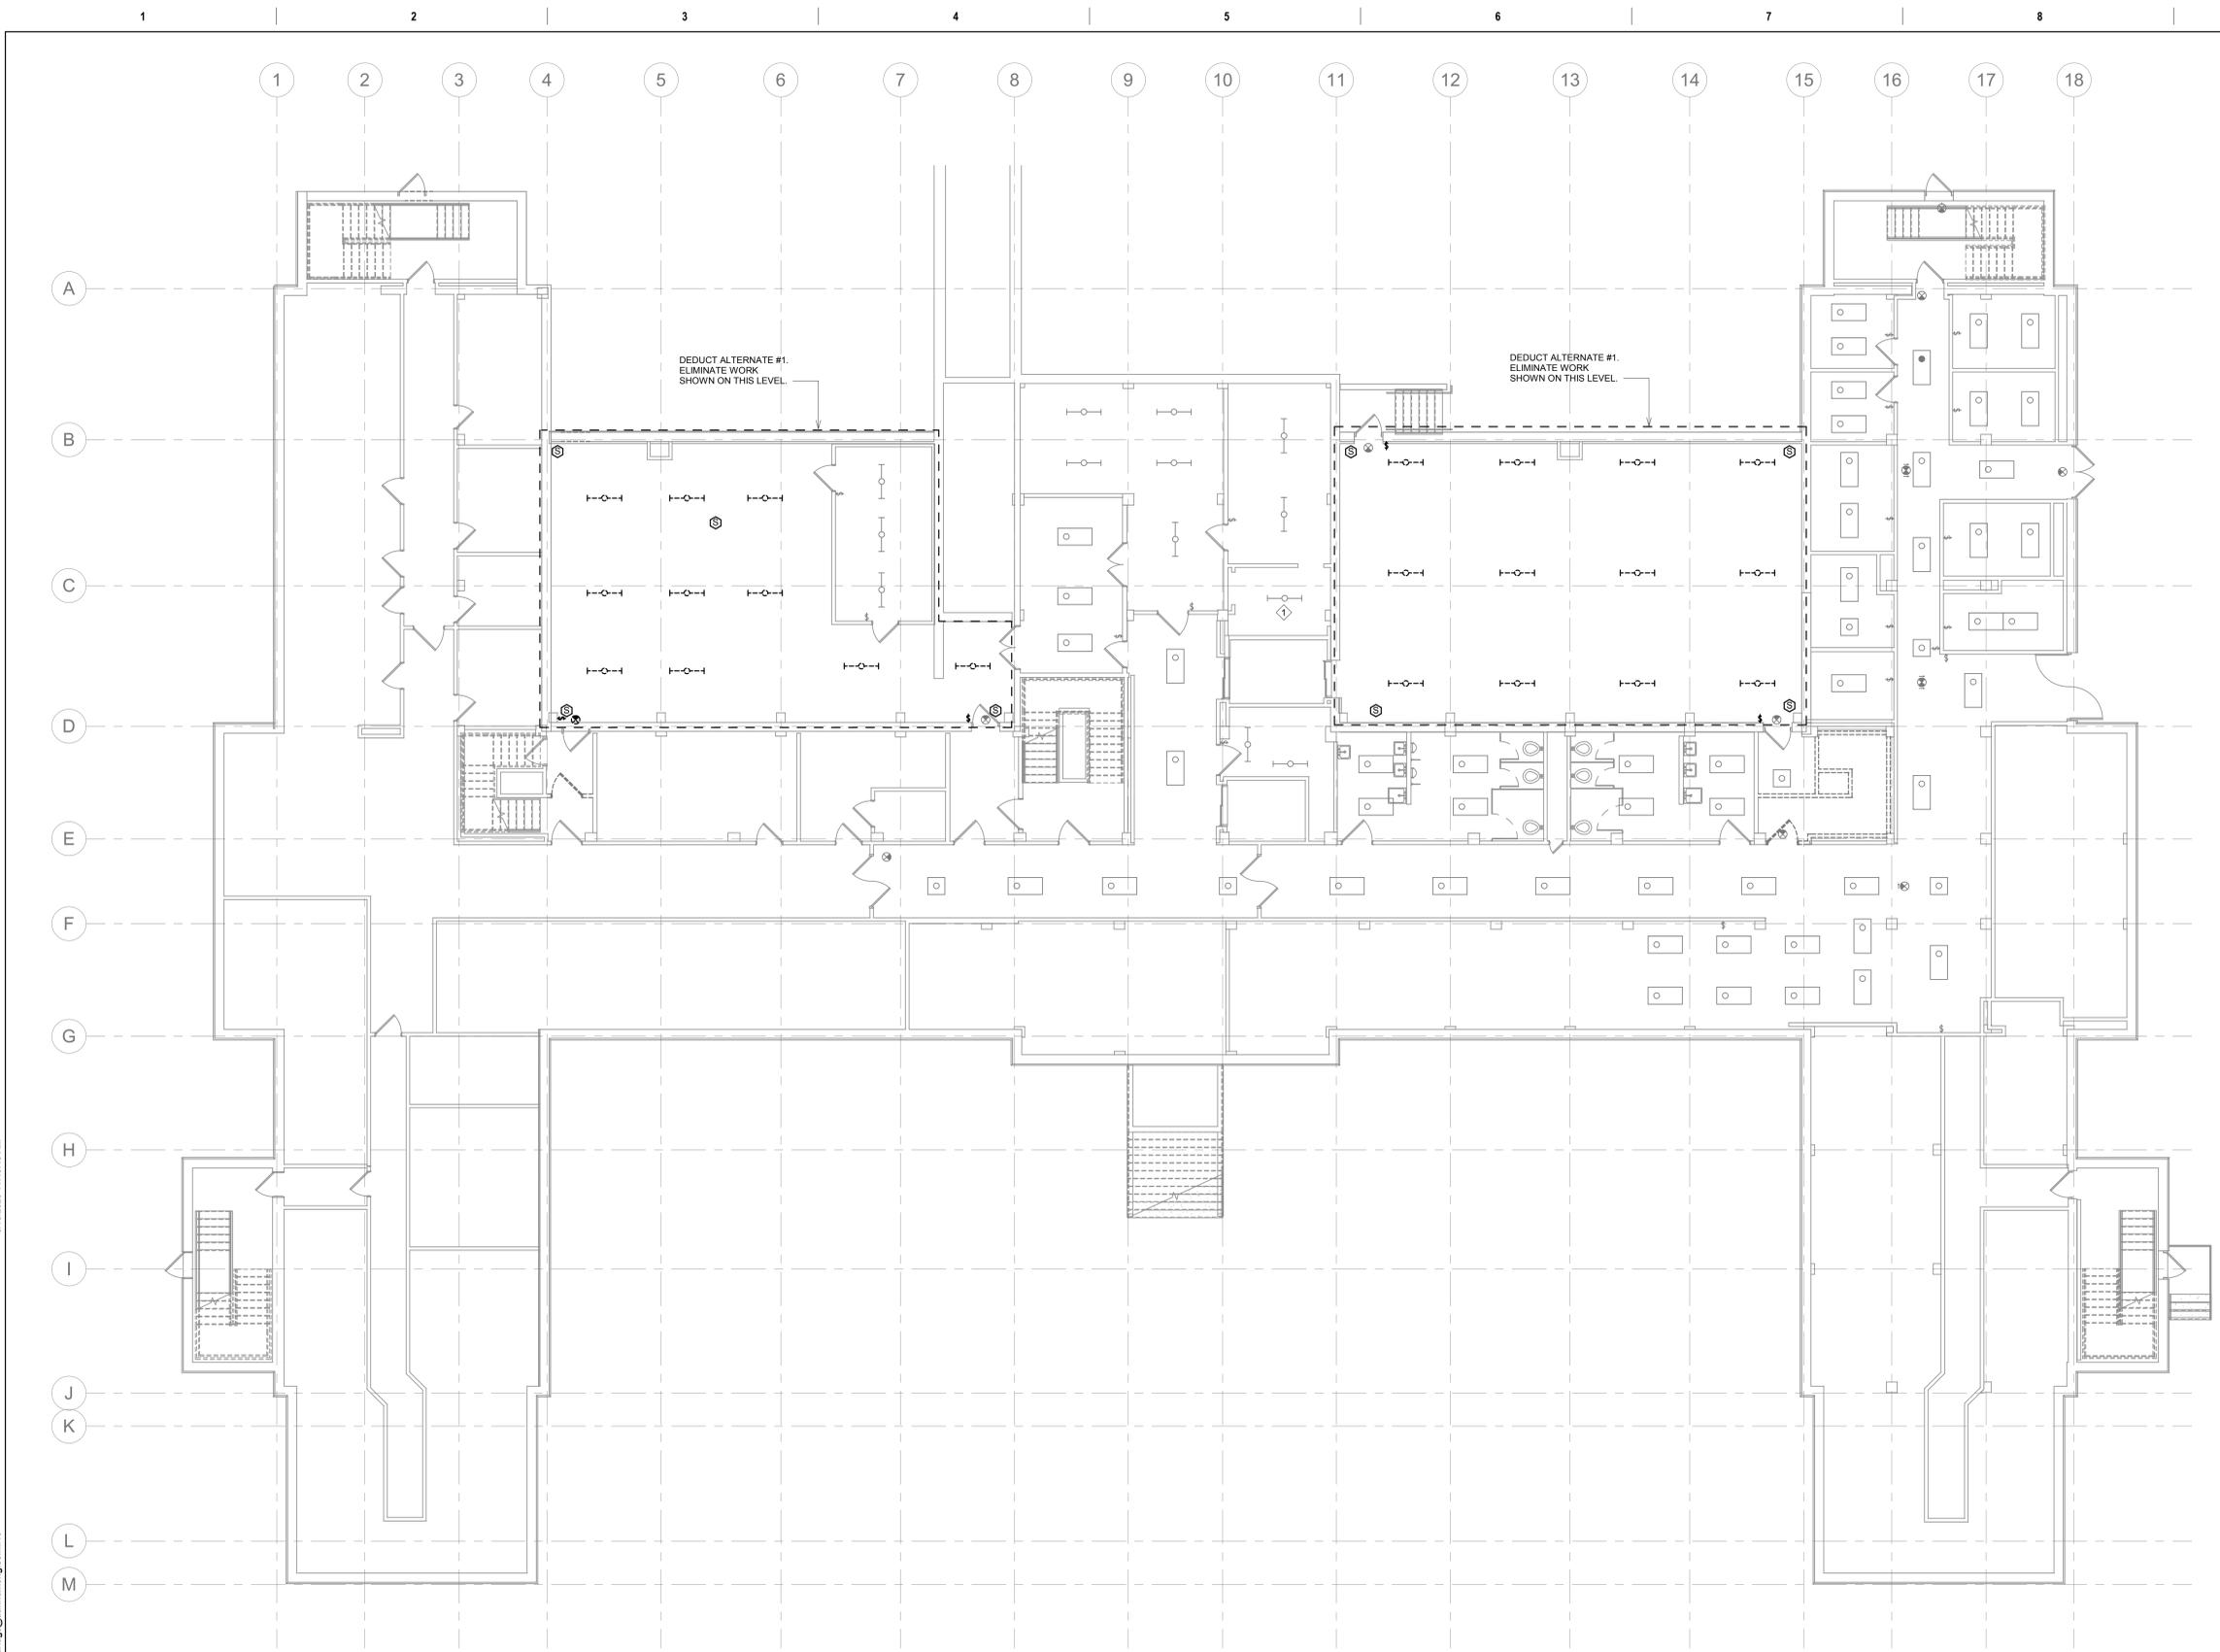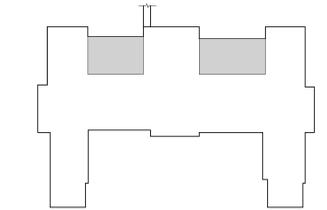

1 BASEMENT LIGHTING DEMOLITION PLAN
1/8" = 1'-0"

Revision#	Description	Date:

CONSULTANT

DUNHAM

50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612.465.7550 Fax: 612.465.7551
 Website: dunhaminc.com
 mechanical + electrical consulting engineering
 652950-007-00

ARCHITECT/ENGINEER OF RECORD

ANDERSON

13605 1st Ave. N., #100 Plymouth, MN 55441
 P 763.412.4000 | F 763.412.4090 | ae-mn.com
 Anderson Engineering of Minnesota, LLC | Proj # Project Number

STAMP

I hereby certify that this plan, specification or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the laws of the State of Minnesota.

Name: Curtis D. Barlage, P.E.
 Date: 05/22/2020 Reg. No. 45914

Project Title RENOVATE BUILDING 28 FIRST FLOOR EAST RTTP		Project Number 656-19-306	
Location SAINT CLOUD, MN		Building Number 28	
Phase CONSTRUCTION DOCUMENTS		Drawing Number ELD101	
Drawing Title BASEMENT LIGHTING DEMOLITION PLAN		Issue Date MAY 22, 2020	Checked CB
		Drawn BZ	

VA



U.S. Department of Veterans Affairs

Veterans Health Administration
 St. Cloud VA Health Care System

GENERAL NOTES:

- A. BUILDING WILL BE IN USE DURING CONSTRUCTION. SCHEDULE AND CARRY OUT THE WORK IN SUCH A MANNER AS TO CAUSE THE OWNER A MINIMUM OF INCONVENIENCE DUE TO SERVICE INTERRUPTION. TEMPORARY SERVICES (FEEDER, BRANCH CIRCUIT, AND SIGNAL SYSTEMS) SHALL BE INSTALLED IF ONE AREA OR PHASE OF CONSTRUCTION DISRUPTS SERVICE TO ANOTHER AREA OF THE BUILDING(S) OR IF THE EQUIPMENT, CONDUITS, OR FEEDERS HAVE TO BE RELOCATED TO ALLOW CONSTRUCTION TO PROGRESS. SERVICE INTERRUPTIONS SHALL BE CONFINED TO THE SMALLEST AREA POSSIBLE AT ANY ONE TIME AND INTERRUPTIONS SHALL BE SCHEDULED WITH THE OWNER'S SITE REPRESENTATIVE. THERE SHALL BE DESIGNATED AREAS WHERE INTERRUPTIONS LIMITED TO AND SHALL BE CONDUCTED AFTER HOURS (8:00 PM - 4:00 AM) MONDAY THROUGH SATURDAY. AFTER SERVICE HAS BEEN RESTORED FOLLOWING AN INTERRUPTION, INSPECT AREAS AFFECTED BY THE INTERRUPTION AND BE RESPONSIBLE FOR RETURNING AUTOMATICALLY CONTROLLED EQUIPMENT TO THE SAME OPERATING CONDITION WHICH EXISTED PRIOR TO THE INTERRUPTION.
- B. SIGNIFICANT NOISE PRODUCING WORK SHALL BE CONDUCTED AFTER HOURS (8:00 PM - 6:00AM)
- C. REMOVE, REPLACE, RELOCATE, ETC. ANY ELECTRICAL DEVICES AND/OR ANY CONDUIT/WIRINGS AS REQUIRED TO COMPLETE REMODELING AS INDICATED IN THE CONTRACT DOCUMENTS.
- D. DRAWINGS INDICATE EXISTING CONDITIONS AS THEY WERE INDICATED ON OWNER PROVIDED AS-BUILT DRAWINGS AND SITE VERIFICATION. ACTUAL CONDITIONS MAY VARY FROM THE CONDITIONS INDICATED. THE CONTRACTOR IS RESPONSIBLE TO FIELD VERIFY EXACT CONDITIONS.
- E. ALL DEVICES, EQUIPMENT, CABLING, ETC. INDICATED IN THE CONTRACT DOCUMENTS TO BE REMOVED SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO DISPOSE OF IN ACCORDANCE WITH LOCAL AND FEDERAL REGULATIONS. REFER TO SPECIFICATIONS FOR ADDITIONAL INFORMATION.
- F. DEMOLISH HOME RUN WIRING BACK TO SOURCE UNLESS NOTED OTHERWISE. DO NOT LEAVE CONDUCTORS ABANDONED IN WIREWAY.
- G. TEMPORARILY SUPPORT ELECTRICAL FIXTURES, EQUIPMENT, CONDUITS, AND CABLING AS REQUIRED FOR MECHANICAL WORK. REINSTALL AFTER COMPLETION OF WORK.

KEY PLAN

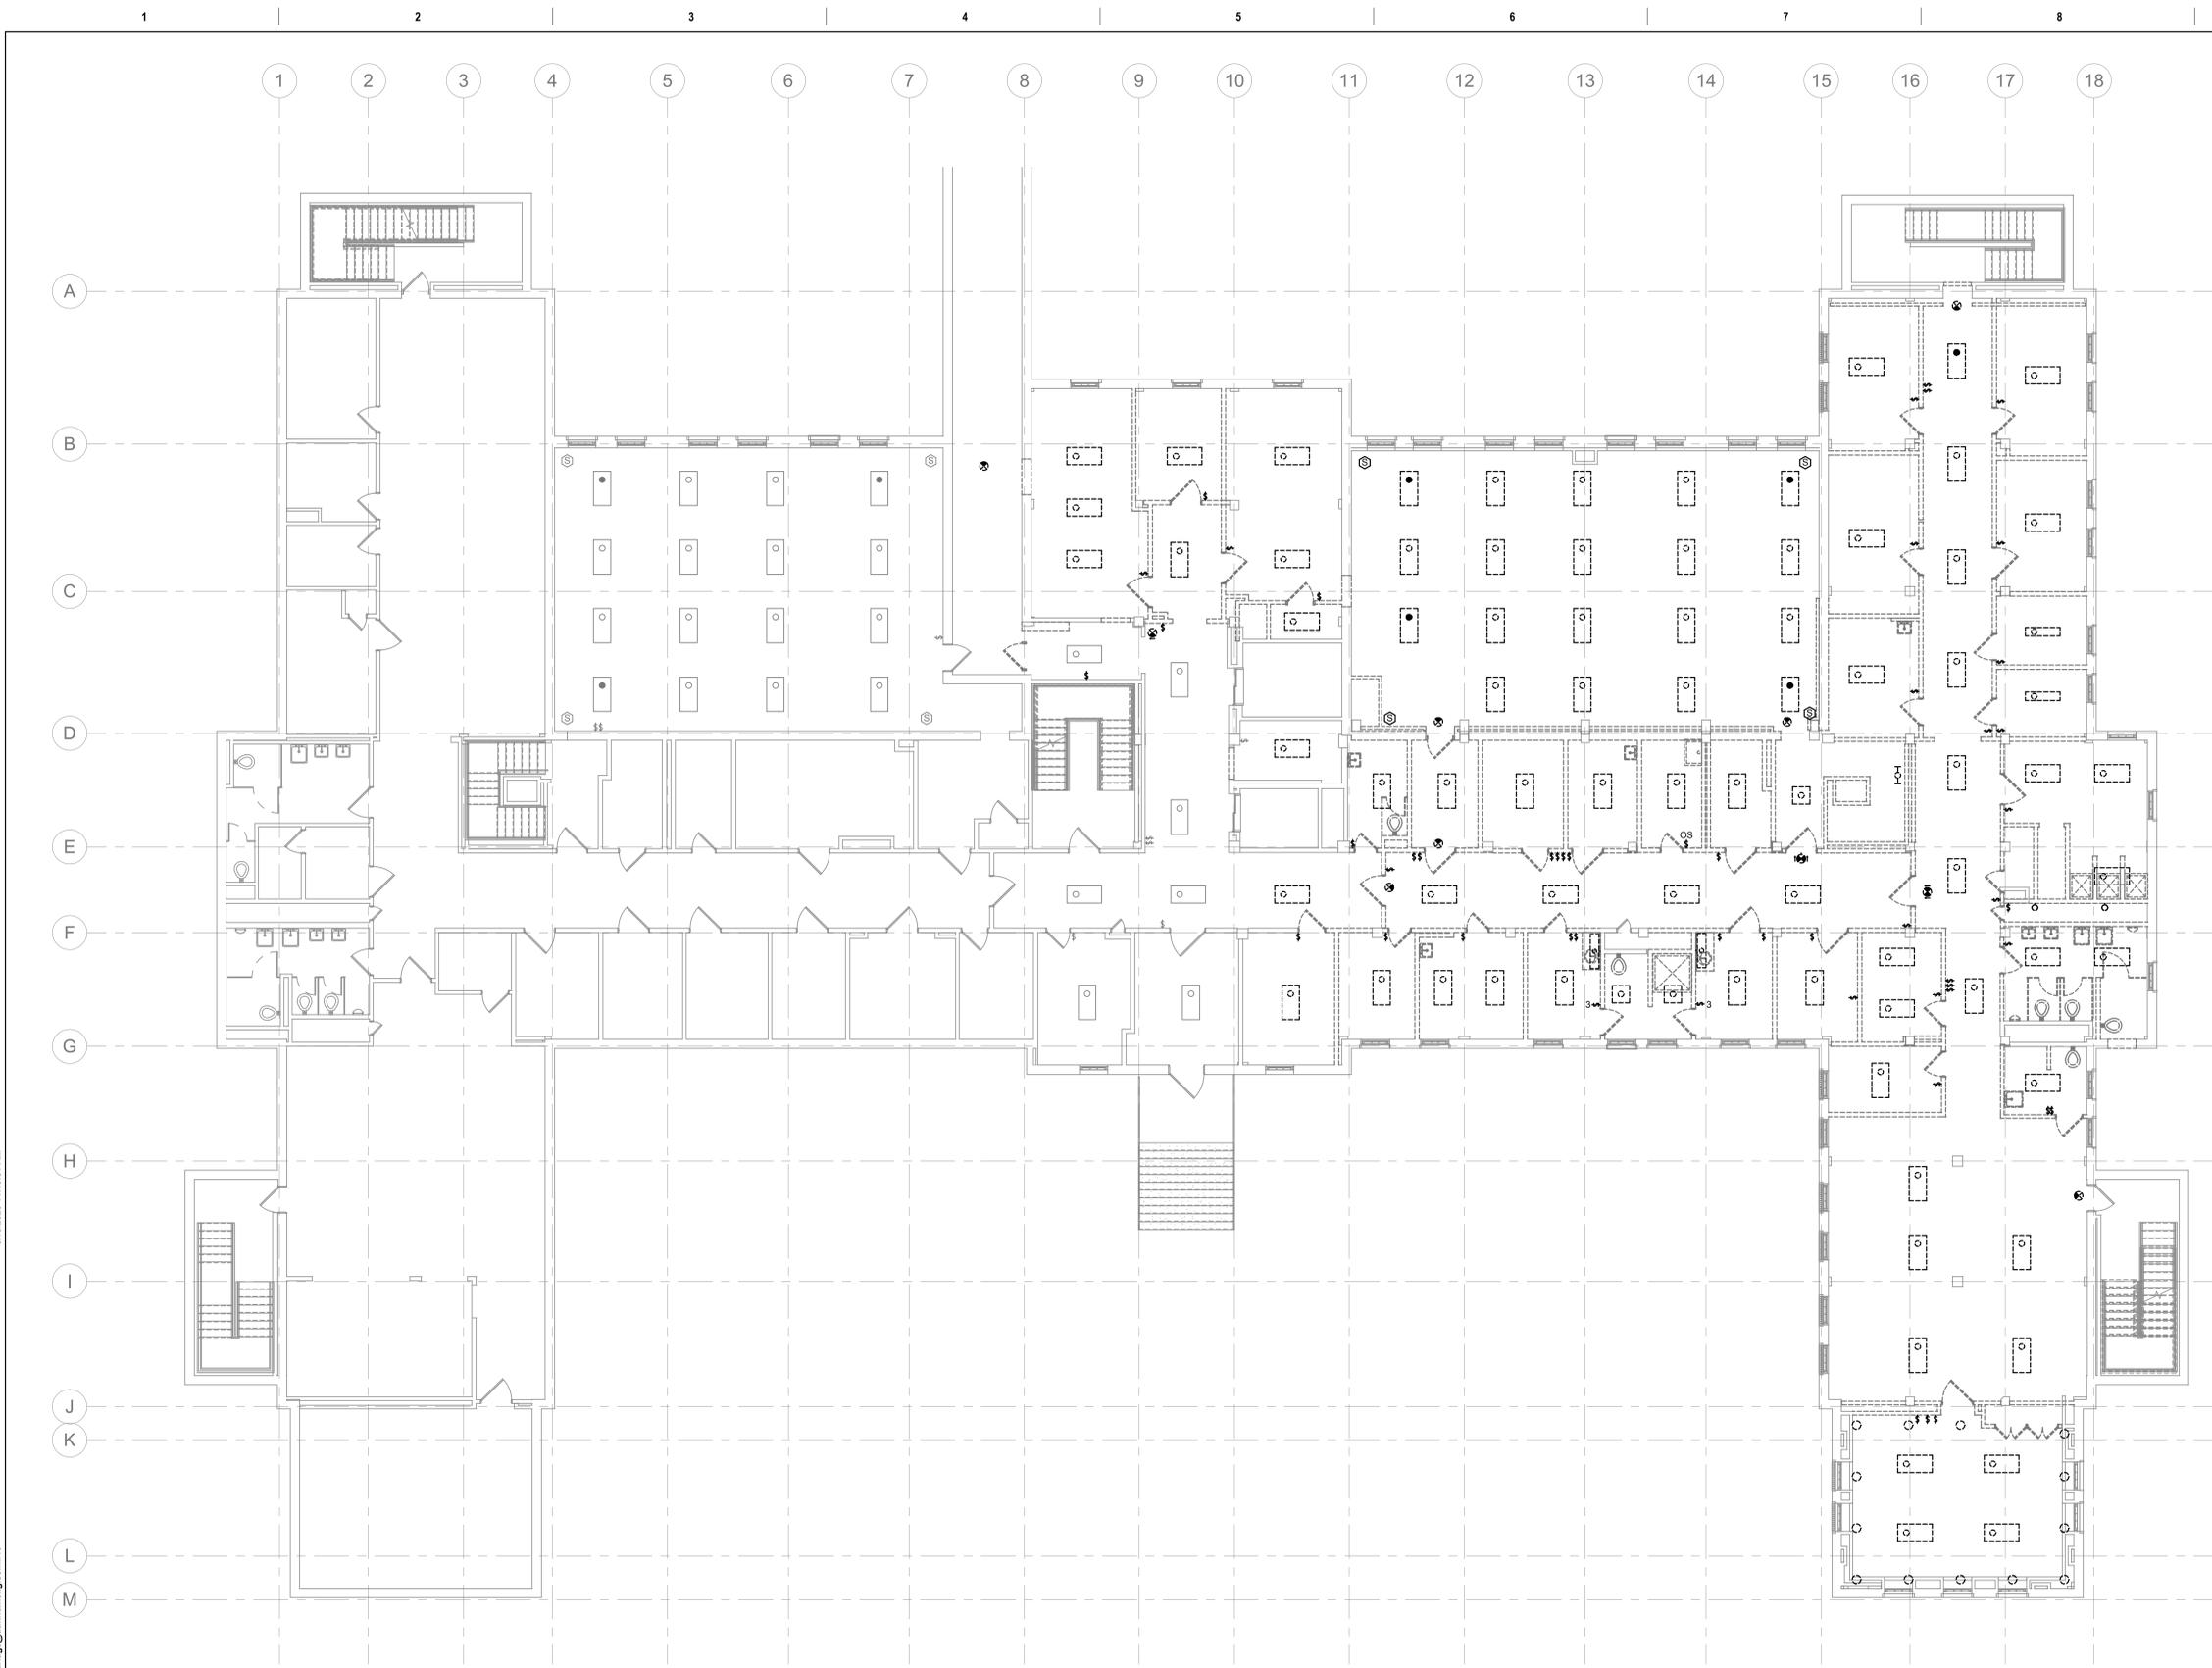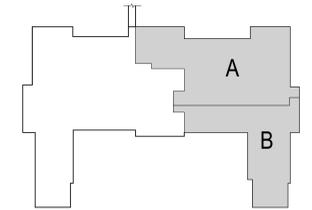

1 FIRST FLOOR LIGHTING DEMOLITION PLAN
1/8" = 1'-0"

Revision#	Description	Date:

CONSULTANT

DUNHAM

DUNHAM
50 South Sixth Street / Suite 1100
Minneapolis, Minnesota 55402-1540
PHONE: 612.465.7550 FAX: 612.465.7551
WWW: dunhameng.com
mechanical • electrical consulting engineering
652950-007-00

ARCHITECT/ENGINEER OF RECORD

ANDERSON

13605 1st Ave. N. #100 Plymouth, MN 55441
P 763.412.4000 | F 763.412.4090 | ae-mn.com
Anderson Engineering of Minnesota, LLC | Proj # Project Number

STAMP

I hereby certify that this plan, specification or report was prepared by me or under my direct supervision and that I am a duly licensed Professional Engineer under the laws of the State of Minnesota.

Name: Curtis D. Barlage, P.E.
Date: 05/22/2020 Reg. No. 45914

Project Title
RENOVATE BUILDING 28
FIRST FLOOR EAST RTTP

Location
SAINT CLOUD, MN

Phase
CONSTRUCTION DOCUMENTS

Drawing Title
FIRST FLOOR LIGHTING DEMOLITION PLAN

Issue Date
MAY 22, 2020

Checked
CB

Drawn
BZ

Project Number
656-19-306

Building Number
28

Drawing Number
ELD111

VA

U.S. Department of Veterans Affairs

Veterans Health Administration
St. Cloud VA Health Care System



GENERAL NOTES:

- A. BUILDING WILL BE IN USE DURING CONSTRUCTION. SCHEDULE AND CARRY OUT THE WORK IN SUCH A MANNER AS TO CAUSE THE OWNER A MINIMUM OF INCONVENIENCE DUE TO SERVICE INTERRUPTION. TEMPORARY SERVICES (FEEDER, BRANCH CIRCUIT, AND SIGNAL SYSTEMS) SHALL BE INSTALLED IF ONE AREA OR PHASE OF CONSTRUCTION DISRUPTS SERVICE TO ANOTHER AREA OF THE BUILDING(S) OR IF THE EQUIPMENT, CONDUITS, OR FEEDERS HAVE TO BE RELOCATED TO ALLOW CONSTRUCTION TO PROGRESS. SERVICE INTERRUPTIONS SHALL BE CONFINED TO THE SMALLEST AREA POSSIBLE AT ANY ONE TIME AND INTERRUPTIONS SHALL BE SCHEDULED WITH THE OWNER'S SITE REPRESENTATIVE. THERE SHALL BE DESIGNATED AREAS WHERE INTERRUPTIONS LIMITED TO AND SHALL BE CONDUCTED AFTER HOURS (8:00 PM - 4:00 AM) MONDAY THROUGH SATURDAY. AFTER SERVICE HAS BEEN RESTORED FOLLOWING AN INTERRUPTION, INSPECT AREAS AFFECTED BY THE INTERRUPTION AND BE RESPONSIBLE FOR RETURNING AUTOMATICALLY CONTROLLED EQUIPMENT TO THE SAME OPERATING CONDITION WHICH EXISTED PRIOR TO THE INTERRUPTION.
- B. SIGNIFICANT NOISE PRODUCING WORK SHALL BE CONDUCTED AFTER HOURS (8:00 PM - 6:00AM)
- C. REMOVE, REPLACE, RELOCATE, ETC. ANY ELECTRICAL DEVICES AND/OR ANY CONDUIT/WIRINGS AS REQUIRED TO COMPLETE REMODELING AS INDICATED IN THE CONTRACT DOCUMENTS.
- D. DRAWINGS INDICATE EXISTING CONDITIONS AS THEY WERE INDICATED ON OWNER PROVIDED AS-BUILT DRAWINGS AND SITE VERIFICATION. ACTUAL CONDITIONS MAY VARY FROM THE CONDITIONS INDICATED. THE CONTRACTOR IS RESPONSIBLE TO FIELD VERIFY EXACT CONDITIONS.
- E. ALL DEVICES, EQUIPMENT, CABLING, ETC. INDICATED IN THE CONTRACT DOCUMENTS TO BE REMOVED SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO DISPOSE OF IN ACCORDANCE WITH LOCAL AND FEDERAL REGULATIONS. REFER TO SPECIFICATIONS FOR ADDITIONAL INFORMATION.
- F. DEMOLISH HOME RUN WIRING BACK TO SOURCE UNLESS NOTED OTHERWISE. DO NOT LEAVE CONDUCTORS ABANDONED IN WIREWAY.
- G. TEMPORARILY SUPPORT ELECTRICAL FIXTURES, EQUIPMENT, CONDUITS, AND CABLING AS REQUIRED FOR MECHANICAL WORK. REINSTALL AFTER COMPLETION OF WORK.

KEY NOTES:

- ◇ CEILING TO BE REMOVED AND REINSTALLED FOR MECHANICAL WORK. REMOVE AND REINSTALL ELECTRICAL EQUIPMENT AS REQUIRED.

KEY PLAN

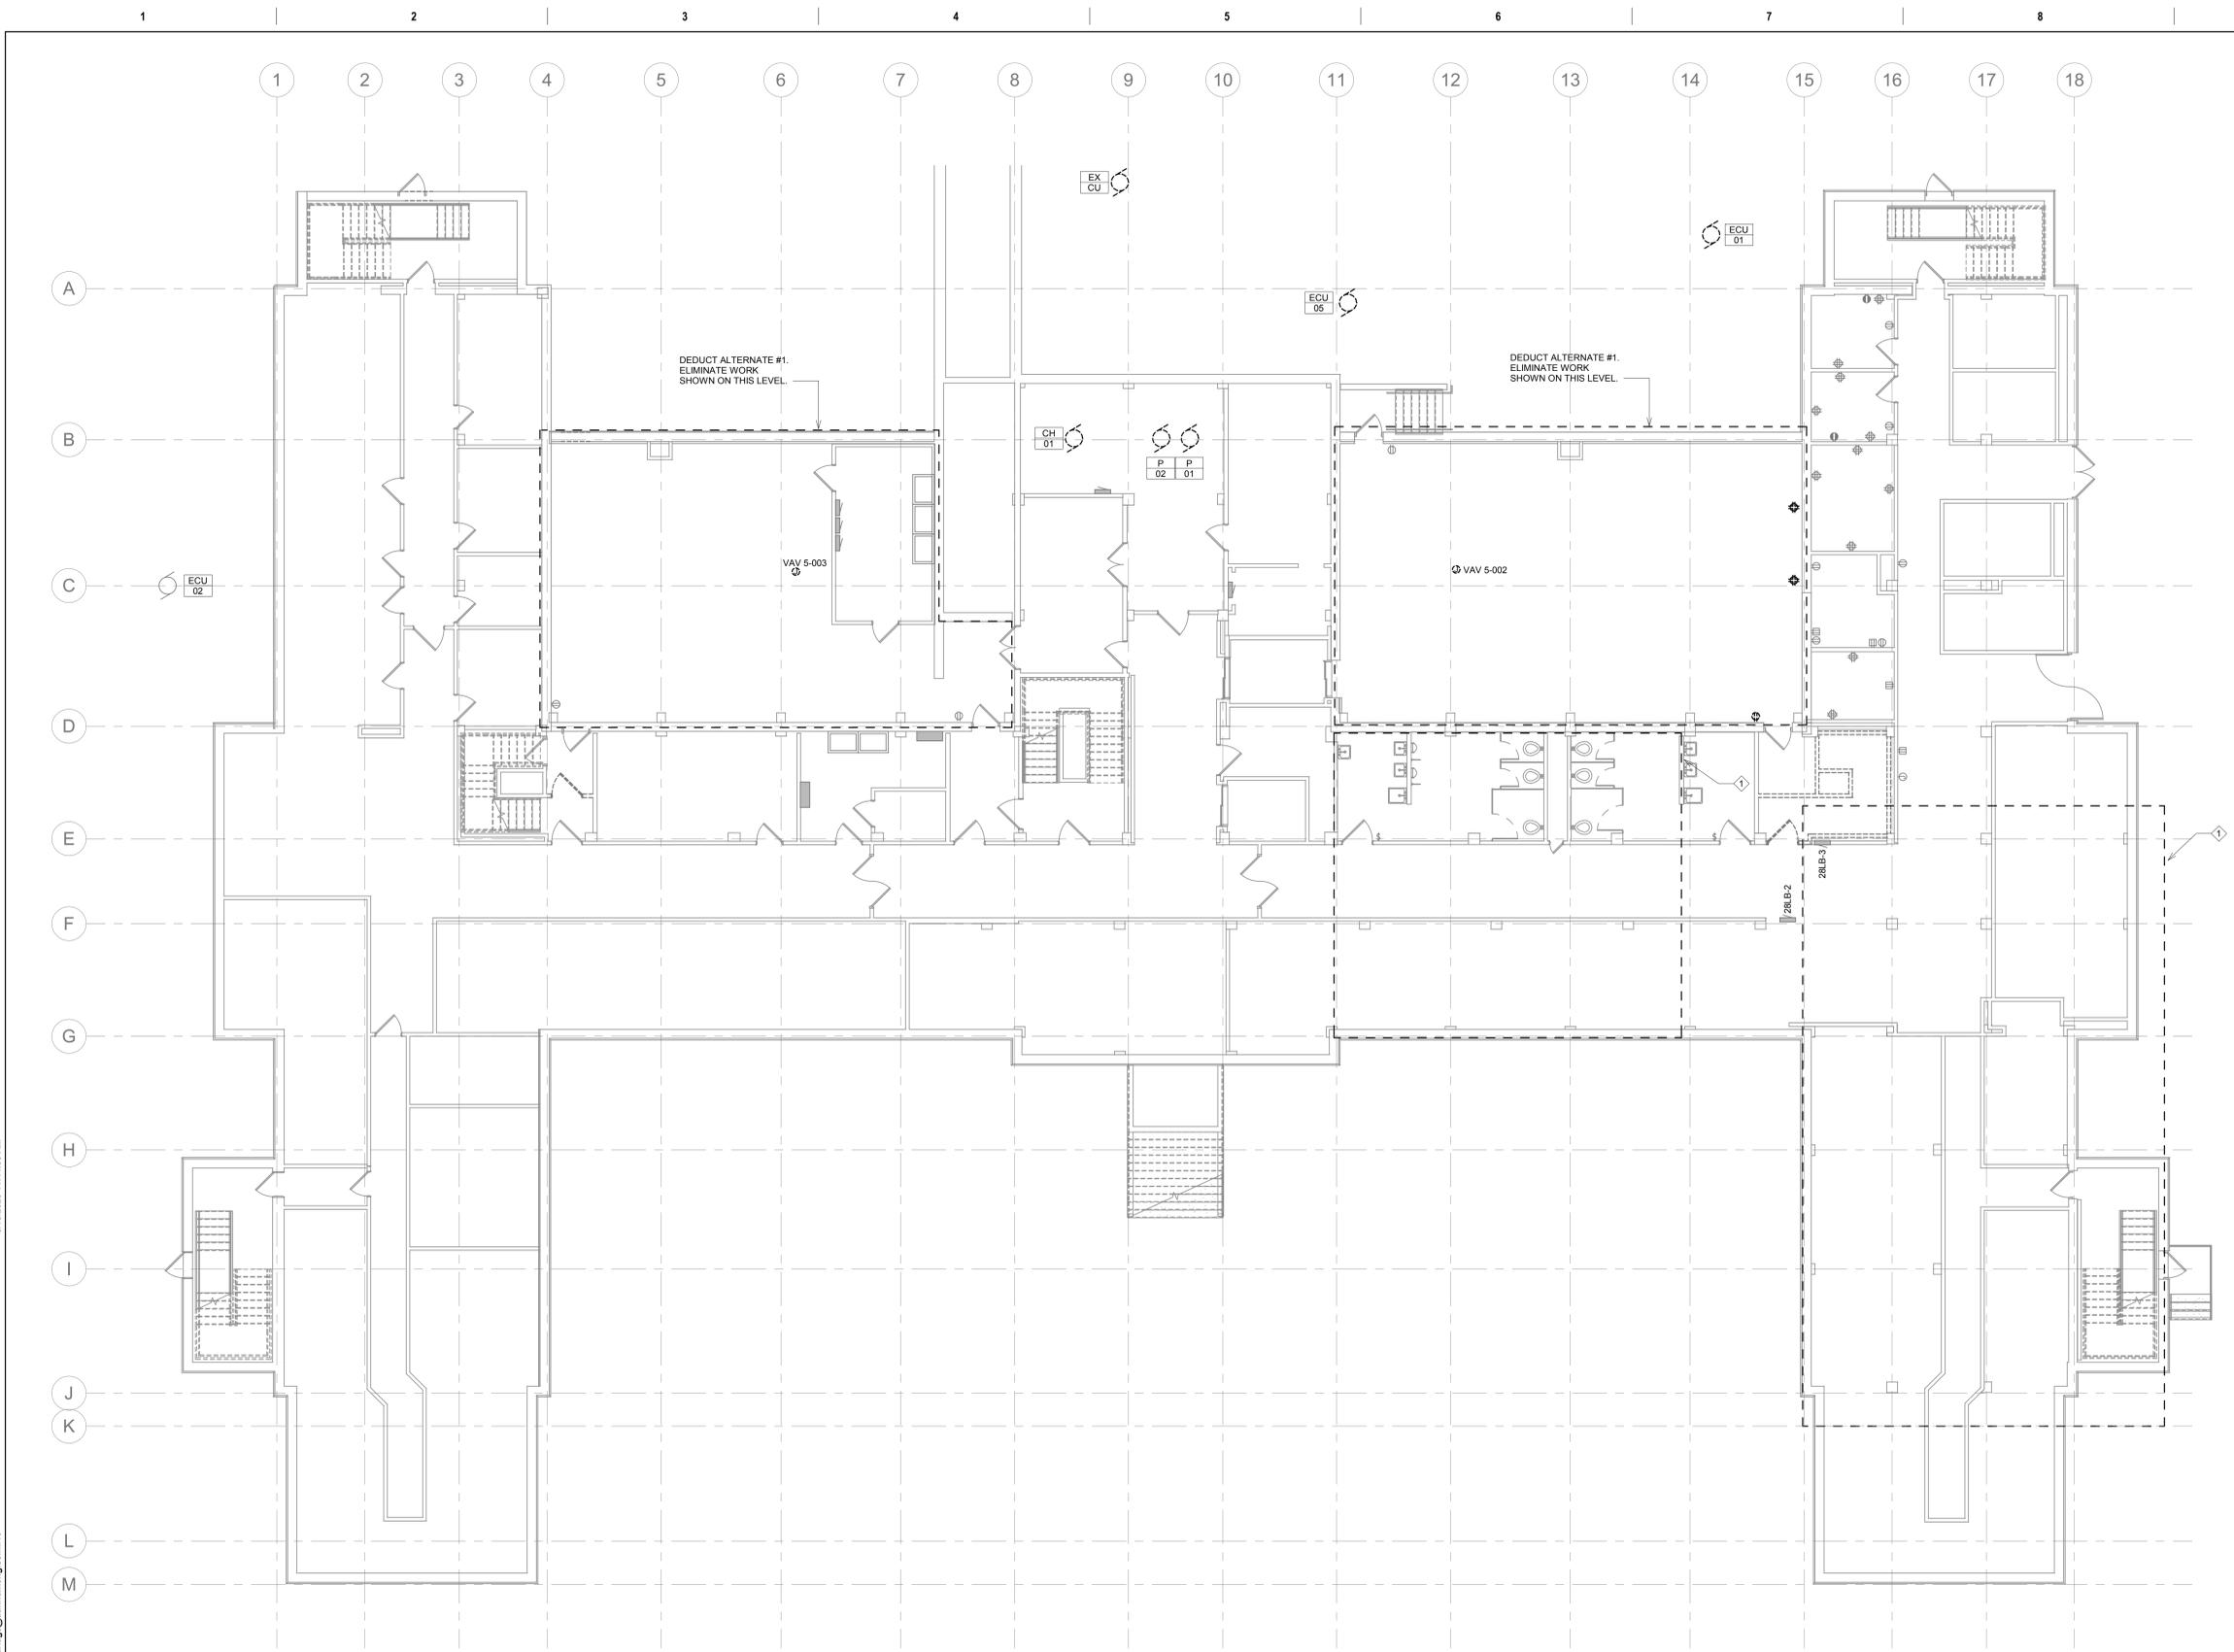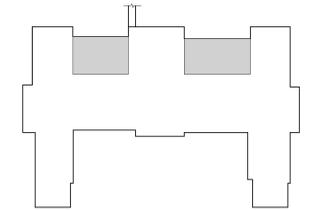

1 BASEMENT POWER DEMOLITION PLAN
1/8" = 1'-0"

Revision#	Description	Date:

CONSULTANT

DUNHAM

50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612.465.7550 Fax: 612.465.7551
 Website: dunhameng.com
 mechanical + electrical consulting engineering
 650950-007-00

ARCHITECT/ENGINEER OF RECORD

ANDERSON

13605 1st Ave. N. #100 Plymouth, MN 55441
 P 763.412.4000 | F 763.412.4090 | ae-mn.com
 Anderson Engineering of Minnesota, LLC | Proj # Project Number

STAMP

I hereby certify that this plan, specification or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the laws of the State of Minnesota.

Name: Curtis D. Barlage, P.E.
 Date: 05/22/2020 Reg. No. 45914

Project Title RENOVATE BUILDING 28 FIRST FLOOR EAST RTTP		
Location SAINT CLOUD, MN		
Phase CONSTRUCTION DOCUMENTS		
Drawing Title BASEMENT POWER DEMOLITION PLAN		
Issue Date MAY 22, 2020	Checked CB	Drawn BZ

Project Number 656-19-306
Building Number 28
Drawing Number EPD101



VA U.S. Department of Veterans Affairs

Veterans Health Administration
 St. Cloud VA Health Care System

GENERAL NOTES:

- A. BUILDING WILL BE IN USE DURING CONSTRUCTION. SCHEDULE AND CARRY OUT THE WORK IN SUCH A MANNER AS TO CAUSE THE OWNER A MINIMUM OF INCONVENIENCE DUE TO SERVICE INTERRUPTION. TEMPORARY SERVICES (FEEDER, BRANCH CIRCUIT, AND SIGNAL SYSTEMS) SHALL BE INSTALLED IF ONE AREA OR PHASE OF CONSTRUCTION DISRUPTS SERVICE TO ANOTHER AREA OF THE BUILDING(S) OR IF THE EQUIPMENT, CONDUITS, OR FEEDERS HAVE TO BE RELOCATED TO ALLOW CONSTRUCTION TO PROGRESS. SERVICE INTERRUPTIONS SHALL BE CONFINED TO THE SMALLEST AREA POSSIBLE AT ANY ONE TIME AND INTERRUPTIONS SHALL BE SCHEDULED WITH THE OWNER'S SITE REPRESENTATIVE. THERE SHALL BE DESIGNATED AREAS WHERE INTERRUPTIONS LIMITED TO AND SHALL BE CONDUCTED AFTER HOURS (8:00 PM - 4:00 AM) MONDAY THROUGH SATURDAY. AFTER SERVICE HAS BEEN RESTORED FOLLOWING AN INTERRUPTION, INSPECT AREAS AFFECTED BY THE INTERRUPTION AND BE RESPONSIBLE FOR RETURNING AUTOMATICALLY CONTROLLED EQUIPMENT TO THE SAME OPERATING CONDITION WHICH EXISTED PRIOR TO THE INTERRUPTION.
- B. SIGNIFICANT NOISE PRODUCING WORK SHALL BE CONDUCTED AFTER HOURS (8:00 PM - 6:00AM)
- C. REMOVE, REPLACE, RELOCATE, ETC. ANY ELECTRICAL DEVICES AND/OR ANY CONDUIT/WIRING AS REQUIRED TO COMPLETE REMODELING AS INDICATED IN THE CONTRACT DOCUMENTS.
- D. DRAWINGS INDICATE EXISTING CONDITIONS AS THEY WERE INDICATED ON OWNER PROVIDED AS-BUILT DRAWINGS AND SITE VERIFICATION. ACTUAL CONDITIONS MAY VARY FROM THE CONDITIONS INDICATED. THE CONTRACTOR IS RESPONSIBLE TO FIELD VERIFY EXACT CONDITIONS.
- E. ALL DEVICES, EQUIPMENT, CABLING, ETC. INDICATED IN THE CONTRACT DOCUMENTS TO BE REMOVED SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO DISPOSE OF IN ACCORDANCE WITH LOCAL AND FEDERAL REGULATIONS. REFER TO SPECIFICATIONS FOR ADDITIONAL INFORMATION.
- F. DEMOLISH HOME RUN WIRING BACK TO SOURCE UNLESS NOTED OTHERWISE. DO NOT LEAVE CONDUCTORS ABANDONED IN WIREWAY.
- G. TEMPORARILY SUPPORT ELECTRICAL FIXTURES, EQUIPMENT, CONDUITS, AND CABLING AS REQUIRED FOR MECHANICAL WORK. REINSTALL AFTER COMPLETION OF WORK.

KEY PLAN

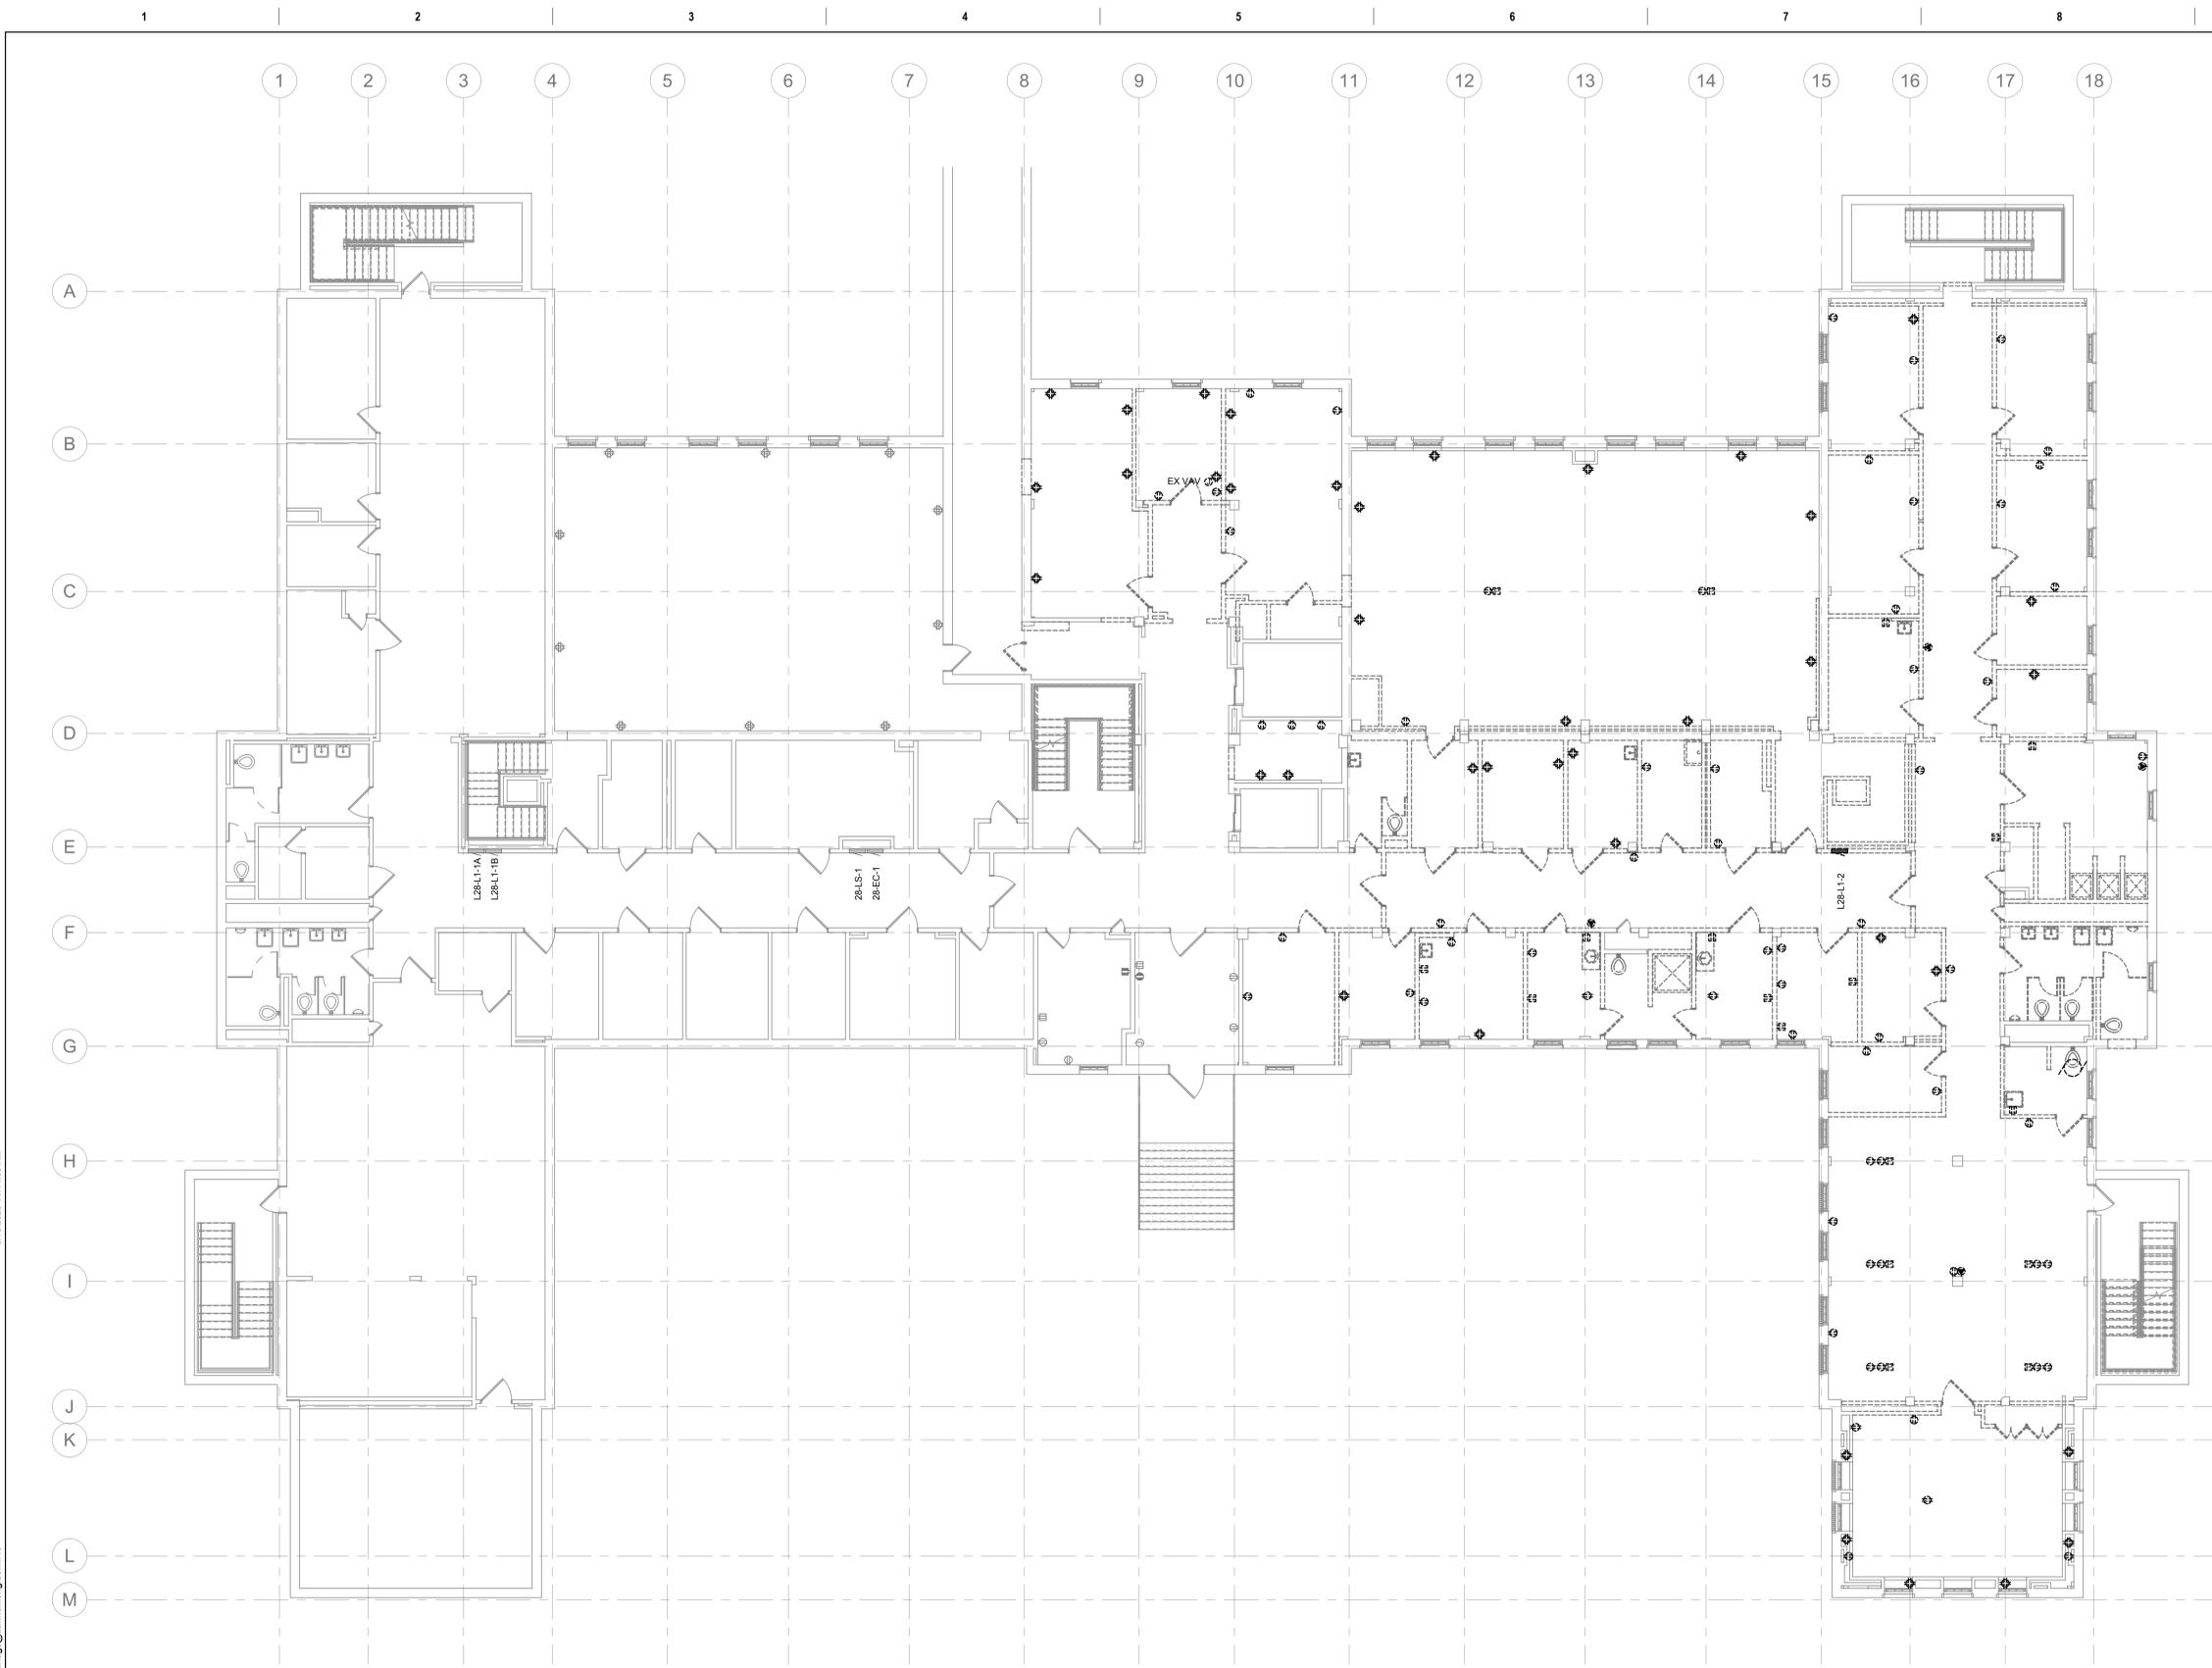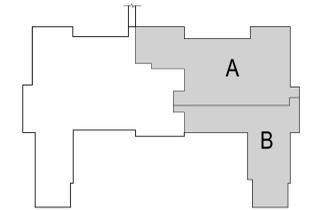

1 FIRST FLOOR POWER DEMOLITION PLAN
1/8" = 1'-0"

Revision#	Description	Date:

CONSULTANT

DUNHAM

50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612.465.7550 Fax: 612.465.7551
 Website: dunhameng.com
 mechanical + electrical consulting engineering
 652950-007-00

ARCHITECT/ENGINEER OF RECORD

ANDERSON

13605 1st Ave. N. #100 Plymouth, MN 55441
 P 763.412.4000 | F 763.412.4090 | ae-mn.com
 Anderson Engineering of Minnesota, LLC | Proj # Project Number

STAMP

I hereby certify that this plan, specification or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the laws of the State of Minnesota.

Name: Curtis D. Barlage, P.E.
 Date: 05/22/2020 Reg. No. 45914

Project Title
 RENOVATE BUILDING 28
 FIRST FLOOR EAST RTTP

Location
 SAINT CLOUD, MN

Phase
 CONSTRUCTION DOCUMENTS

Drawing Title
 FIRST FLOOR POWER DEMOLITION
 PLAN

Issue Date
 MAY 22, 2020

Checked
 CB

Drawn
 BZ

Project Number
 656-19-306

Building Number
 28

Drawing Number
 EPD111

VA

U.S. Department of Veterans Affairs

Veterans Health Administration
 St. Cloud VA Health Care System



GENERAL NOTES:

- A. BUILDING WILL BE IN USE DURING CONSTRUCTION. SCHEDULE AND CARRY OUT THE WORK IN SUCH A MANNER AS TO CAUSE THE OWNER A MINIMUM OF INCONVENIENCE DUE TO SERVICE INTERRUPTION. TEMPORARY SERVICES (FEEDER, BRANCH CIRCUIT, AND SIGNAL SYSTEMS) SHALL BE INSTALLED IF ONE AREA OR PHASE OF CONSTRUCTION DISRUPTS SERVICE TO ANOTHER AREA OF THE BUILDING(S) OR IF THE EQUIPMENT, CONDUITS, OR FEEDERS HAVE TO BE RELOCATED TO ALLOW CONSTRUCTION TO PROGRESS. SERVICE INTERRUPTIONS SHALL BE CONFINED TO THE SMALLEST AREA POSSIBLE AT ANY ONE TIME AND INTERRUPTIONS SHALL BE SCHEDULED WITH THE OWNER'S SITE REPRESENTATIVE. THERE SHALL BE DESIGNATED AREAS WHERE INTERRUPTIONS LIMITED TO AND SHALL BE CONDUCTED AFTER HOURS (8:00 PM - 6:00 AM) MONDAY THROUGH SATURDAY. AFTER SERVICE HAS BEEN RESTORED FOLLOWING AN INTERRUPTION, INSPECT AREAS AFFECTED BY THE INTERRUPTION AND BE RESPONSIBLE FOR RETURNING AUTOMATICALLY CONTROLLED EQUIPMENT TO THE SAME OPERATING CONDITION WHICH EXISTED PRIOR TO THE INTERRUPTION.
- B. SIGNIFICANT NOISE PRODUCING WORK SHALL BE CONDUCTED AFTER HOURS (8:00 PM - 6:00AM)
- C. REMOVE, REPLACE, RELOCATE, ETC. ANY ELECTRICAL DEVICES AND/OR ANY CONDUIT/WIRING AS REQUIRED TO COMPLETE REMODELING AS INDICATED IN THE CONTRACT DOCUMENTS.
- D. DRAWINGS INDICATE EXISTING CONDITIONS AS THEY WERE INDICATED ON OWNER PROVIDED AS-BUILT DRAWINGS AND SITE VERIFICATION. ACTUAL CONDITIONS MAY VARY FROM THE CONDITIONS INDICATED. THE CONTRACTOR IS RESPONSIBLE TO FIELD VERIFY EXACT CONDITIONS.
- E. ALL DEVICES, EQUIPMENT, CABLING, ETC. INDICATED IN THE CONTRACT DOCUMENTS TO BE REMOVED, SHALL BE DISPOSED OF IN ACCORDANCE WITH LOCAL AND FEDERAL REGULATIONS. REFER TO SPECIFICATIONS FOR ADDITIONAL INFORMATION.
- F. DEMOLISH LOW VOLTAGE DEVICE CABLING BACK TO SOURCE WHEN DEMOLISHING LOW VOLTAGE DEVICES.
- G. DEMOLISH ANY FIRE/SMOKE DAMPERS AND DUCT DETECTORS, WHICH MAY NOT BE SHOWN ON THE PLANS, THAT ARE PART OF DIV. 23 DEMOLITION. COORDINATE WITH THE MECHANICAL CONTRACTOR DURING DEMOLITION.

KEY NOTES:

- ① CEILING TO BE REMOVED AND REINSTALLED FOR MECHANICAL WORK. REMOVE AND REINSTALL ELECTRICAL EQUIPMENT AS REQUIRED.

KEY PLAN

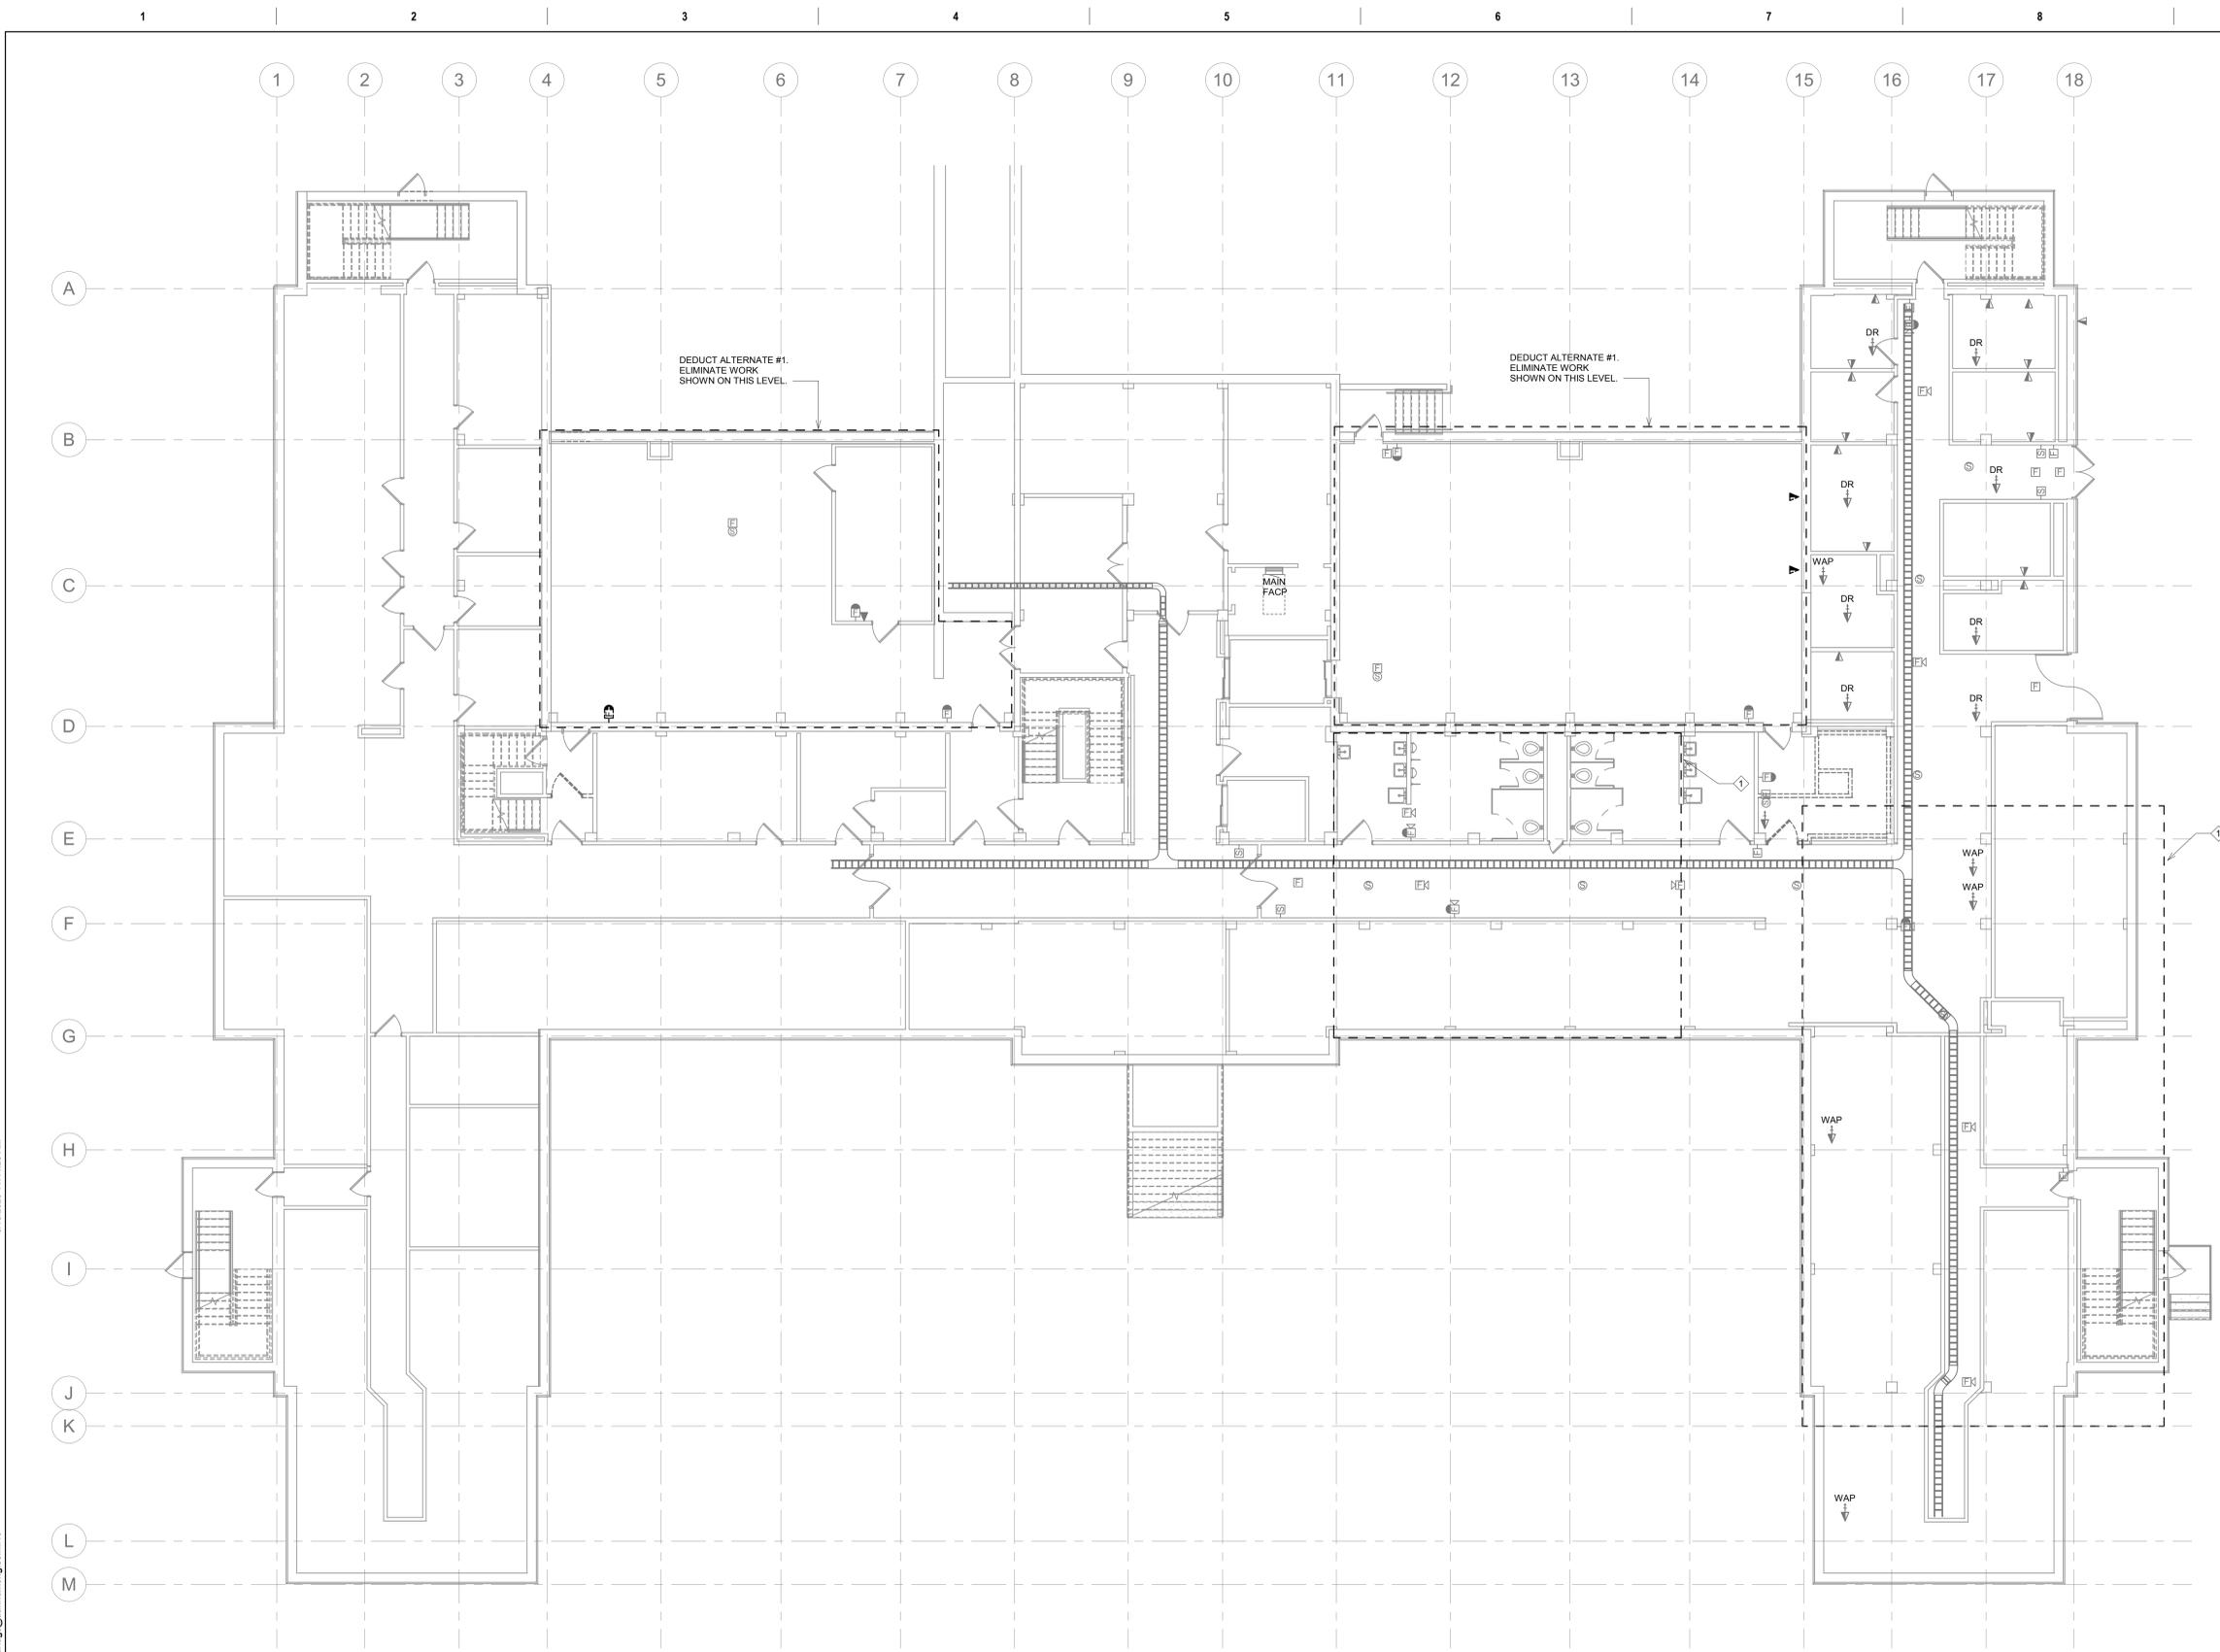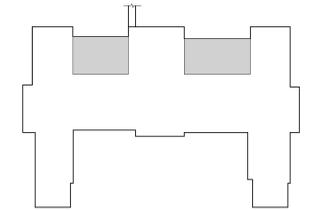

1 BASEMENT SYSTEMS DEMOLITION PLAN
1/8" = 1'-0"

Revision#	Description	Date:

CONSULTANT

DUNHAM

50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612.465.7550 Fax: 612.465.7551
 Website: dunhaminc.com
 mechanical + electrical consulting engineering
 652950-007-00

ARCHITECT/ENGINEER OF RECORD

ANDERSON

13605 1st Ave. N. #100 Plymouth, MN 55441
 P 763.412.4000 | F 763.412.4090 | ae-mn.com
 Anderson Engineering of Minnesota, LLC | Proj # Project Number

STAMP

I hereby certify that this plan, specification or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the laws of the State of Minnesota.

Name: Curtis D. Barlage, P.E.
 Date: 05/22/2020 Reg. No. 45914

Project Title
 RENOVATE BUILDING 28
 FIRST FLOOR EAST RTTP

Location
 SAINT CLOUD, MN

Phase
 CONSTRUCTION DOCUMENTS

Drawing Title
 BASEMENT SYSTEMS DEMOLITION
 PLAN

Issue Date
 MAY 22, 2020

Checked
 CB

Drawn
 BZ

Project Number
 656-19-306

Building Number
 28

Drawing Number
 ESD101

VA

U.S. Department of Veterans Affairs

Veterans Health Administration
 St. Cloud VA Health Care System



GENERAL NOTES:

- A. BUILDING WILL BE IN USE DURING CONSTRUCTION. SCHEDULE AND CARRY OUT THE WORK IN SUCH A MANNER AS TO CAUSE THE OWNER A MINIMUM OF INCONVENIENCE DUE TO SERVICE INTERRUPTION. TEMPORARY SERVICES (FEEDER, BRANCH CIRCUIT, AND SIGNAL SYSTEMS) SHALL BE INSTALLED IF ONE AREA OR PHASE OF CONSTRUCTION DISRUPTS SERVICE TO ANOTHER AREA OF THE BUILDING(S) OR IF THE EQUIPMENT, CONDUITS, OR FEEDERS HAVE TO BE RELOCATED TO ALLOW CONSTRUCTION TO PROGRESS. SERVICE INTERRUPTIONS SHALL BE CONFINED TO THE SMALLEST AREA POSSIBLE AT ANY ONE TIME AND INTERRUPTIONS SHALL BE SCHEDULED WITH THE OWNER'S SITE REPRESENTATIVE. THERE SHALL BE DESIGNATED AREAS WHERE INTERRUPTIONS LIMITED TO AND SHALL BE CONDUCTED AFTER HOURS (8:00 PM - 6:00 AM) MONDAY THROUGH SATURDAY. AFTER SERVICE HAS BEEN RESTORED FOLLOWING AN INTERRUPTION, INSPECT AREAS AFFECTED BY THE INTERRUPTION AND BE RESPONSIBLE FOR RETURNING AUTOMATICALLY CONTROLLED EQUIPMENT TO THE SAME OPERATING CONDITION WHICH EXISTED PRIOR TO THE INTERRUPTION.
- B. SIGNIFICANT NOISE PRODUCING WORK SHALL BE CONDUCTED AFTER HOURS (8:00 PM - 6:00AM)
- C. REMOVE, REPLACE, RELOCATE, ETC. ANY ELECTRICAL DEVICES AND/OR ANY CONDUIT/WIRING AS REQUIRED TO COMPLETE REMODELING AS INDICATED IN THE CONTRACT DOCUMENTS.
- D. DRAWINGS INDICATE EXISTING CONDITIONS AS THEY WERE INDICATED ON OWNER PROVIDED AS-BUILT DRAWINGS AND SITE VERIFICATION. ACTUAL CONDITIONS MAY VARY FROM THE CONDITIONS INDICATED. THE CONTRACTOR IS RESPONSIBLE TO FIELD VERIFY EXACT CONDITIONS.
- E. ALL DEVICES, EQUIPMENT, CABLING, ETC. INDICATED IN THE CONTRACT DOCUMENTS TO BE REMOVED, SHALL BE DISPOSED OF IN ACCORDANCE WITH LOCAL AND FEDERAL REGULATIONS. REFER TO SPECIFICATIONS FOR ADDITIONAL INFORMATION.
- F. DEMOLISH LOW VOLTAGE DEVICE CABLING BACK TO SOURCE WHEN DEMOLISHING LOW VOLTAGE DEVICES.
- G. DEMOLISH ANY FIRE/SMOKE DAMPERS AND DUCT DETECTORS, WHICH MAY NOT BE SHOWN ON THE PLANS, THAT ARE PART OF DIV. 23 DEMOLITION. COORDINATE WITH THE MECHANICAL CONTRACTOR DURING DEMOLITION.

KEY NOTES:

- ◇ TEMPORARILY SUPPORT WAP DURING CONSTRUCTION, REINSTALL IN SIMILAR LOCATION ON NEW PLAN.

KEY PLAN

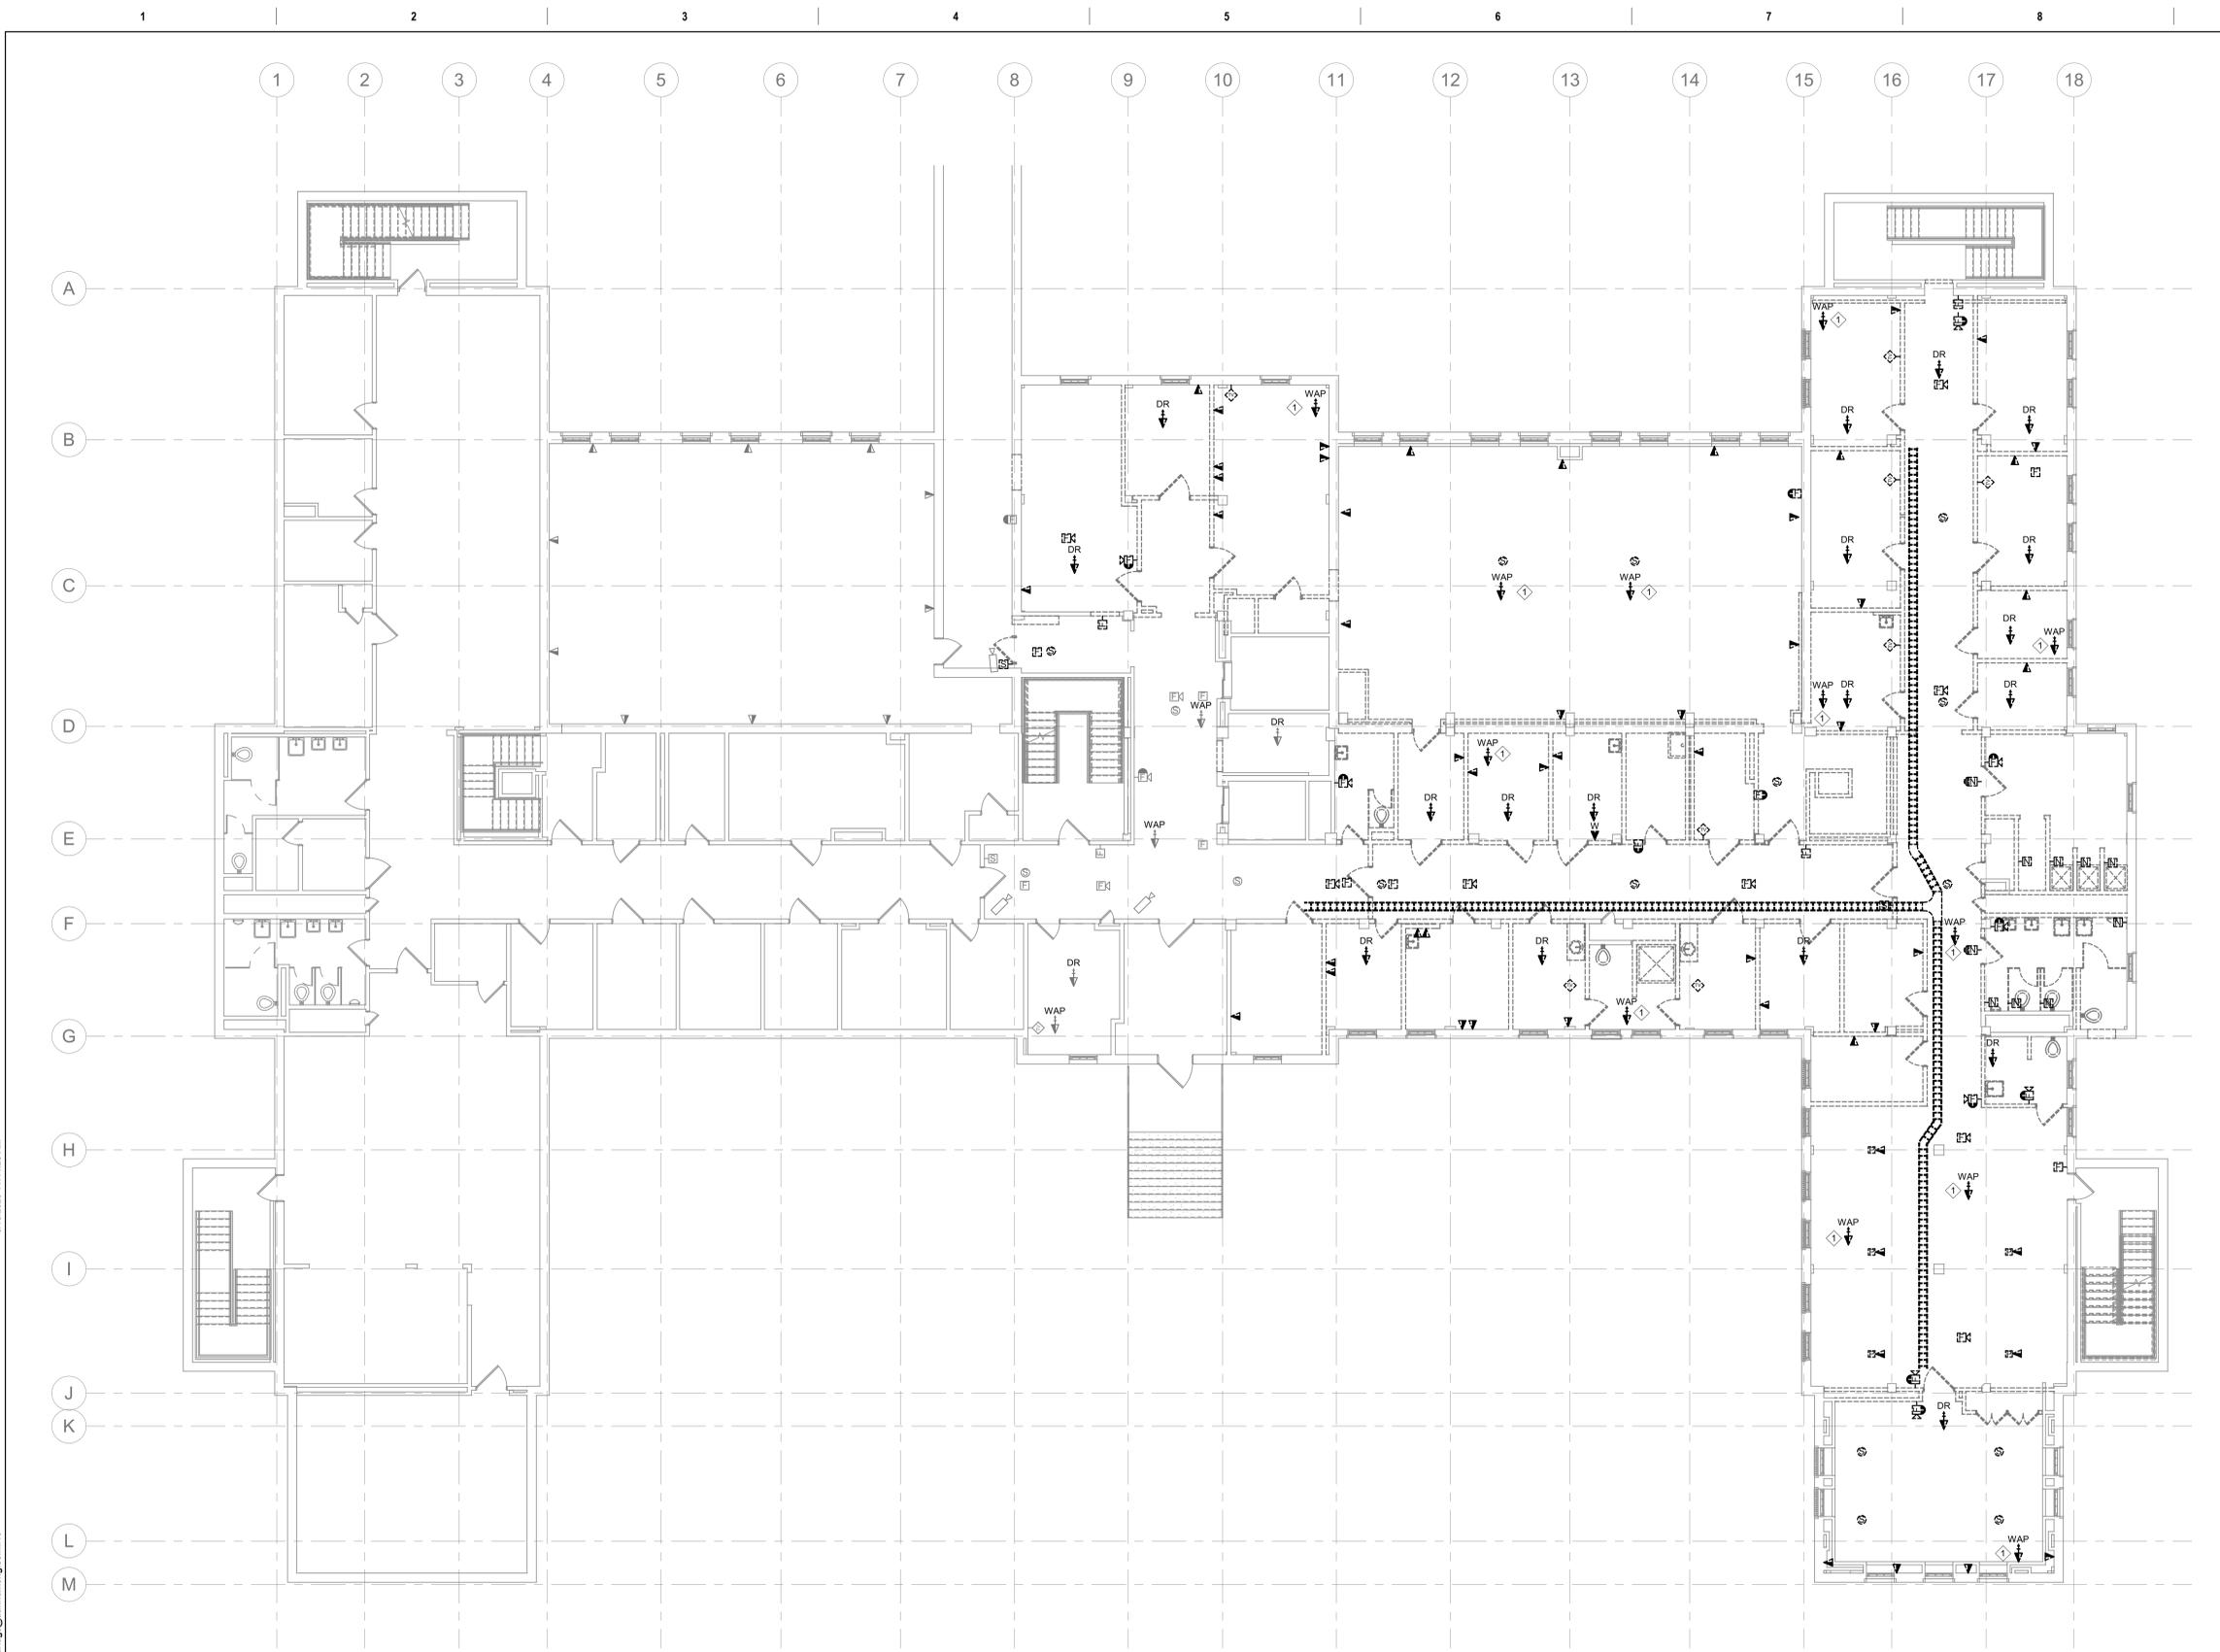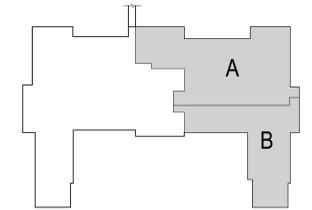

1 FIRST FLOOR SYSTEMS DEMOLITION PLAN
1/8" = 1'-0"

Revision#	Description	Date:

CONSULTANT

DUNHAM

50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612.465.7550 Fax: 612.465.7551
 Website: dunhameng.com
 mechanical + electrical consulting engineering
 652950-007-00

ARCHITECT/ENGINEER OF RECORD

ANDERSON

13605 1st Ave. N. #100 Plymouth, MN 55441
 P 763.412.4000 | F 763.412.4090 | ae-mn.com
 Anderson Engineering of Minnesota, LLC | Proj # Project Number

STAMP

I hereby certify that this plan, specification or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the laws of the State of Minnesota.

Name: Curtis D. Barlage, P.E.
 Date: 05/22/2020 Reg. No. 45914

Project Title	RENOVATE BUILDING 28 FIRST FLOOR EAST RTTP
Location	SAINT CLOUD, MN
Phase	CONSTRUCTION DOCUMENTS
Drawing Title	FIRST FLOOR SYSTEMS DEMOLITION PLAN
Issue Date	MAY 22, 2020
Checked	CB
Drawn	BZ

Project Number
656-19-306

Building Number
28

Drawing Number
ESD111

VA

U.S. Department of Veterans Affairs

Veterans Health Administration
 St. Cloud VA Health Care System



GENERAL NOTES:

- A. BUILDING WILL BE IN USE DURING CONSTRUCTION. SCHEDULE AND CARRY OUT THE WORK IN SUCH A MANNER AS TO CAUSE THE OWNER A MINIMUM OF INCONVENIENCE DUE TO SERVICE INTERRUPTION. TEMPORARY SERVICES (FEEDER, BRANCH CIRCUIT, AND SIGNAL SYSTEMS) SHALL BE INSTALLED IF ONE AREA OR PHASE OF CONSTRUCTION DISRUPTS SERVICE TO ANOTHER AREA OF THE BUILDING(S) OR IF THE EQUIPMENT, CONDUITS, OR FEEDERS HAVE TO BE RELOCATED TO ALLOW CONSTRUCTION TO PROGRESS. SERVICE INTERRUPTIONS SHALL BE CONFINED TO THE SMALLEST AREA POSSIBLE AT ANY ONE TIME AND INTERRUPTIONS SHALL BE SCHEDULED WITH THE OWNER'S SITE REPRESENTATIVE. THERE SHALL BE DESIGNATED AREAS WHERE INTERRUPTIONS LIMITED TO AND SHALL BE CONDUCTED AFTER HOURS (8:00 PM - 6:00 AM) MONDAY THROUGH SATURDAY. AFTER SERVICE HAS BEEN RESTORED FOLLOWING AN INTERRUPTION, INSPECT AREAS AFFECTED BY THE INTERRUPTION AND BE RESPONSIBLE FOR RETURNING AUTOMATICALLY CONTROLLED EQUIPMENT TO THE SAME OPERATING CONDITION WHICH EXISTED PRIOR TO THE INTERRUPTION.
- B. SIGNIFICANT NOISE PRODUCING WORK SHALL BE CONDUCTED AFTER HOURS (8:00 PM - 6:00 AM) AND WEEKENDS.
- C. DO NOT REUSE EXISTING WIRING. PROVIDE NEW HOME RUNS UNLESS NOTED OTHERWISE. PROVIDE DEDICATED NEUTRALS AS REQUIRED BY THE NEC. HANDLE TIES OR MULTI POLE BREAKERS FOR SINGLE PHASE LOADS ARE UNACCEPTABLE.
- D. COORDINATE LOCATION AND INSTALLATION OF CEILING MOUNTED EQUIPMENT WITH THE VA PRIOR TO ROUGH-IN.
- E. INSTALL MINIMUM #10 AWG FOR ALL 120V CIRCUIT HOMERUNS IN EXCESS OF 75'.
- F. ROUTE CONDUITS IN A MANNER TO CONCEAL WHERE POSSIBLE.
- G. WHERE LIGHTING CONTROL DEVICES (OCCUPANCY / VACANCY SENSORS, RELAY MODULES, ETC) ARE SHOWN ON PLANS, LOCATE DEVICES IN EACH SPACE PER DEVICE TYPE AND MANUFACTURER RECOMMENDATIONS. INSTALL ALL RELAYS AND/OR POWER PACKS IN NEMA 1 ENCLOSURES TO ACHIEVE PLENUM RATINGS.
- H. LIFE SAFETY LIGHTING SHALL BE UNSWITCHED UNLESS NOTED OTHERWISE.

KEY NOTES:

- ① CEILING TO BE REMOVED AND REINSTALLED FOR MECHANICAL WORK. REMOVE AND REINSTALL LIGHT FIXTURES AS REQUIRED.
- ② LIGHT FIXTURE 8'-0" AFF.
- ③ LIGHT FIXTURE 7'-6" AFF.

KEY PLAN

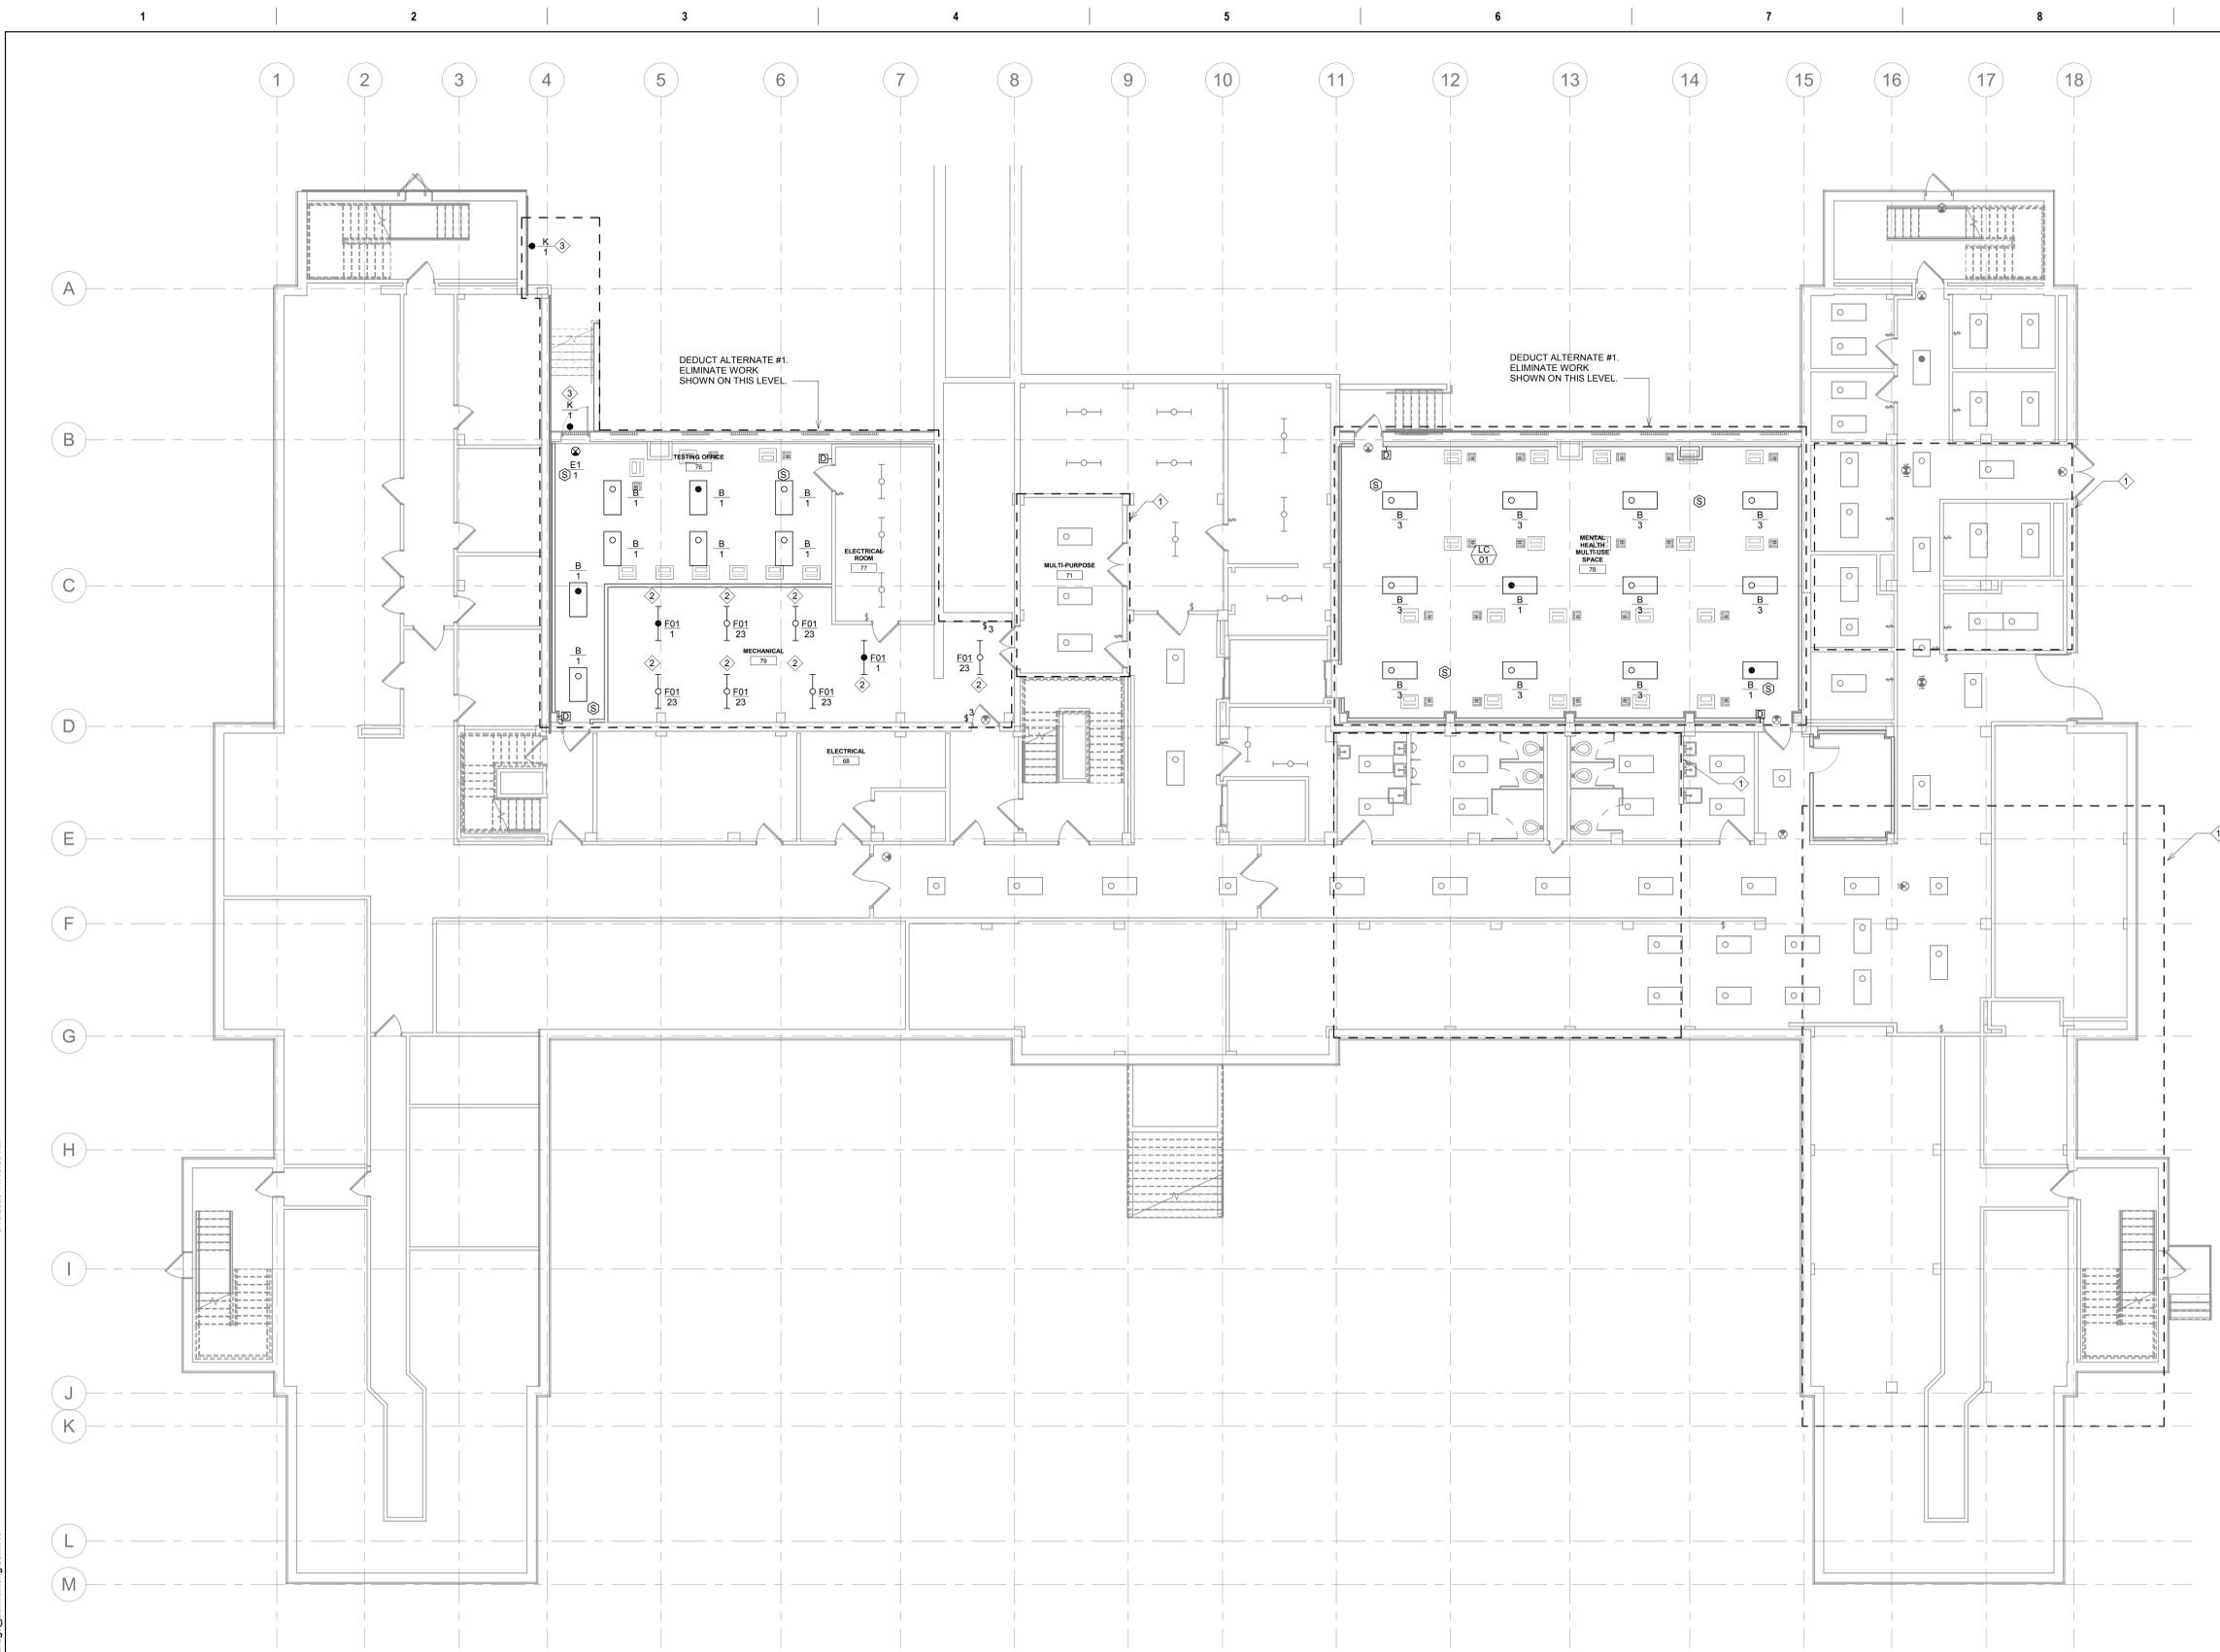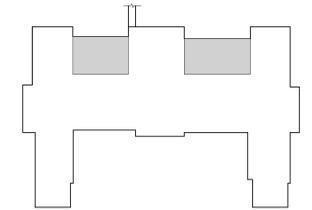

1 BASEMENT LIGHTING FLOOR PLAN
1/8" = 1'-0"

Revision#	Description	Date:

CONSULTANT

DUNHAM

50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612.465.7550 Fax: 612.465.7551
 Website: dunhameng.com
 mechanical + electrical consulting engineering
 652950-007-00

ARCHITECT/ENGINEER OF RECORD

ANDERSON

13605 1st Ave. N. #100 Plymouth, MN 55441
 P 763.412.4000 | F 763.412.4090 | ae-mn.com
 Anderson Engineering of Minnesota, LLC | Proj # Project Number

STAMP

I hereby certify that this plan, specification or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the laws of the State of Minnesota.

Name: Curtis D. Barlage, P.E.
 Date: 05/22/2020 Reg. No. 45914

Project Title
 RENOVATE BUILDING 28
 FIRST FLOOR EAST RTTP

Location
 SAINT CLOUD, MN

Phase
 CONSTRUCTION DOCUMENTS

Drawing Title
 BASEMENT LIGHTING FLOOR PLAN

Issue Date
 MAY 22, 2020

Checked
 CB

Drawn
 BZ

Project Number
 656-19-306

Building Number
 28

Drawing Number
 EL101

VA

U.S. Department of Veterans Affairs

Veterans Health Administration
 St. Cloud VA Health Care System

GENERAL NOTES:



- A. BUILDING WILL BE IN USE DURING CONSTRUCTION. SCHEDULE AND CARRY OUT THE WORK IN SUCH A MANNER AS TO CAUSE THE OWNER A MINIMUM OF INCONVENIENCE DUE TO SERVICE INTERRUPTION. TEMPORARY SERVICES (FEEDER, BRANCH CIRCUIT, AND SIGNAL SYSTEMS) SHALL BE INSTALLED IF ONE AREA OR PHASE OF CONSTRUCTION DISRUPTS SERVICE TO ANOTHER AREA OF THE BUILDING(S) OR IF THE EQUIPMENT, CONDUITS, OR FEEDERS HAVE TO BE RELOCATED TO ALLOW CONSTRUCTION TO PROGRESS. SERVICE INTERRUPTIONS SHALL BE CONFINED TO THE SMALLEST AREA POSSIBLE AT ANY ONE TIME AND INTERRUPTIONS SHALL BE SCHEDULED WITH THE OWNER'S SITE REPRESENTATIVE. THERE SHALL BE DESIGNATED AREAS WHERE INTERRUPTIONS LIMITED TO AND SHALL BE CONDUCTED AFTER HOURS (8:00 PM - 6:00 AM) MONDAY THROUGH SATURDAY. AFTER SERVICE HAS BEEN RESTORED FOLLOWING AN INTERRUPTION, INSPECT AREAS AFFECTED BY THE INTERRUPTION AND BE RESPONSIBLE FOR RETURNING AUTOMATICALLY CONTROLLED EQUIPMENT TO THE SAME OPERATING CONDITION WHICH EXISTED PRIOR TO THE INTERRUPTION.
- B. SIGNIFICANT NOISE PRODUCING WORK SHALL BE CONDUCTED AFTER HOURS (8:00 PM - 6:00 AM) AND WEEKENDS.
- C. DO NOT REUSE EXISTING WIRING. PROVIDE NEW HOME RUNS UNLESS NOTED OTHERWISE. PROVIDE DEDICATED NEUTRALS AS REQUIRED BY THE NEC. HANDLE TIES OR MULTI POLE BREAKERS FOR SINGLE PHASE LOADS ARE UNACCEPTABLE.
- D. COORDINATE LOCATION AND INSTALLATION OF CEILING MOUNTED EQUIPMENT WITH THE VA PRIOR TO ROUGH-IN.
- E. INSTALL MINIMUM #10 AWG FOR ALL 120V CIRCUIT HOMERUNS IN EXCESS OF 75'.
- F. ROUTE CONDUITS IN A MANNER TO CONCEAL WHERE POSSIBLE.
- G. WHERE LIGHTING CONTROL DEVICES (OCCUPANCY / VACANCY SENSORS, RELAY MODULES, ETC) ARE SHOWN ON PLANS, LOCATE DEVICES IN EACH SPACE PER DEVICE TYPE AND MANUFACTURER RECOMMENDATIONS. INSTALL ALL RELAYS AND/OR POWER PACKS IN NEMA 1 ENCLOSURES TO ACHIEVE PLENUM RATINGS.
- H. LIFE SAFETY LIGHTING SHALL BE UNSWITCHED UNLESS NOTED OTHERWISE.

ALL NORMAL LIGHTING CONNECTED TO PANEL 28-L1-2. ALL CRITICAL LIGHTING CONNECTED TO PANEL 28-EC1-2. ALL LIFE SAFETY LIGHTING CONNECTED TO PANEL 28-L1-2.

KEY NOTES:

- ◆ CEILING TO BE REMOVED AND REINSTALLED FOR MECHANICAL WORK. REMOVE AND REINSTALL LIGHT FIXTURES AS REQUIRED.
- ◆ LIGHT FIXTURE 8'-0" AFF.

KEY PLAN

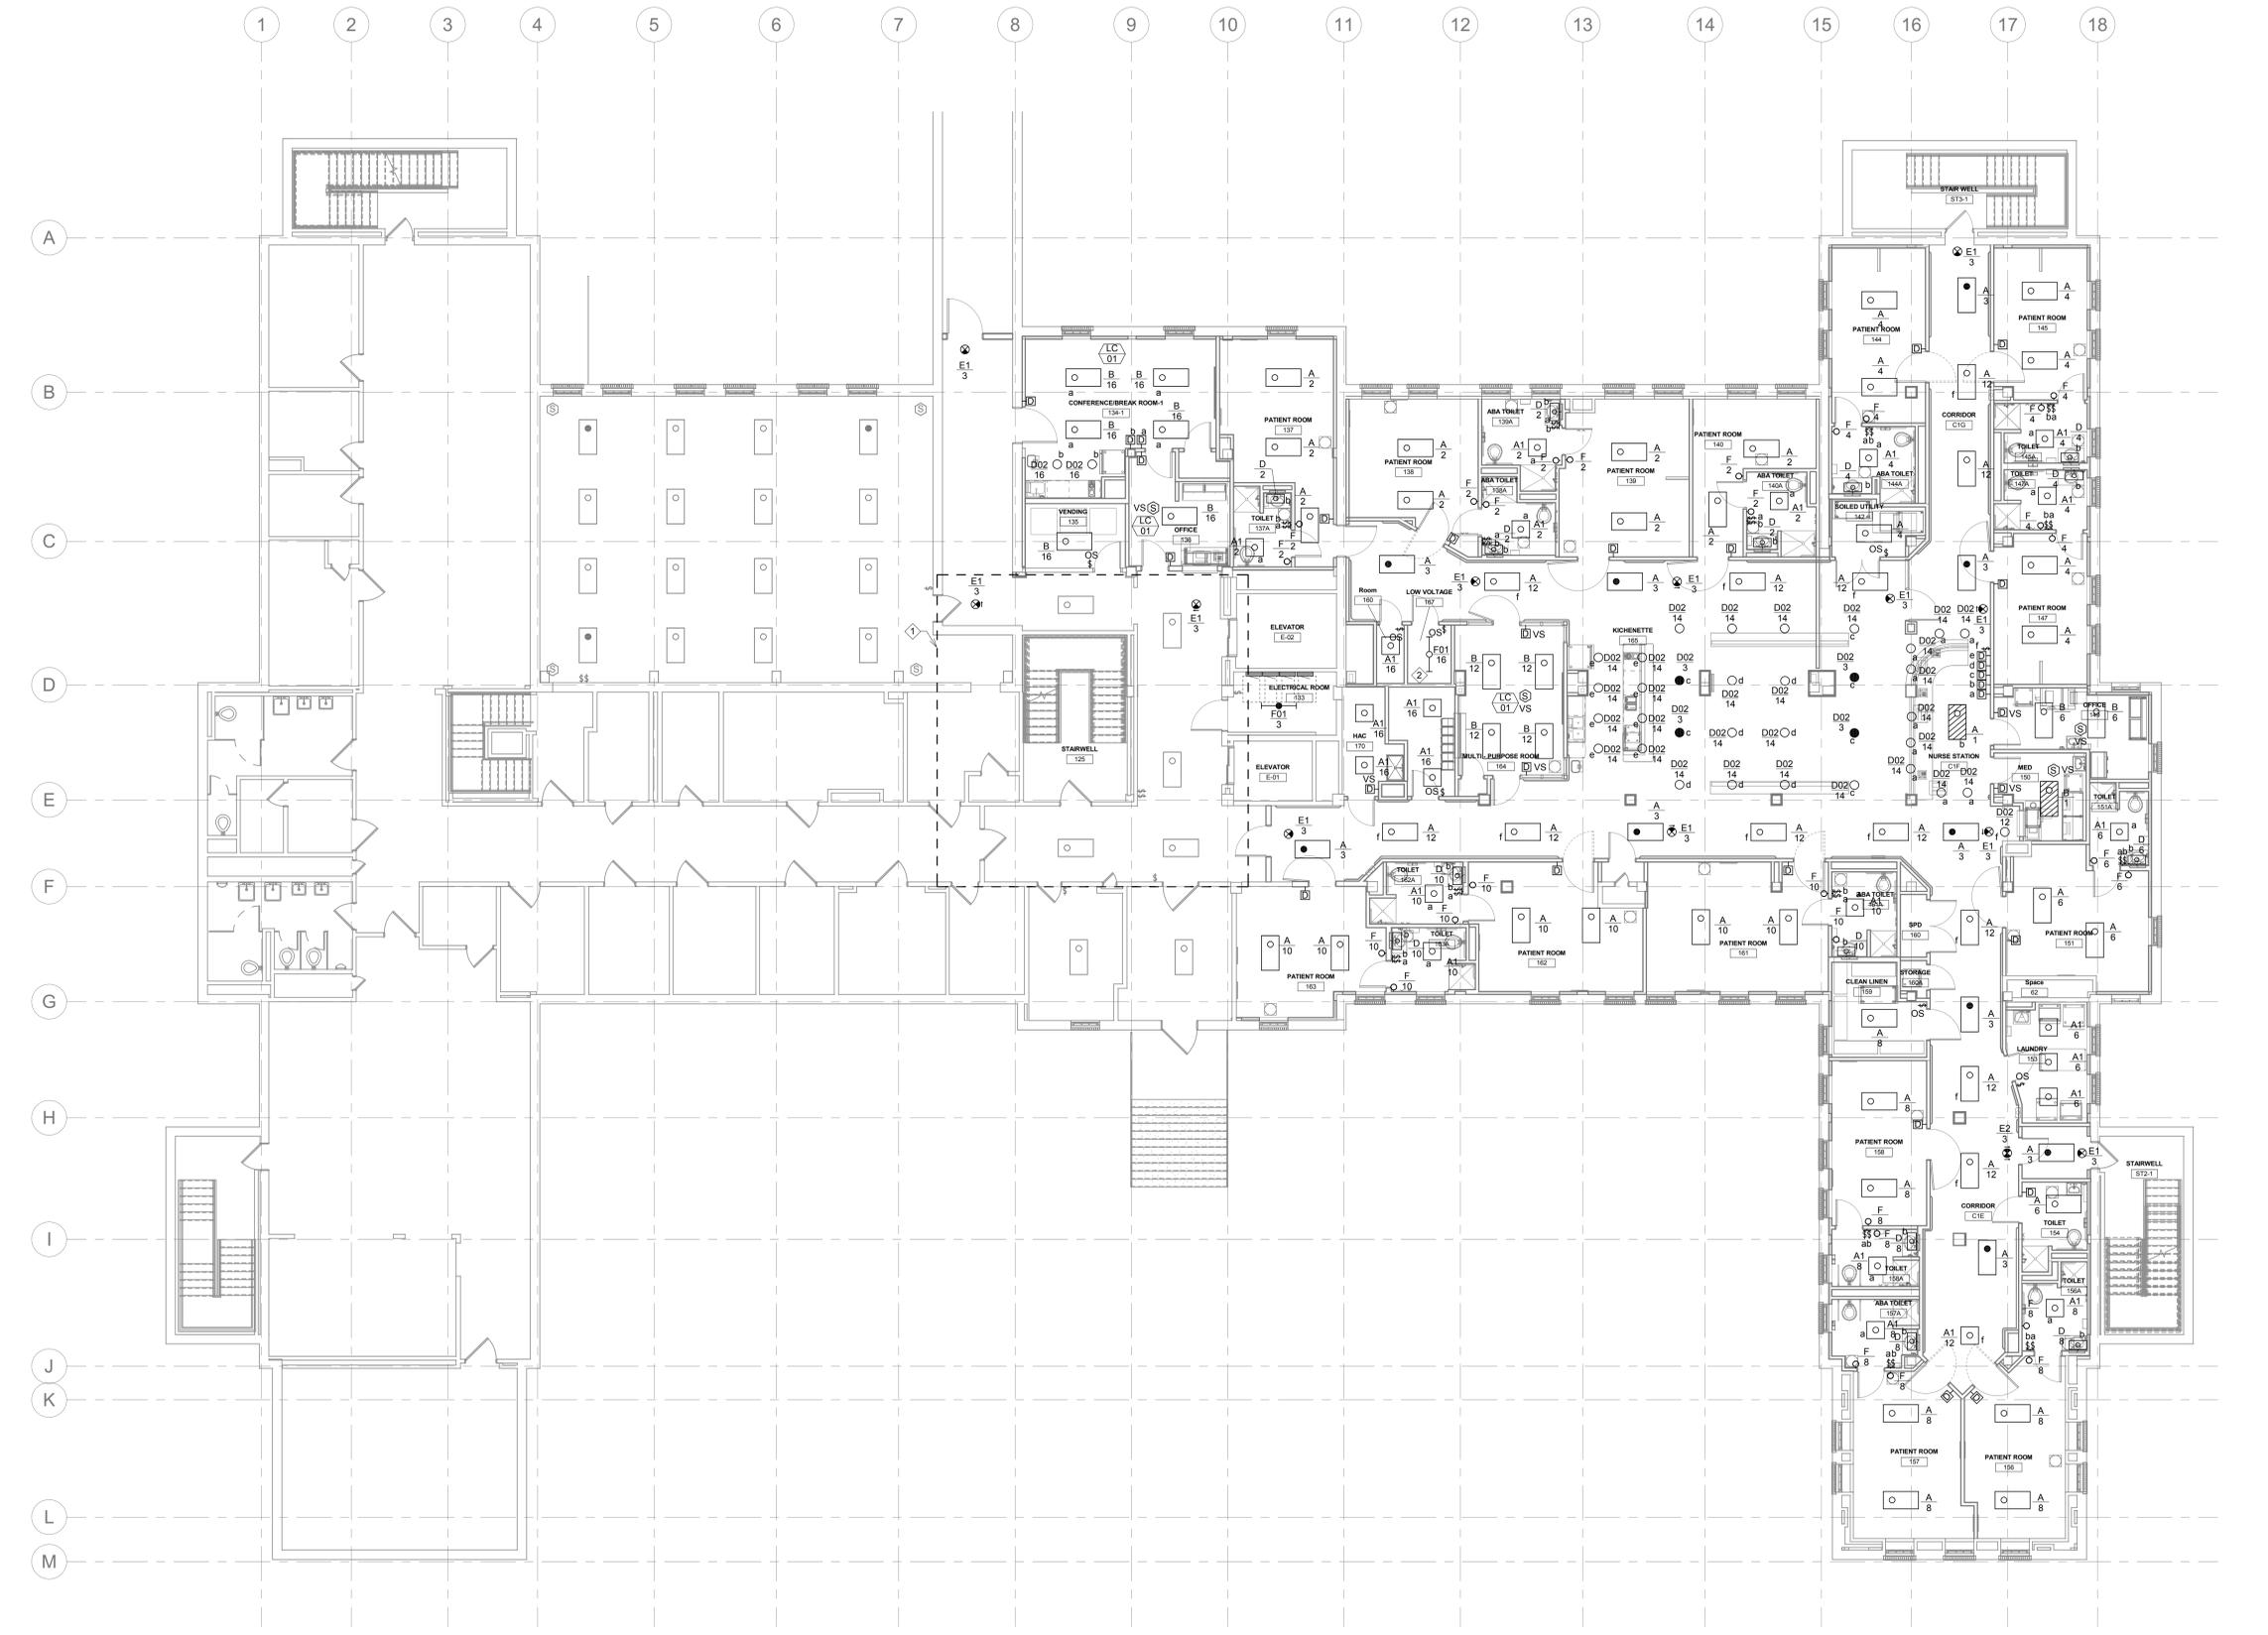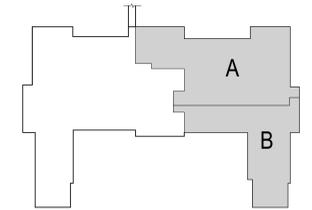

1 FIRST LIGHTING FLOOR PLAN
1/8" = 1'-0"

Revision#	Description	Date:

CONSULTANT
DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612.465.7550 FAX: 612.465.7551
 www.dunham.com
 mechanical + electrical consulting engineering
 652959-007-00

ARCHITECT/ENGINEER OF RECORD
ANDERSON
 13605 1st Ave. N. #100 Plymouth, MN 55441
 P 763.412.4000 | F 763.412.4090 | ae-mn.com
 Anderson Engineering of Minnesota, LLC | Proj # Project Number

STAMP
 I hereby certify that this plan, specification or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the laws of the State of Minnesota.
 Name: Curtis D. Barlage, P.E.
 Date: 05/22/2020 Reg. No. 45914

Project Title RENOVATE BUILDING 28 FIRST FLOOR EAST RTTP		Project Number 656-19-306	
Location SAINT CLOUD, MN		Building Number 28	
Phase CONSTRUCTION DOCUMENTS		Drawing Number EL111	
Issue Date MAY 22, 2020	Checked CB	Drawn BZ	

U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System



GENERAL NOTES:

- A. BUILDING WILL BE IN USE DURING CONSTRUCTION. SCHEDULE AND CARRY OUT THE WORK IN SUCH A MANNER AS TO CAUSE THE OWNER A MINIMUM OF INCONVENIENCE DUE TO SERVICE INTERRUPTION. TEMPORARY SERVICES (FEEDER, BRANCH CIRCUIT, AND SIGNAL SYSTEMS) SHALL BE INSTALLED IF ONE AREA OR PHASE OF CONSTRUCTION DISRUPTS SERVICE TO ANOTHER AREA OF THE BUILDING(S) OR IF THE EQUIPMENT, CONDUITS, OR FEEDERS HAVE TO BE RELOCATED TO ALLOW CONSTRUCTION TO PROGRESS. SERVICE INTERRUPTIONS SHALL BE CONFINED TO THE SMALLEST AREA POSSIBLE AT ANY ONE TIME AND INTERRUPTIONS SHALL BE SCHEDULED WITH THE OWNER'S SITE REPRESENTATIVE. THERE SHALL BE DESIGNATED AREAS WHERE INTERRUPTIONS LIMITED TO AND SHALL BE CONDUCTED AFTER HOURS (8:00 PM - 6:00 AM) MONDAY THROUGH SATURDAY. AFTER SERVICE HAS BEEN RESTORED FOLLOWING AN INTERRUPTION, INSPECT AREAS AFFECTED BY THE INTERRUPTION AND BE RESPONSIBLE FOR RETURNING AUTOMATICALLY CONTROLLED EQUIPMENT TO THE SAME OPERATING CONDITION WHICH EXISTED PRIOR TO THE INTERRUPTION.
- B. SIGNIFICANT NOISE PRODUCING WORK SHALL BE CONDUCTED AFTER HOURS (8:00 PM - 6:00 AM) AND WEEKENDS.
- C. DO NOT REUSE EXISTING WIRING. PROVIDE NEW HOME RUNS UNLESS NOTED OTHERWISE. PROVIDE DEDICATED NEUTRALS AS REQUIRED BY THE NEC. HANDLE TIES OR MULTI POLE BREAKERS FOR SINGLE PHASE LOADS ARE UNACCEPTABLE.
- D. COORDINATE LOCATION AND INSTALLATION OF CEILING MOUNTED EQUIPMENT WITH THE VA PRIOR TO ROUGH-IN.
- E. INSTALL MINIMUM #10 AWG FOR ALL 120V CIRCUIT HOMERUNS IN EXCESS OF 75'.
- F. ROUTE CONDUITS IN A MANNER TO CONCEAL WHERE POSSIBLE.
- G. DEVICES SHOWN BACK-TO-BACK ARE FOR INTENT PURPOSES ONLY. DO NOT INSTALL BACK-TO-BACK TO PREVENT NOISE TRAVEL. SEE SPECIFICATIONS FOR ADDITIONAL INFORMATION.
- H. ALL FURNITURE LAYOUTS ARE SHOWN FOR DESIGN INTENT ONLY. FINAL LOCATIONS OF FURNITURE AND ASSOCIATED POWER/DATA OUTLETS TO BE COORDINATED WITH OWNER.
- I. REFER TO MECHANICAL ELECTRICAL (ME) SCHEDULES FOR ELECTRICAL CONNECTION REQUIREMENTS TO MECHANICAL EQUIPMENT.
- J. COORDINATE RECEPTACLE DEVICES NEXT TO COMMUNICATION DEVICES, SUCH THAT THE DEVICES ARE MOUNTED NEXT TO EACH OTHER.
- K. UNLESS NOTED OTHERWISE, NORMAL POWER-FED DEVICES AND EQUIPMENT ARE CIRCUITED TO PANEL 28-LB-8.

KEY NOTES:

- 1 PROVIDE DUAL-CHANNEL WIREMOLD VISTA ARCHITECTURAL COLUMN, OR APPROVED EQUAL, TO CONNECT TO FURNITURE SYSTEM. ROUTE WIRES THROUGH FURNITURE SYSTEM RACEWAY. SEE ARCHITECTURAL FURNITURE PLANS FOR ADDITIONAL INFORMATION.
- 2 EXTEND BUSBAR FROM 28 MSB-1 TO NEW 2000A DISTRIBUTION SECTIONS. EXISTING 28 MSB-1 IS SQUARE D QED SWITCHBOARD.
- 3 ROUTE CONDUIT THROUGH TUNNEL/CRAWL SPACE AND MECHANICAL ROOM TO AREA BELOW NEW ELECTRICAL ROOM 133. REFER TO RISER FOR ADDITIONAL INFORMATION.
- 4 CEILING TO BE REMOVED AND REINSTALLED FOR MECHANICAL WORK. REMOVE AND REINSTALL ELECTRICAL EQUIPMENT AS REQUIRED.

KEY PLAN

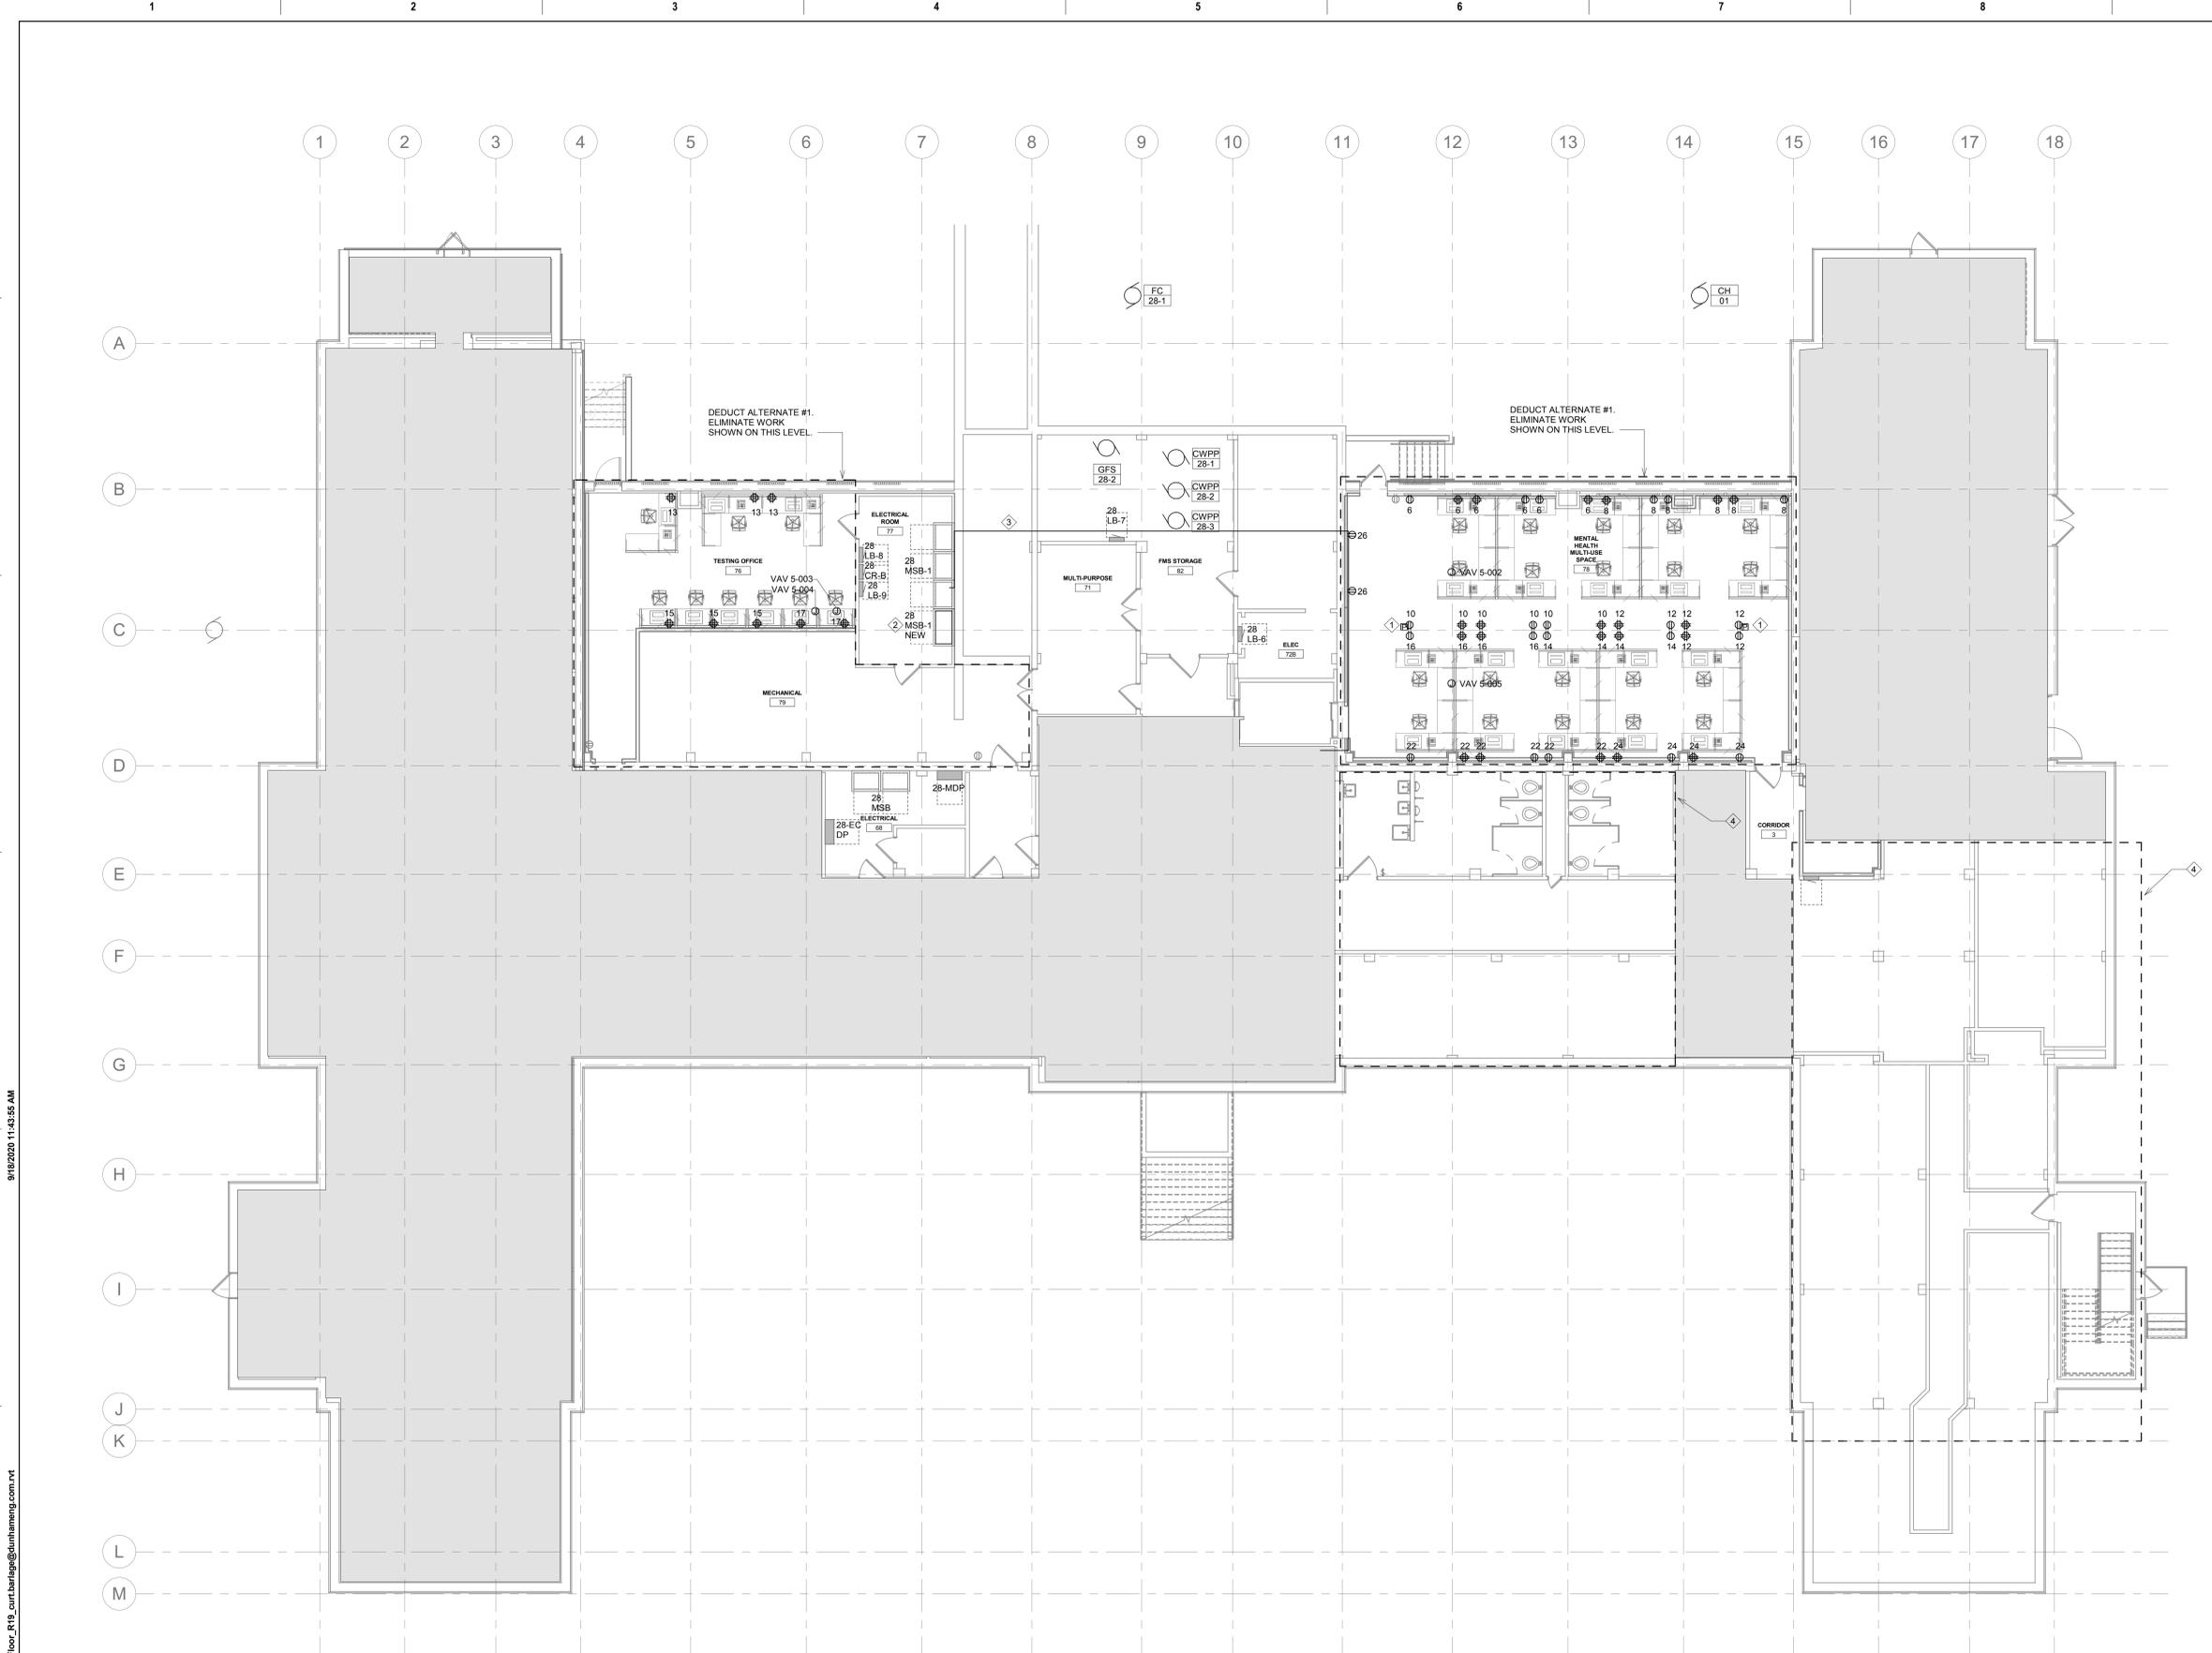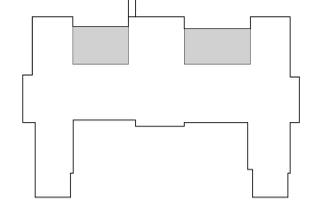

1 BASEMENT POWER FLOOR PLAN
1/8" = 1'-0"

Revision#	Description	Date:

CONSULTANT
DUNHAM
50 South Sixth Street / Suite 1100
Minneapolis, Minnesota 55402-1540
Phone: 612.465.7550 Fax: 612.465.7551
www.dunhaminc.com
mechanical + electrical consulting engineering
652959-007-00



ARCHITECT/ENGINEER OF RECORD
ANDERSON
13605 1st Ave. N. #100 Plymouth, MN 55441
P 763.412.4000 | F 763.412.4090 | ae-mn.com
Anderson Engineering of Minnesota, LLC | Proj # Project Number

STAMP
I hereby certify that this plan, specification or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the laws of the State of Minnesota.
Name: Curtis D. Barlage, P.E.
Date: 05/22/2020 Reg. No. 45914

Project Title RENOVATE BUILDING 28 FIRST FLOOR EAST RTRP		Project Number 656-19-306	
Location SAINT CLOUD, MN		Building Number 28	
Phase CONSTRUCTION DOCUMENTS		Drawing Number EP101	
Drawing Title BASEMENT POWER FLOOR PLAN		Issue Date MAY 22, 2020	Checked CB
		Drawn BZ	

VA U.S. Department of Veterans Affairs
Veterans Health Administration
St. Cloud VA Health Care System