


UPGRADE PUBLIC ADDRESS SYSTEM

St. Cloud VA Health Care System Main Campus, St. Cloud, Minnesota

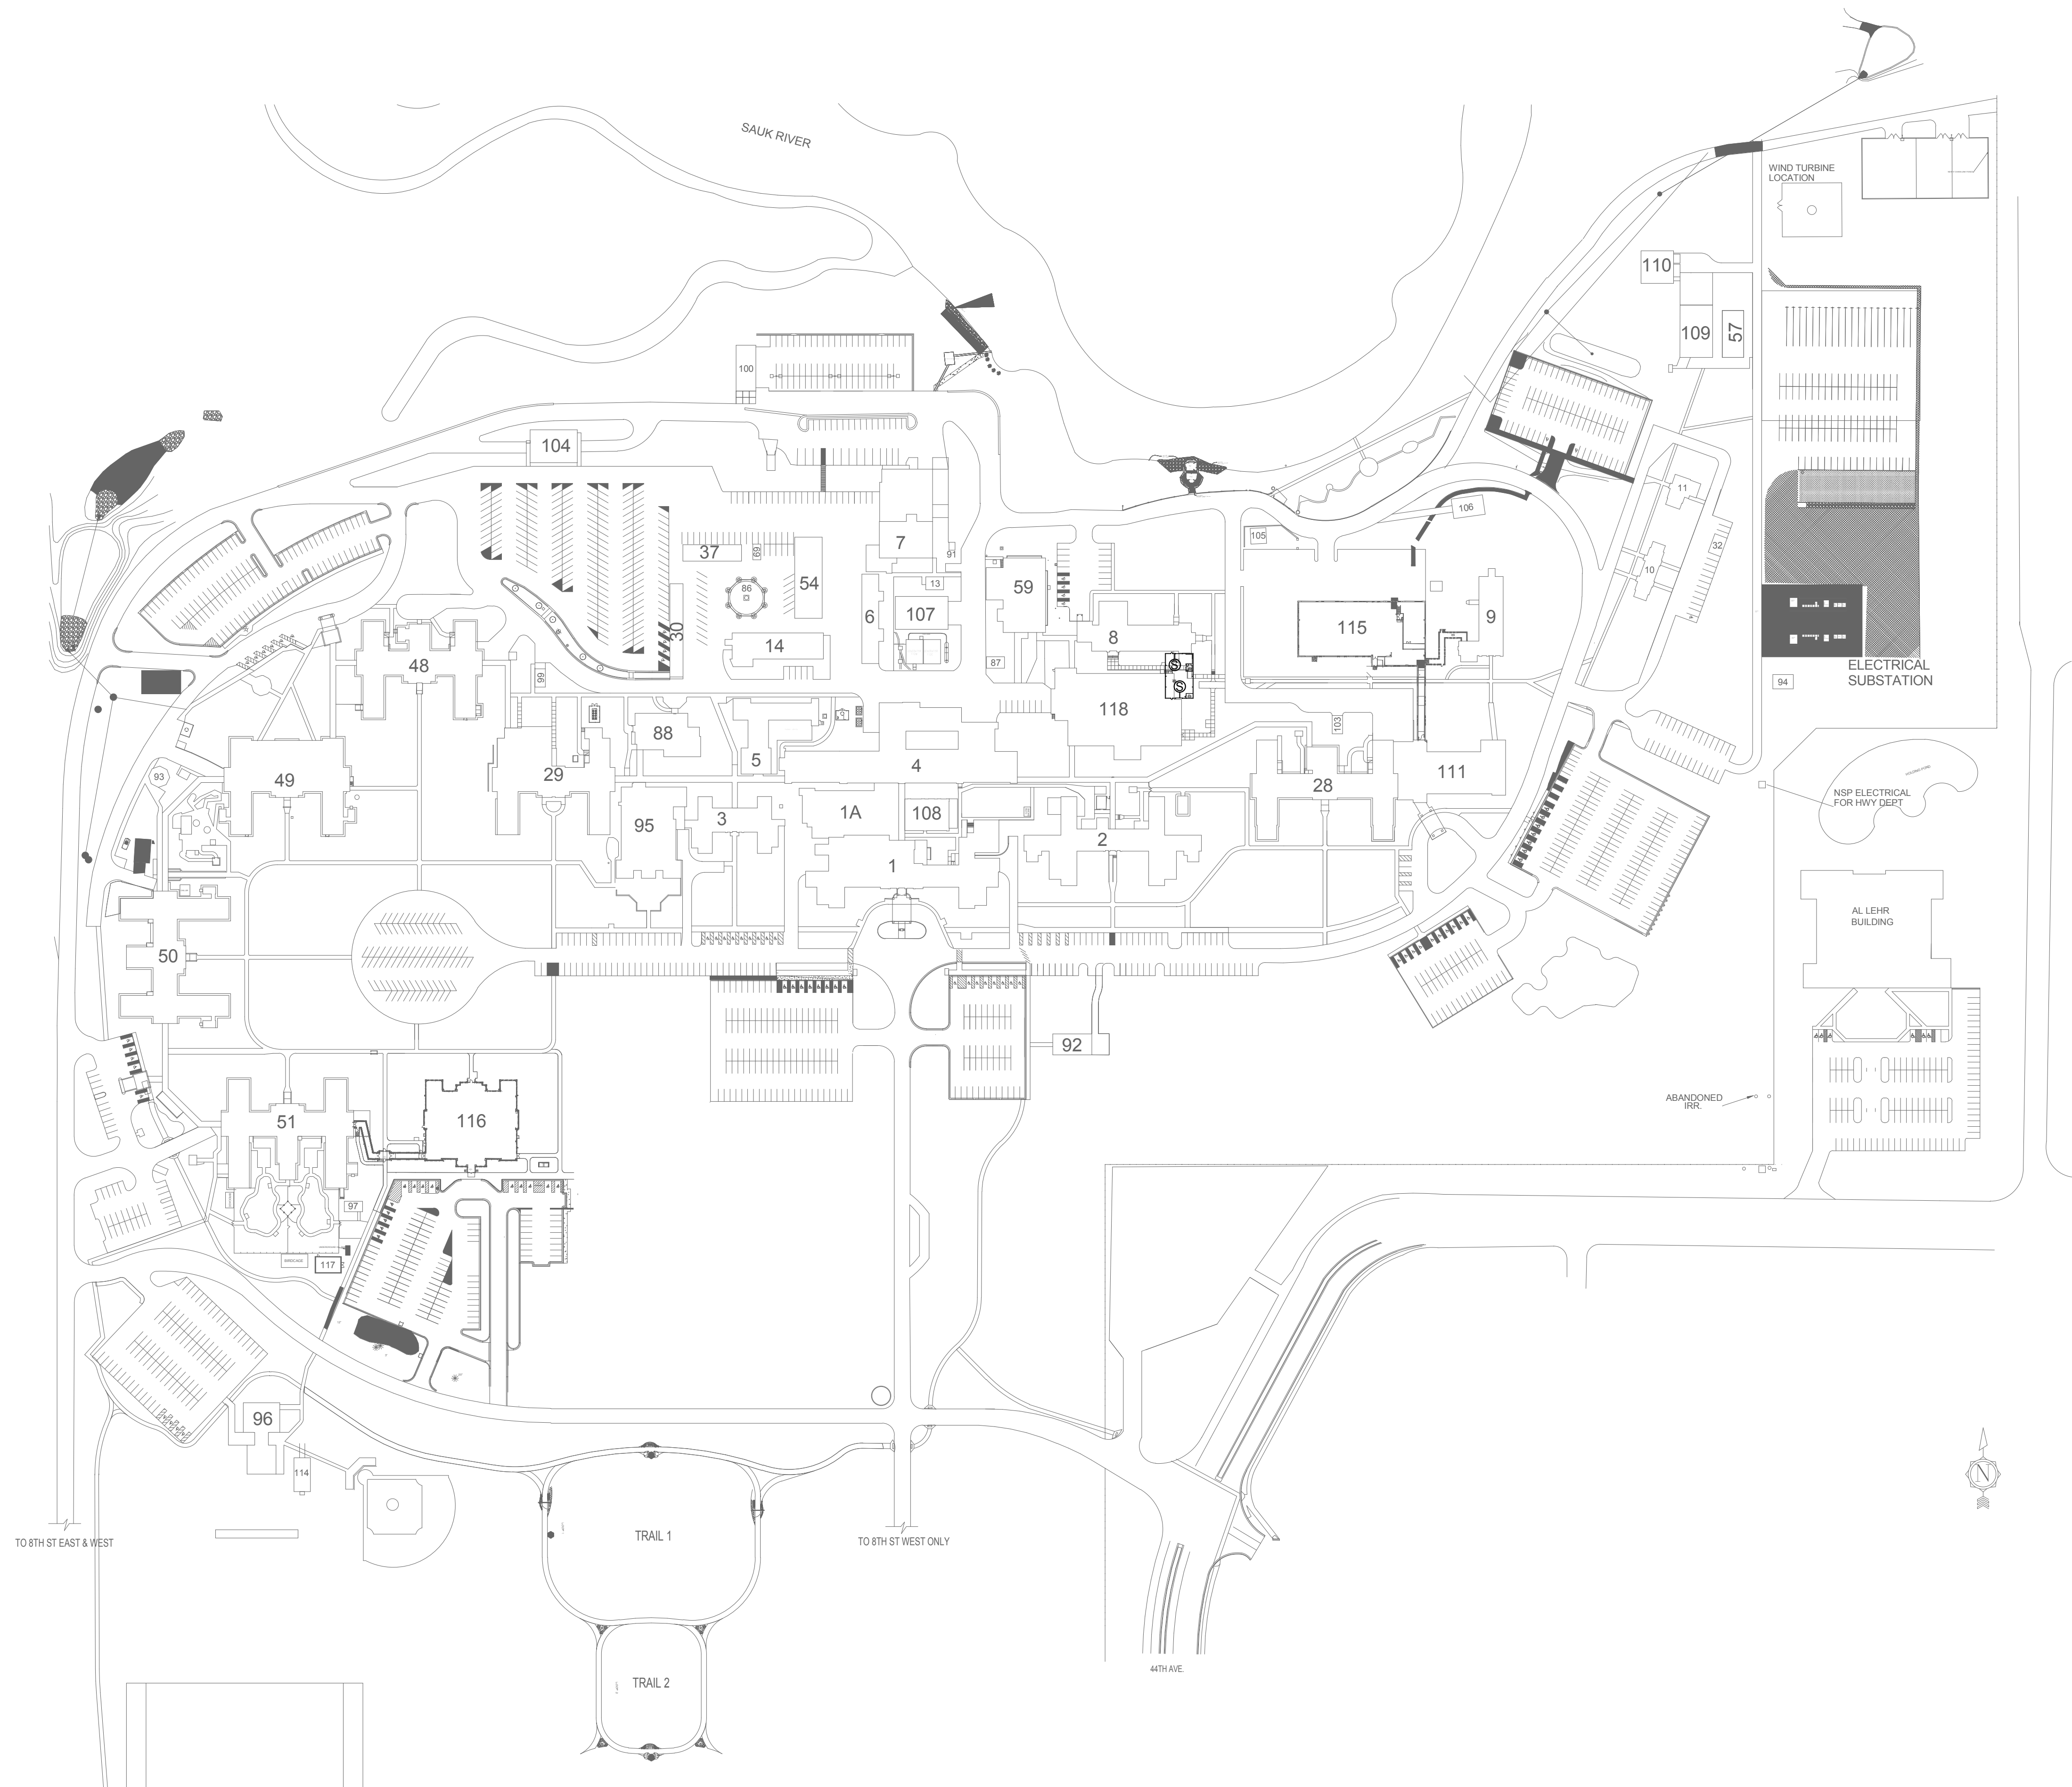

GENERAL CONDITIONS

All dimensions on drawings are approximate; Drawings are not to be scaled. It is the responsibility of the contractor to verify all field conditions and physical dimensions that influence the construction area.

It is recommended that contractors visit the proposed construction site prior to submitting their bids and they are encouraged to do so.

Contractor shall adhere strictly to State and Federal Occupational Safety and Health Administration (OSHA) Standards.

Contractor shall park only in the designated parking areas and are not to park on the lawn areas; the only exception is to load or unload supplies or equipment.

Contractor is responsible for the safeguarding of their tools and equipment. All tools and equipment are not to be left unattended and are to be secured at all times when the contractor is not present, or the construction site is not supervised by the contractor.

All VA property is to be safeguarded from damage. Any damaged VA property is to be restored to original condition prior to damage or replaced completely. This includes installation, labor, and procurement expenses.

All demolished material becomes the property and the responsibility of the contractor with the exception of specified items designated either in the plans or verbally requested by the COR to be retained by the VA. Offsite disposal of the demolished items is the responsibility of the contractor.

Contractor must control demolition and construction dust from facility by erecting a dust barrier and ventilation with hepa filters. If venting to outside, the contractor will insure negative air pressure is maintained in encapsulated work area. When transporting debris, wet down sufficiently to prevent dust spreading.

If scaffolding is used, it must be used in accordance with (OSHA) regulations and is to be enclosed for the first eight feet above ground at end of each working day, until dismantled. Ladders must be removed and locked up at the end of each working day to prevent unauthorized persons from having access.

Clean all debris from construction site to the satisfaction of the COR.

Contractor is responsible for erecting a barrier around work site to prevent patients, staff and visitors from entering construction site. This fence may be a plastic snow fence. Coordinate construction materials and location of fence with COR.

Contractor is responsible for repairing and replacing any damaged lawn. The restoration will be performed by a landscape contractor that regularly does sodding as part of their business. All damaged lawn will be overcut by 6" or more to accommodate full width rolls of sod. Top soil to be tilled and graded to a smooth matching grade of undamaged lawn. Sod to be thoroughly saturated with water upon placement. The contractor is responsible for watering new sod until project acceptance by the COR.

Access to all buildings and parking areas must be maintained throughout the project.

Contractors are to coordinate all work with the Contracting Officers Representative. (C.O.R.)

Contractor may park 1 (one) semi trailer in the lot near the wind turbine. The Contractor may park up to 4 (four) worker vehicles in the lot near the wind turbine. The Contractor may place 2 (two) dumpsters in the lot near the wind turbine provided they are covered and locked.

1/24/2019 12:11:15 PM

C:\Revit\Projects\VA ST CLOUD\FACING_Elec_R12.dwg

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com
AE PROJECT NUMBER: Project Number

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.

 Signature: *Chris Piliod*
 Name: Chris M. Piliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE COVER SHEET	DATE:
APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR	DATE:
APPROVED: CHIEF OF STAFF	DATE:
APPROVED: HEALTH CARE SYSTEM DIRECTOR	DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM	FLUT SCALE:
PROJECT NO.:	PROJECT NO.:
BUILDING NO.:	CHECKED BY: CP
DATE:	CG
ISSUE DATE	DATE:
1/24/19	DATE:
LOCATION	DRAWING NO.
VA MEDICAL CENTER ST. CLOUD, MN 56303	ET.000



U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

SYMBOL DESIGNATIONS

SYMBOL SCHEDULE NOTES
A. THESE SYMBOLS COMPRISE A STANDARD LIST, NOT ALL SYMBOLS MAY APPEAR ON THESE DRAWINGS.

GENERAL
HEAVY DASHED LINE WEIGHT INDICATES EXISTING ITEM TO BE REMOVED.
LIGHT SOLID LINE WEIGHT INDICATES EXISTING ITEM TO REMAIN.

NOTES & TAGS
EQUIPMENT IDENTIFICATION TAG - SEE EQUIPMENT SCHEDULES
FEEDER SIZE TAG - SEE POWER RISER SCHEDULE

RACEWAYS
CONDUIT CONCEALED IN CEILING OR WALLS
CONDUIT CONCEALED IN THE FLOOR OR BELOW

SYMBOL DESIGNATIONS MTG HT

LIGHTING
LIGHT FIXTURE ID - REFER TO LIGHT FIXTURE SCHEDULE
A - INDICATES LIGHT FIXTURE TYPE
- INDICATES LIGHT FIXTURE NUMBER

POWER
BRANCH CIRCUIT PANEL
EQUIPMENT CABINET
TRANSFORMER
MOTOR OR MOTOR CONNECTION

SYMBOL DESIGNATIONS MTG HT

SWITCHES AND CONTROLS
SINGLE POLE TOGGLE SWITCH
DOUBLE POLE TOGGLE SWITCH
THREE WAY TOGGLE SWITCH

FIRE ALARM
MANUAL PULL STATION
HEAT DETECTOR (#=FIXED TEMP, R=RATE OF RISE)
SMOKE DETECTOR (#=PHOTOELEC, #=IONIZATION)

SYMBOL DESIGNATIONS MTG HT

SIGNALS COMMUNICATIONS
DATA BOX - WALL MOUNT (#= WIRE COUNTS)
VOICE/DATE BOX - WALL MOUNT/FLOOR BOX (#= WIRE COUNTS)

SECURITY
SECURITY - WALL MOUNT - TYPICAL
CR - CARD READER
KP - KEYPAD
KS - KEY SWITCH

ELECTRICAL SHEET LIST

Table with columns SHEET NUMBER and SHEET NAME. Lists sheets E000 through E103-02, including titles like COVER SHEET, ELECTRICAL TITLE SHEET, and various building demolition floor plans.


ELECTRICAL SHEET LIST

Table with columns SHEET NUMBER and SHEET NAME. Lists sheets ET04-00 through ET501, including titles like BUILDING 04 - PAGING SPEAKER FLOOR PLAN - BASEMENT and ENLARGED COMMUNICATION ROOM PLANS.

Revisions:
Date:
1/24/2019 1:20:19 PM

ELECTRICAL ABBREVIATIONS

Table of electrical abbreviations. Columns include: A, AMP, AA, AC, ADD, AFC, AFCl, AFF, AHU, AL, ANT, ATS, BAS, BFC, BPS, C, CAB, CB, CCB, CFTV, CKT, CU, DN, EC, ELEC, EM, EMT, ENCL, EP, EPO, EWC, F, FA, FACP, FSD, FV, G, GND, GFI, IG, JBOX, KV, KVA, KW, KWH, MC, MCB, MLO, MRS, MSB, MT, NC, NEC, NIC, NO, NTS, OC, PB, PE, PF, PH, PNL, PRI, RECEPT, REFG, RTU, SEC, SPKR, SW, SWBD, TEL, TR, PE, PF, PH, PNL, PRI, RECEPT, REFG, RTU, SEC, SPKR, SW, SWBD, TEL, TR, TSTAT, TYP, UC, UG, UH, UNO, USB, V, VA, VAC, VDC, W, WP, XFMR, THERMOSTAT, UNDER COUNTER, UNDERGROUND, UNIT HEATER, UNLESS NOTED OTHERWISE, UNIVERSAL SERIAL BUS, VOLT, VOLT-AMP, VOLTS ALTERNATING CURRENT, VOLTS DIRECT CURRENT, WATT OR WIRE, WEATHERPROOF, TRANSFORMER

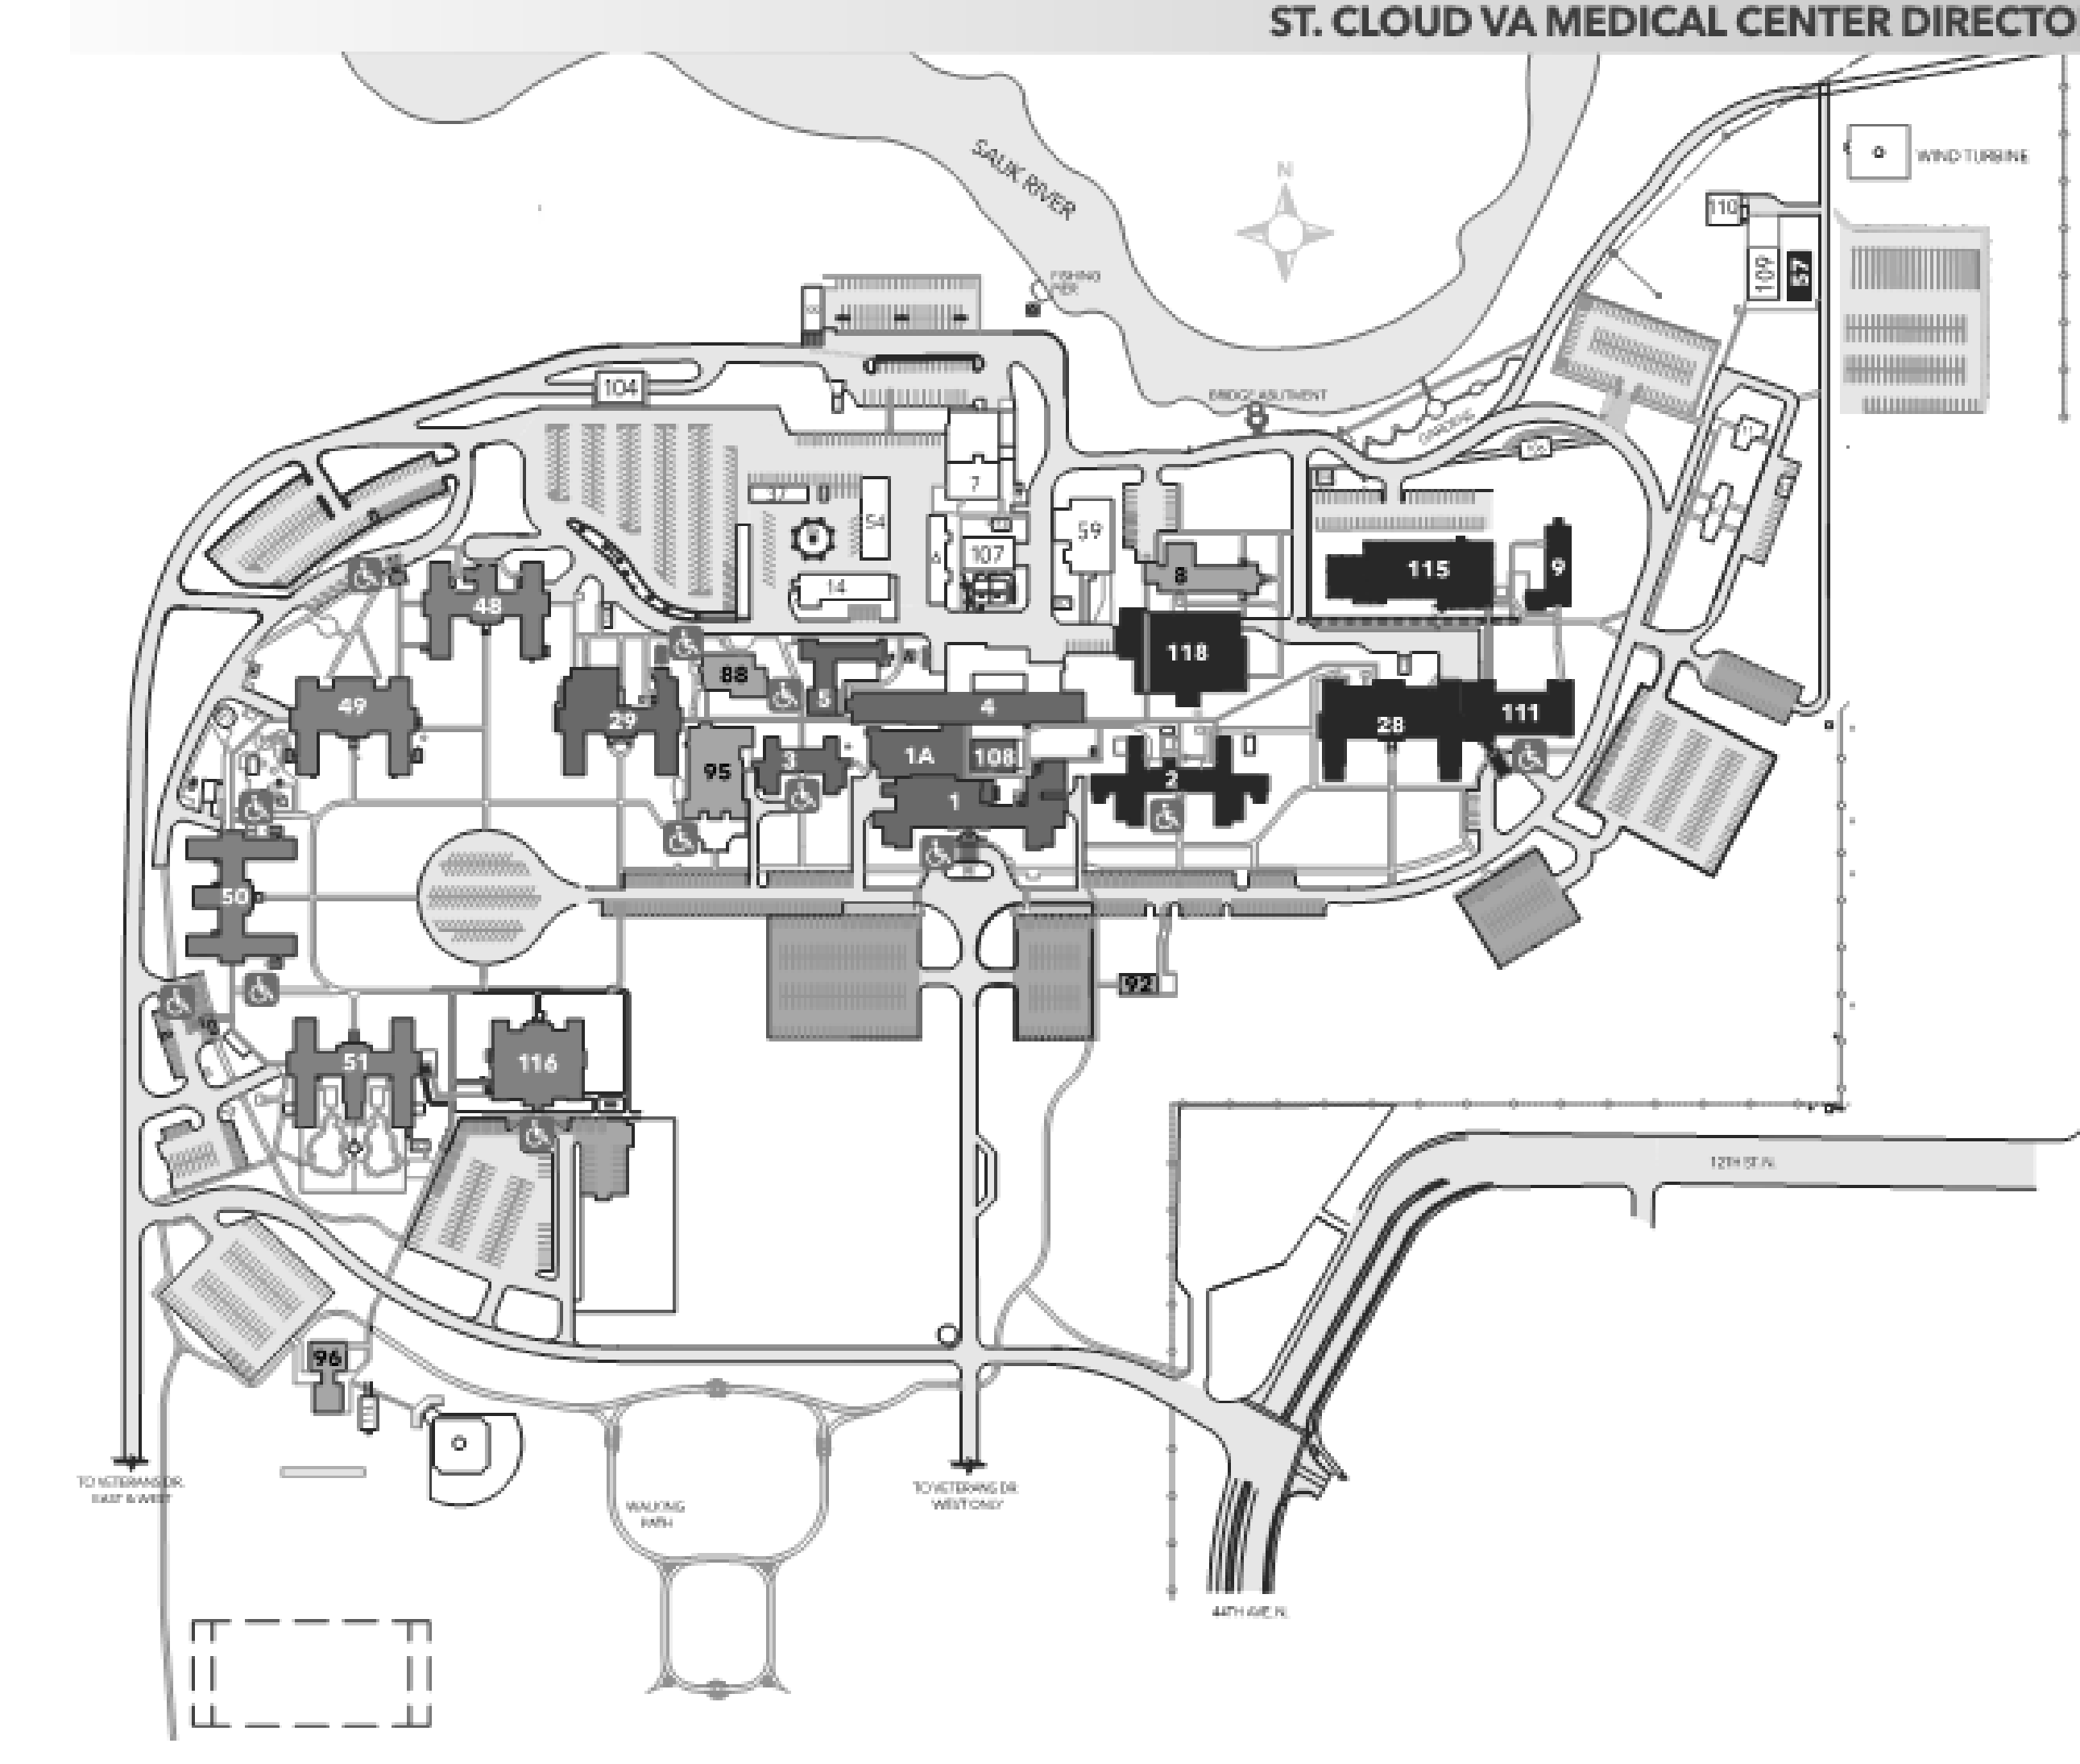

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)
DUNHAM
50 South Sixth Street / Suite 1100
Minneapolis, Minnesota 55402-1540

ARCHITECT/ENGINEER OF RECORD
ANDERSON ENGINEERING
Anderson Engineering of Minnesota, LLC
13605 1st Avenue North
Suite 100
Plymouth, MN 55441


STAMP
I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
Chris P. Peltier
Name: Chris M. Peltier, P.E.
Date: 1/24/19
Registration Number: 50826

Approval table with columns: APPROVED SERVICE LINE DIRECTOR, APPROVED INFECTON CONTROL NURSE, APPROVED GEMS COORDINATOR, APPROVED PATIENT SAFETY, APPROVED PROJECTS SECTION MANAGER, APPROVED CHIEF OF POLICE, APPROVED DIRECTOR FMS, APPROVED SAFETY MANAGER. Includes dates and signatures.

Project information table: PROJECT TITLE (UPGRADE PUBLIC ADDRESS SYSTEM), BUILDING No., CHECKED BY (CP, CG), DRAWN, DATE (1/24/19), DRAWING NO. (E000).


VA logo and U.S. Department of Veterans Affairs logo. Text: Veterans Health Administration, St. Cloud VA Health Care System.

No.	BUILDING SCHEDULE
1	OUTPATIENT CLINIC
2	CHEMICAL DEPENDENCE
3	F.M.S. & DENTAL
4	DIETETICS & ADMINISTRATION
5	PHARMACY
6	UTILITY SHOPS
7	BOILER HOUSE
8	AUDITORIUM/RECREATION
9	DOMICILIARY-POLICE
10	DSS
11	BUSINESS OFFICE/CONTRACTING
13	ENGINEER STORAGE
14	SUPPLY WAREHOUSE
28	MENTAL HEALTH
29	AUDIOLOGY, RELEASE OF INFORM.
30	SUPPLY & ENGINEER STORAGE
32	THREE CAR STORAGE
48	A.D.H.C.-NURSE ED.
49	COMMUNITY LIVING CENTER
50	COMMUNITY LIVING CENTER
51	COMMUNITY LIVING CENTER
54	STATION GARAGE
57	CWT
59	LAUNDRY
69	STORAGE
86	WATER TOWER
87	PUMPING STATION
88	CHAPEL
91	BOILER BLOWDOWN PUMPHOUSE
92	V.F.W. RECREATION-DR. REID BLD
93	A.L.A. RECREATION
94	ELECTRIC METER HOUSE
95	CANTEEN
96	RECREATION
97	GENERATOR
99	GENERATOR
100	ENGINEERING STORAGE
103	GENERATOR
104	SUPPLY WAREHOUSE
105	STORAGE
106	GAME FARM
107	ENGINEERING STORAGE
108	PHARMACY/TELEPHONE
111	MENTAL HEALTH
112E	GENERATOR
112W	GENERATOR
113	GENERATOR
114	GENERATOR/PUMP HOUSE
115	MENTAL HEALTH
116	REHABILITATION
117	GENERATOR
118	KITCHEN

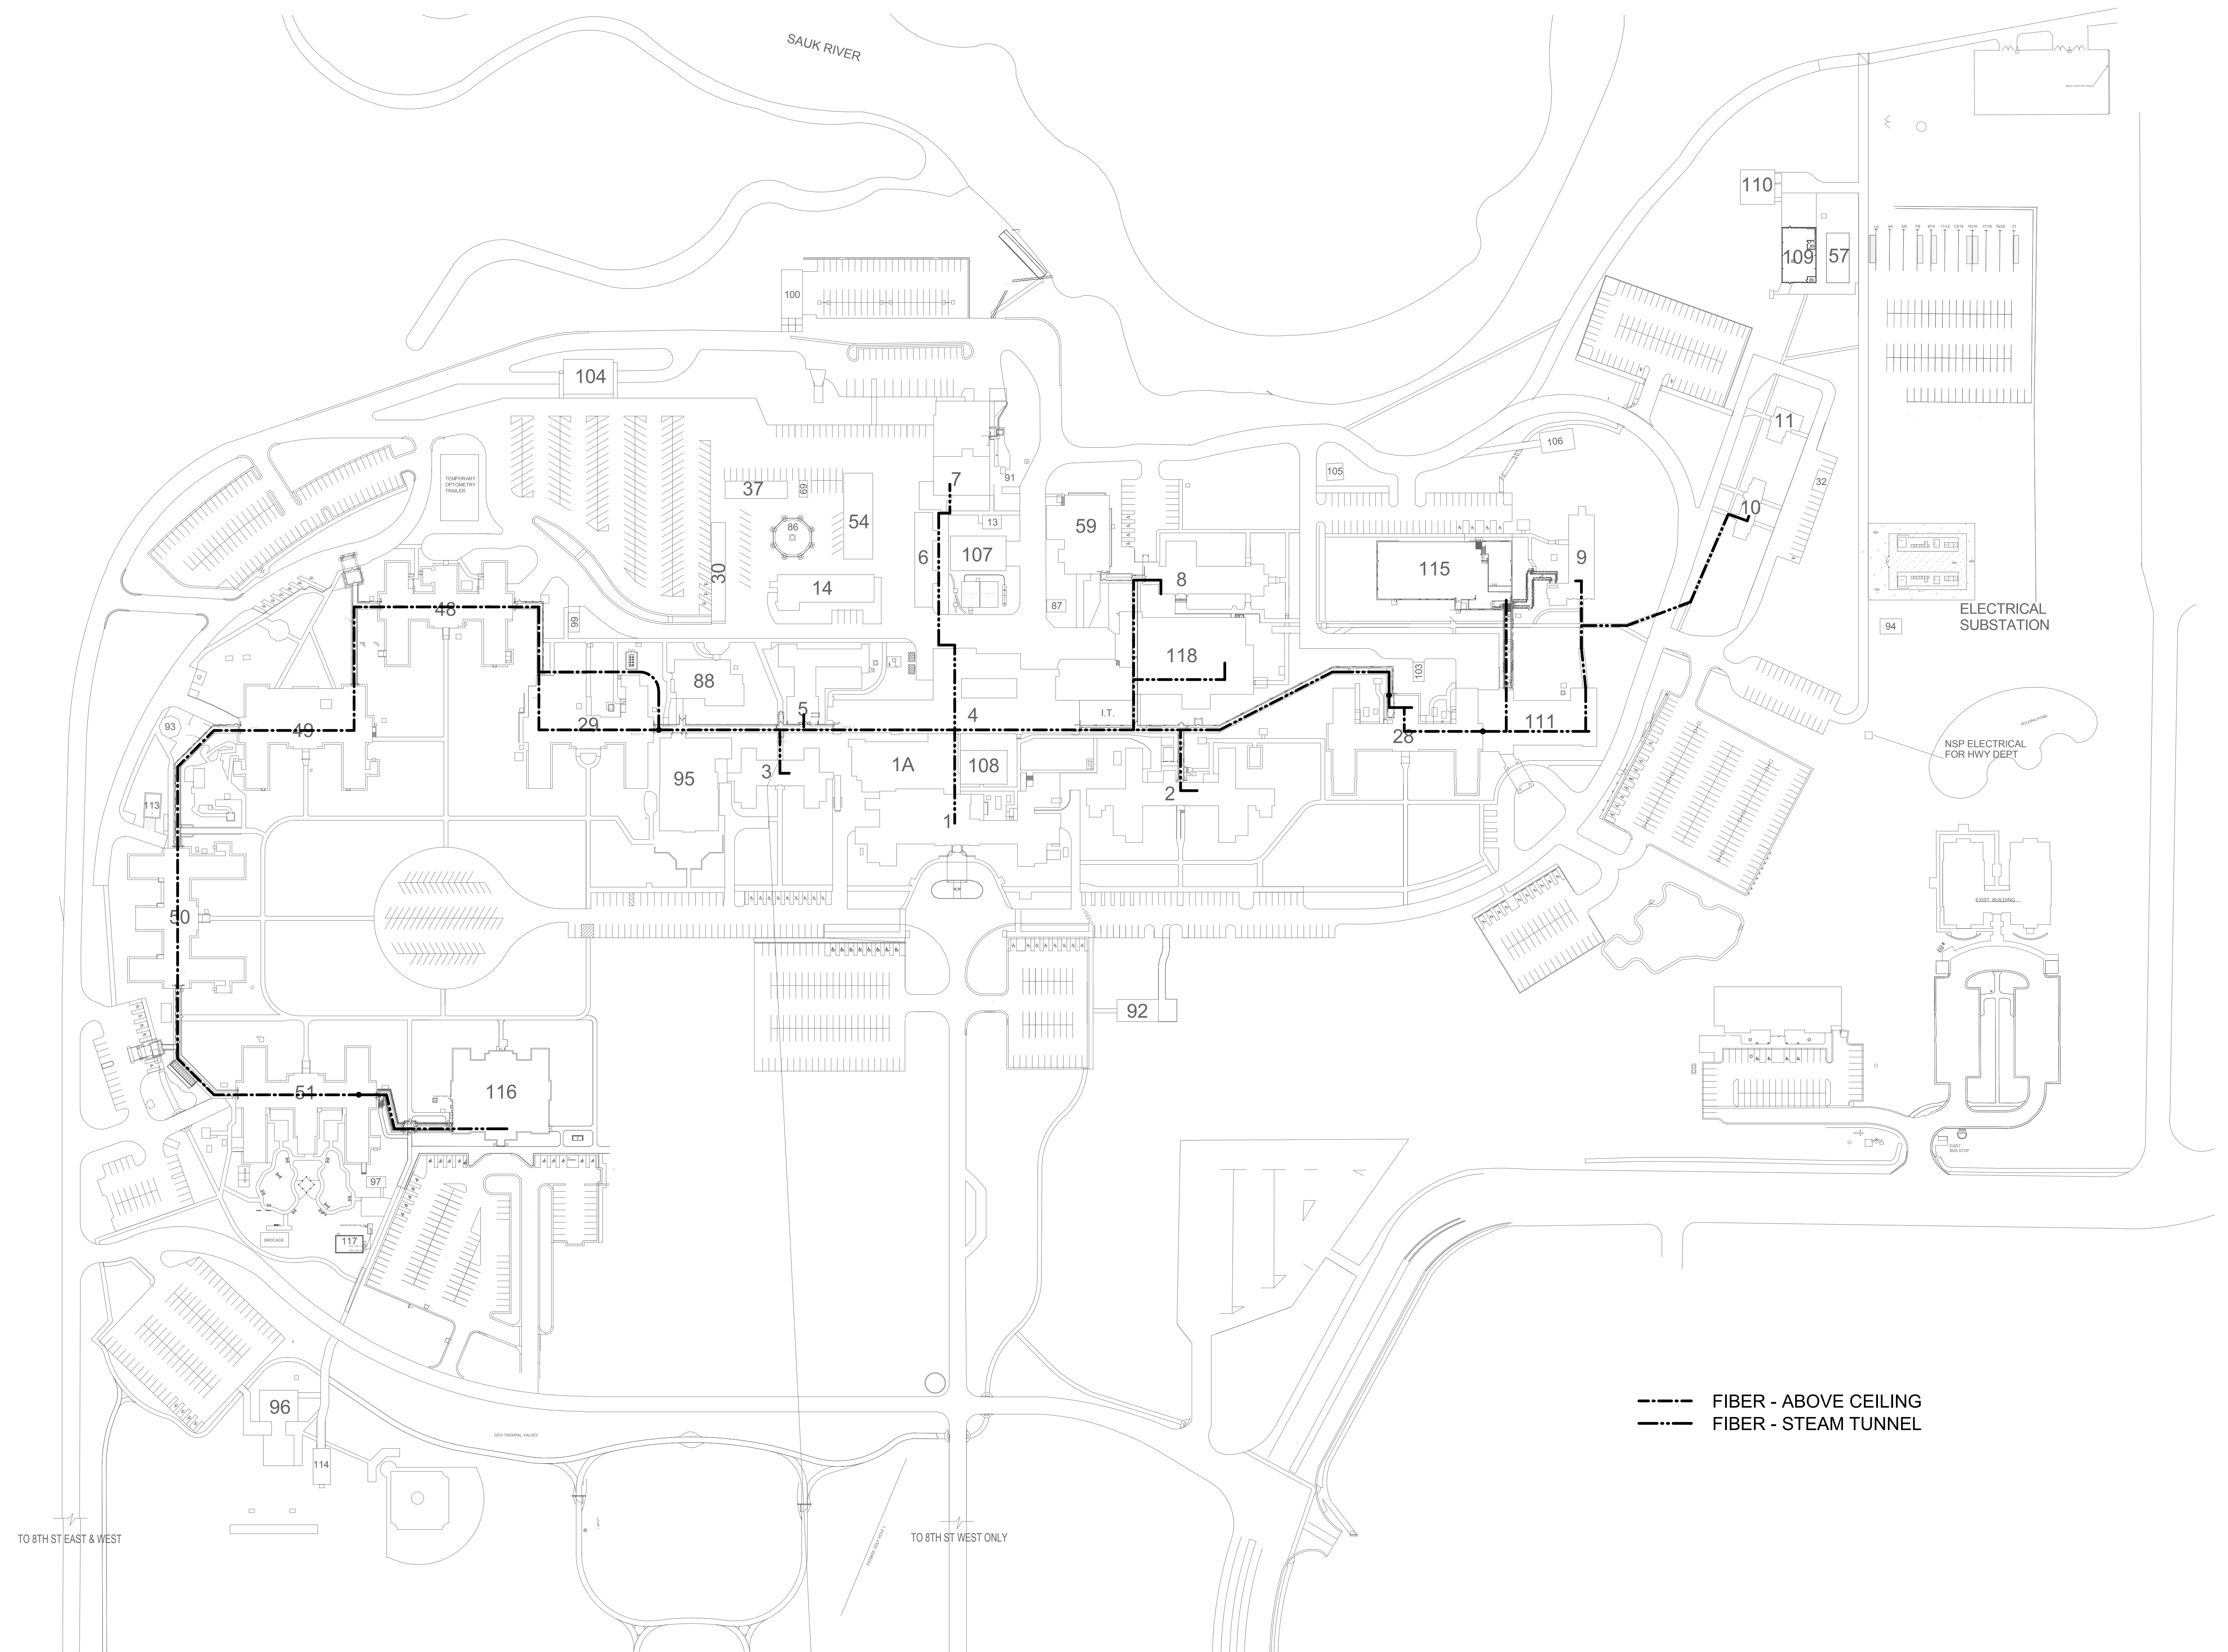

--- FIBER - ABOVE CEILING
 --- FIBER - STEAM TUNNEL

1 SITE PLAN
 1" = 100'-0"

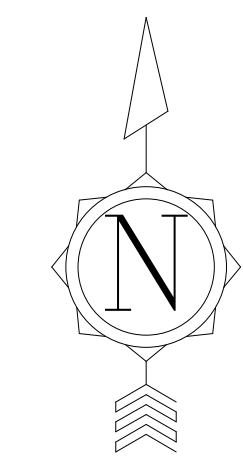

C:\Revit\Projects\VA ST CLOUD\FINING_Elec_R12.dwg 1/24/2019 12:11:15 PM

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

 DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com
 AE PROJECT NUMBER: Project Number

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Piliod*
 Name: Chris M. Piliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:


DRAWING TITLE SITE PLAN	APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR	DATE:
APPROVED: CHIEF OF STAFF	DATE:	APPROVED: HEALTH CARE SYSTEM DIRECTOR
DATE:	DATE:	DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		FLUT SCALE
PROJECT NO.		PROJECT NO.
BUILDING No.	CHECKED BY	DRAWN
	CP	CG
ISSUE DATE	DATE	DRAWING NO.
1/24/19	1/24/19	ET.101
LOCATION VA MEDICAL CENTER ST. CLOUD, MN 56303		DATE

VA

U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

1/24/2019 1:20:20 PM
C:\Revit\Projects\VA ST CLC\CLD\PAGING\Bldg_R1E_chp.rvt

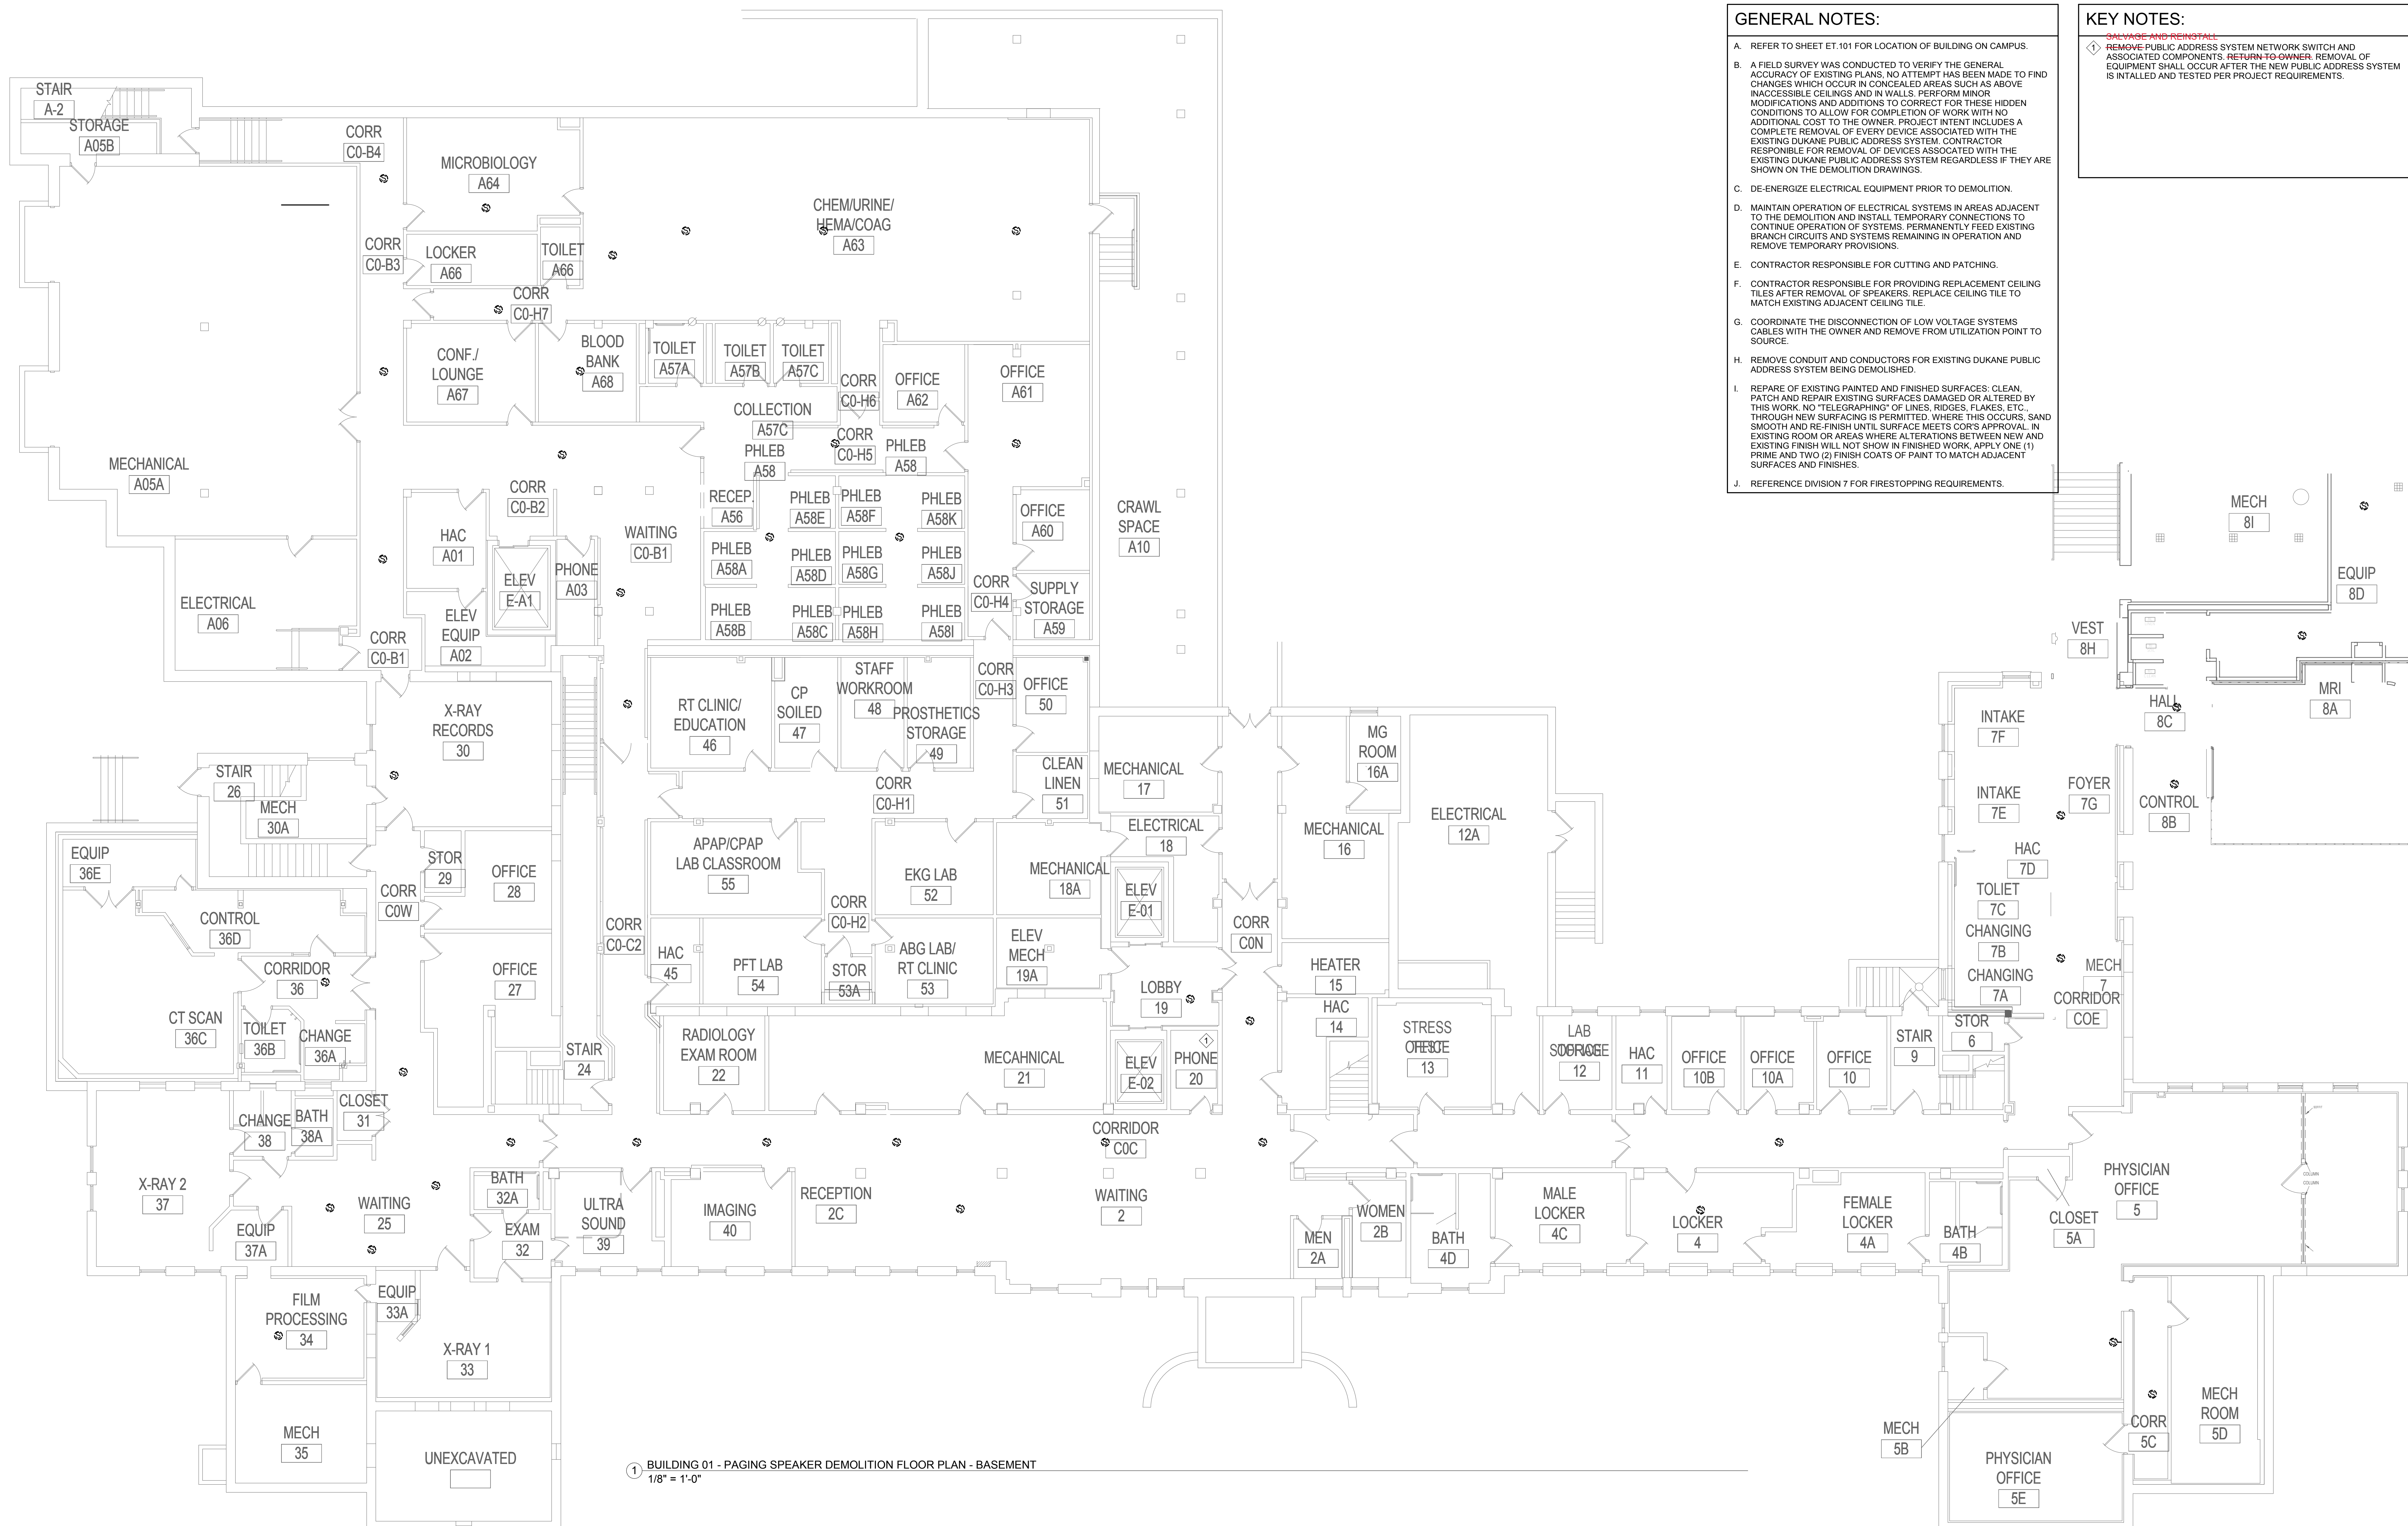

- GENERAL NOTES:**
- A. REFER TO SHEET ET-101 FOR LOCATION OF BUILDING ON CAMPUS.
 - B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE INACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
 - C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
 - D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
 - E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
 - F. CONTRACTOR RESPONSIBLE FOR PROVIDING REPLACEMENT CEILING TILES AFTER REMOVAL OF SPEAKERS. REPLACE CEILING TILE TO MATCH EXISTING ADJACENT CEILING TILE.
 - G. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
 - H. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
 - I. REPAIR OF EXISTING PAINTED AND FINISHED SURFACES: CLEAN, PATCH AND REPAIR EXISTING SURFACES DAMAGED OR ALTERED BY THIS WORK. NO "TELEGRAPHING" OF LINES, RIDGES, FLAKES, ETC. THROUGH NEW SURFACING IS PERMITTED. WHERE THIS OCCURS, SAND SMOOTH AND RE-FINISH UNTIL SURFACE MEETS COR'S APPROVAL. IN EXISTING ROOM OR AREAS WHERE ALTERATIONS BETWEEN NEW AND EXISTING FINISH WILL NOT SHOW IN FINISHED WORK, APPLY ONE (1) PRIME AND TWO (2) FINISH COATS OF PAINT TO MATCH ADJACENT SURFACES AND FINISHES.
 - J. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.

- KEY NOTES:**
- REMOVE PUBLIC ADDRESS SYSTEM NETWORK SWITCH AND ASSOCIATED COMPONENTS. RETURN-TO-OWNER. REMOVAL OF EQUIPMENT SHALL OCCUR AFTER THE NEW PUBLIC ADDRESS SYSTEM IS INSTALLED AND TESTED PER PROJECT REQUIREMENTS.

1 BUILDING 01 - PAGING SPEAKER DEMOLITION FLOOR PLAN - BASEMENT
1/8" = 1'-0"

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)
DUNHAM
DUNHAM
50 South Sixth Street / Suite 1100
Minneapolis, Minnesota 55402-1540
Phone: 612-465-7550 Fax: 612-465-7551
Web: dunhaminc.com
mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD
ANDERSON ENGINEERING
ENGINEERING • ARCHITECTURE • LAND SURVEYING
ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
Anderson Engineering of Minnesota, LLC
13605 1st Avenue North
Suite 100
Plymouth, MN 55441
763-412-4000 (o) 763-412-4090 (f)
www.ae-mn.com
AE PROJECT NUMBER: Project Number

STAMP
I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
Chris M. Piliod
Signature: Chris M. Piliod, P.E.
Name: Chris M. Piliod, P.E.
Date: 1/24/19
Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE BUILDING 01 - PAGING SPEAKER DEMOLITION FLOOR PLAN - BASEMENT	DATE:
APPROVED: HEALTH CARE SYSTEM DIRECTOR	DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM	PROJECT NO.:
APPROVED: CHIEF OF STAFF	DATE:
BUILDING No.:	CHECKED BY: CP
DATE:	CG
ISSUE DATE 1/24/19	DRAWING NO. ED01-00
LOCATION VA MEDICAL CENTER ST. CLOUD, MN 56303	DATE:

VA
U.S. Department of Veterans Affairs
Veterans Health Administration
St. Cloud VA Health Care System

1/24/2019 1:20:21 PM

C:\Revit\Projects\VA ST CLOUD PAGING_Bldg_R1E.dwg

GENERAL NOTES:

- A. REFER TO SHEET ET.101 FOR LOCATION OF BUILDING ON CAMPUS.
- B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE UNACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
- C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
- D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
- E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
- F. CONTRACTOR RESPONSIBLE FOR PROVIDING REPLACEMENT CEILING TILES AFTER REMOVAL OF SPEAKERS. REPLACE CEILING TILE TO MATCH EXISTING ADJACENT CEILING TILE.
- G. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
- H. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
- I. REPAIR OF EXISTING PAINTED AND FINISHED SURFACES: CLEAN, PATCH AND REPAIR EXISTING SURFACES DAMAGED OR ALTERED BY THIS WORK. NO "TELEGRAPHING" OF LINES, RIDGES, FLAKES, ETC. THROUGH NEW SURFACING IS PERMITTED. WHERE THIS OCCURS, SAND SMOOTH AND RE-FINISH UNTIL SURFACE MEETS COR'S APPROVAL. IN EXISTING ROOM OR AREAS WHERE ALTERATIONS BETWEEN NEW AND EXISTING FINISH WILL NOT SHOW IN FINISHED WORK, APPLY ONE (1) PRIME AND TWO (2) FINISH COATS OF PAINT TO MATCH ADJACENT SURFACES AND FINISHES.
- J. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.



1 BUILDING 01 - PAGING SPEAKER DEMOLITION FLOOR PLAN - FIRST FLOOR
1/8" = 1'-0"

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

 DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-485-7550 Fax: 612-485-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com
AE PROJECT NUMBER: Project Number

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.

 Name: Chris M. Piliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE
BUILDING 01 - PAGING SPEAKER DEMOLITION FLOOR PLAN - FIRST FLOOR
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:
 APPROVED: CHIEF OF STAFF
 DATE:
 APPROVED: HEALTH CARE SYSTEM DIRECTOR
 DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PLOT SCALE	
PROJECT NO.		ISSUE DATE	
BUILDING No.	CHECKED BY	DRAWN	DATE
	CP	CG	1/24/19
LOCATION	DATE	DRAWING NO.	
VA MEDICAL CENTER ST. CLOUD, MN 56303		ED01-01	

U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

- GENERAL NOTES:**
- A. REFER TO SHEET ET.101 FOR LOCATION OF BUILDING ON CAMPUS.
 - B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE UNACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
 - C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
 - D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
 - E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
 - F. CONTRACTOR RESPONSIBLE FOR PROVIDING REPLACEMENT CEILING TILES AFTER REMOVAL OF SPEAKERS. REPLACE CEILING TILE TO MATCH EXISTING ADJACENT CEILING TILE.
 - G. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
 - H. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
 - I. REPAIR OF EXISTING PAINTED AND FINISHED SURFACES: CLEAN, PATCH AND REPAIR EXISTING SURFACES DAMAGED OR ALTERED BY THIS WORK. NO "TELEGRAPHING" OF LINES, RIDGES, FLAKES, ETC. THROUGH NEW SURFACING IS PERMITTED. WHERE THIS OCCURS, SAND SMOOTH AND RE-FINISH UNTIL SURFACE MEETS COR'S APPROVAL. IN EXISTING ROOM OR AREAS WHERE ALTERATIONS BETWEEN NEW AND EXISTING FINISH WILL NOT SHOW IN FINISHED WORK, APPLY ONE (1) PRIME AND TWO (2) FINISH COATS OF PAINT TO MATCH ADJACENT SURFACES AND FINISHES.
 - J. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.

1 BUILDING 01 - PAGING SPEAKER DEMOLITION FLOOR PLAN - SECOND FLOOR
1/8" = 1'-0"

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilioid*
 Name: Chris M. Pilioid, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE BUILDING 01 - PAGING SPEAKER DEMOLITION FLOOR PLAN - SECOND FLOOR	APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
DATE:	DATE:
APPROVED: CHIEF OF STAFF	DATE:
APPROVED: HEALTH CARE SYSTEM DIRECTOR	DATE:


PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM	BUILDING No:	CHECKED BY:	DRAWN BY:	ISSUE DATE:
		CP	CG	1/24/19
LOCATION VA MEDICAL CENTER ST. CLOUD, MN 56303	DRAWING NO. ED01-02			



C:\Revit\Projects\VA ST CL CLOUD PAGING_Bldg_ET12.dwg.plt 1/24/2019 11:26:22 PM

GENERAL NOTES:

- A. REFER TO SHEET ET.101 FOR LOCATION OF BUILDING ON CAMPUS.
- B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE INACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
- C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
- D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
- E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
- F. CONTRACTOR RESPONSIBLE FOR PROVIDING REPLACEMENT CEILING TILES AFTER REMOVAL OF SPEAKERS. REPLACE CEILING TILE TO MATCH EXISTING ADJACENT CEILING TILE.
- G. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
- H. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
- I. REPAIR OF EXISTING PAINTED AND FINISHED SURFACES: CLEAN, PATCH AND REPAIR EXISTING SURFACES DAMAGED OR ALTERED BY THIS WORK. NO "TELEGRAPHING" OF LINES, RIDGES, FLAKES, ETC. THROUGH NEW SURFACING IS PERMITTED. WHERE THIS OCCURS, SAND SMOOTH AND RE-FINISH UNTIL SURFACE MEETS COR'S APPROVAL. IN EXISTING ROOM OR AREAS WHERE ALTERATIONS BETWEEN NEW AND EXISTING FINISH WILL NOT SHOW IN FINISHED WORK, APPLY ONE (1) PRIME AND TWO (2) FINISH COATS OF PAINT TO MATCH ADJACENT SURFACES AND FINISHES.
- J. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.

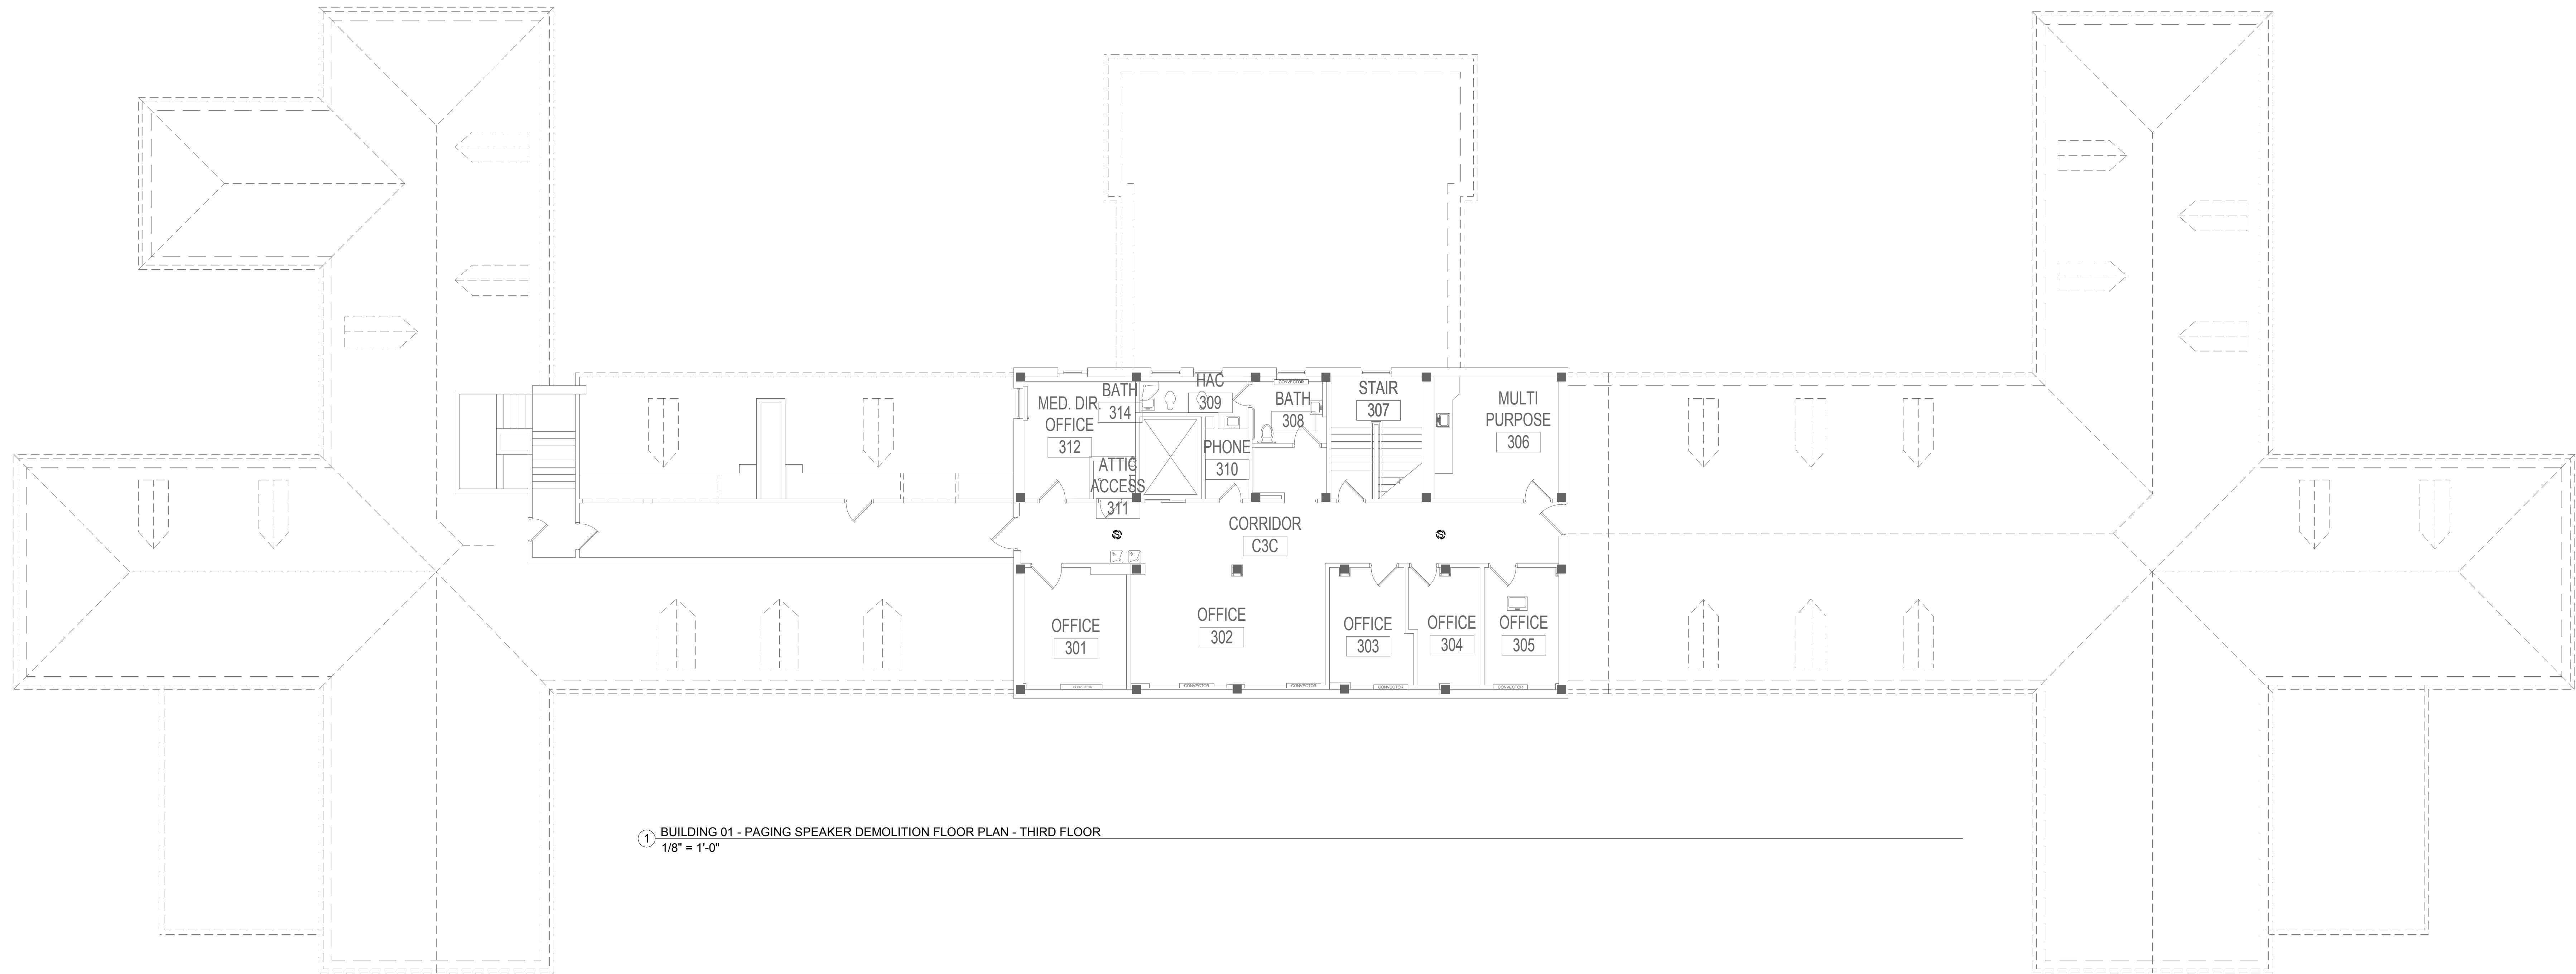

1 BUILDING 01 - PAGING SPEAKER DEMOLITION FLOOR PLAN - THIRD FLOOR
1/8" = 1'-0"

1/24/2019 1:26:25 PM

C:\Revit\Projects\VA ST CLOUD PAGING_Elec_R12.dwg

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilioud*
 Name: Chris M. Pilioud, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE
BUILDING 01 - PAGING SPEAKER DEMOLITION FLOOR PLAN - THIRD FLOOR
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:
 APPROVED: CHIEF OF STAFF
 DATE:
 APPROVED: HEALTH CARE SYSTEM DIRECTOR
 DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PLOT SCALE	
PROJECT NO.		PROJECT NO.	
BUILDING No.	CHECKED BY	DRAWN	ISSUE DATE
	CP	CG	1/24/19
LOCATION	DATE	DRAWING NO.	
VA MEDICAL CENTER ST. CLOUD, MN 56303		ED01-03	


VA
U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

GENERAL NOTES:

- A. REFER TO SHEET ET.101 FOR LOCATION OF BUILDING ON CAMPUS.
- B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE UNACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
- C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
- D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
- E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
- F. CONTRACTOR RESPONSIBLE FOR PROVIDING REPLACEMENT CEILING TILES AFTER REMOVAL OF SPEAKERS. REPLACE CEILING TILE TO MATCH EXISTING ADJACENT CEILING TILE.
- G. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
- H. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
- I. REPAIR OF EXISTING PAINTED AND FINISHED SURFACES: CLEAN, PATCH AND REPAIR EXISTING SURFACES DAMAGED OR ALTERED BY THIS WORK. NO "TELEGRAPHING" OF LINES, RIDGES, FLAKES, ETC. THROUGH NEW SURFACING IS PERMITTED. WHERE THIS OCCURS, SAND SMOOTH AND RE-FINISH UNTIL SURFACE MEETS COR'S APPROVAL. IN EXISTING ROOM OR AREAS WHERE ALTERATIONS BETWEEN NEW AND EXISTING FINISH WILL NOT SHOW IN FINISHED WORK, APPLY ONE (1) PRIME AND TWO (2) FINISH COATS OF PAINT TO MATCH ADJACENT SURFACES AND FINISHES.
- J. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.

KEY NOTES:

- ① DEMOLISH EXISTING PUBLIC ADDRESS SYSTEM CABLING, CONNECTIVITY AND ENCLOSURE. REMOVE 120VAC BACK TO SOURCE. REMOVE AND RETURN PUBLIC ADDRESS SYSTEM AMPLIFIERS TO OWNER. REMOVAL OF EXISTING SYSTEM SHALL OCCUR AFTER THE NEW PUBLIC ADDRESS SYSTEM IS INSTALLED AND TESTED PER PROJECT REQUIREMENTS.
- ② SALVAGE AND REINSTALL REMOVE PUBLIC ADDRESS SYSTEM NETWORK SWITCH AND ASSOCIATED COMPONENTS. RETURN TO OWNER. REMOVAL OF EQUIPMENT SHALL OCCUR AFTER THE NEW PUBLIC ADDRESS SYSTEM IS INSTALLED AND TESTED PER PROJECT REQUIREMENTS.

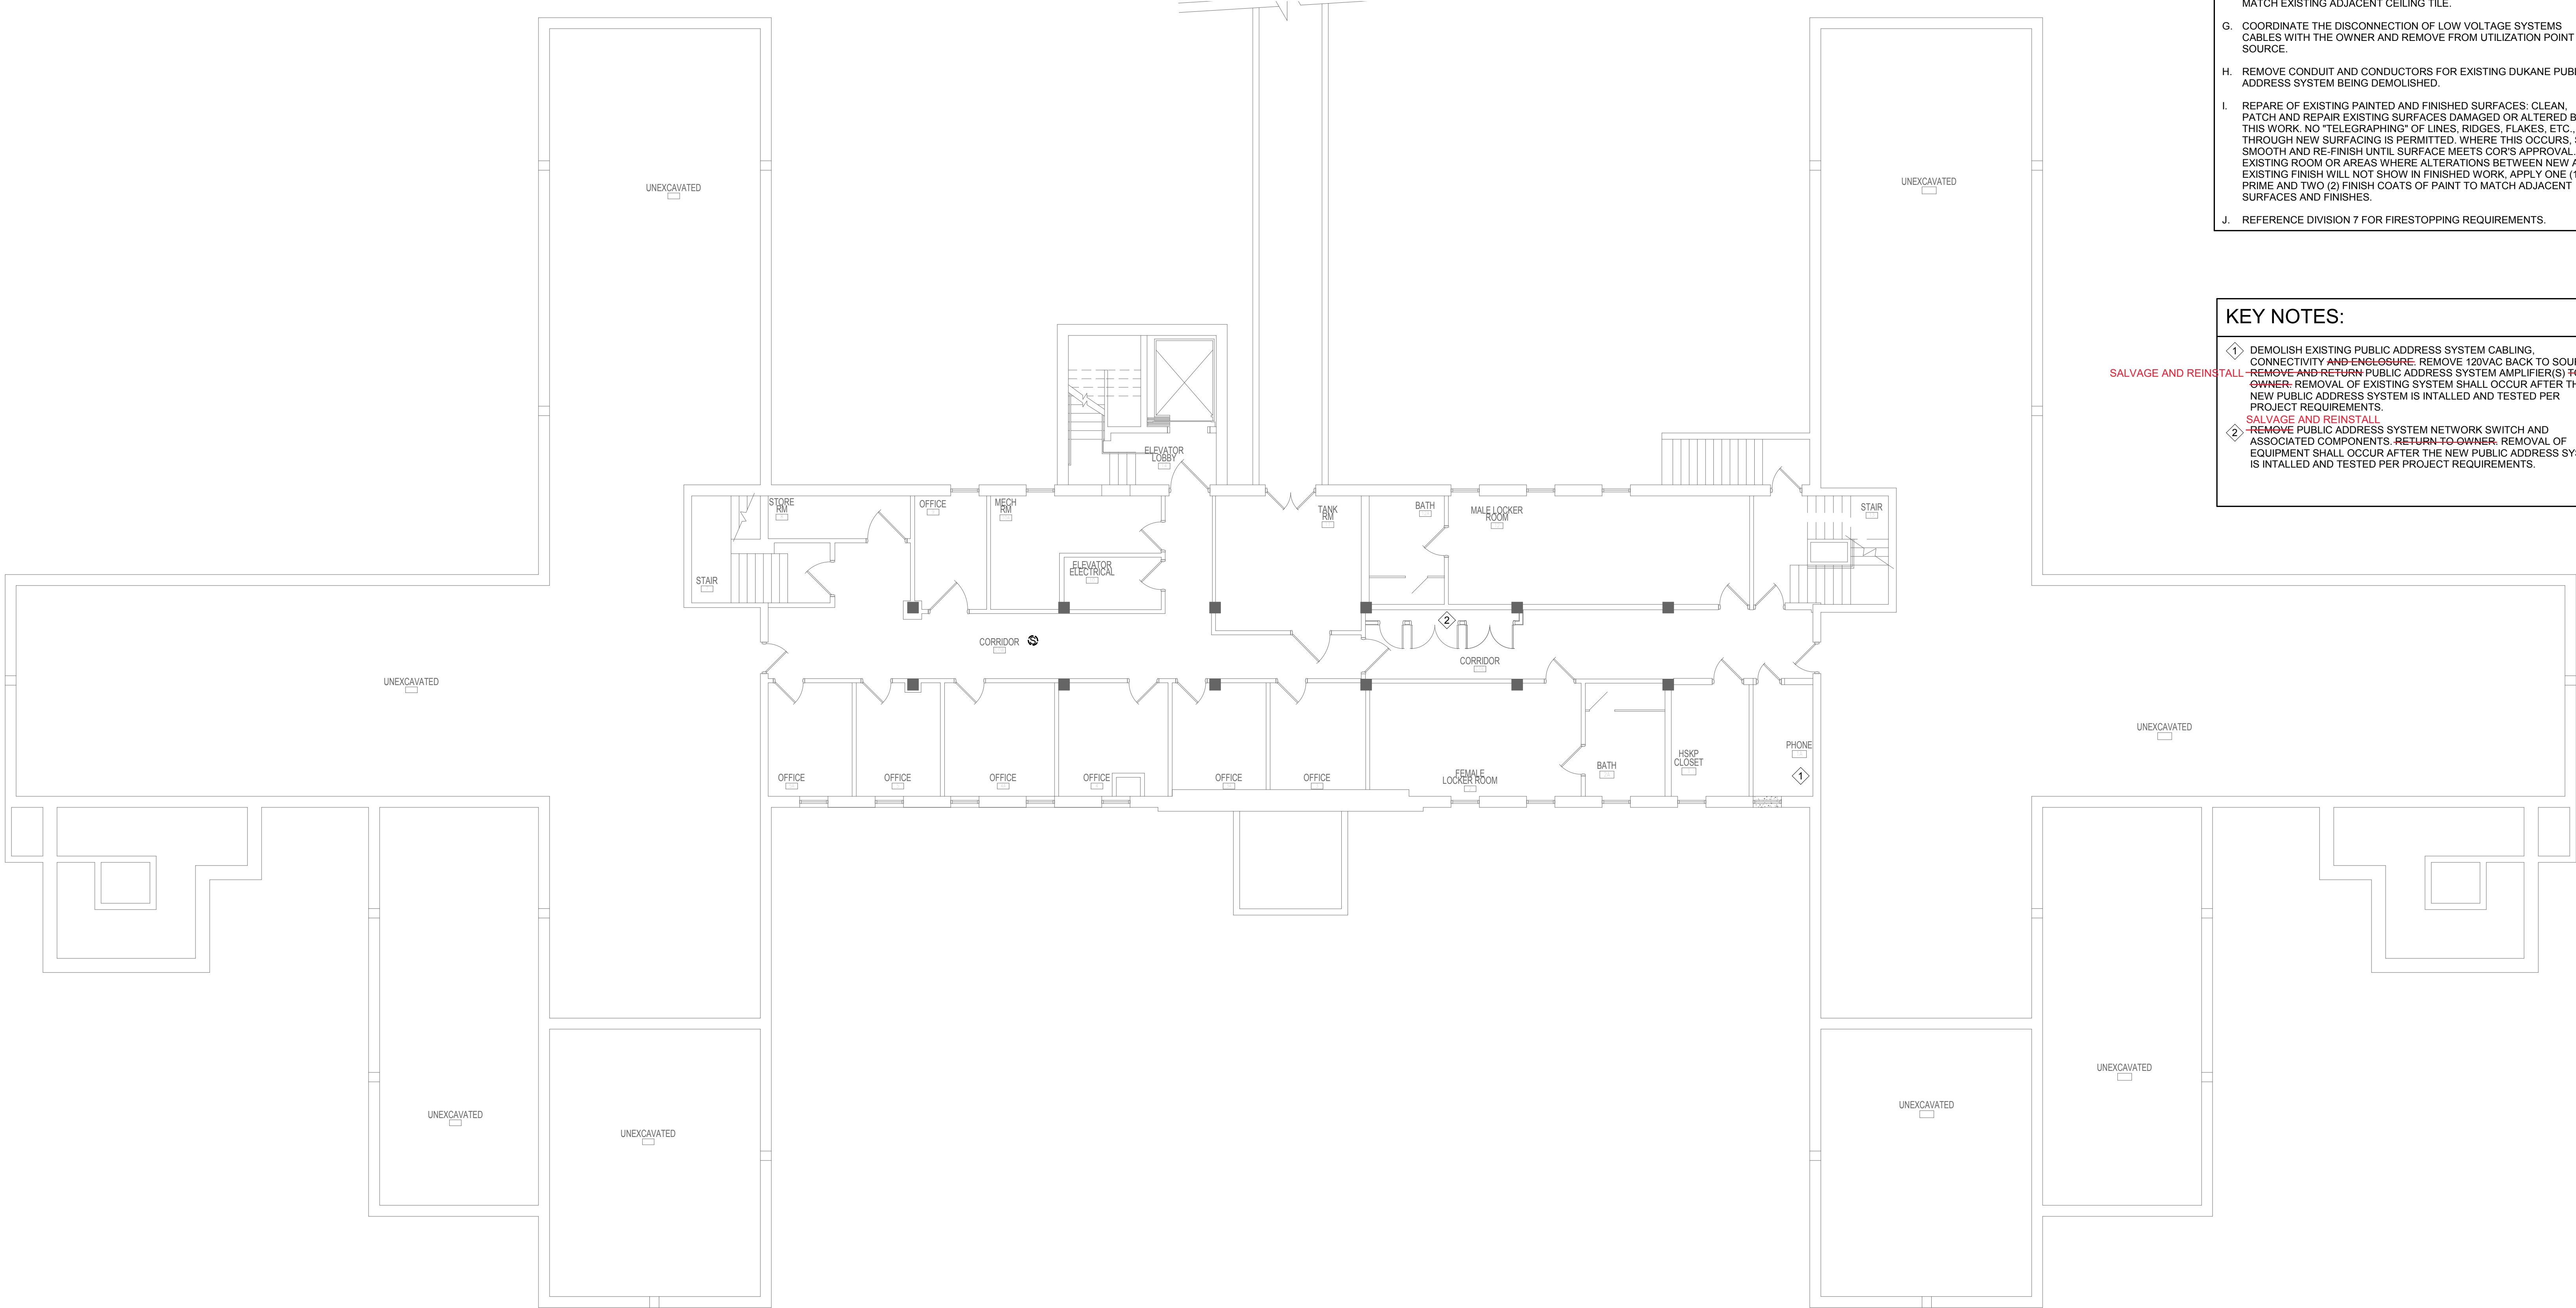

① BUILDING 08 - PAGING SPEAKER FLOOR PLAN - THIRD FLOOR
1/8" = 1'-0"

C:\Revit\Projects\VA ST CLOUD PAGING_Elec_R12.dwg

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826


APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE
BUILDING 02 - PAGING SPEAKER DEMOLITION FLOOR PLAN - BASEMENT
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:
 APPROVED: CHIEF OF STAFF
 DATE:
 APPROVED: HEALTH CARE SYSTEM DIRECTOR
 DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PLOT SCALE	
PROJECT NO.		DATE	
BUILDING No.	CHECKED BY	DRAWN	ISSUE DATE
	CP	CG	1/24/19
LOCATION	DATE	DRAWING NO.	
VA MEDICAL CENTER ST. CLOUD, MN 56303		ED02-00	

VA
U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

- GENERAL NOTES:**
- A. REFER TO SHEET ET.101 FOR LOCATION OF BUILDING ON CAMPUS.
 - B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE INACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
 - C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
 - D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
 - E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
 - F. CONTRACTOR RESPONSIBLE FOR PROVIDING REPLACEMENT CEILING TILES AFTER REMOVAL OF SPEAKERS. REPLACE CEILING TILE TO MATCH EXISTING ADJACENT CEILING TILE.
 - G. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
 - H. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
 - I. REPAIR OF EXISTING PAINTED AND FINISHED SURFACES: CLEAN, PATCH AND REPAIR EXISTING SURFACES DAMAGED OR ALTERED BY THIS WORK. NO "TELEGRAPHING" OF LINES, RIDGES, FLAKES, ETC. THROUGH NEW SURFACING IS PERMITTED. WHERE THIS OCCURS, SAND SMOOTH AND RE-FINISH UNTIL SURFACE MEETS COR'S APPROVAL. IN EXISTING ROOM OR AREAS WHERE ALTERATIONS BETWEEN NEW AND EXISTING FINISH WILL NOT SHOW IN FINISHED WORK, APPLY ONE (1) PRIME AND TWO (2) FINISH COATS OF PAINT TO MATCH ADJACENT SURFACES AND FINISHES.
 - J. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.

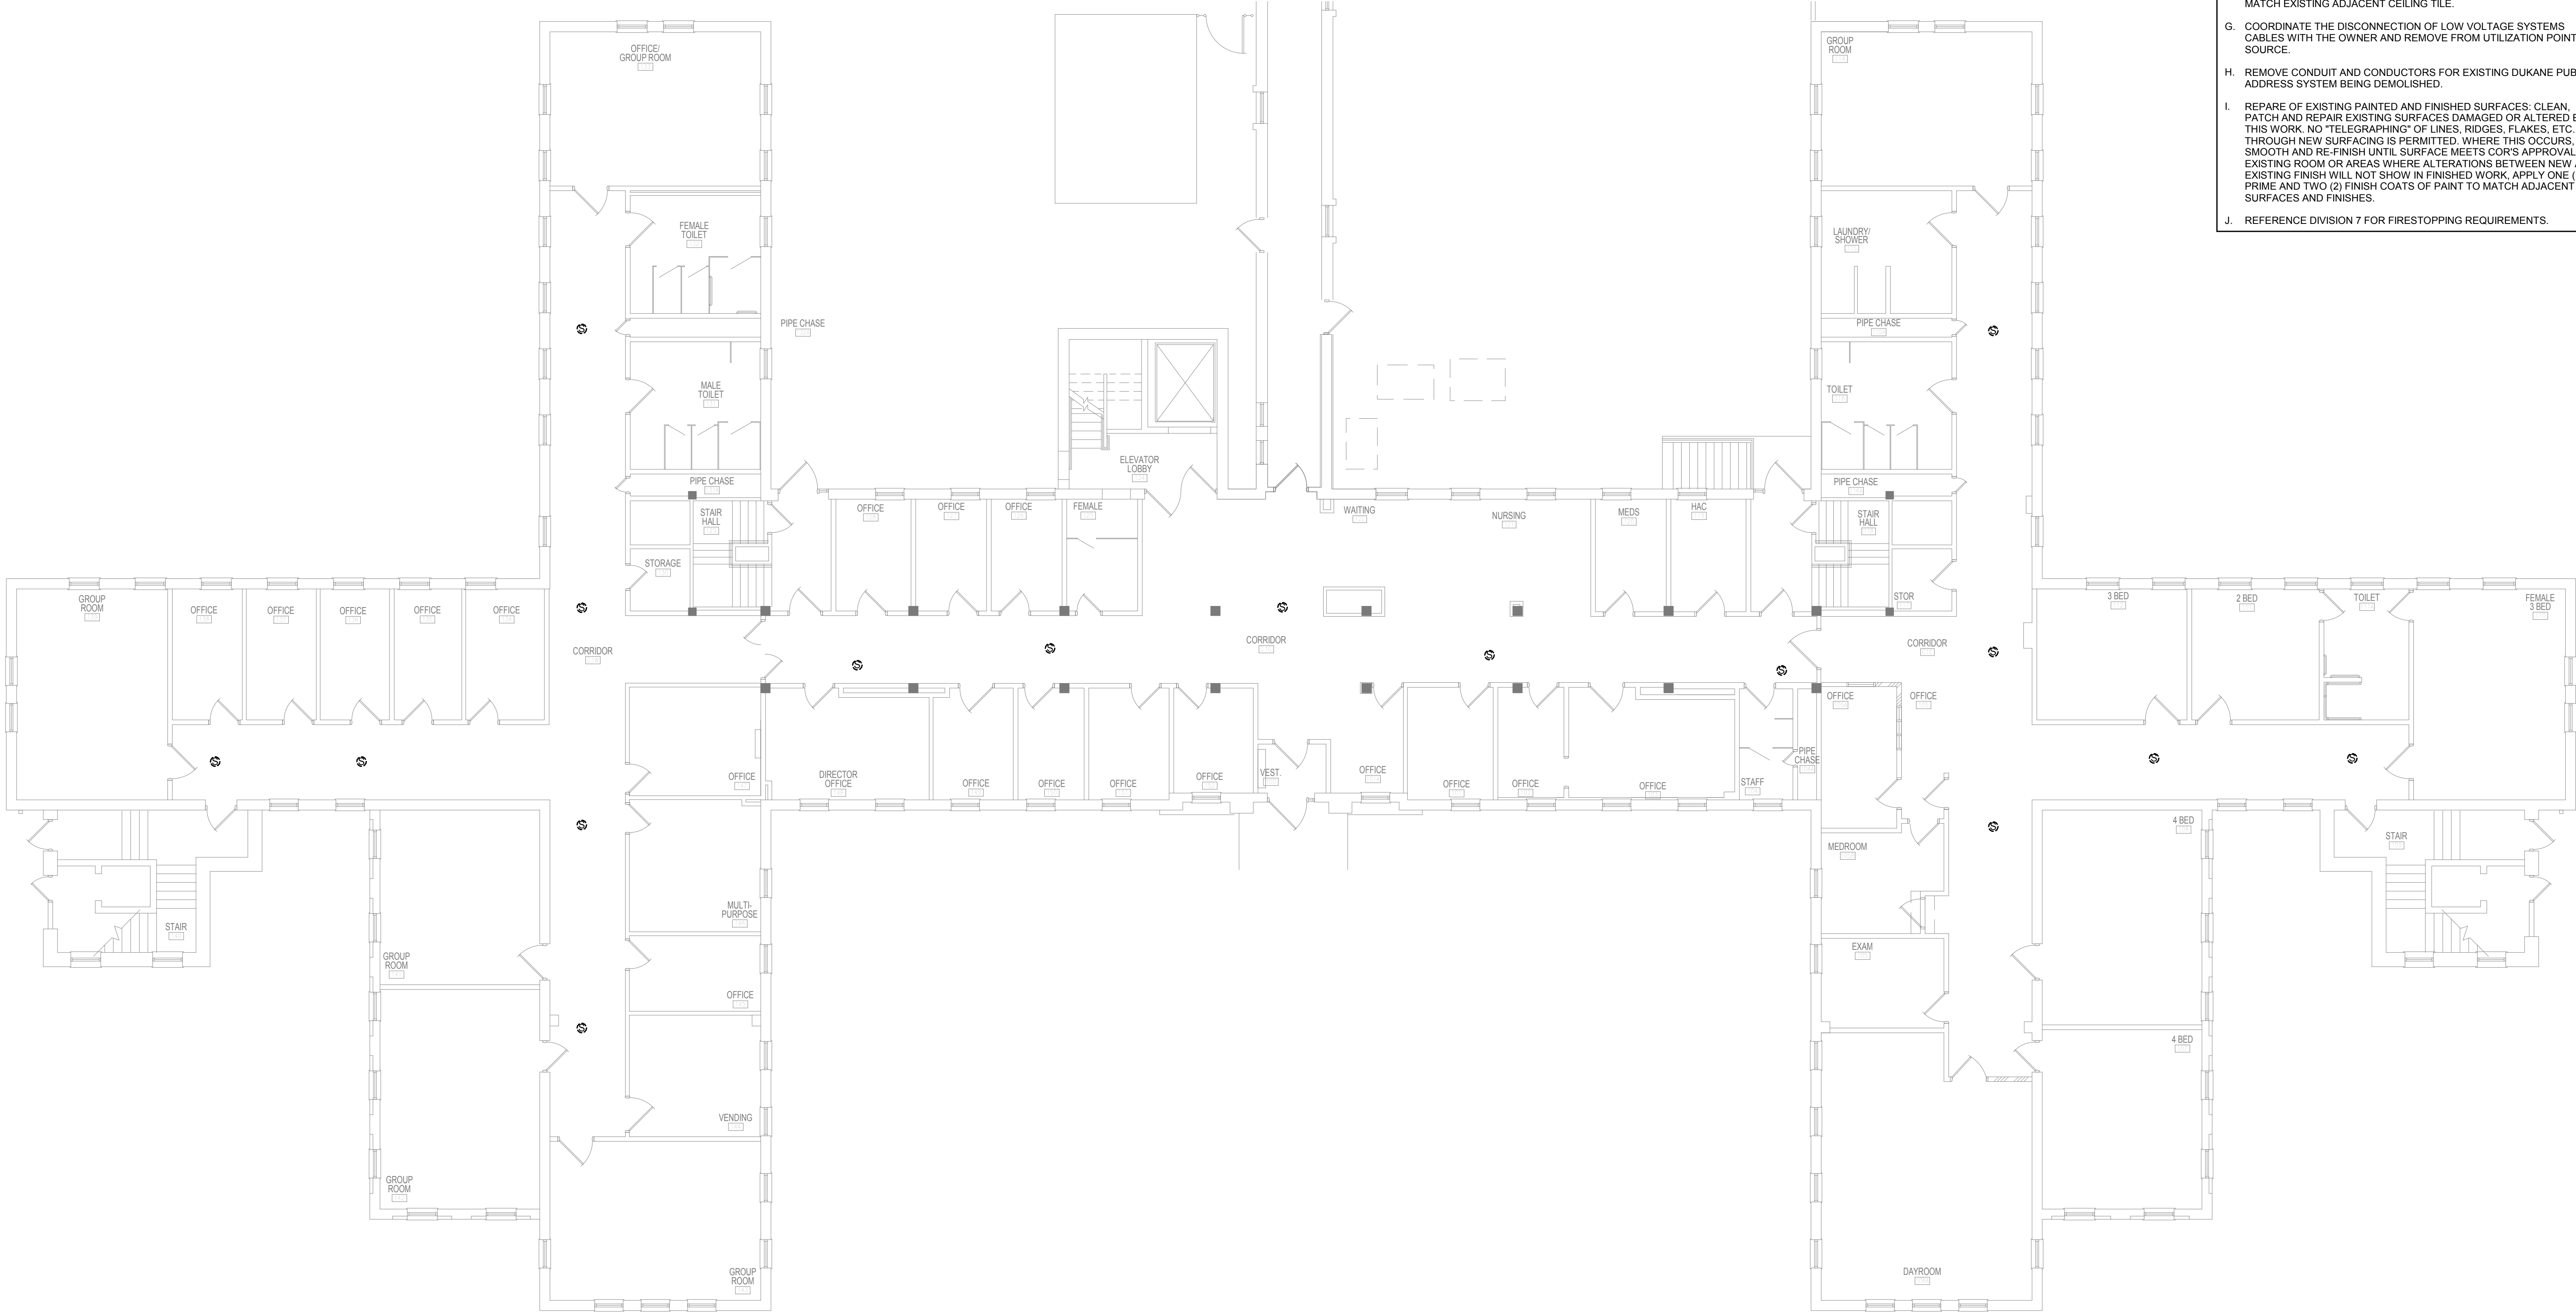

1 BUILDING 02 - PAGING SPEAKER DEMOLITION FLOOR PLAN - FIRST FLOOR
1/8" = 1'-0"

C:\Revit\Projects\VA ST CLOUD PAGING_Elec_R12.dwg

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com
AE PROJECT NUMBER: Project Number

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826


APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE
BUILDING 02 - PAGING SPEAKER DEMOLITION FLOOR PLAN - FIRST FLOOR
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:
 APPROVED: CHIEF OF STAFF
 DATE:
 APPROVED: HEALTH CARE SYSTEM DIRECTOR
 DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PLOT SCALE	
PROJECT NO.		PROJECT NO.	
BUILDING No.	CHECKED BY	DRAWN	ISSUE DATE
	CP	CG	1/24/19
LOCATION	DATE	DRAWING NO.	
VA MEDICAL CENTER ST. CLOUD, MN 56303		ED02-01	

VA
U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

- GENERAL NOTES:**
- A. REFER TO SHEET ET.101 FOR LOCATION OF BUILDING ON CAMPUS.
 - B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE INACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
 - C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
 - D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
 - E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
 - F. CONTRACTOR RESPONSIBLE FOR PROVIDING REPLACEMENT CEILING TILES AFTER REMOVAL OF SPEAKERS. REPLACE CEILING TILE TO MATCH EXISTING ADJACENT CEILING TILE.
 - G. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
 - H. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
 - I. REPAIR OF EXISTING PAINTED AND FINISHED SURFACES: CLEAN, PATCH AND REPAIR EXISTING SURFACES DAMAGED OR ALTERED BY THIS WORK. NO "TELEGRAPHING" OF LINES, RIDGES, FLAKES, ETC. THROUGH NEW SURFACING IS PERMITTED. WHERE THIS OCCURS, SAND SMOOTH AND RE-FINISH UNTIL SURFACE MEETS COR'S APPROVAL. IN EXISTING ROOM OR AREAS WHERE ALTERATIONS BETWEEN NEW AND EXISTING FINISH WILL NOT SHOW IN FINISHED WORK, APPLY ONE (1) PRIME AND TWO (2) FINISH COATS OF PAINT TO MATCH ADJACENT SURFACES AND FINISHES.
 - J. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.

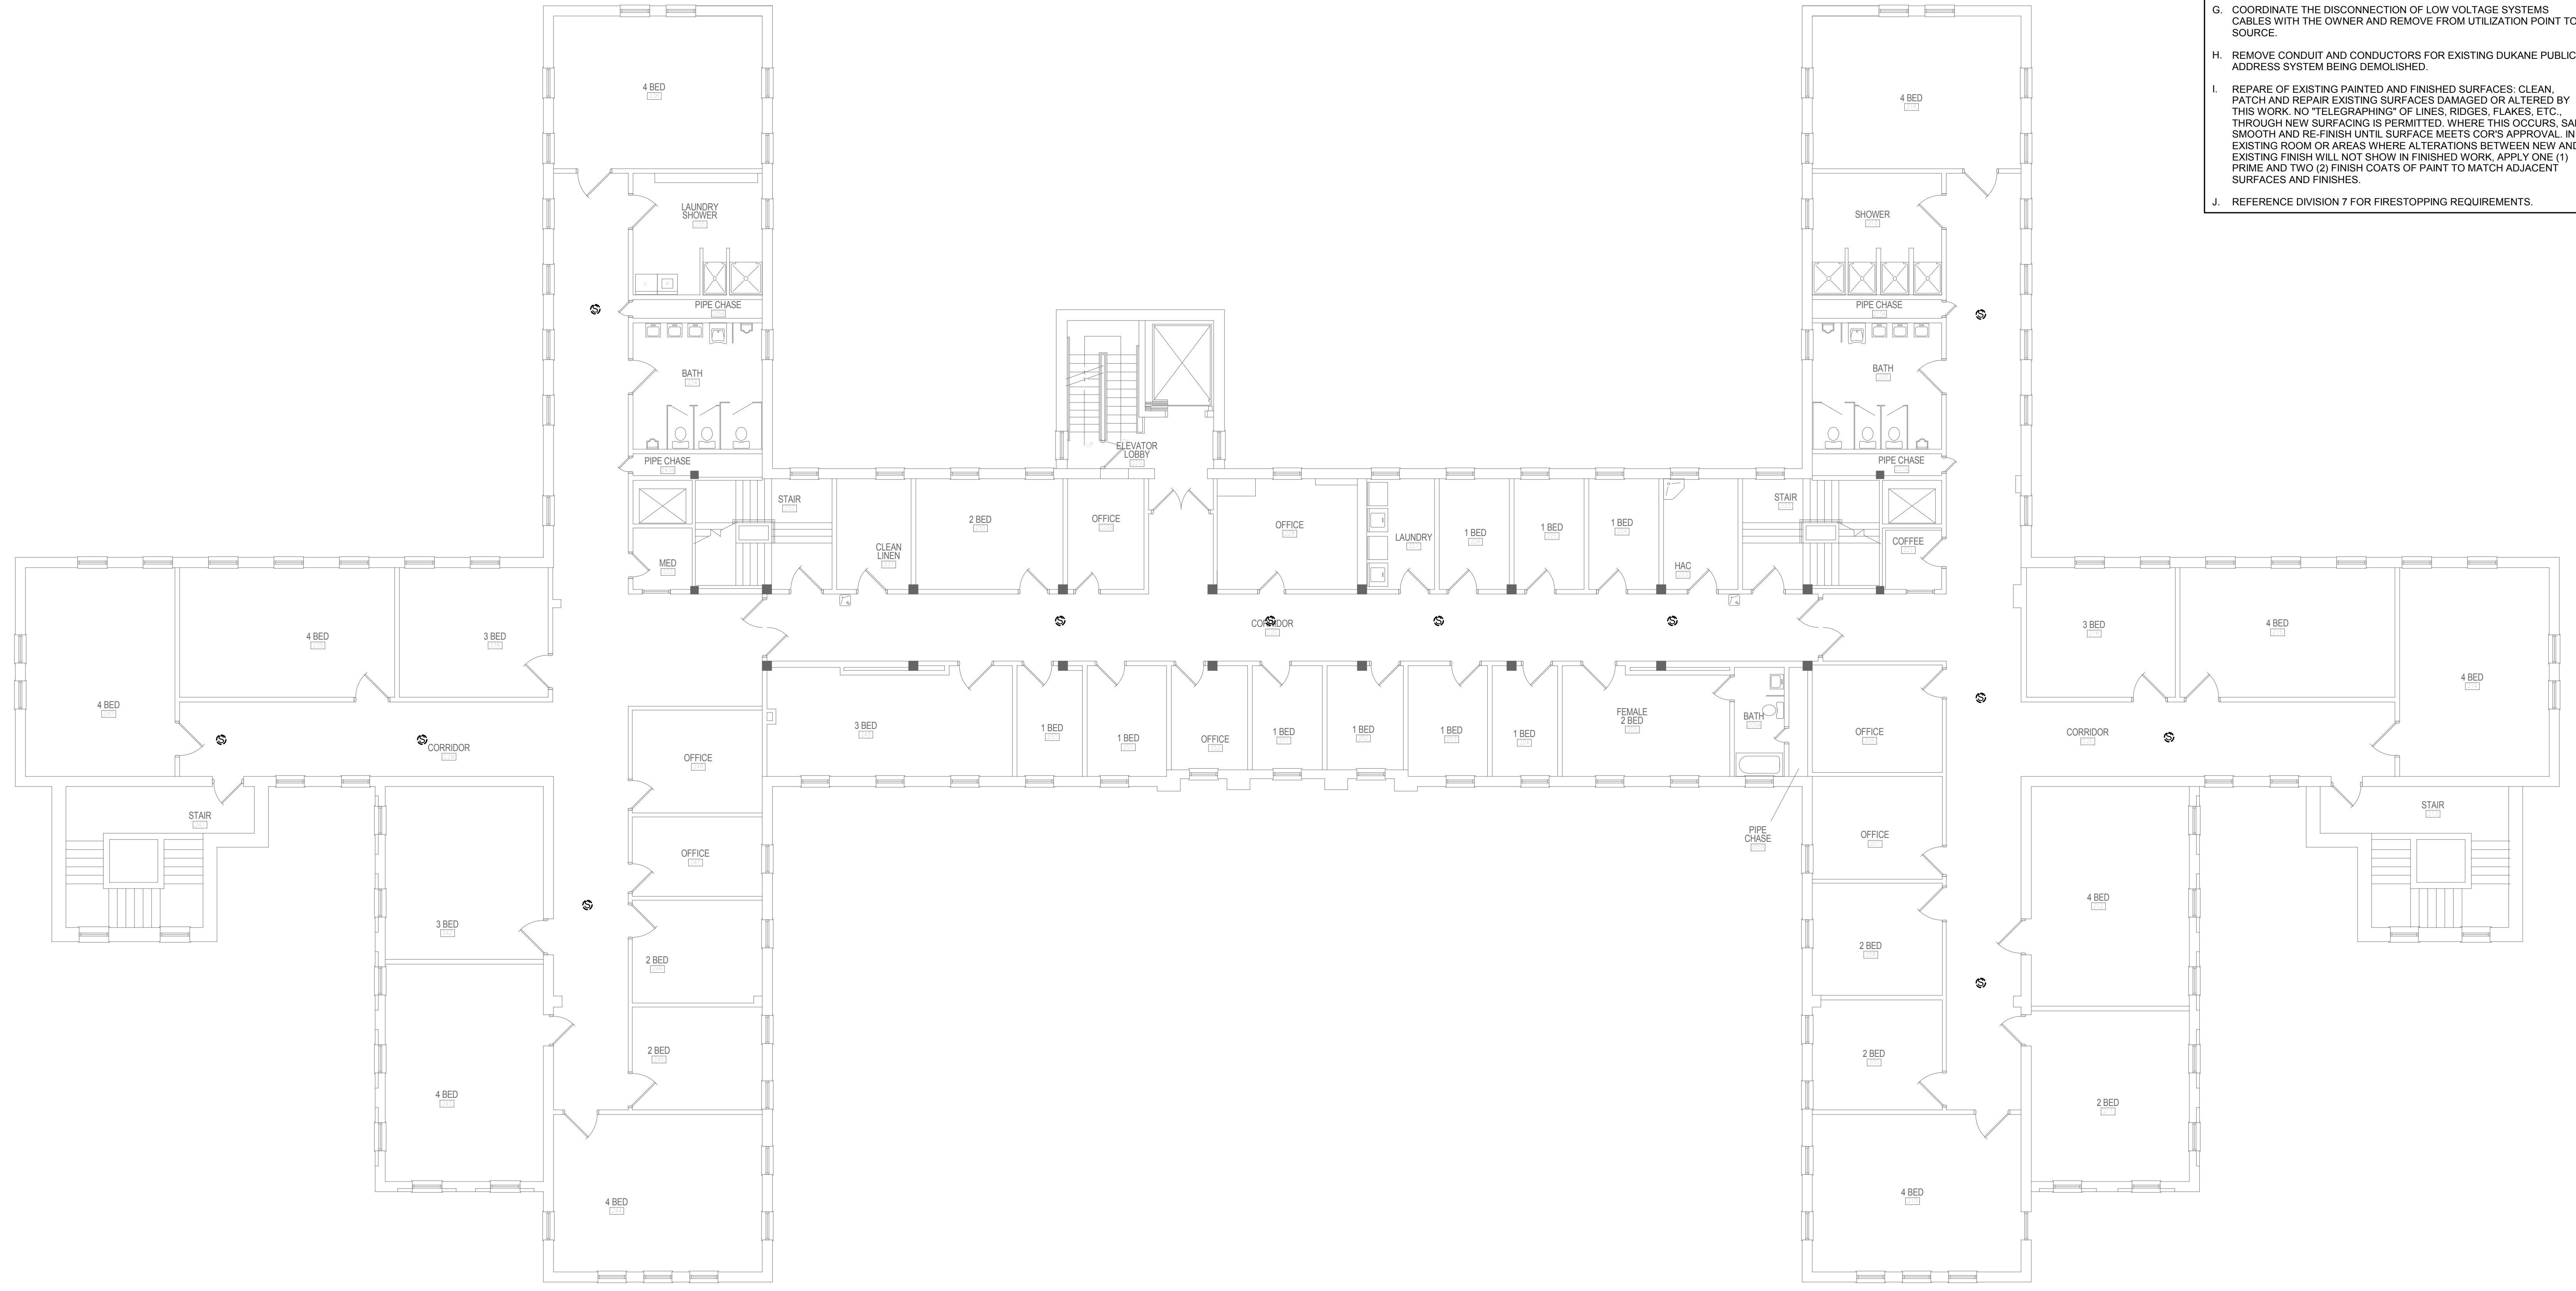

1 BUILDING 02 - PAGING SPEAKER DEMOLITION FLOOR PLAN - SECOND FLOOR
1/8" = 1'-0"

C:\Revit\Projects\VA ST CLOUD\PAGING\Bldg_ET12.dwg

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com
AE PROJECT NUMBER: Project Number

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Piliod*
 Name: Chris M. Piliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:


DRAWING TITLE
BUILDING 02 - PAGING SPEAKER DEMOLITION FLOOR PLAN - SECOND FLOOR
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:
 APPROVED: CHIEF OF STAFF
 DATE:
 APPROVED: HEALTH CARE SYSTEM DIRECTOR
 DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PLOT SCALE	
PROJECT NO.		ISSUE DATE	
BUILDING No.	CHECKED BY	DRAWN	DATE
	CP	CG	1/24/19
LOCATION	VA MEDICAL CENTER ST. CLOUD, MN 56303	DRAWING NO.	ED02-02


VA
U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

GENERAL NOTES:


- A. REFER TO SHEET ET.101 FOR LOCATION OF BUILDING ON CAMPUS.
- B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE INACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
- C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
- D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
- E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
- F. CONTRACTOR RESPONSIBLE FOR PROVIDING REPLACEMENT CEILING TILES AFTER REMOVAL OF SPEAKERS. REPLACE CEILING TILE TO MATCH EXISTING ADJACENT CEILING TILE.
- G. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
- H. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
- I. REPAIR OF EXISTING PAINTED AND FINISHED SURFACES: CLEAN, PATCH AND REPAIR EXISTING SURFACES DAMAGED OR ALTERED BY THIS WORK. NO "TELEGRAPHING" OF LINES, RIDGES, FLAKES, ETC. THROUGH NEW SURFACING IS PERMITTED. WHERE THIS OCCURS, SAND SMOOTH AND RE-FINISH UNTIL SURFACE MEETS COR'S APPROVAL. IN EXISTING ROOM OR AREAS WHERE ALTERATIONS BETWEEN NEW AND EXISTING FINISH WILL NOT SHOW IN FINISHED WORK, APPLY ONE (1) PRIME AND TWO (2) FINISH COATS OF PAINT TO MATCH ADJACENT SURFACES AND FINISHES.
- J. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.

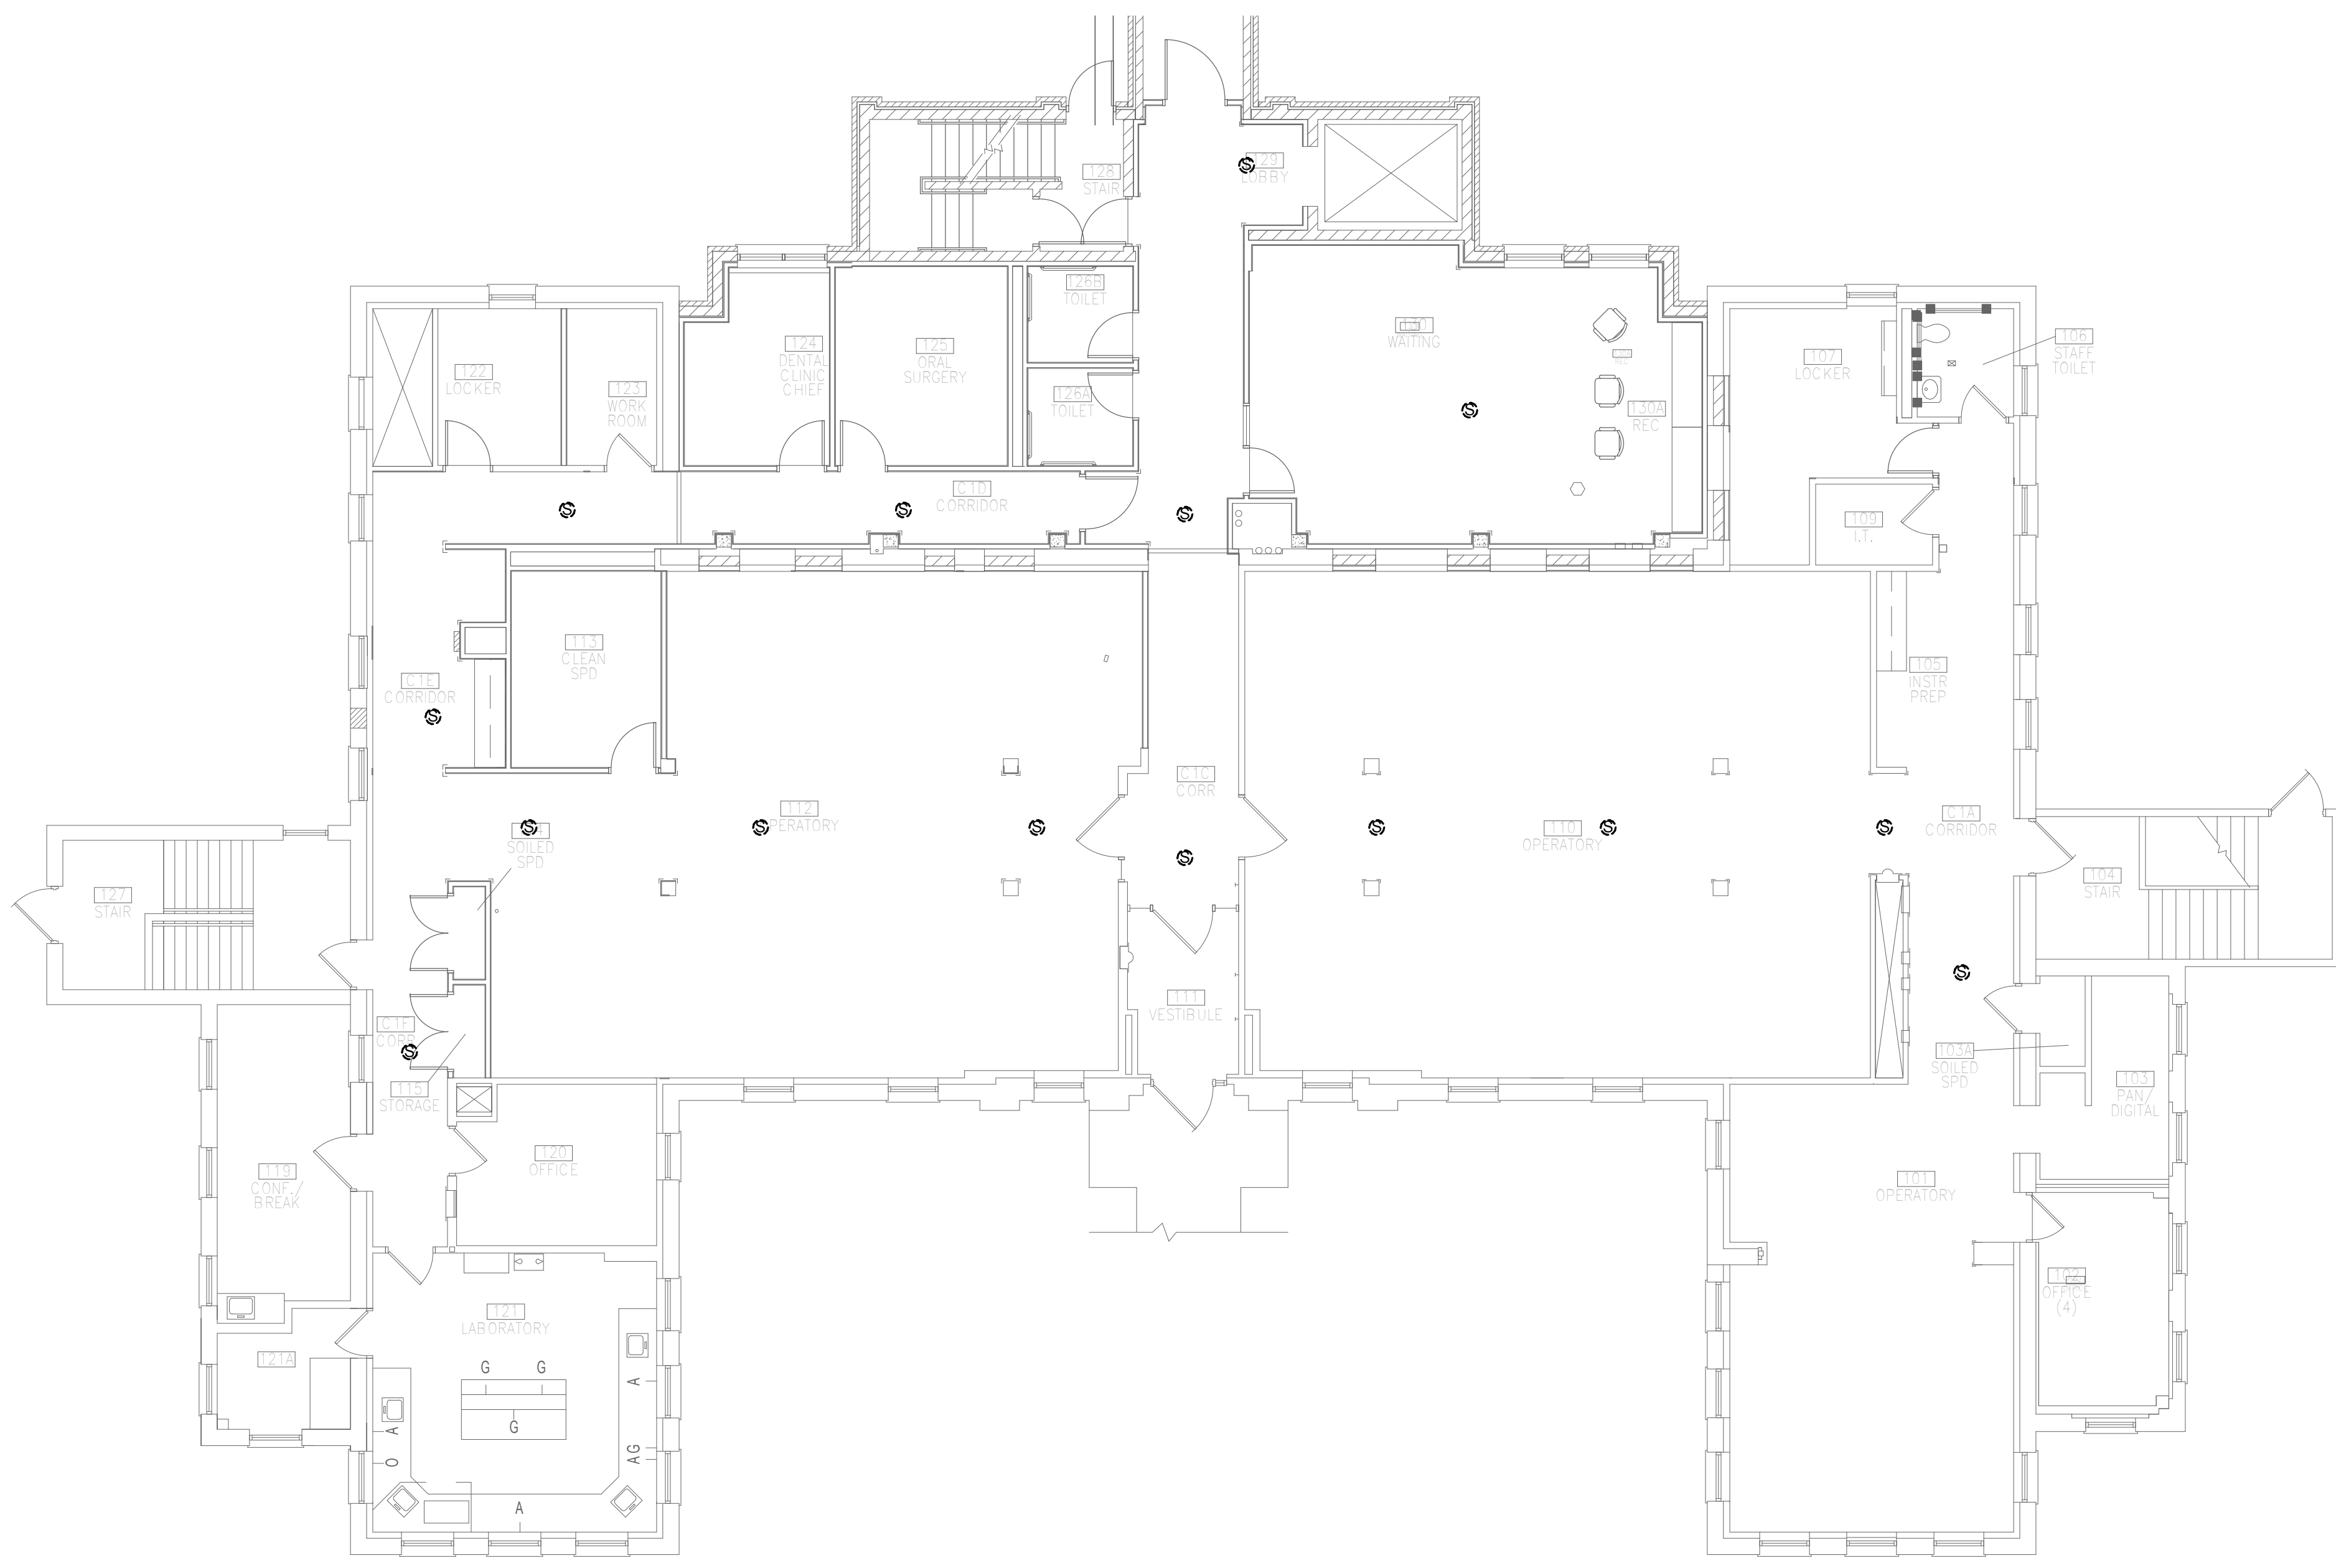

1 BUILDING 03 - PAGING SPEAKER DEMOLITION FLOOR PLAN - FIRST FLOOR
1/8" = 1'-0"

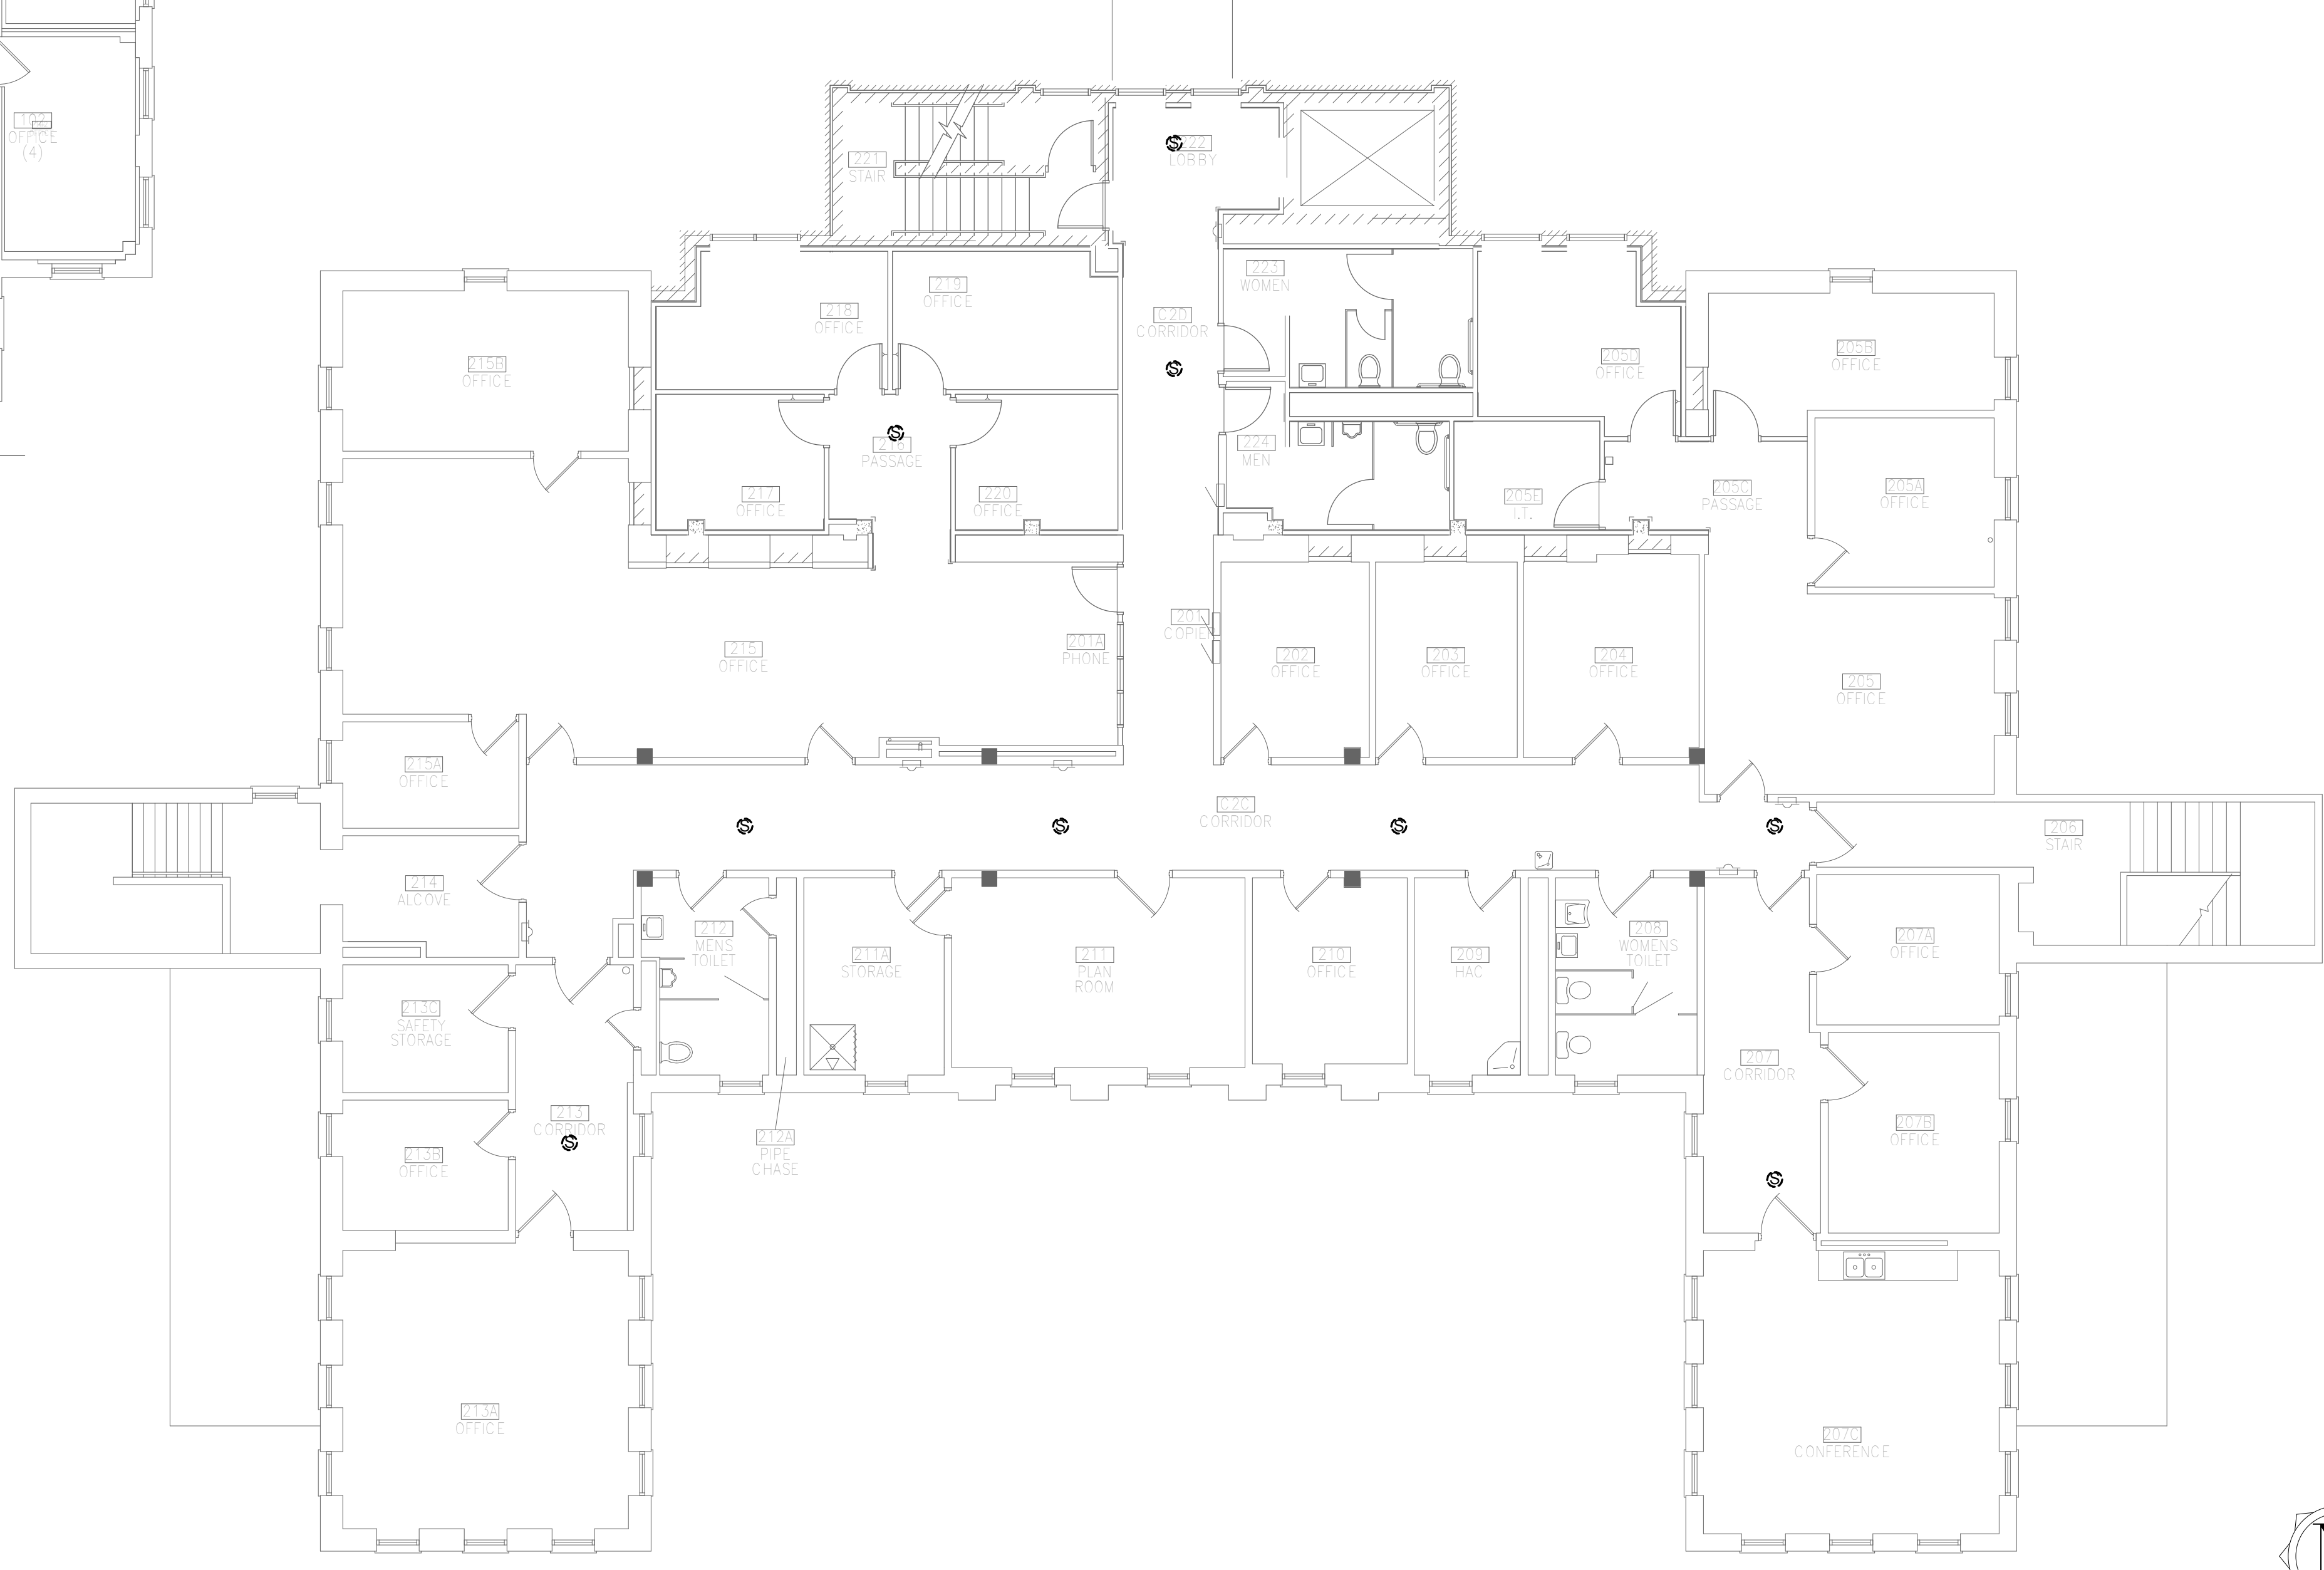

2 BUILDING 03 - PAGING SPEAKER DEMOLITION FLOOR PLAN - SECOND FLOOR
1/8" = 1'-0"

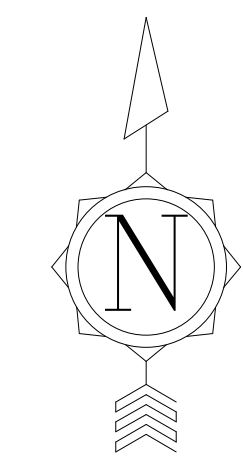

C:\Revit\Projects\VA ST CLOUD PAGING_Bldg_R12.dwg 1/24/2019 1:26:25 PM

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

 DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE
BUILDING 03 - PAGING SPEAKER DEMOLITION FLOOR PLAN - FIRST AND SECOND FLOOR
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:
 APPROVED: CHIEF OF STAFF
 DATE:
 APPROVED: HEALTH CARE SYSTEM DIRECTOR
 DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		FLIGHT SCALE
PROJECT NO.		PROJECT NO.
BUILDING No.	CHECKED BY	DRAWN
	CP	CG
ISSUE DATE	1/24/19	
LOCATION	DATE	DRAWING NO.
VA MEDICAL CENTER ST. CLOUD, MN 56303		ED03-01

VA
U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

A

B

C

D

E


F

GENERAL NOTES:

- A. REFER TO SHEET ET.101 FOR LOCATION OF BUILDING ON CAMPUS.
- B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE INACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
- C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
- D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
- E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
- F. CONTRACTOR RESPONSIBLE FOR PROVIDING REPLACEMENT CEILING TILES AFTER REMOVAL OF SPEAKERS. REPLACE CEILING TILE TO MATCH EXISTING ADJACENT CEILING TILE.
- G. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
- H. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
- I. REPAIR OF EXISTING PAINTED AND FINISHED SURFACES. CLEAN, PATCH AND REPAIR EXISTING SURFACES DAMAGED OR ALTERED BY THIS WORK. NO "TELEGRAPHING" OF LINES, RIDGES, FLAKES, ETC. THROUGH NEW SURFACING IS PERMITTED. WHERE THIS OCCURS, SAND SMOOTH AND RE-FINISH UNTIL SURFACE MEETS COR'S APPROVAL. IN EXISTING ROOM OR AREAS WHERE ALTERATIONS BETWEEN NEW AND EXISTING FINISH WILL NOT SHOW IN FINISHED WORK, APPLY ONE (1) PRIME AND TWO (2) FINISH COATS OF PAINT TO MATCH ADJACENT SURFACES AND FINISHES.
- J. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.

KEY NOTES:

- ① ~~REMOVE AND REINSTALL~~
REMOVE PUBLIC ADDRESS SYSTEM NETWORK SWITCH AND ASSOCIATED COMPONENTS. RETURN-TO-OWNER. REMOVAL OF EQUIPMENT SHALL OCCUR AFTER THE NEW PUBLIC ADDRESS SYSTEM IS INSTALLED AND TESTED PER PROJECT REQUIREMENTS.

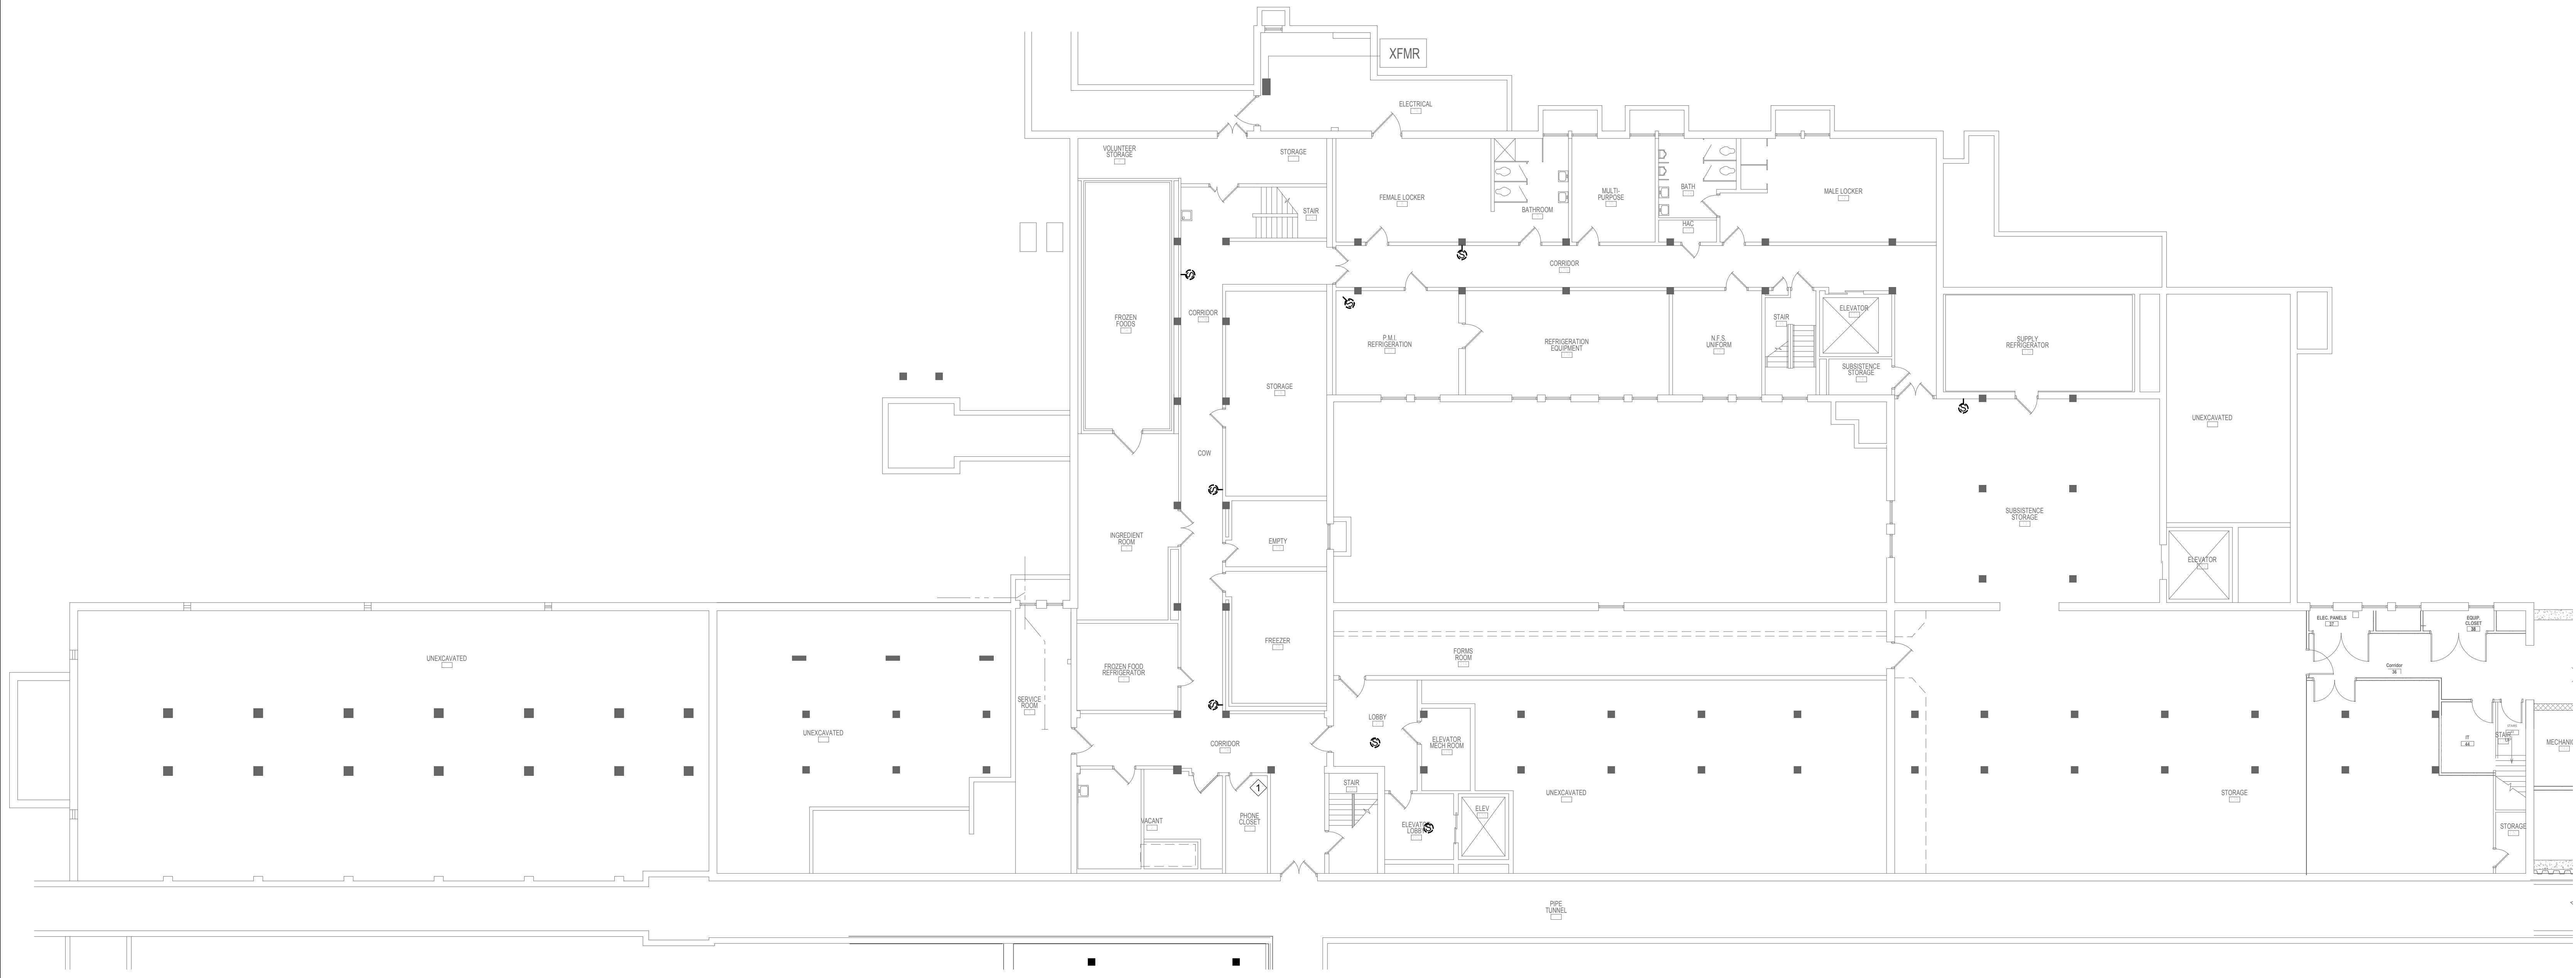

1 BUILDING 04 - PAGING SPEAKER FLOOR PLAN - BASEMENT
3/32" = 1'-0"

1/24/2019 11:26:28 PM
C:\Revit\Projects\VA ST CLOUD PAGING_Elec_R12.dwg.rvt

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826


APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE
BUILDING 04 - PAGING SPEAKER DEMOLITION FLOOR PLAN - BASEMENT
 DATE:
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:
 APPROVED: CHIEF OF STAFF
 DATE:
 APPROVED: HEALTH CARE SYSTEM DIRECTOR
 DATE:

PROJECT TITLE
UPGRADE PUBLIC ADDRESS SYSTEM
 FLIGHT SCALE:
 PROJECT NO.:
 BUILDING No.:
 CHECKED BY: CP
 DRAWN BY: CG
 ISSUE DATE: 1/24/19
 LOCATION: VA MEDICAL CENTER ST. CLOUD, MN 56303
 DRAWING NO.: ED04-00

U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

- GENERAL NOTES:**
- A. REFER TO SHEET ET.101 FOR LOCATION OF BUILDING ON CAMPUS.
 - B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE INACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
 - C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
 - D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
 - E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
 - F. CONTRACTOR RESPONSIBLE FOR PROVIDING REPLACEMENT CEILING TILES AFTER REMOVAL OF SPEAKERS. REPLACE CEILING TILE TO MATCH EXISTING ADJACENT CEILING TILE.
 - G. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
 - H. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
 - I. REPAIR OF EXISTING PAINTED AND FINISHED SURFACES: CLEAN, PATCH AND REPAIR EXISTING SURFACES DAMAGED OR ALTERED BY THIS WORK. NO "TELEGRAPHING" OF LINES, RIDGES, FLAKES, ETC. THROUGH NEW SURFACING IS PERMITTED. WHERE THIS OCCURS, SAND SMOOTH AND RE-FINISH UNTIL SURFACE MEETS COR'S APPROVAL. IN EXISTING ROOM OR AREAS WHERE ALTERATIONS BETWEEN NEW AND EXISTING FINISH WILL NOT SHOW IN FINISHED WORK, APPLY ONE (1) PRIME AND TWO (2) FINISH COATS OF PAINT TO MATCH ADJACENT SURFACES AND FINISHES.
 - J. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.

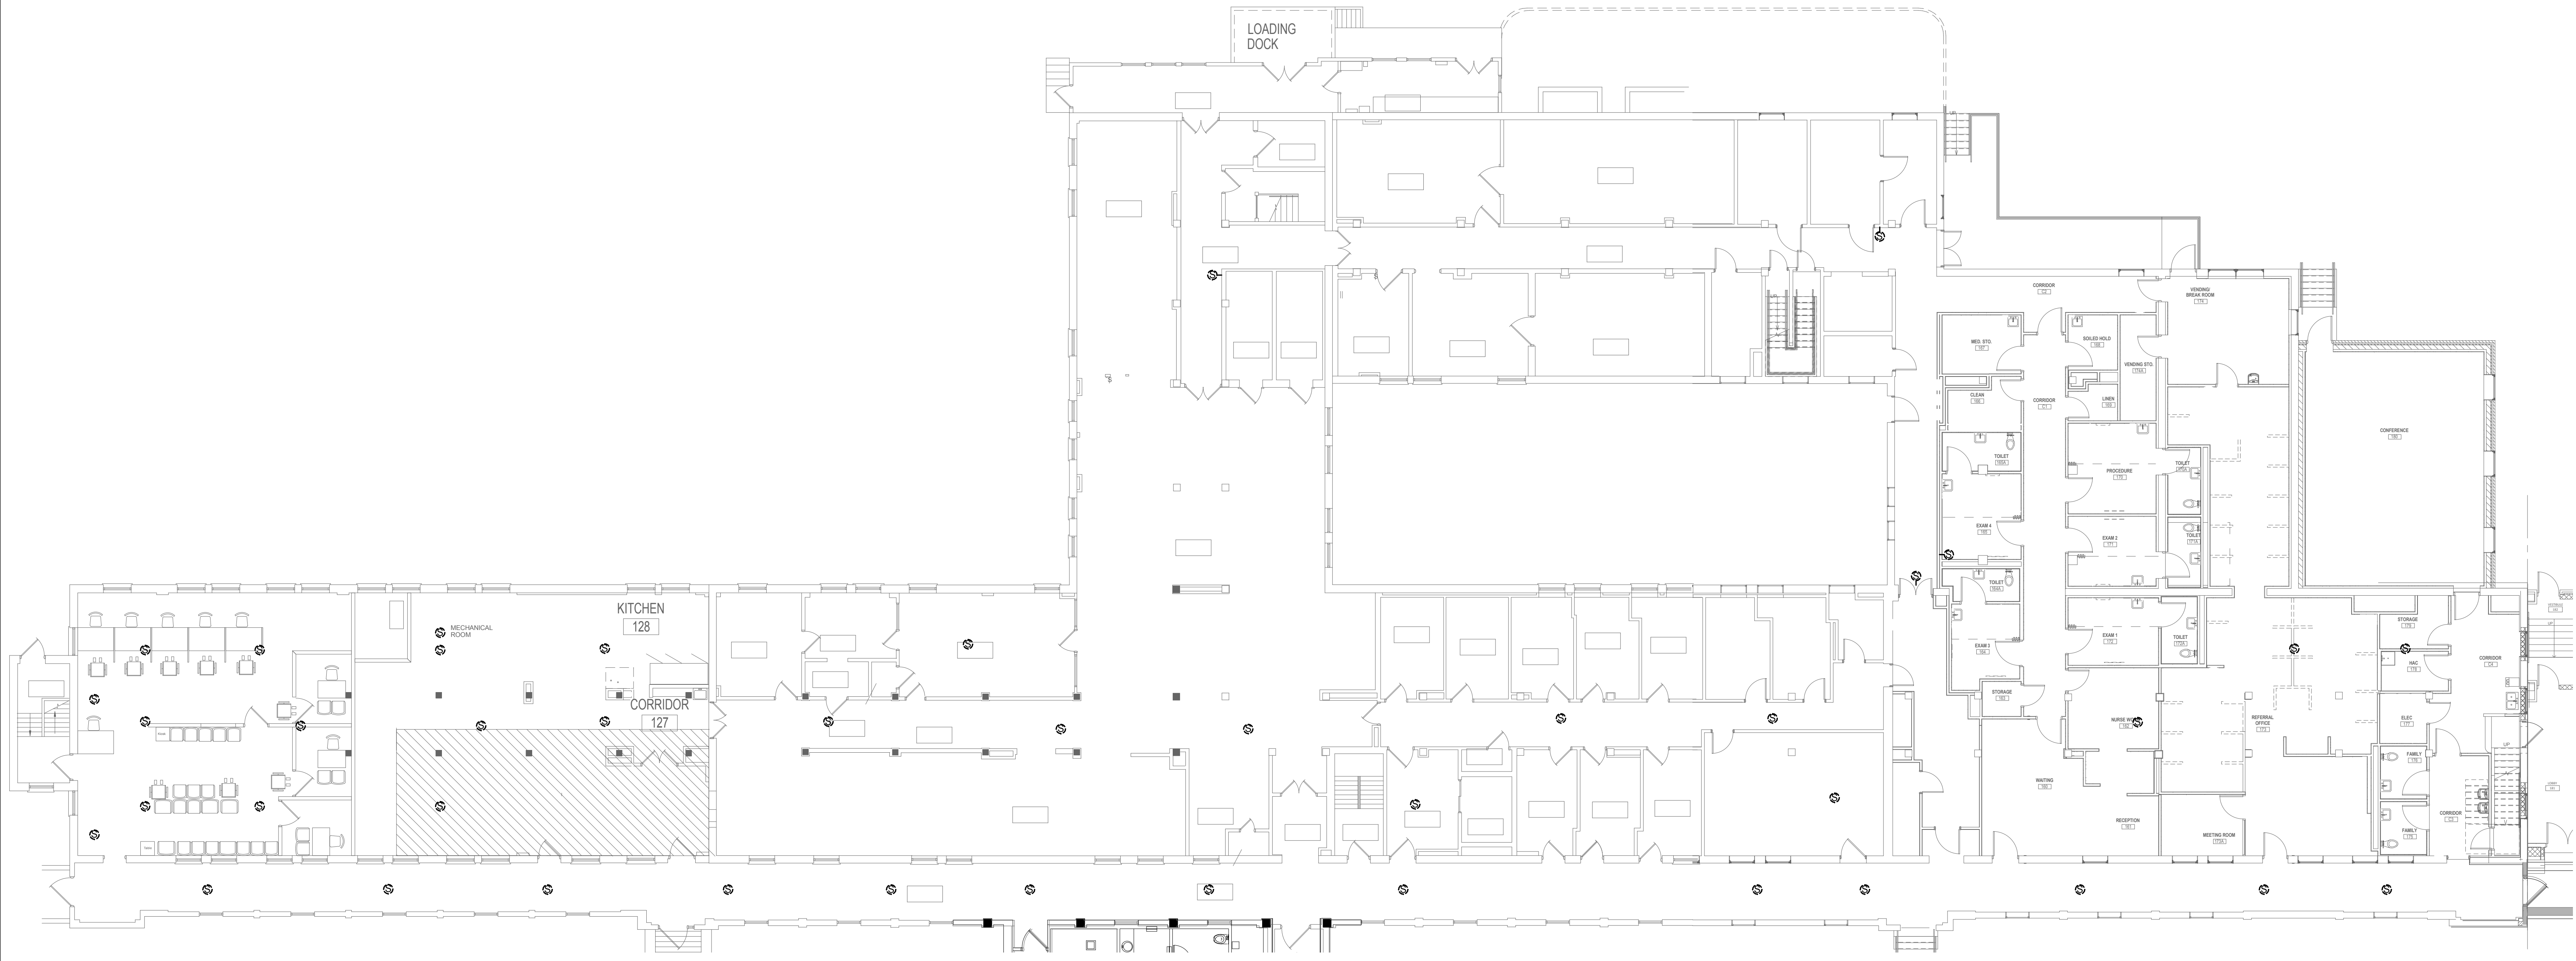

1 BUILDING 04 - PAGING SPEAKER DEMOLITION FLOOR PLAN - FIRST FLOOR
3/32" = 1'-0"

1/24/2019 11:26:27 PM
C:\Revit\Projects\VA ST CLOUD PAGING_Elec_R12.dwg.rvt

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)
DUNHAM
50 South Sixth Street / Suite 1100
Minneapolis, Minnesota 55402-1540
Phone: 612-465-7550 Fax: 612-465-7551
Web: dunhaminc.com
mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD
ANDERSON ENGINEERING
ENGINEERING • ARCHITECTURE • LAND SURVEYING
ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
Anderson Engineering of Minnesota, LLC
13605 1st Avenue North
Suite 100
Plymouth, MN 55441
763-412-4000 (o) 763-412-4090 (f)
www.ae-mn.com
AE PROJECT NUMBER: Project Number

STAMP
I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
Signature: *Chris M. Pilioud*
Name: Chris M. Pilioud, P.E.
Date: 1/24/19
Registration Number: 50826


APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE
BUILDING 04 - PAGING SPEAKER DEMOLITION FLOOR PLAN - FIRST FLOOR
APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
DATE:
APPROVED: CHIEF OF STAFF
DATE:
APPROVED: HEALTH CARE SYSTEM DIRECTOR
DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PROJECT NO.:	
BUILDING NO.:	CHECKED BY CP	DRAWN CG	ISSUE DATE 1/24/19
LOCATION VA MEDICAL CENTER ST. CLOUD, MN 56303		DRAWING NO. ED04-01	

VA
U.S. Department of Veterans Affairs
Veterans Health Administration
St. Cloud VA Health Care System

- GENERAL NOTES:**
- A. REFER TO SHEET ET.101 FOR LOCATION OF BUILDING ON CAMPUS.
 - B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE INACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
 - C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
 - D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
 - E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
 - F. CONTRACTOR RESPONSIBLE FOR PROVIDING REPLACEMENT CEILING TILES AFTER REMOVAL OF SPEAKERS. REPLACE CEILING TILE TO MATCH EXISTING ADJACENT CEILING TILE.
 - G. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
 - H. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
 - I. REPAIR OF EXISTING PAINTED AND FINISHED SURFACES: CLEAN, PATCH AND REPAIR EXISTING SURFACES DAMAGED OR ALTERED BY THIS WORK. NO "TELEGRAPHING" OF LINES, RIDGES, FLAKES, ETC. THROUGH NEW SURFACING IS PERMITTED. WHERE THIS OCCURS, SAND SMOOTH AND RE-FINISH UNTIL SURFACE MEETS COR'S APPROVAL. IN EXISTING ROOM OR AREAS WHERE ALTERATIONS BETWEEN NEW AND EXISTING FINISH WILL NOT SHOW IN FINISHED WORK, APPLY ONE (1) PRIME AND TWO (2) FINISH COATS OF PAINT TO MATCH ADJACENT SURFACES AND FINISHES.
 - J. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.

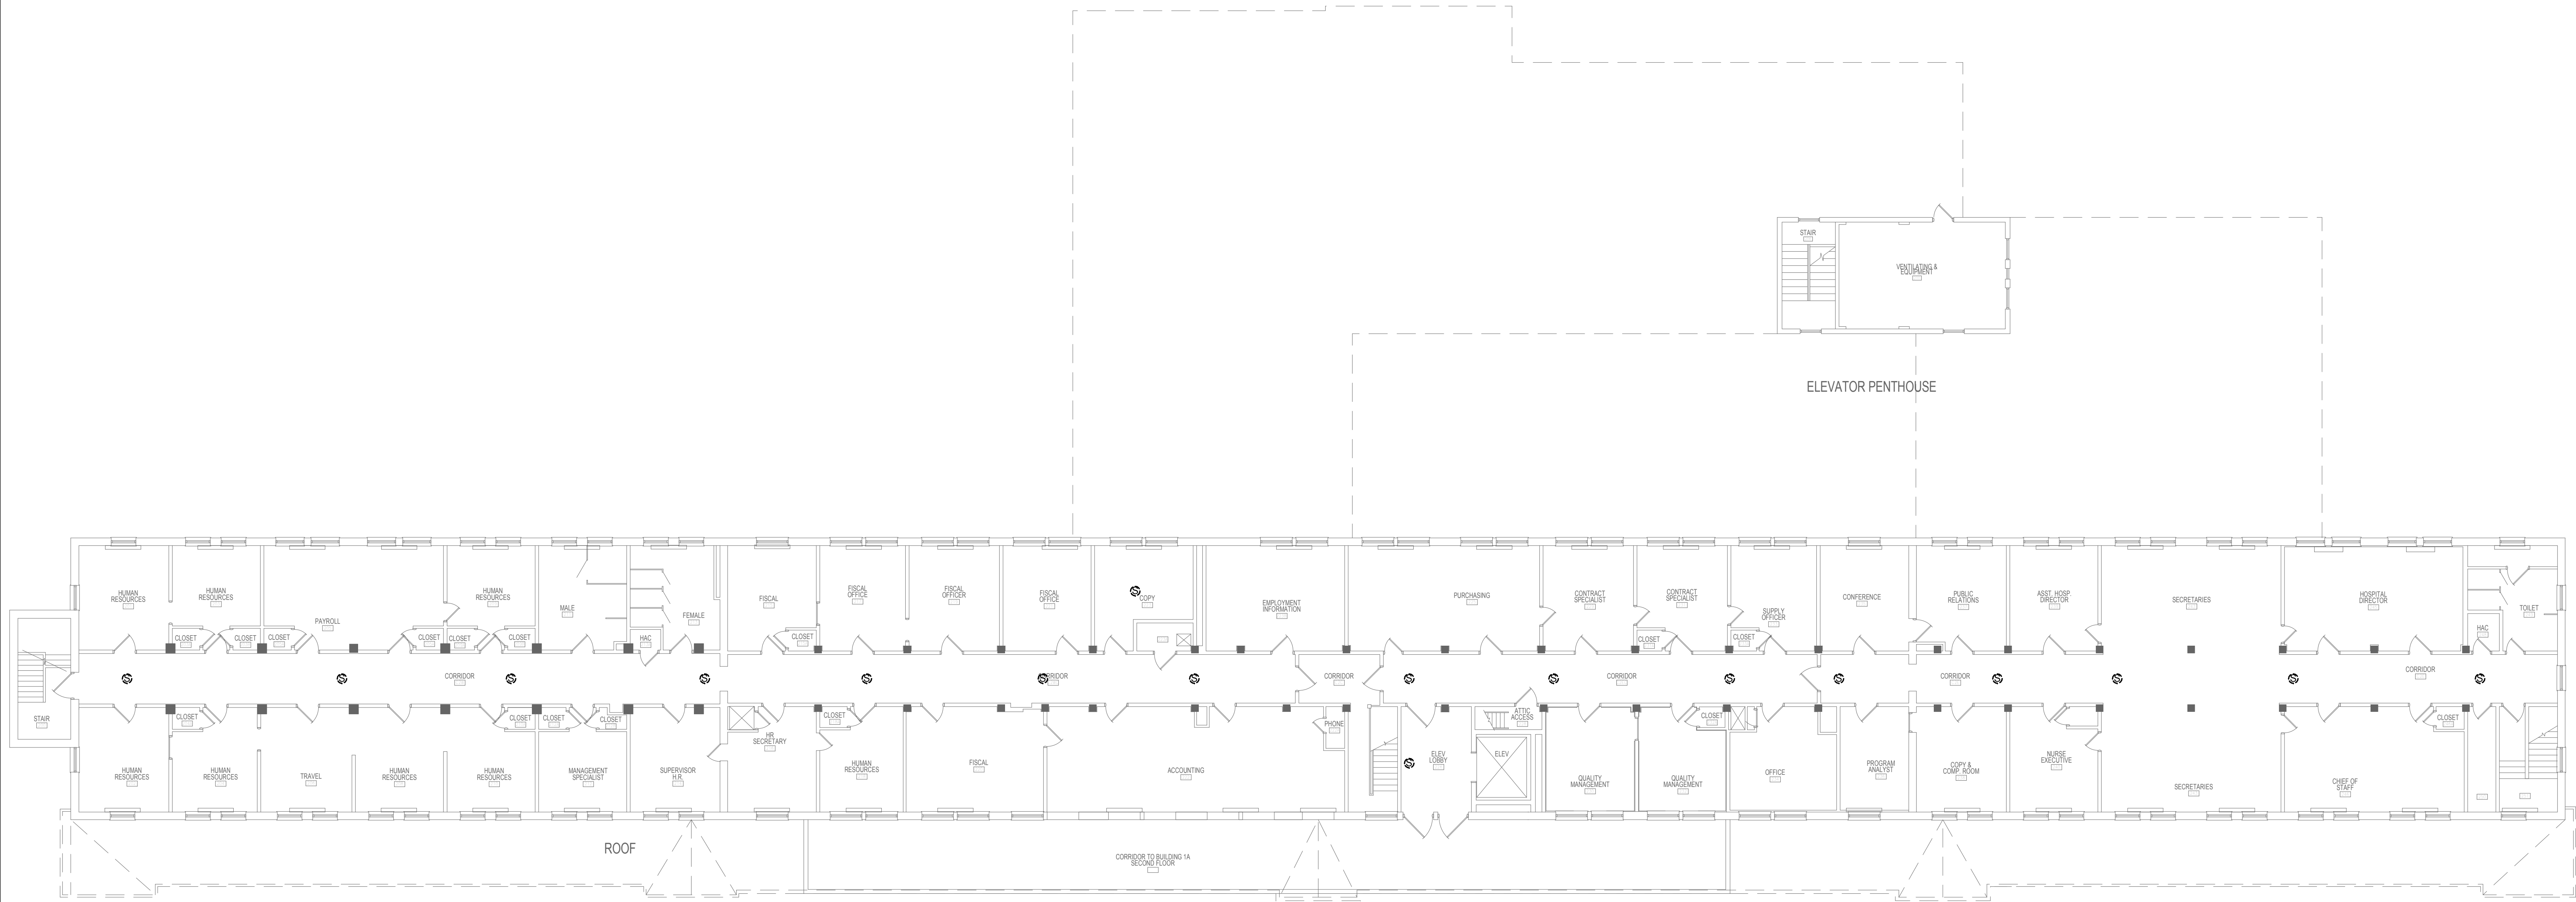

1 BUILDING 06 - PAGING SPEAKER FLOOR PLAN - FIRST FLOOR
3/32" = 1'-0"

C:\Revit\Projects\VA ST CLOUD\PAGING_Elec_R12_cmg.rvt

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)
DUNHAM
50 South Sixth Street / Suite 1100
Minneapolis, Minnesota 55402-1540
Phone: 612-465-7550 Fax: 612-465-7551
Web: dunhaminc.com
mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD
ANDERSON ENGINEERING
ENGINEERING • ARCHITECTURE • LAND SURVEYING
ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
Anderson Engineering of Minnesota, LLC
13605 1st Avenue North
Suite 100
Plymouth, MN 55441
763-412-4000 (o) 763-412-4090 (f)
www.ae-mn.com
AE PROJECT NUMBER: Project Number

STAMP
I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
Signature: *Chris M. Pilliod*
Name: Chris M. Pilliod, P.E.
Date: 1/24/19
Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE
BUILDING 04 - PAGING SPEAKER
DEMOLITION FLOOR PLAN - SECOND
FLOOR
APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PROJECT NO.:	
APPROVED: CHIEF OF STAFF	DATE:	BUILDING No.:	CHECKED BY: CP
APPROVED: HEALTH CARE SYSTEM DIRECTOR	DATE:	DRAWN: CG	ISSUE DATE: 1/24/19
LOCATION: VA MEDICAL CENTER ST. CLOUD, MN 56303		DRAWING NO.: ED04-02	



- GENERAL NOTES:**
- A. REFER TO SHEET ET.101 FOR LOCATION OF BUILDING ON CAMPUS.
 - B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE INACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
 - C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
 - D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
 - E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
 - F. CONTRACTOR RESPONSIBLE FOR PROVIDING REPLACEMENT CEILING TILES AFTER REMOVAL OF SPEAKERS. REPLACE CEILING TILE TO MATCH EXISTING ADJACENT CEILING TILE.
 - G. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
 - H. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
 - I. REPAIR OF EXISTING PAINTED AND FINISHED SURFACES: CLEAN, PATCH AND REPAIR EXISTING SURFACES DAMAGED OR ALTERED BY THIS WORK. NO "TELEGRAPHING" OF LINES, RIDGES, FLAKES, ETC. THROUGH NEW SURFACING IS PERMITTED. WHERE THIS OCCURS, SAND SMOOTH AND RE-FINISH UNTIL SURFACE MEETS COR'S APPROVAL. IN EXISTING ROOM OR AREAS WHERE ALTERATIONS BETWEEN NEW AND EXISTING FINISH WILL NOT SHOW IN FINISHED WORK, APPLY ONE (1) PRIME AND TWO (2) FINISH COATS OF PAINT TO MATCH ADJACENT SURFACES AND FINISHES.
 - J. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.



Building 4

Building 3

1 BUILDING 05 - PAGING SPEAKER DEMOLITION FLOOR PLAN - FIRST FLOOR
1/8" = 1'-0"

C:\Revit\Projects\VA ST CLOUD\PAGING_Elec_R12.dwg 1/24/2019 1:26:28 PM

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com
AE PROJECT NUMBER: Project Number

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:


DRAWING TITLE
BUILDING 05 - PAGING SPEAKER DEMOLITION FLOOR PLAN - FIRST FLOOR
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PLOT SCALE	
PROJECT NO.		DATE	
APPROVED: CHIEF OF STAFF	DATE:	BUILDING No.	CHECKED BY
		CP	CG
		DRAWN	ISSUE DATE
			1/24/19
APPROVED: HEALTH CARE SYSTEM DIRECTOR	DATE:	LOCATION	DRAWING NO.
		VA MEDICAL CENTER ST. CLOUD, MN 56303	ED05-01

VA **U.S. Department of Veterans Affairs**
 Veterans Health Administration
 St. Cloud VA Health Care System

GENERAL NOTES:

- A. REFER TO SHEET ET.101 FOR LOCATION OF BUILDING ON CAMPUS.
- B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE INACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
- C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
- D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
- E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
- F. CONTRACTOR RESPONSIBLE FOR PROVIDING REPLACEMENT CEILING TILES AFTER REMOVAL OF SPEAKERS. REPLACE CEILING TILE TO MATCH EXISTING ADJACENT CEILING TILE.
- G. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
- H. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
- I. REPAIR OF EXISTING PAINTED AND FINISHED SURFACES: CLEAN, PATCH AND REPAIR EXISTING SURFACES DAMAGED OR ALTERED BY THIS WORK. NO "TELEGRAPHING" OF LINES, RIDGES, FLAKES, ETC. THROUGH NEW SURFACING IS PERMITTED. WHERE THIS OCCURS, SAND SMOOTH AND RE-FINISH UNTIL SURFACE MEETS COR'S APPROVAL. IN EXISTING ROOM OR AREAS WHERE ALTERATIONS BETWEEN NEW AND EXISTING FINISH WILL NOT SHOW IN FINISHED WORK, APPLY ONE (1) PRIME AND TWO (2) FINISH COATS OF PAINT TO MATCH ADJACENT SURFACES AND FINISHES.
- J. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.

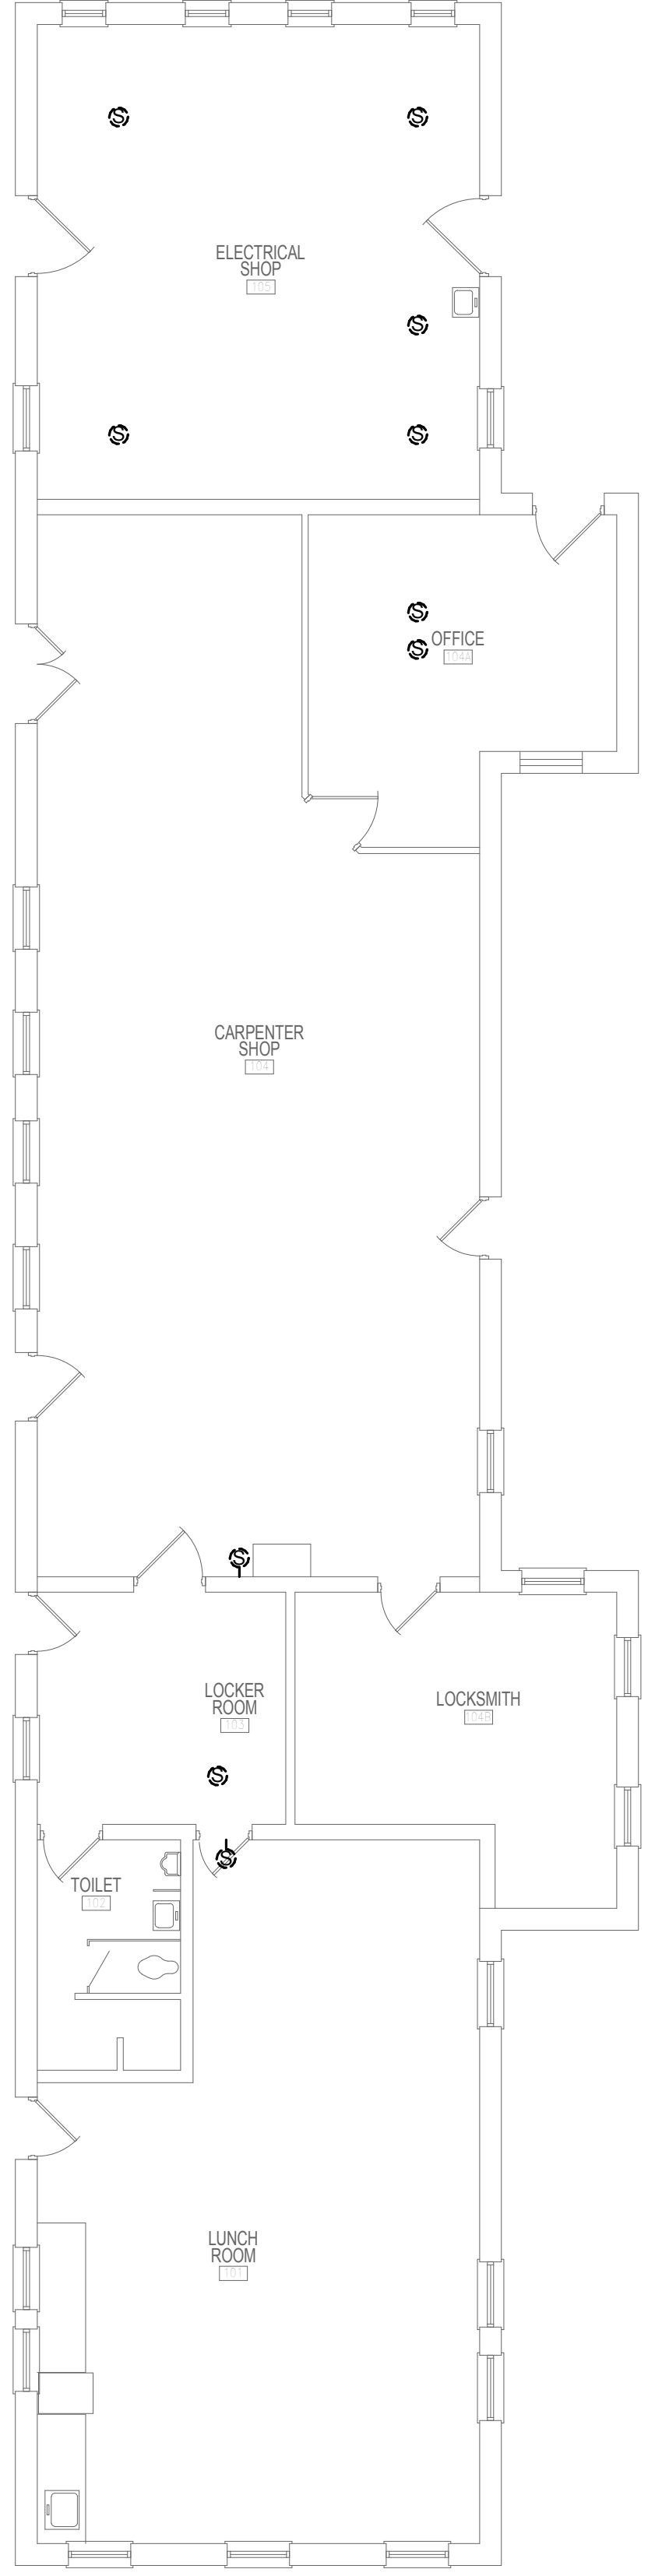

1 BUILDING 06 - PAGING SPEAKER DEMOLITION FLOOR PLAN - FIRST FLOOR
1/8" = 1'-0"

C:\Revit\Projects\VA ST CLOUD\PAGING_Elec_R12.dwg 1/24/2019 1:26:28 PM

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:


DRAWING TITLE
BUILDING 06 - PAGING SPEAKER DEMOLITION FLOOR PLAN - FIRST FLOOR
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:
 APPROVED: CHIEF OF STAFF
 DATE:
 APPROVED: HEALTH CARE SYSTEM DIRECTOR
 DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PROJECT NO.:	
BUILDING No.:	CHECKED BY:	DRAWN:	ISSUE DATE:
	CP	CG	1/24/19
LOCATION	DATE:	DRAWING NO.	
VA MEDICAL CENTER ST. CLOUD, MN 56303		ED06-01	

VA
U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

GENERAL NOTES:

- A. REFER TO SHEET ET.101 FOR LOCATION OF BUILDING ON CAMPUS.
- B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE INACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
- C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
- D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
- E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
- F. CONTRACTOR RESPONSIBLE FOR PROVIDING REPLACEMENT CEILING TILES AFTER REMOVAL OF SPEAKERS. REPLACE CEILING TILE TO MATCH EXISTING ADJACENT CEILING TILE.
- G. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
- H. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
- I. REPAIR OF EXISTING PAINTED AND FINISHED SURFACES: CLEAN, PATCH AND REPAIR EXISTING SURFACES DAMAGED OR ALTERED BY THIS WORK. NO "TELEGRAPHING" OF LINES, RIDGES, FLAKES, ETC. THROUGH NEW SURFACING IS PERMITTED. WHERE THIS OCCURS, SAND SMOOTH AND RE-FINISH UNTIL SURFACE MEETS COR'S APPROVAL. IN EXISTING ROOM OR AREAS WHERE ALTERATIONS BETWEEN NEW AND EXISTING FINISH WILL NOT SHOW IN FINISHED WORK, APPLY ONE (1) PRIME AND TWO (2) FINISH COATS OF PAINT TO MATCH ADJACENT SURFACES AND FINISHES.
- J. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.

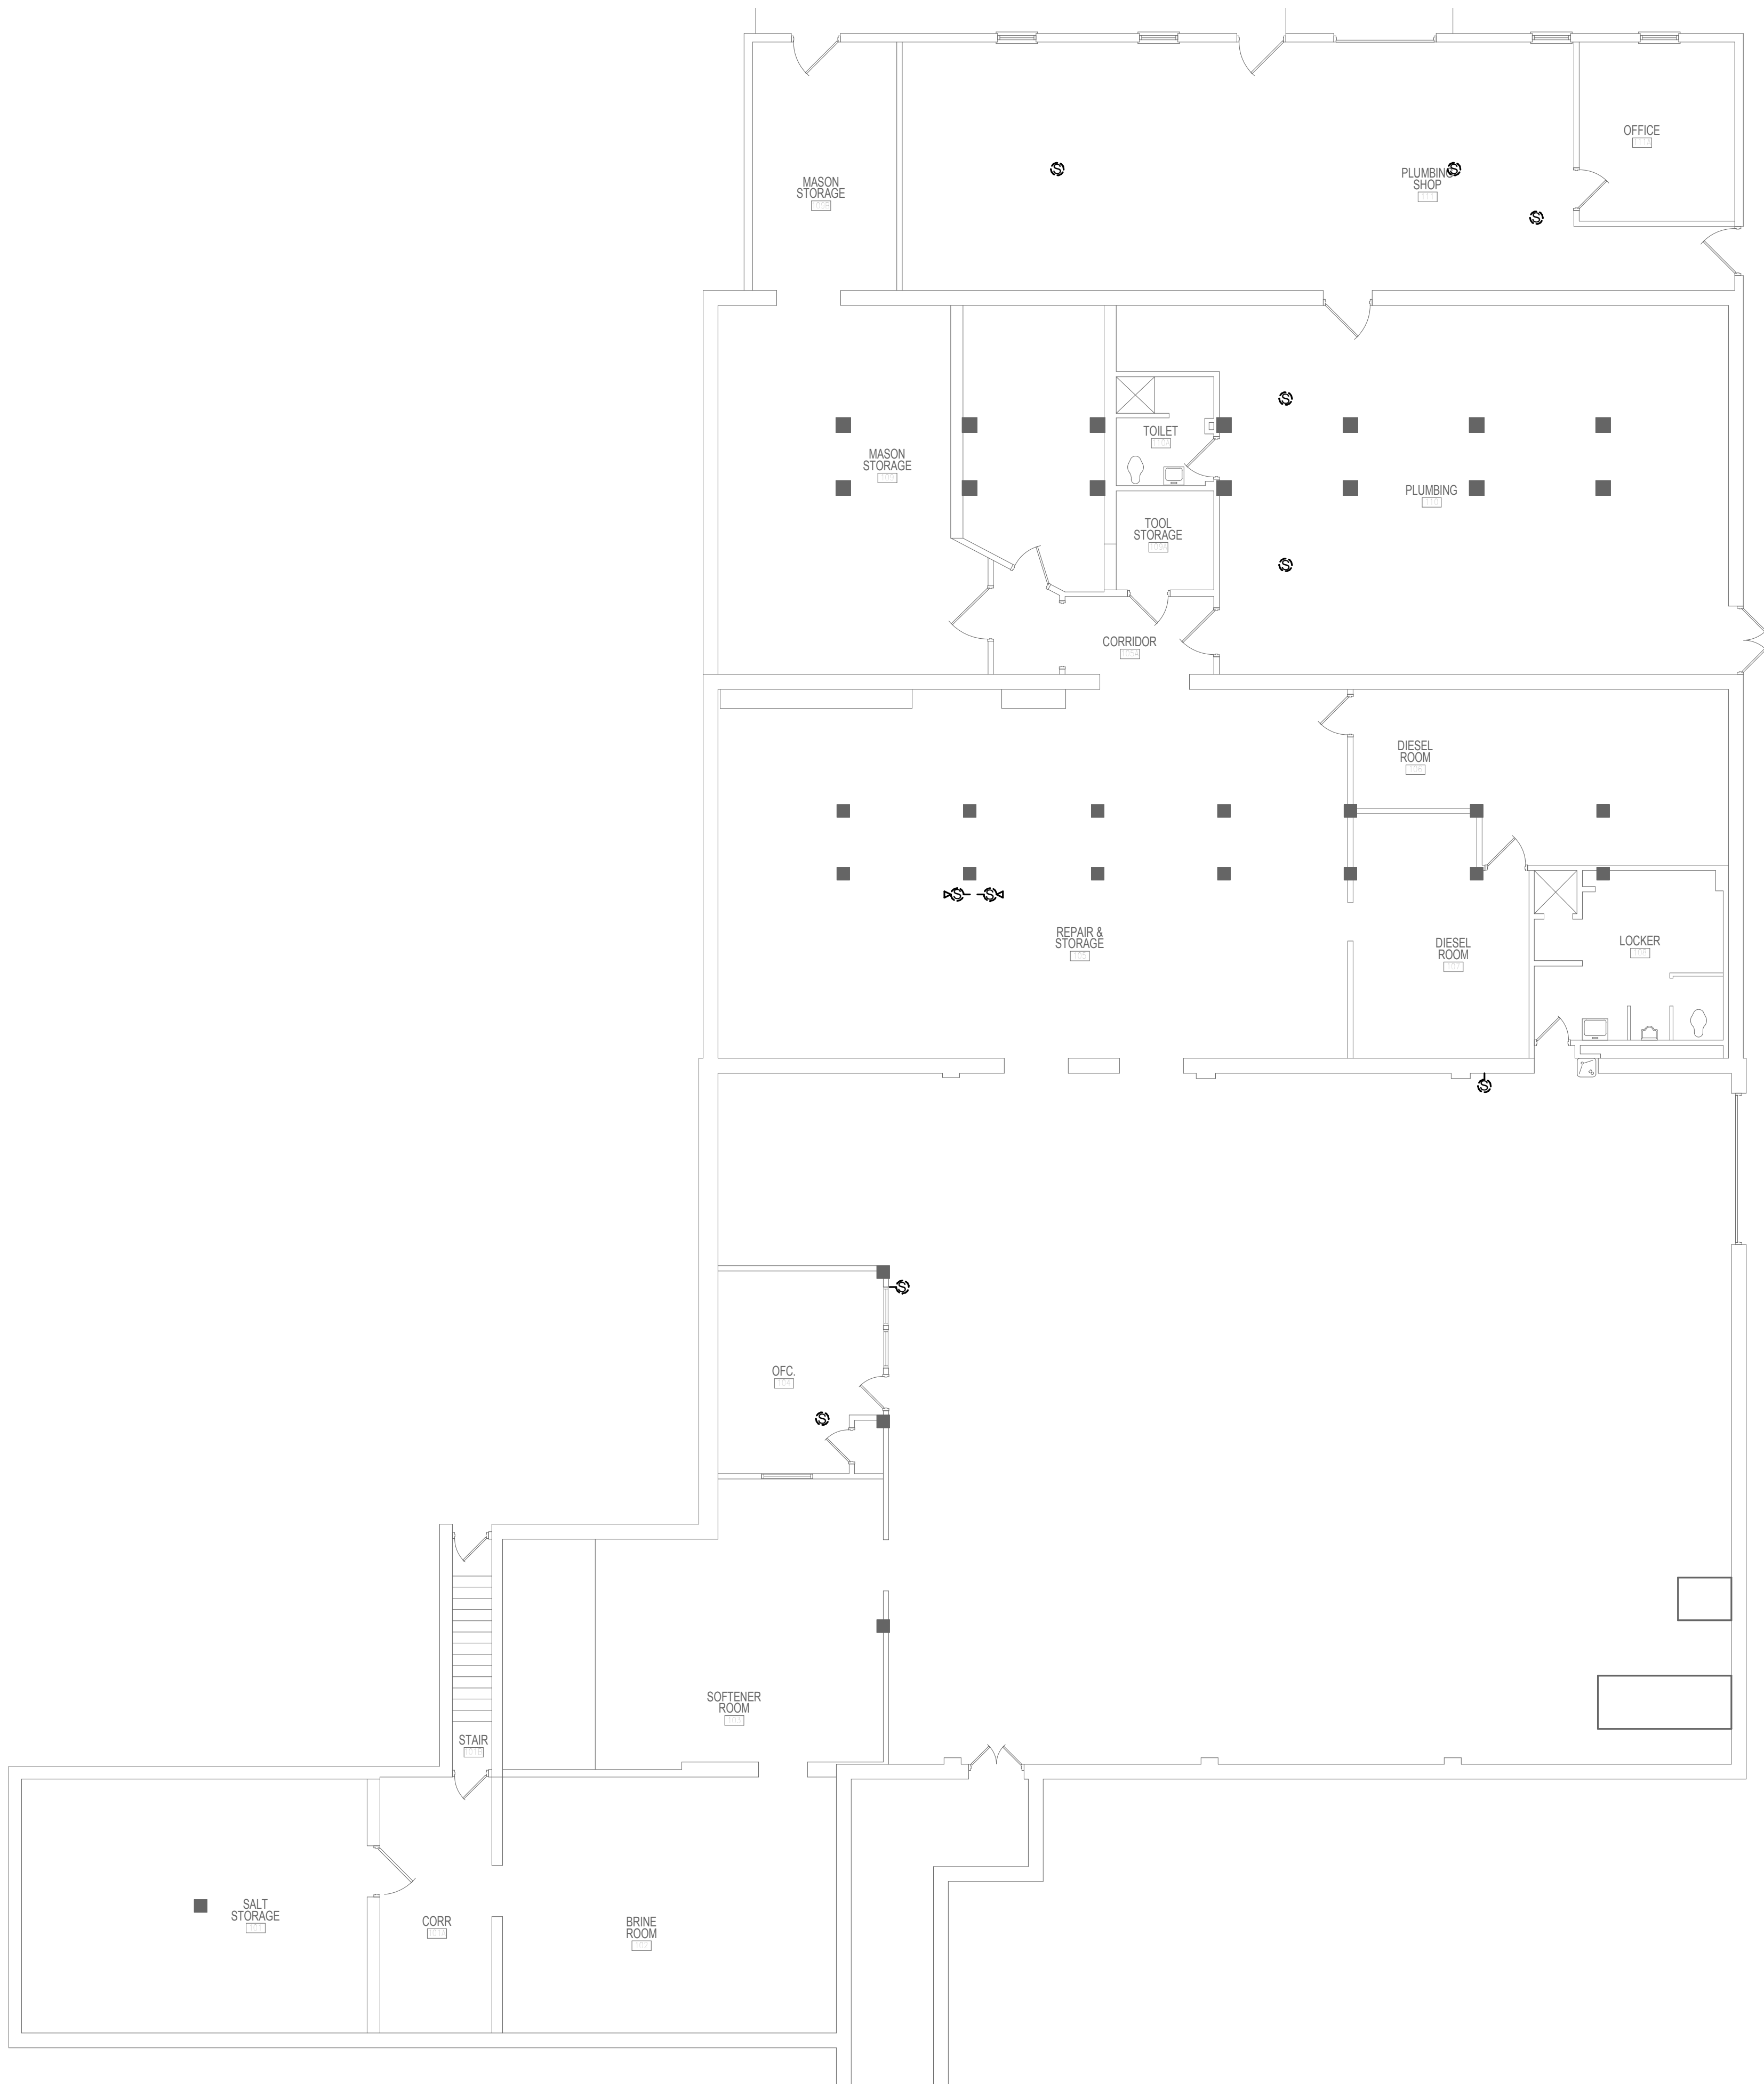

1 BUILDING 07 - PAGING SPEAKER DEMOLITION FLOOR PLAN - FIRST FLOOR
1/8" = 1'-0"

C:\Revit\Projects\VA ST CLOUD\PAGING_Elec_R12.dwg 1/24/2019 12:28:30 PM

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE
BUILDING 07 - PAGING SPEAKER DEMOLITION FLOOR PLAN - FIRST FLOOR
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:
 APPROVED: CHIEF OF STAFF
 DATE:
 APPROVED: HEALTH CARE SYSTEM DIRECTOR
 DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PLOT SCALE	
PROJECT NO.		DATE	
BUILDING No.	CHECKED BY	DRAWN	ISSUE DATE
	CP	CG	1/24/19
LOCATION	DATE	DRAWING NO.	
VA MEDICAL CENTER ST. CLOUD, MN 56303		ED07-01	

VA **U.S. Department of Veterans Affairs**
 Veterans Health Administration
 St. Cloud VA Health Care System

GENERAL NOTES:

- A. REFER TO SHEET ET.101 FOR LOCATION OF BUILDING ON CAMPUS.
- B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE INACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
- C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
- D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
- E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
- F. CONTRACTOR RESPONSIBLE FOR PROVIDING REPLACEMENT CEILING TILES AFTER REMOVAL OF SPEAKERS. REPLACE CEILING TILE TO MATCH EXISTING ADJACENT CEILING TILE.
- G. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
- H. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
- I. REPAIR OF EXISTING PAINTED AND FINISHED SURFACES: CLEAN, PATCH AND REPAIR EXISTING SURFACES DAMAGED OR ALTERED BY THIS WORK. NO "TELEGRAPHING" OF LINES, RIDGES, FLAKES, ETC. THROUGH NEW SURFACING IS PERMITTED. WHERE THIS OCCURS, SAND SMOOTH AND RE-FINISH UNTIL SURFACE MEETS COR'S APPROVAL. IN EXISTING ROOM OR AREAS WHERE ALTERATIONS BETWEEN NEW AND EXISTING FINISH WILL NOT SHOW IN FINISHED WORK, APPLY ONE (1) PRIME AND TWO (2) FINISH COATS OF PAINT TO MATCH ADJACENT SURFACES AND FINISHES.
- J. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.



1 BUILDING 08 - PAGING SPEAKER DEMOLITION FLOOR PLAN - BASEMENT
1/8" = 1'-0"

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE
BUILDING 08 - PAGING SPEAKER DEMOLITION FLOOR PLAN - BASEMENT
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:
 APPROVED: CHIEF OF STAFF
 DATE:
 APPROVED: HEALTH CARE SYSTEM DIRECTOR
 DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PROJECT NO.:	
BUILDING No.:	CHECKED BY:	DRAWN:	ISSUE DATE:
	CP	CG	1/24/19
LOCATION	DATE:	DRAWING NO.:	
VA MEDICAL CENTER ST. CLOUD, MN 56303		ED08-00	

VA
U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

C:\Revit\Projects\VA ST CLOUD PAGING_Elec_R12.dwg 1/24/2019 1:26:30 PM

GENERAL NOTES:

- A. REFER TO SHEET ET.101 FOR LOCATION OF BUILDING ON CAMPUS.
- B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE INACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
- C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
- D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
- E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
- F. CONTRACTOR RESPONSIBLE FOR PROVIDING REPLACEMENT CEILING TILES AFTER REMOVAL OF SPEAKERS. REPLACE CEILING TILE TO MATCH EXISTING ADJACENT CEILING TILE.
- G. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
- H. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
- I. REPAIR OF EXISTING PAINTED AND FINISHED SURFACES: CLEAN, PATCH AND REPAIR EXISTING SURFACES DAMAGED OR ALTERED BY THIS WORK. NO "TELEGRAPHING" OF LINES, RIDGES, FLAKES, ETC. THROUGH NEW SURFACING IS PERMITTED. WHERE THIS OCCURS, SAND SMOOTH AND RE-FINISH UNTIL SURFACE MEETS COR'S APPROVAL. IN EXISTING ROOM OR AREAS WHERE ALTERATIONS BETWEEN NEW AND EXISTING FINISH WILL NOT SHOW IN FINISHED WORK, APPLY ONE (1) PRIME AND TWO (2) FINISH COATS OF PAINT TO MATCH ADJACENT SURFACES AND FINISHES.
- J. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.



1 BUILDING 08 - PAGING SPEAKER DEMOLITION FLOOR PLAN - FIRST FLOOR
1/8" = 1'-0"

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:


DRAWING TITLE
BUILDING 08 - PAGING SPEAKER DEMOLITION FLOOR PLAN - FIRST FLOOR
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:
 APPROVED: CHIEF OF STAFF
 DATE:
 APPROVED: HEALTH CARE SYSTEM DIRECTOR
 DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PLOT SCALE	
PROJECT NO.		DATE	
BUILDING No.	CHECKED BY	DRAWN	ISSUE DATE
	CP	CG	1/24/19
LOCATION	DATE	DRAWING NO.	
VA MEDICAL CENTER ST. CLOUD, MN 56303		ED08-01	

VA
U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

GENERAL NOTES:

- A. REFER TO SHEET ET.101 FOR LOCATION OF BUILDING ON CAMPUS.
- B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE INACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
- C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
- D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
- E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
- F. CONTRACTOR RESPONSIBLE FOR PROVIDING REPLACEMENT CEILING TILES AFTER REMOVAL OF SPEAKERS. REPLACE CEILING TILE TO MATCH EXISTING ADJACENT CEILING TILE.
- G. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
- H. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
- I. REPAIR OF EXISTING PAINTED AND FINISHED SURFACES: CLEAN, PATCH AND REPAIR EXISTING SURFACES DAMAGED OR ALTERED BY THIS WORK. NO "TELEGRAPHING" OF LINES, RIDGES, FLAKES, ETC. THROUGH NEW SURFACING IS PERMITTED. WHERE THIS OCCURS, SAND SMOOTH AND RE-FINISH UNTIL SURFACE MEETS COR'S APPROVAL. IN EXISTING ROOM OR AREAS WHERE ALTERATIONS BETWEEN NEW AND EXISTING FINISH WILL NOT SHOW IN FINISHED WORK, APPLY ONE (1) PRIME AND TWO (2) FINISH COATS OF PAINT TO MATCH ADJACENT SURFACES AND FINISHES.
- J. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.

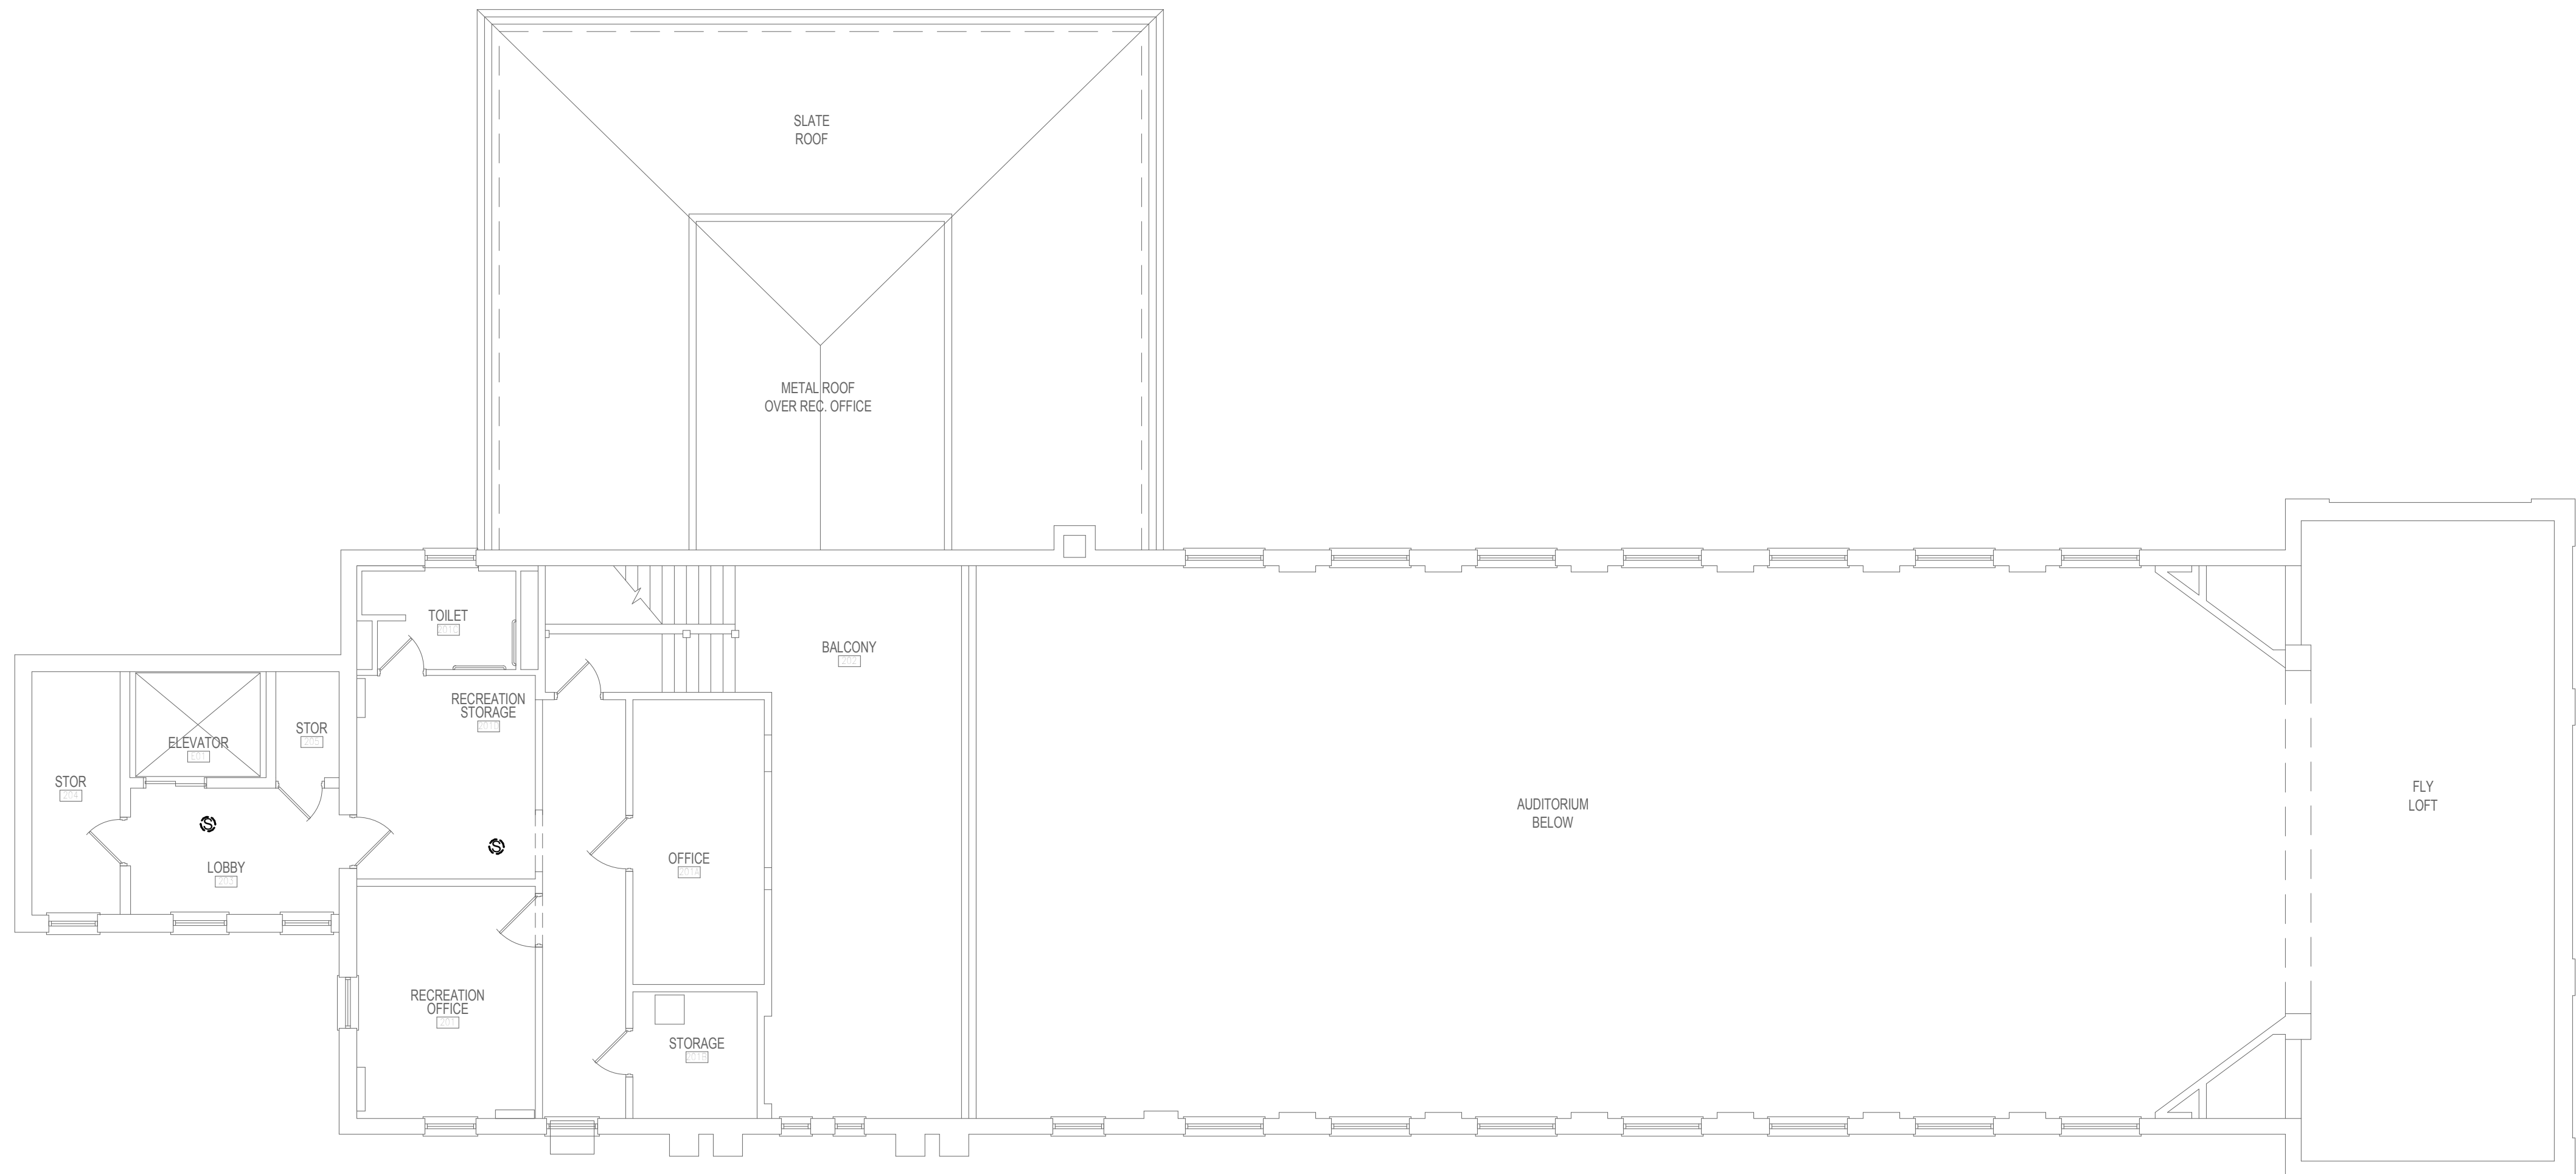

1 BUILDING 08 - PAGING SPEAKER DEMOLITION FLOOR PLAN - SECOND FLOOR
1/8" = 1'-0"

C:\Revit\Projects\VA ST CLOUD PAGING_Elec_R12.dwg 1/24/2019 1:20:32 PM

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD


ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:


DRAWING TITLE
BUILDING 08 - PAGING SPEAKER DEMOLITION FLOOR PLAN - SECOND FLOOR
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PLOT SCALE	
APPROVED: CHIEF OF STAFF		PROJECT NO.	
BUILDING No.	CHECKED BY	DRAWN	ISSUE DATE
	CP	CG	1/24/19
APPROVED: HEALTH CARE SYSTEM DIRECTOR		LOCATION	DRAWING NO.
		VA MEDICAL CENTER ST. CLOUD, MN 56303	ED08-02


VA  **U.S. Department of Veterans Affairs**
 Veterans Health Administration
 St. Cloud VA Health Care System

GENERAL NOTES:


- A. REFER TO SHEET ET.101 FOR LOCATION OF BUILDING ON CAMPUS.
- B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE INACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
- C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
- D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
- E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
- F. CONTRACTOR RESPONSIBLE FOR PROVIDING REPLACEMENT CEILING TILES AFTER REMOVAL OF SPEAKERS. REPLACE CEILING TILE TO MATCH EXISTING ADJACENT CEILING TILE.
- G. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
- H. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
- I. REPAIR OF EXISTING PAINTED AND FINISHED SURFACES: CLEAN, PATCH AND REPAIR EXISTING SURFACES DAMAGED OR ALTERED BY THIS WORK. NO "TELEGRAPHING" OF LINES, RIDGES, FLAKES, ETC. THROUGH NEW SURFACING IS PERMITTED. WHERE THIS OCCURS, SAND SMOOTH AND RE-FINISH UNTIL SURFACE MEETS COR'S APPROVAL. IN EXISTING ROOM OR AREAS WHERE ALTERATIONS BETWEEN NEW AND EXISTING FINISH WILL NOT SHOW IN FINISHED WORK, APPLY ONE (1) PRIME AND TWO (2) FINISH COATS OF PAINT TO MATCH ADJACENT SURFACES AND FINISHES.
- J. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.

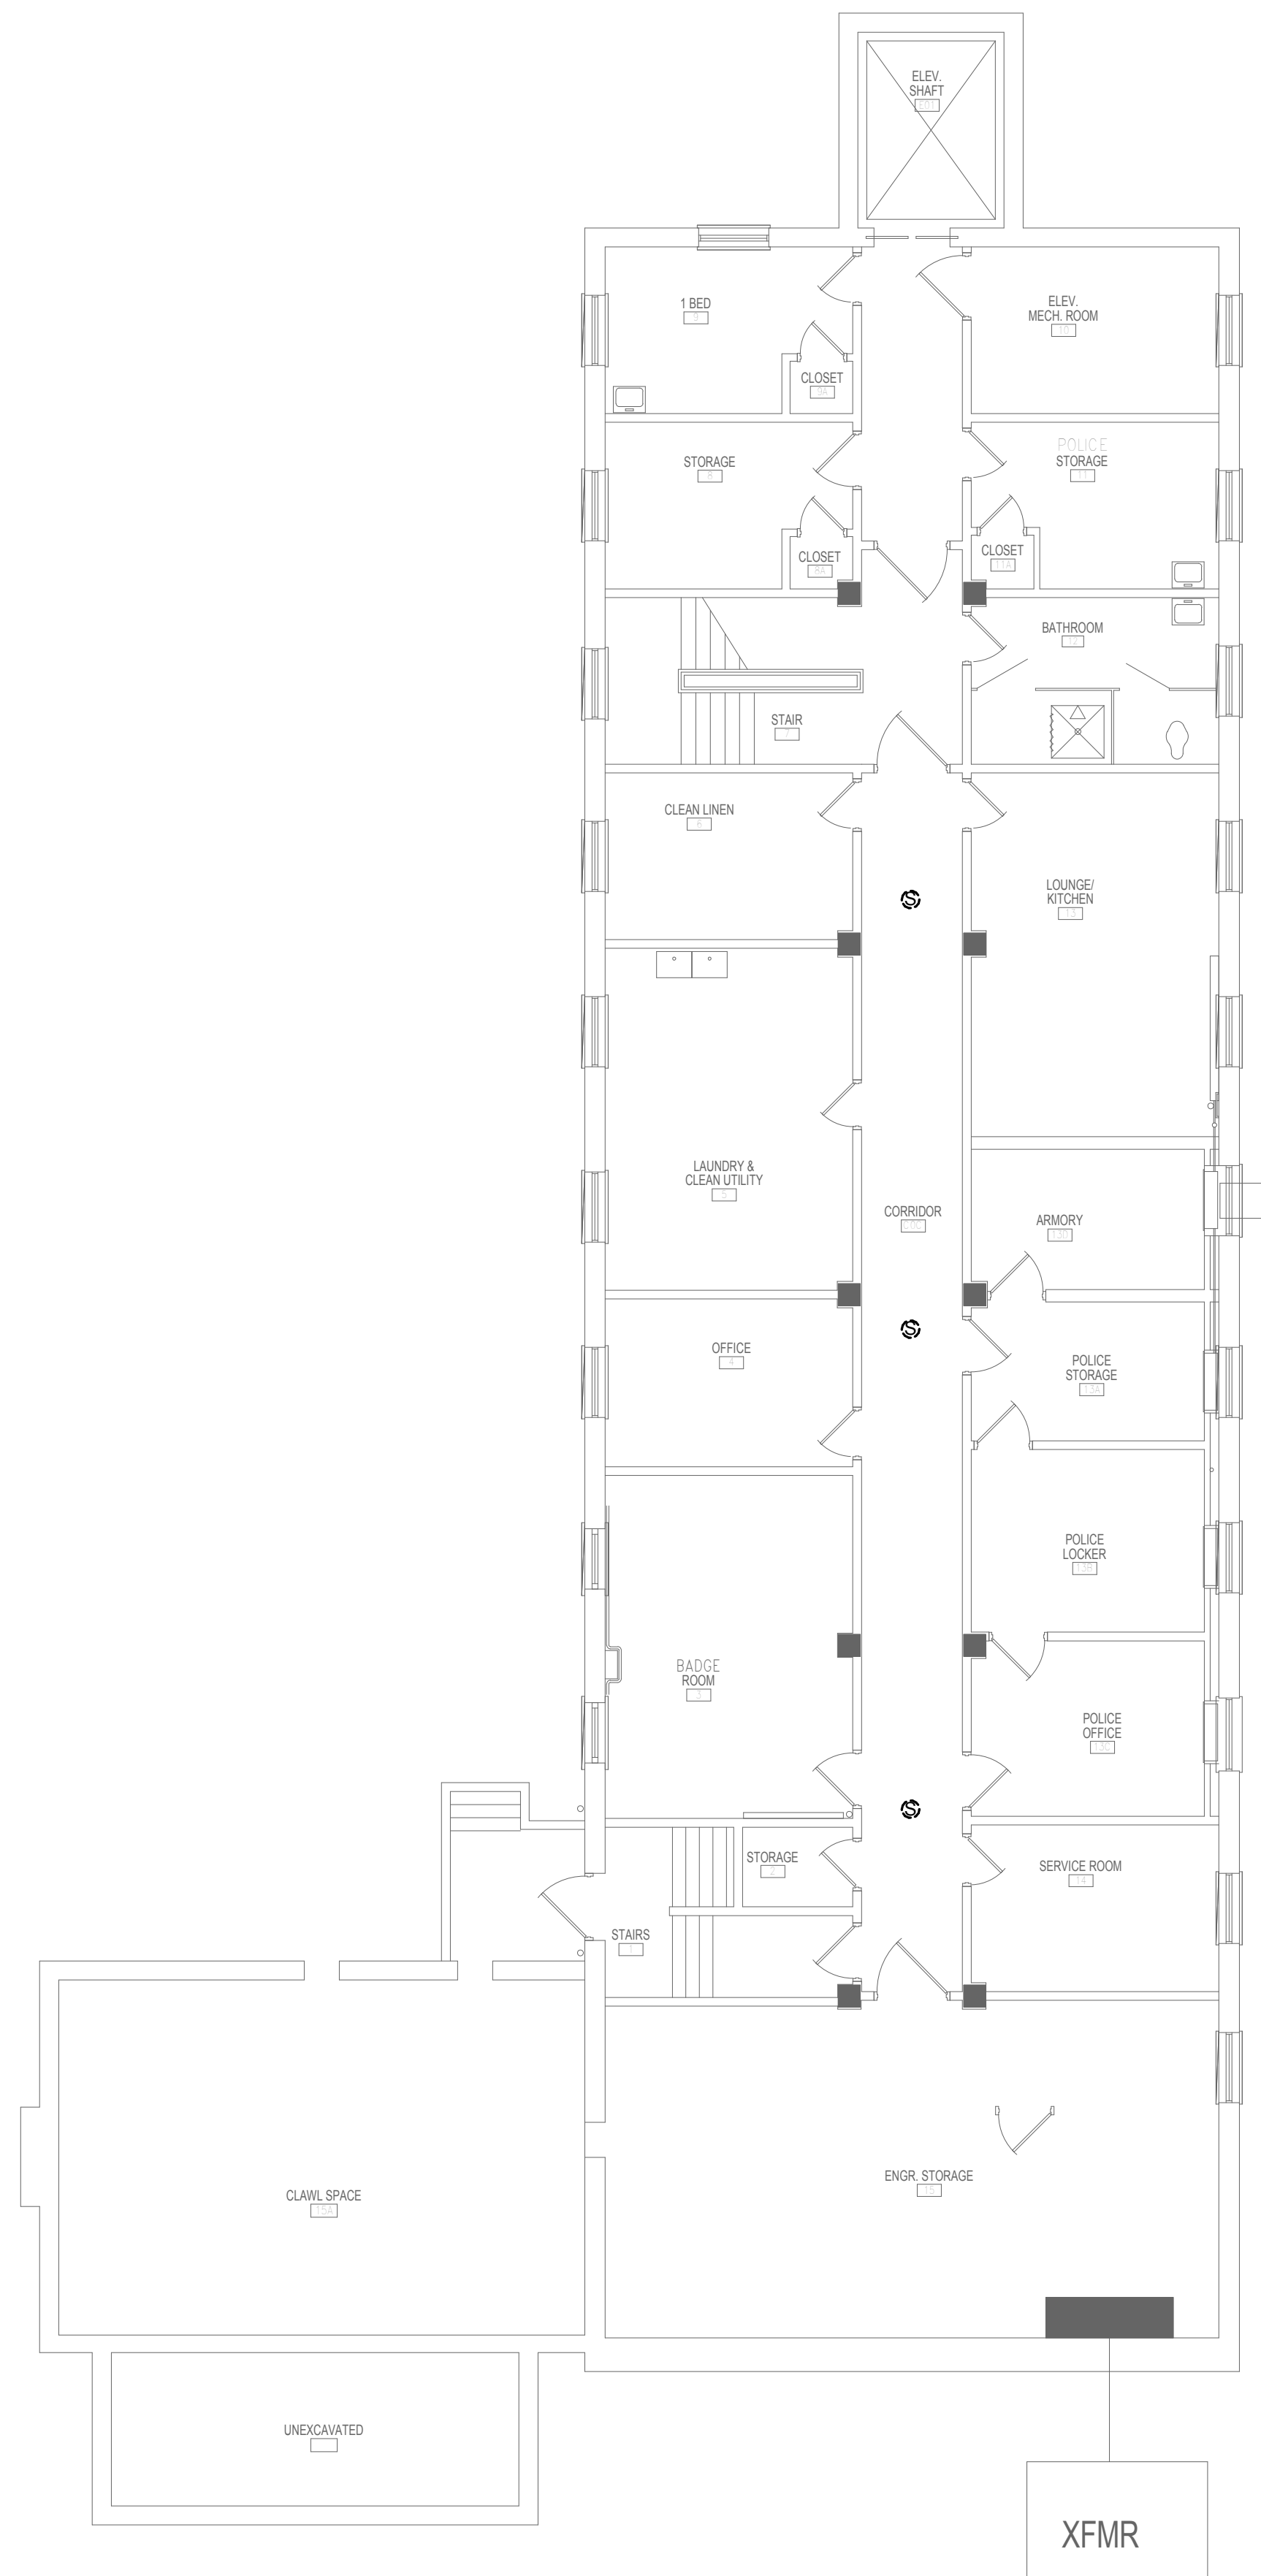

1 BUILDING 09 - PAGING SPEAKER DEMOLITION FLOOR PLAN - BASEMENT
1/8" = 1'-0"

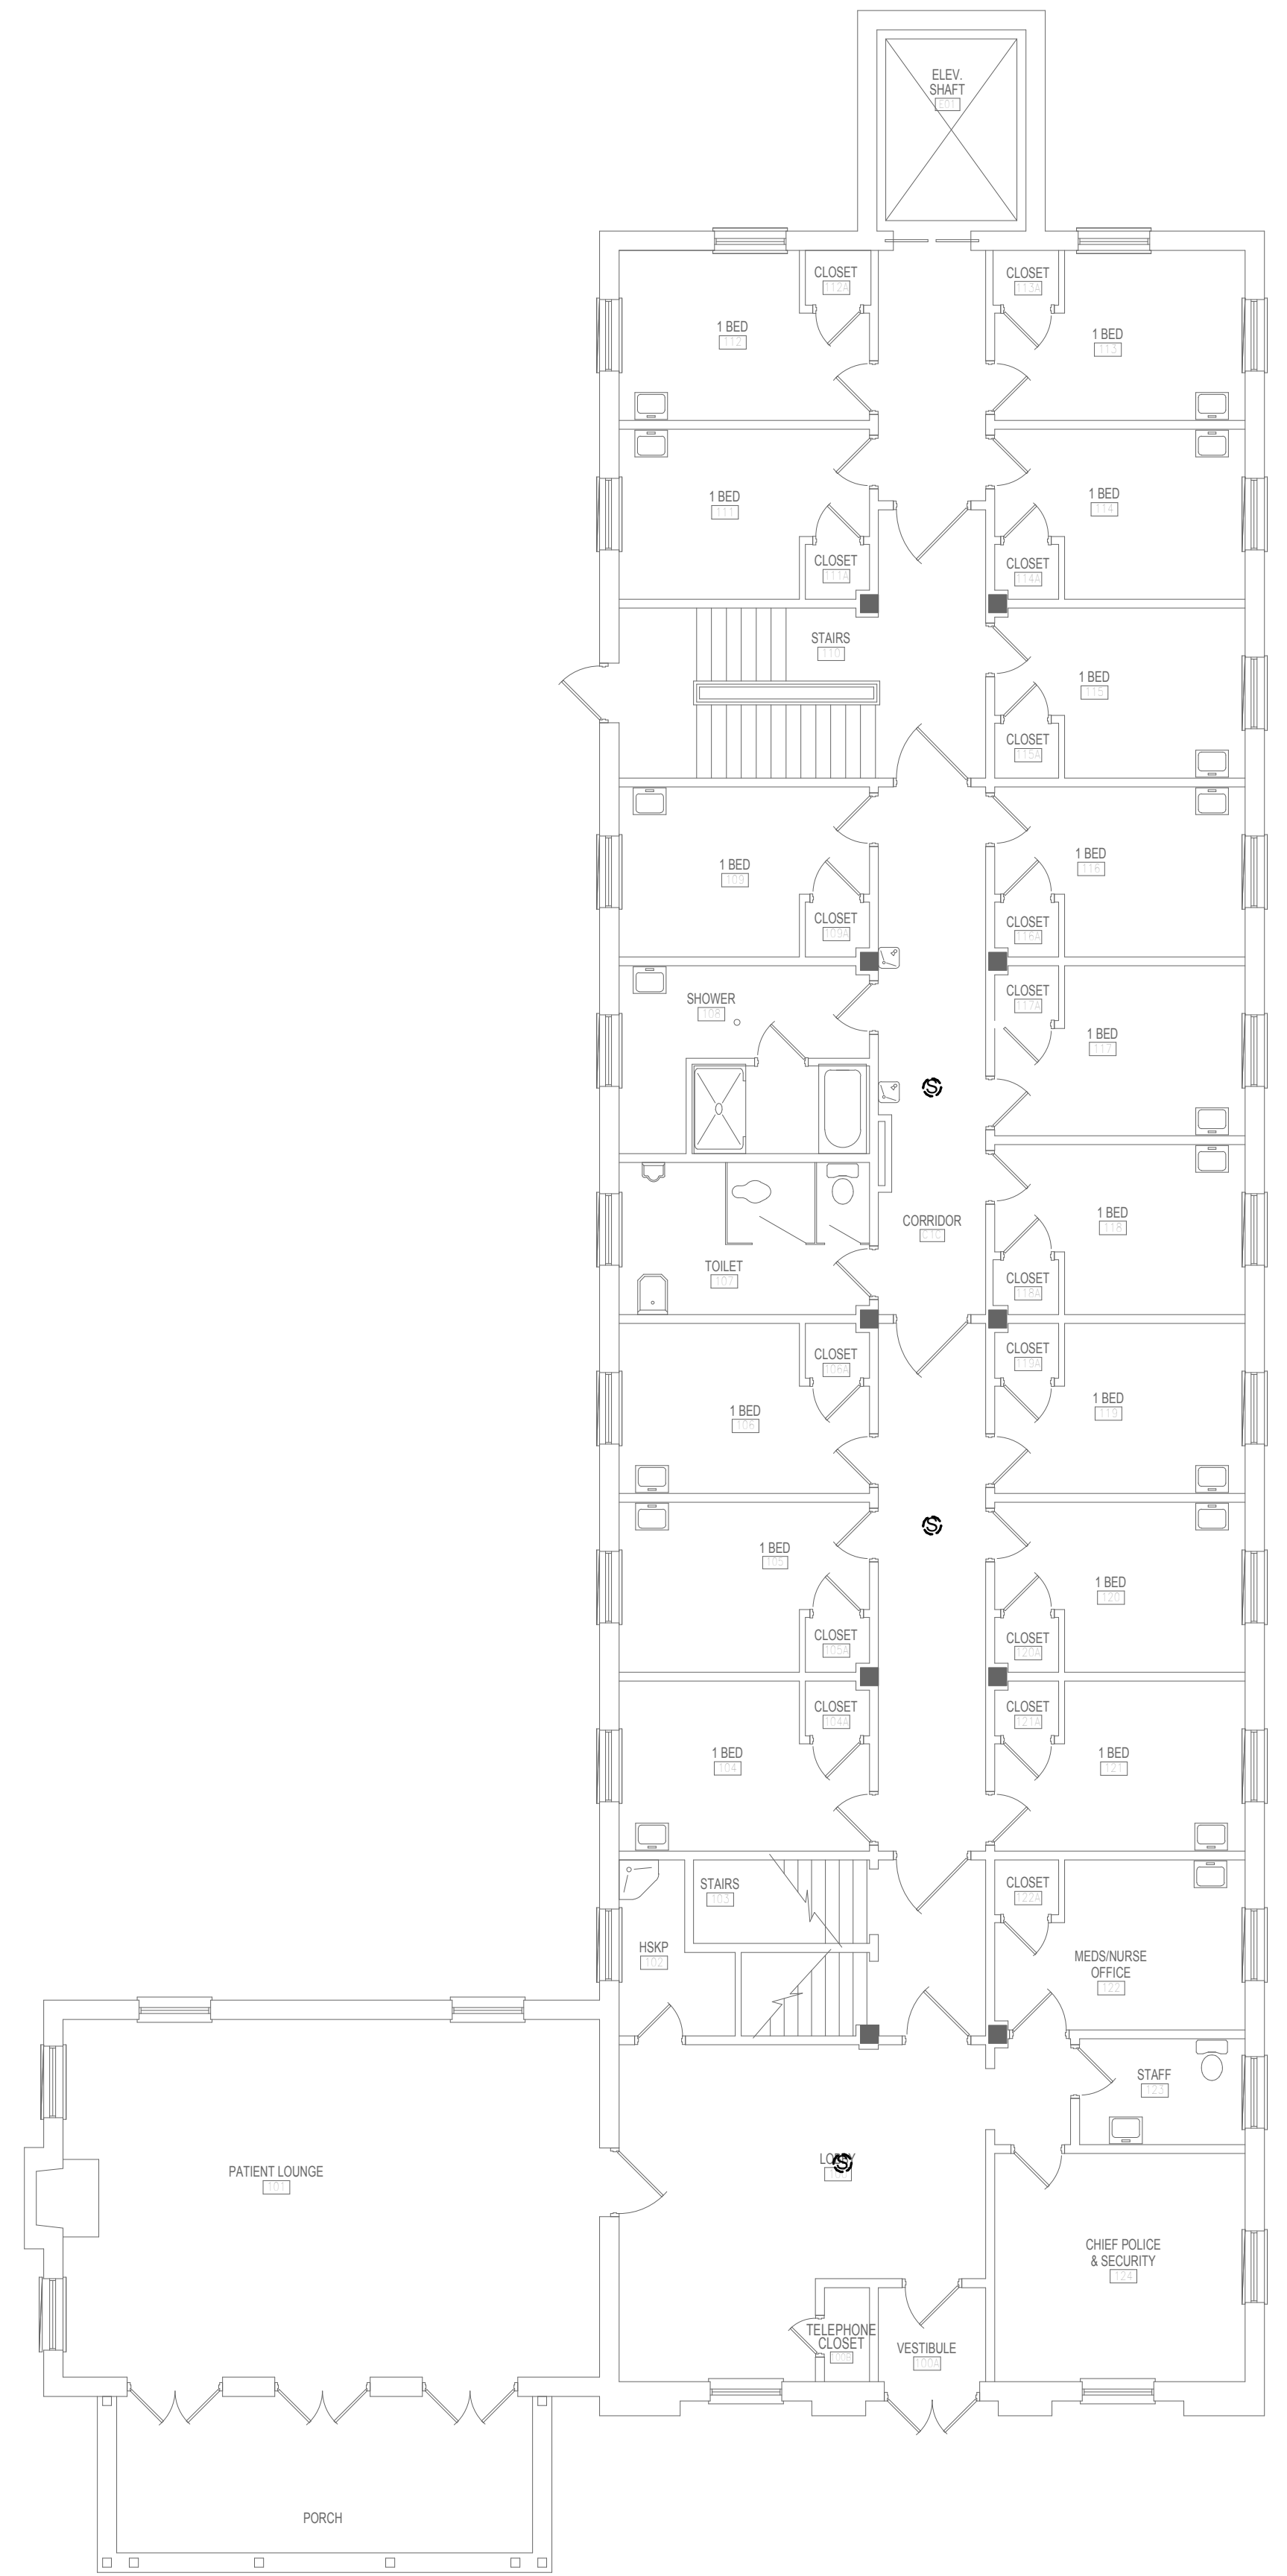

2 BUILDING 09 - PAGING SPEAKER DEMOLITION FLOOR PLAN - FIRST FLOOR
1/8" = 1'-0"

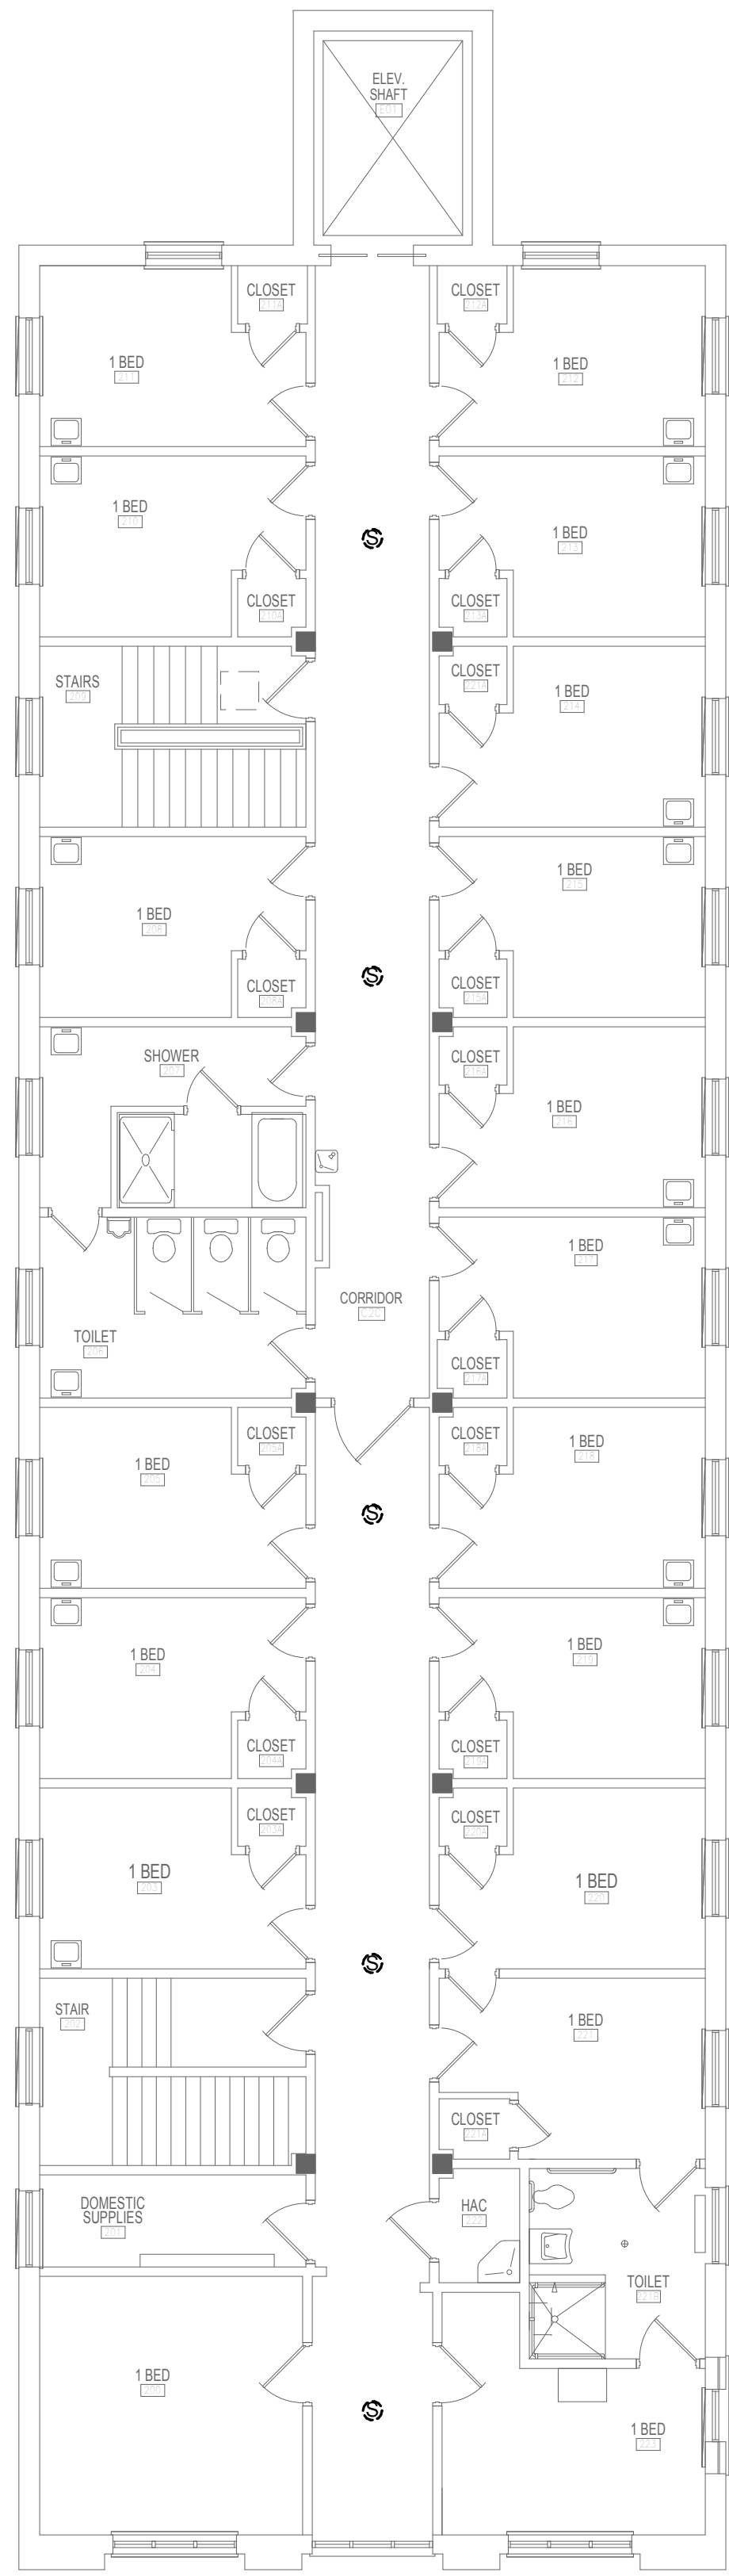

3 BUILDING 09 - PAGING SPEAKER DEMOLITION FLOOR PLAN - SECOND FLOOR
1/8" = 1'-0"

C:\Revit\Projects\VA ST CLOUD PAGING_Elec_R12.dwg

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com
AE PROJECT NUMBER: Project Number




STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilioud*
 Name: Chris M. Pilioud, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE
BUILDING 09 - PAGING SPEAKER DEMOLITION FLOOR PLAN - BASEMENT, FIRST AND SECOND FLOOR
 ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PLOT SCALE	
PROJECT NO.		ISSUE DATE	
APPROVED: CHIEF OF STAFF	DATE:	BUILDING No.	CHECKED BY
			CP
			CG
APPROVED: HEALTH CARE SYSTEM DIRECTOR	DATE:	LOCATION	DRAWING NO.
		VA MEDICAL CENTER ST. CLOUD, MN 56303	ED09-00

VA
U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

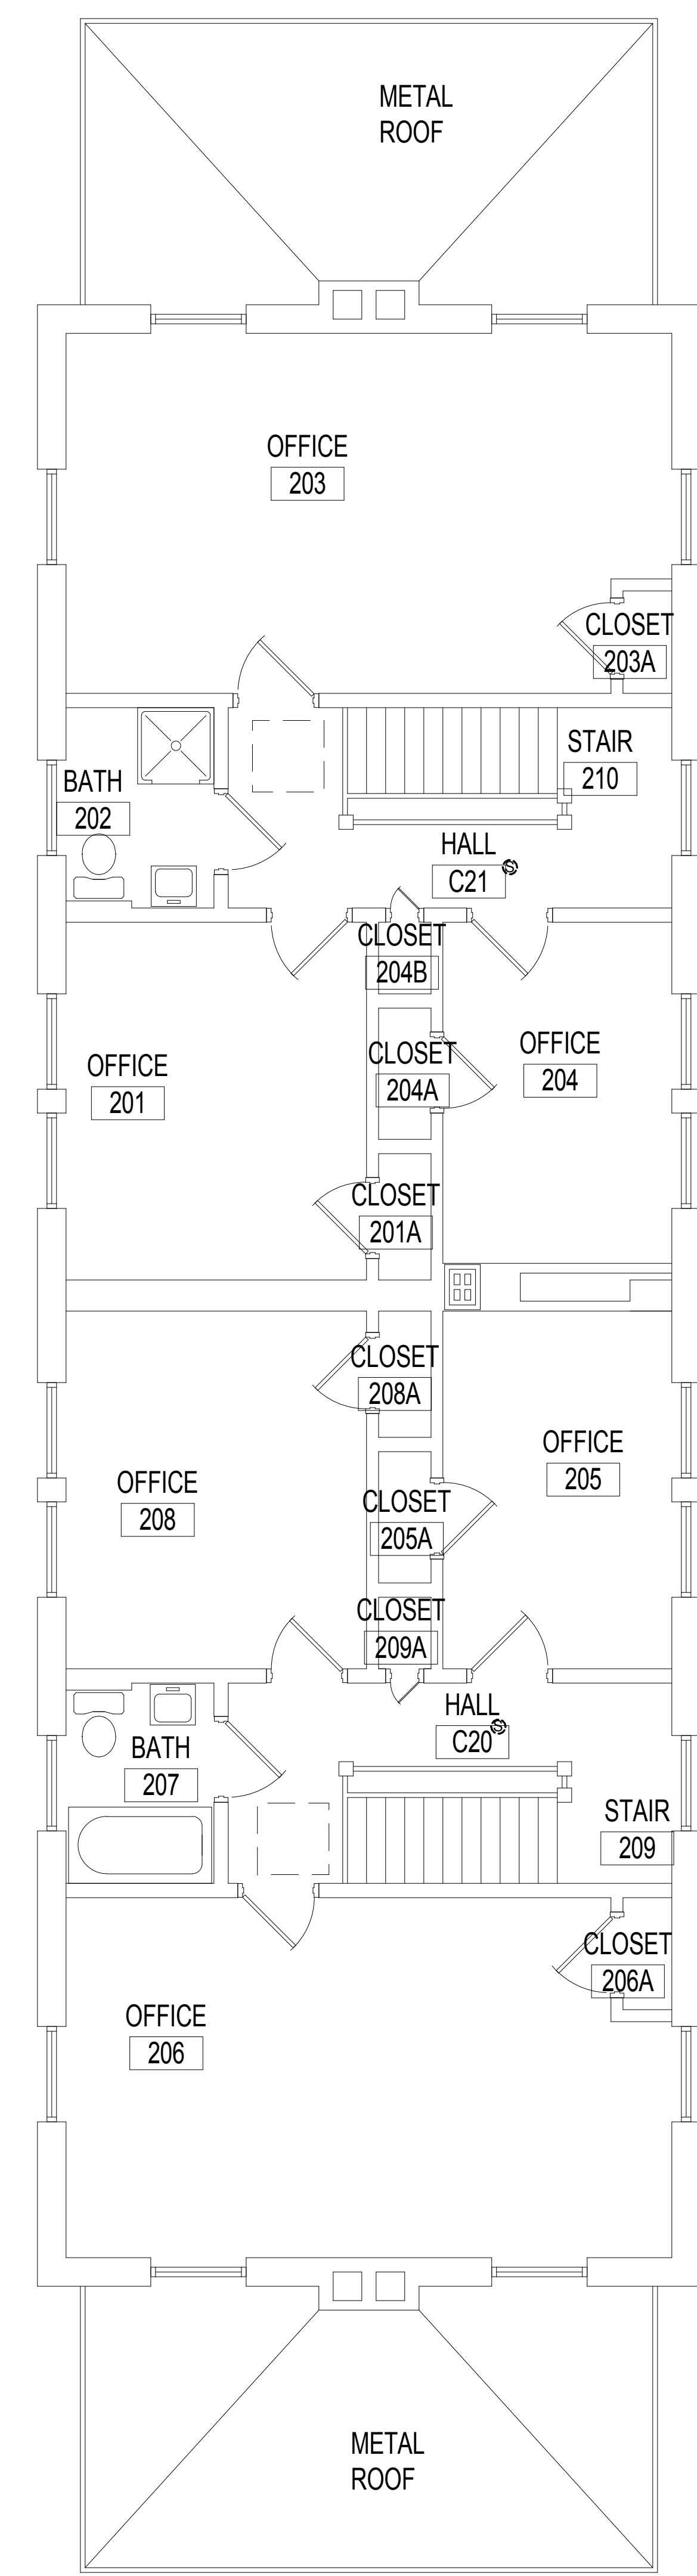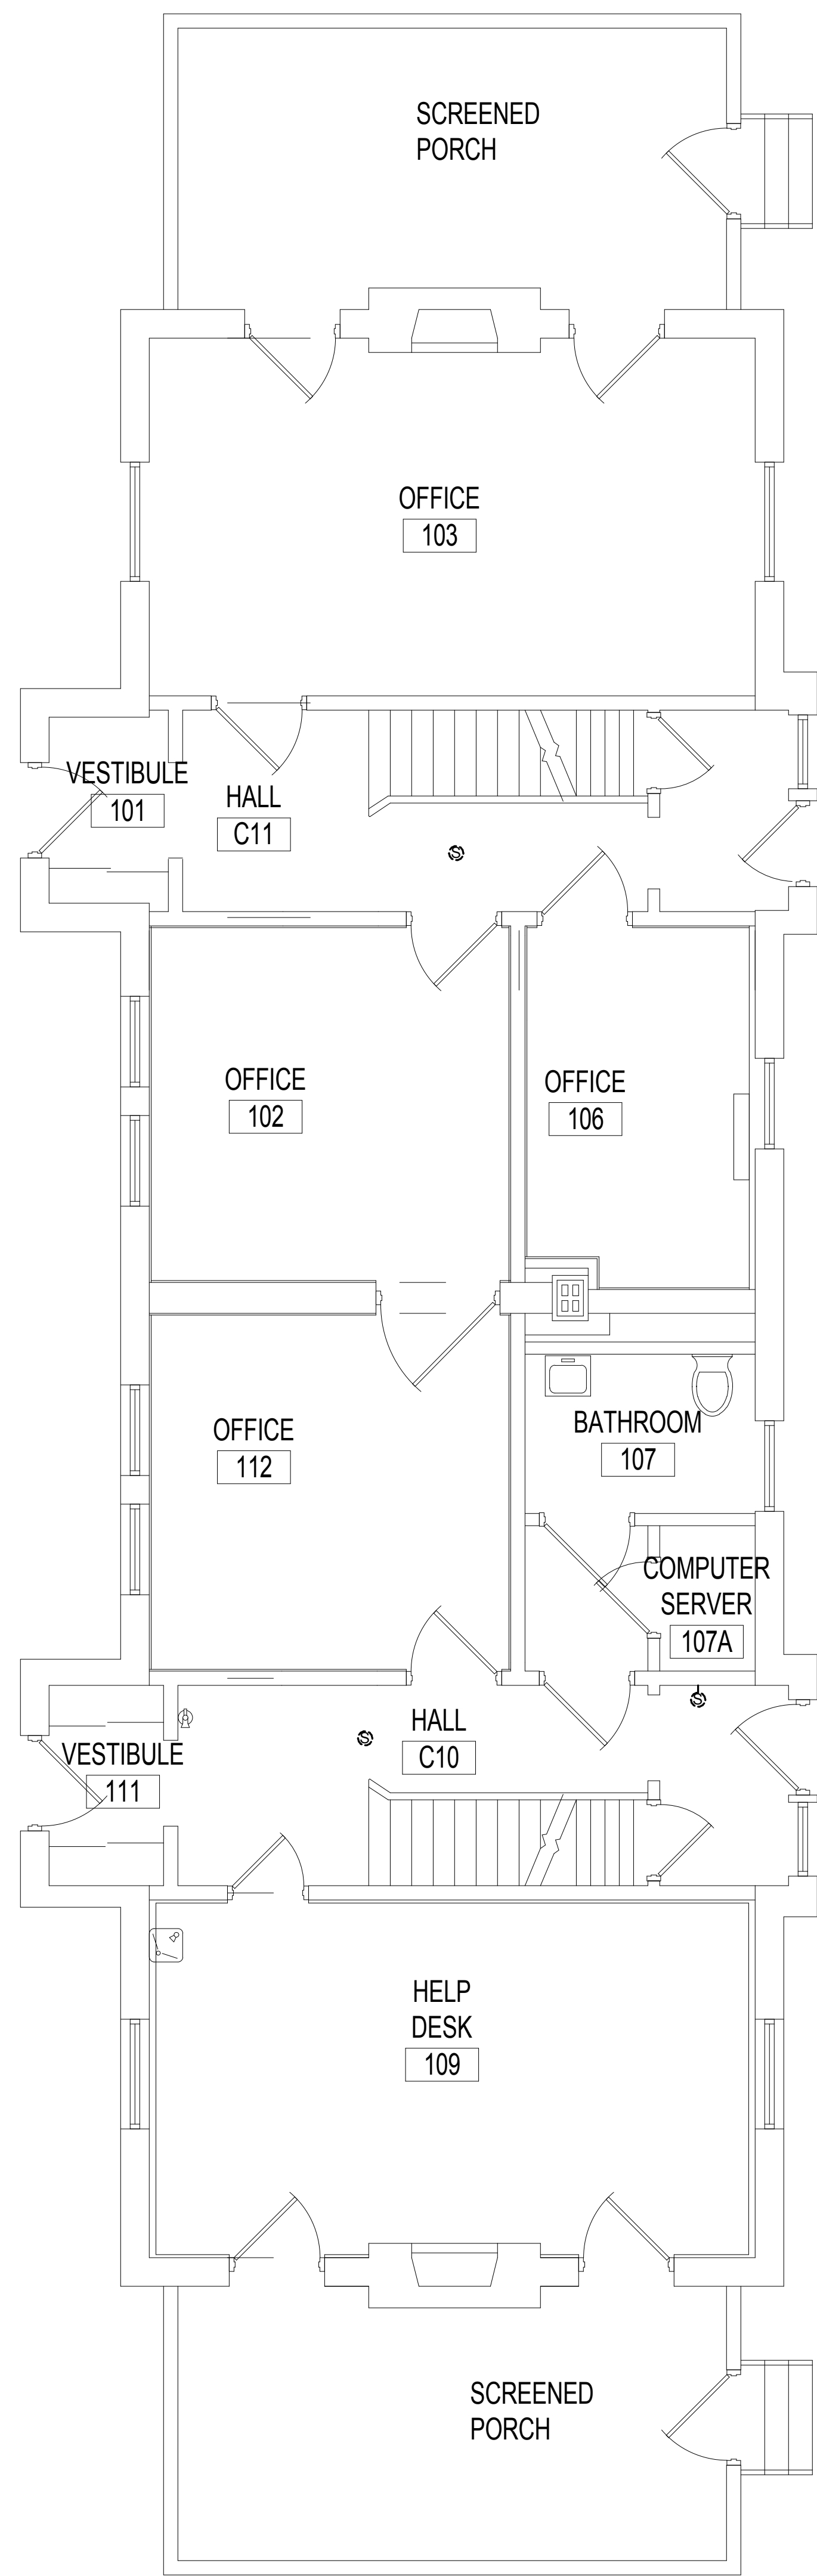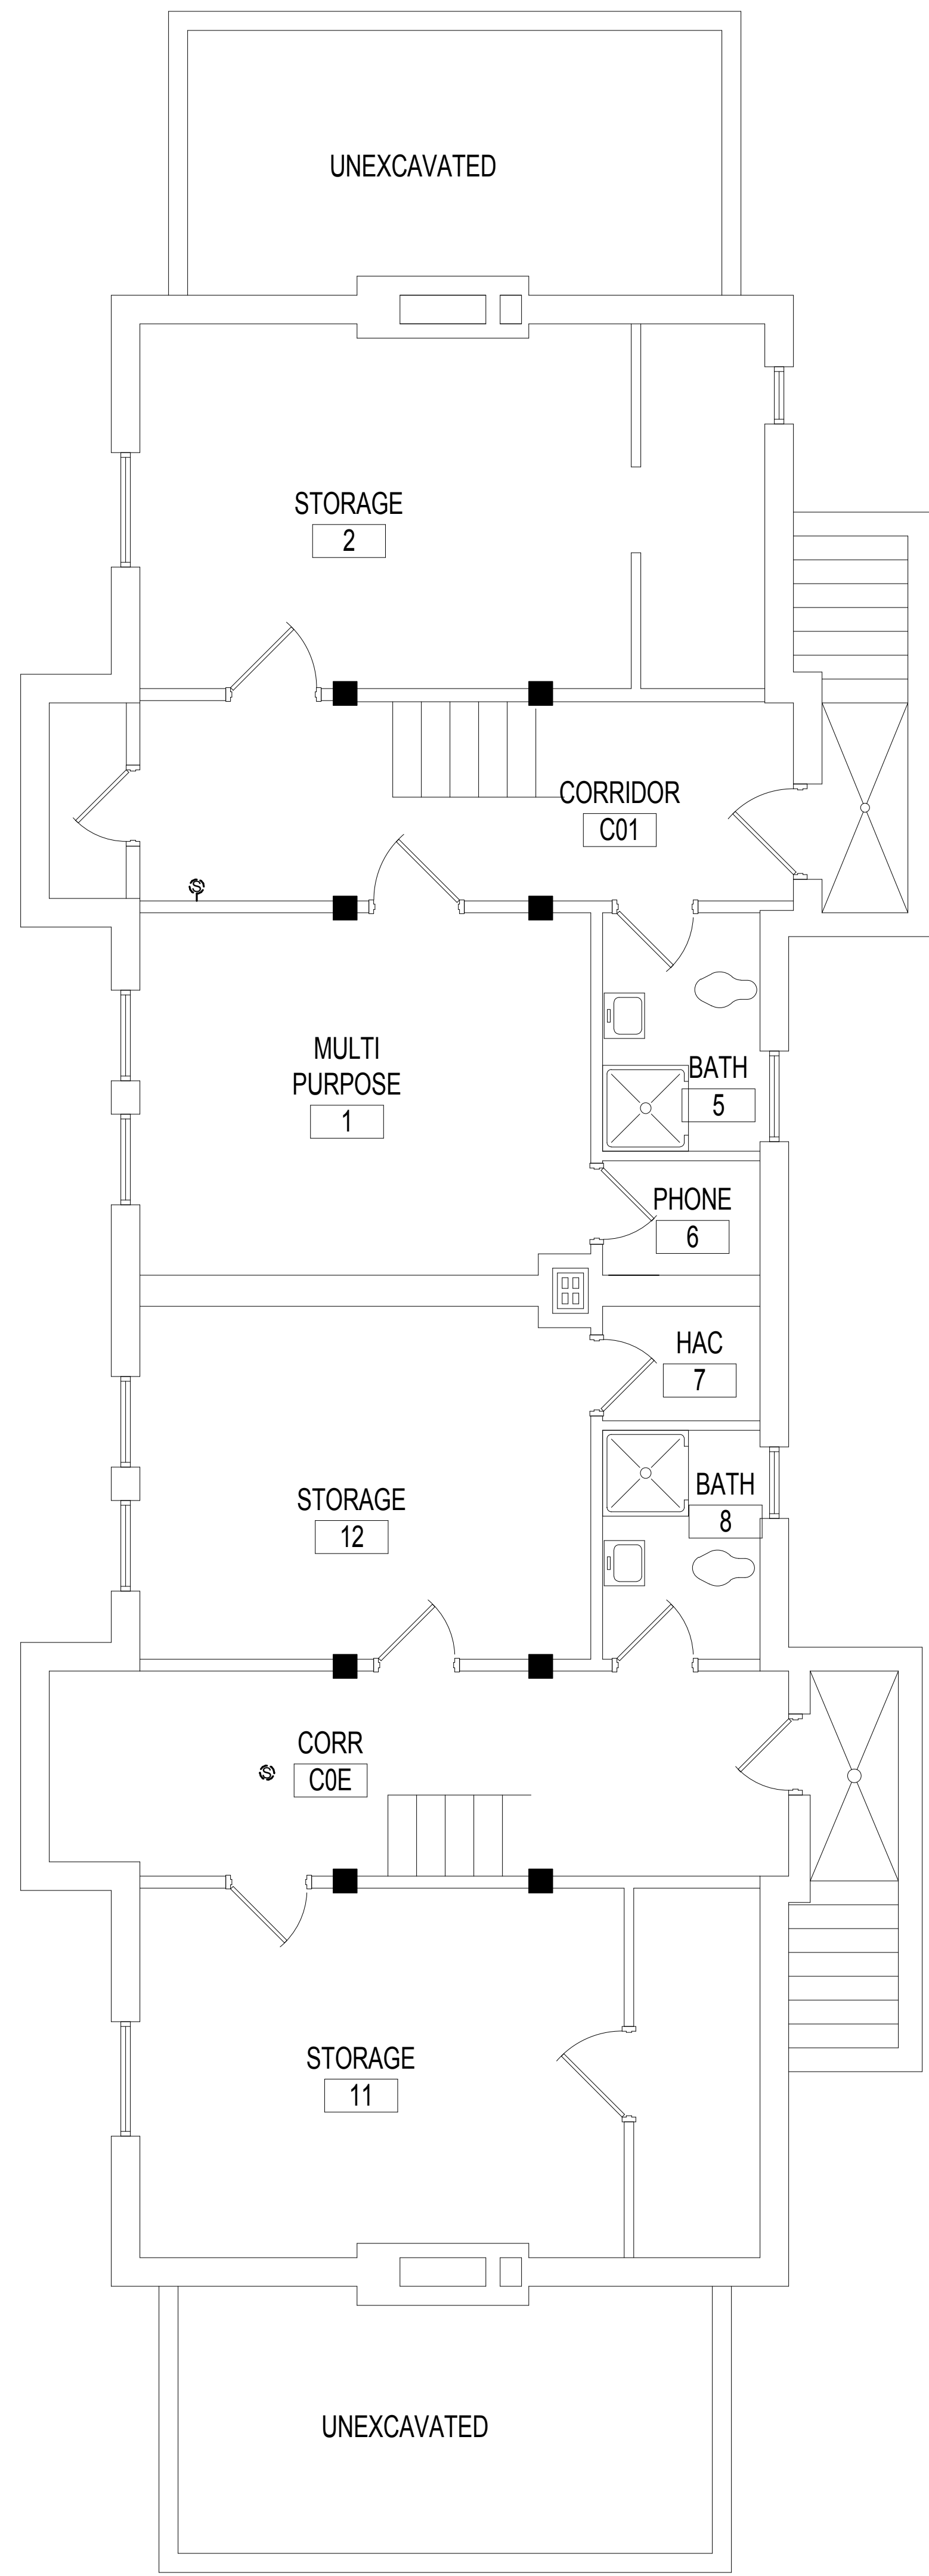

- GENERAL NOTES:**
- A. REFER TO SHEET ET.101 FOR LOCATION OF BUILDING ON CAMPUS.
 - B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE INACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
 - C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
 - D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
 - E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
 - F. CONTRACTOR RESPONSIBLE FOR PROVIDING REPLACEMENT CEILING TILES AFTER REMOVAL OF SPEAKERS. REPLACE CEILING TILE TO MATCH EXISTING ADJACENT CEILING TILE.
 - G. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
 - H. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
 - I. REPAIR OF EXISTING PAINTED AND FINISHED SURFACES: CLEAN, PATCH AND REPAIR EXISTING SURFACES DAMAGED OR ALTERED BY THIS WORK. NO "TELEGRAPHING" OF LINES, RIDGES, FLAKES, ETC. THROUGH NEW SURFACING IS PERMITTED. WHERE THIS OCCURS, SAND SMOOTH AND RE-FINISH UNTIL SURFACE MEETS COR'S APPROVAL. IN EXISTING ROOM OR AREAS WHERE ALTERATIONS BETWEEN NEW AND EXISTING FINISH WILL NOT SHOW IN FINISHED WORK, APPLY ONE (1) PRIME AND TWO (2) FINISH COATS OF PAINT TO MATCH ADJACENT SURFACES AND FINISHES.
 - J. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.

1 BUILDING 10 - PAGING SPEAKER DEMOLITION FLOOR PLAN - BASEMENT
1/4" = 1'-0"

2 BUILDING 10 - PAGING SPEAKER DEMOLITION FLOOR PLAN - FIRST FLOOR
1/4" = 1'-0"

3 BUILDING 10 - PAGING SPEAKER DEMOLITION FLOOR PLAN - SECOND FLOOR
1/4" = 1'-0"

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

 DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com


STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.

 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE
BUILDING 10 - PAGING SPEAKER DEMOLITION FLOOR PLAN - BASEMENT, FIRST & SECOND FLOORS
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:
 APPROVED: CHIEF OF STAFF
 DATE:
 APPROVED: HEALTH CARE SYSTEM DIRECTOR
 DATE:


PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PLOT SCALE	
PROJECT NO.		DATE	
BUILDING No.	CHECKED BY	DRAWN	ISSUE DATE
	CP	CG	1/24/19
LOCATION	DATE	DRAWING NO.	
VA MEDICAL CENTER ST. CLOUD, MN 56303		ED10-00	

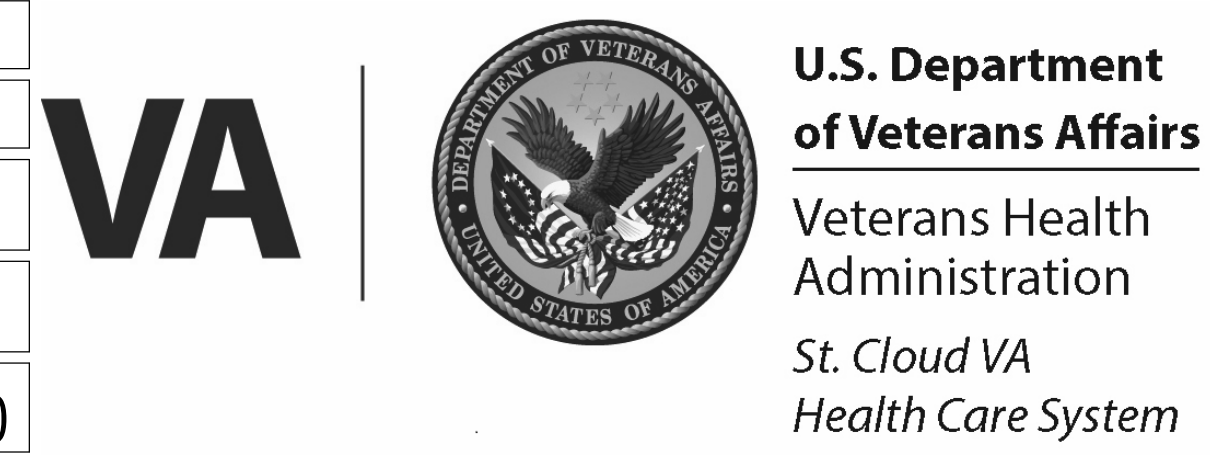

- GENERAL NOTES:**
- A. REFER TO SHEET ET.101 FOR LOCATION OF BUILDING ON CAMPUS.
 - B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE INACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
 - C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
 - D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
 - E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
 - F. CONTRACTOR RESPONSIBLE FOR PROVIDING REPLACEMENT CEILING TILES AFTER REMOVAL OF SPEAKERS. REPLACE CEILING TILE TO MATCH EXISTING ADJACENT CEILING TILE.
 - G. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
 - H. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
 - I. REPAIR OF EXISTING PAINTED AND FINISHED SURFACES: CLEAN, PATCH AND REPAIR EXISTING SURFACES DAMAGED OR ALTERED BY THIS WORK. NO "TELEGRAPHING" OF LINES, RIDGES, FLAKES, ETC. THROUGH NEW SURFACING IS PERMITTED. WHERE THIS OCCURS, SAND SMOOTH AND RE-FINISH UNTIL SURFACE MEETS COR'S APPROVAL. IN EXISTING ROOM OR AREAS WHERE ALTERATIONS BETWEEN NEW AND EXISTING FINISH WILL NOT SHOW IN FINISHED WORK, APPLY ONE (1) PRIME AND TWO (2) FINISH COATS OF PAINT TO MATCH ADJACENT SURFACES AND FINISHES.
 - J. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.




1 BUILDING 11 - PAGING SPEAKER DEMOLITION FLOOR PLAN - BASEMENT
1/4" = 1'-0"

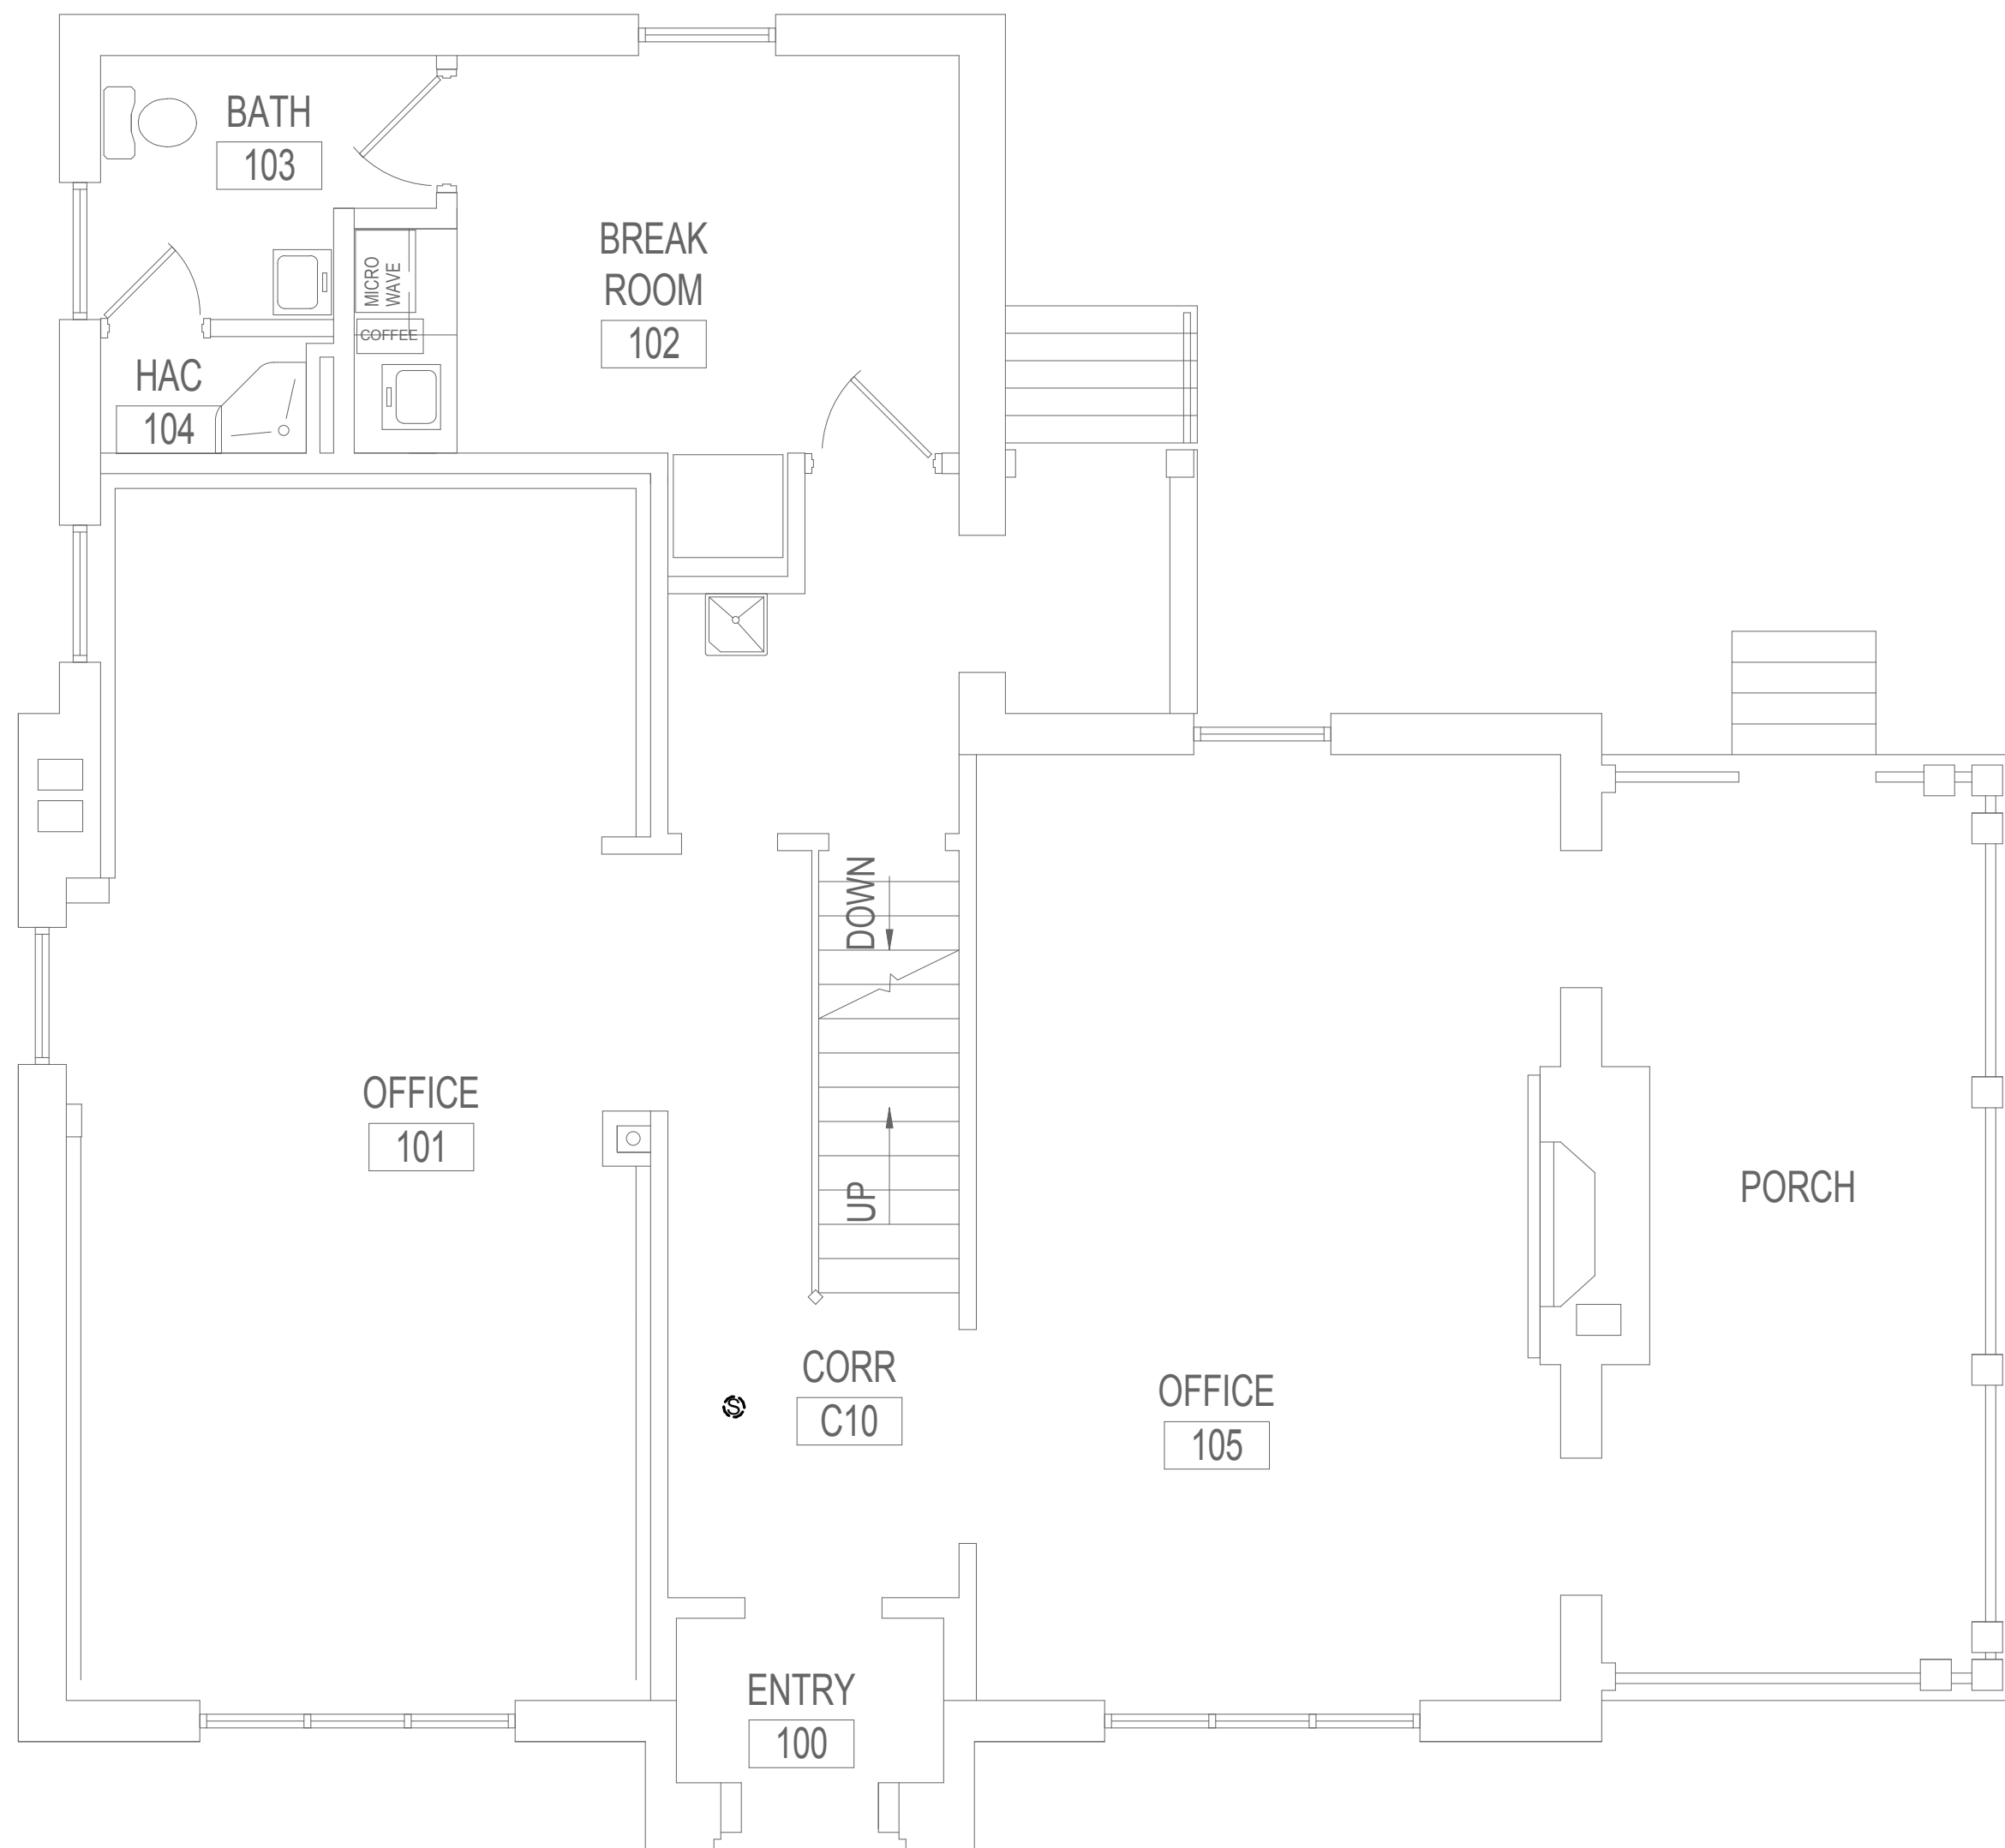

2 BUILDING 11 - PAGING SPEAKER DEMOLITION FLOOR PLAN - FIRST FLOOR
1/4" = 1'-0"

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com
AE PROJECT NUMBER: Project Number

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:


DRAWING TITLE BUILDING 11 - PAGING SPEAKER DEMOLITION FLOOR PLAN - BASEMENT, FIRST & SECOND FLOORS	DATE:
APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR	DATE:
APPROVED: CHIEF OF STAFF	DATE:
APPROVED: HEALTH CARE SYSTEM DIRECTOR	DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM	PROJECT NO.:
BUILDING No.:	CHECKED BY: CP
DATE:	DRAWN: CG
ISSUE DATE: 1/24/19	DRAWING NO. ED11-00
LOCATION: VA MEDICAL CENTER ST. CLOUD, MN 56303	DATE:



GENERAL NOTES:

- A. REFER TO SHEET ET.101 FOR LOCATION OF BUILDING ON CAMPUS.
- B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE INACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
- C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
- D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
- E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
- F. CONTRACTOR RESPONSIBLE FOR PROVIDING REPLACEMENT CEILING TILES AFTER REMOVAL OF SPEAKERS. REPLACE CEILING TILE TO MATCH EXISTING ADJACENT CEILING TILE.
- G. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
- H. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
- I. REPAIR OF EXISTING PAINTED AND FINISHED SURFACES: CLEAN, PATCH AND REPAIR EXISTING SURFACES DAMAGED OR ALTERED BY THIS WORK. NO "TELEGRAPHING" OF LINES, RIDGES, FLAKES, ETC. THROUGH NEW SURFACING IS PERMITTED. WHERE THIS OCCURS, SAND SMOOTH AND RE-FINISH UNTIL SURFACE MEETS COR'S APPROVAL. IN EXISTING ROOM OR AREAS WHERE ALTERATIONS BETWEEN NEW AND EXISTING FINISH WILL NOT SHOW IN FINISHED WORK, APPLY ONE (1) PRIME AND TWO (2) FINISH COATS OF PAINT TO MATCH ADJACENT SURFACES AND FINISHES.
- J. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.

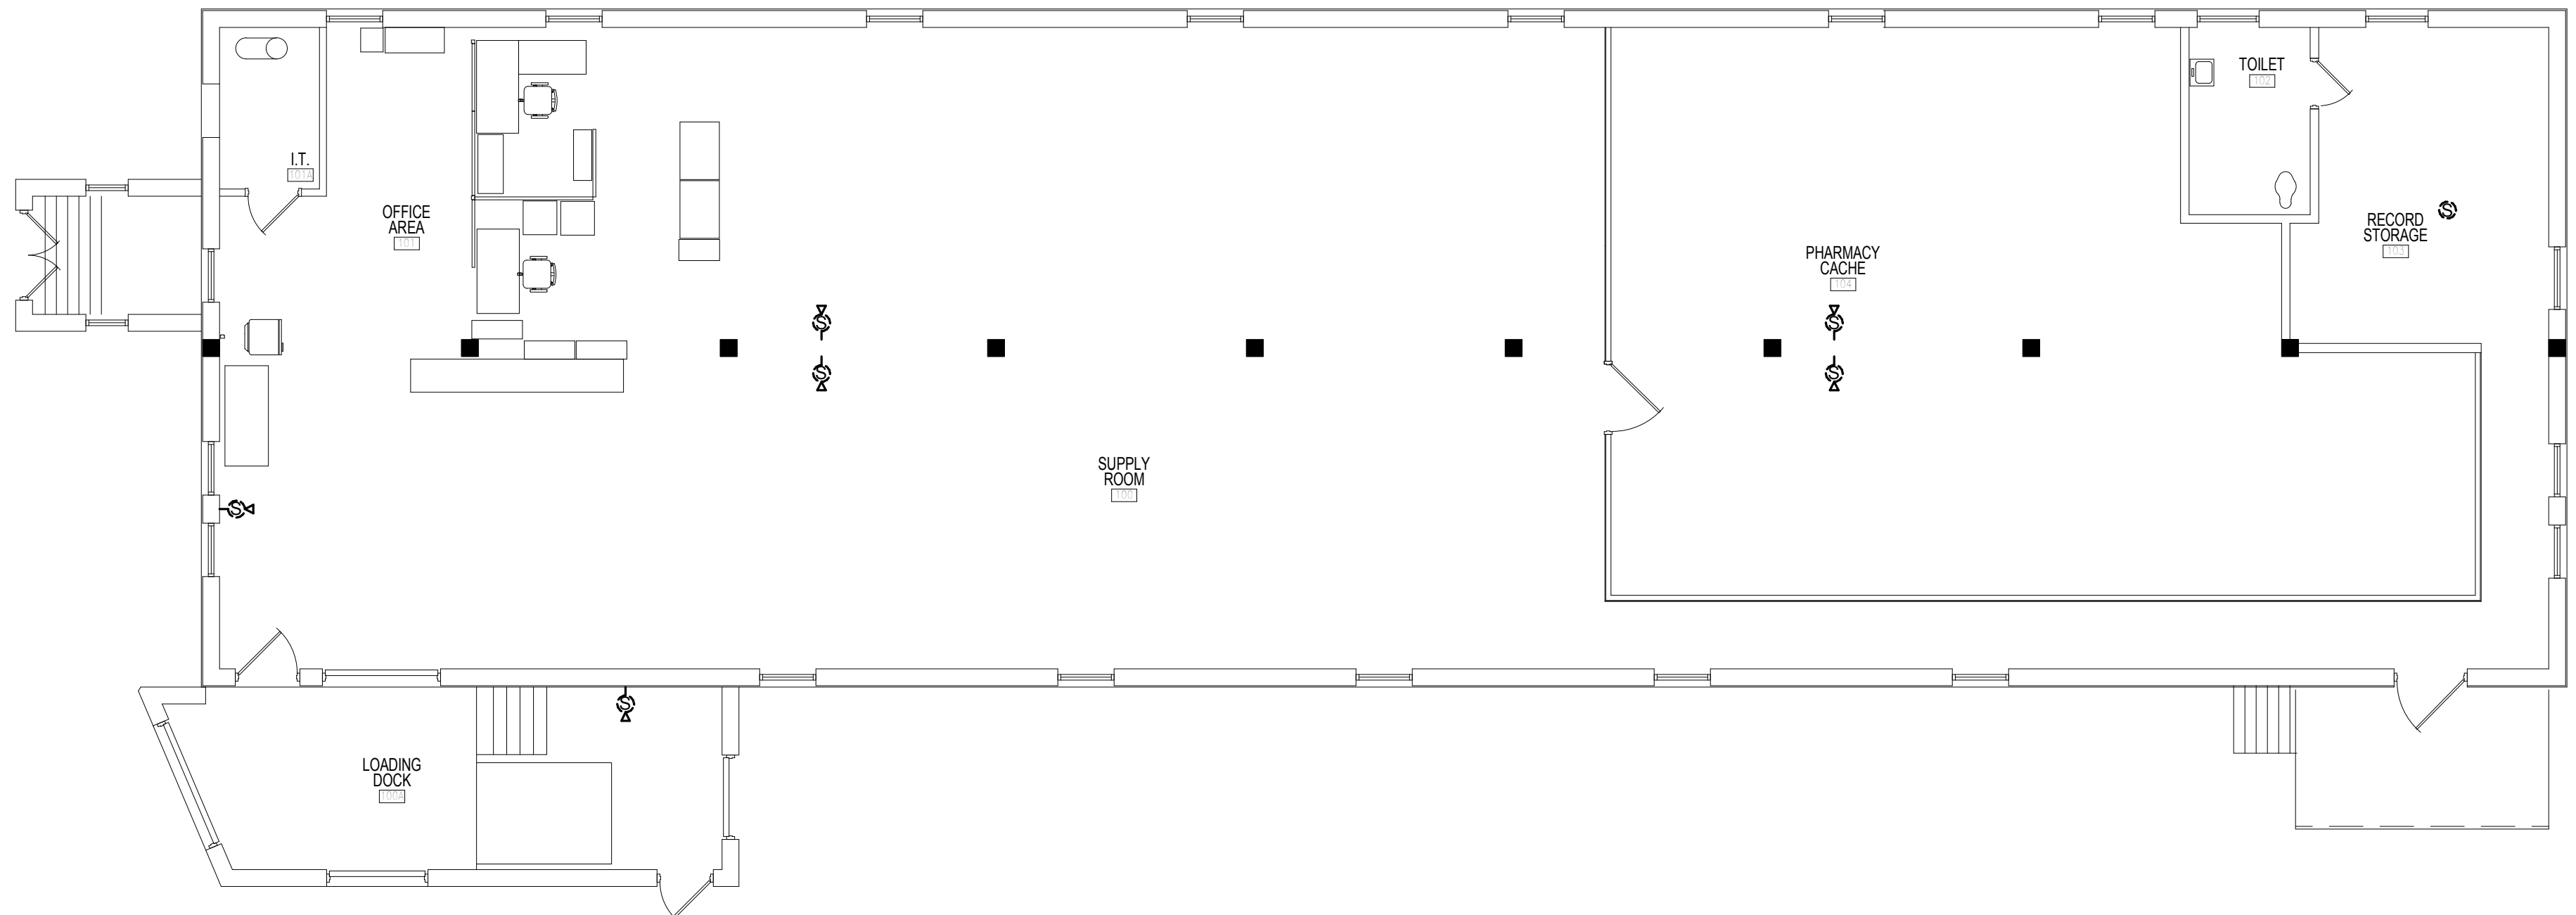

1 BUILDING 14 - PAGING SPEAKER FLOOR PLAN - FIRST FLOOR
1/8" = 1'-0"

C:\Revit\Projects\VA ST CLOUD\PAGING_Elec_R12.dwg 1/24/2019 1:20:38 PM

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE
BUILDING 14 - PAGING SPEAKER DEMOLITION FLOOR PLAN - FIRST FLOOR
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:
 APPROVED: CHIEF OF STAFF
 DATE:
 APPROVED: HEALTH CARE SYSTEM DIRECTOR
 DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PLOT SCALE	
PROJECT NO.		PROJECT NO.	
BUILDING No.	CHECKED BY	DRAWN	ISSUE DATE
	CP	CG	1/24/19
LOCATION	DATE	DRAWING NO.	
VA MEDICAL CENTER ST. CLOUD, MN 56303		ED14-01	

VA **U.S. Department of Veterans Affairs**
 Veterans Health Administration
 St. Cloud VA Health Care System

- GENERAL NOTES:**
- REFER TO SHEET ET-101 FOR LOCATION OF BUILDING ON CAMPUS.
 - A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE ACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
 - DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
 - MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
 - CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
 - CONTRACTOR RESPONSIBLE FOR PROVIDING REPLACEMENT CEILING TILES AFTER REMOVAL OF SPEAKERS. REPLACE CEILING TILE TO MATCH EXISTING ADJACENT CEILING TILE.
 - COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
 - REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
 - REPAIR OF EXISTING PAINTED AND FINISHED SURFACES: CLEAN, PATCH AND REPAIR EXISTING SURFACES DAMAGED OR ALTERED BY THIS WORK. NO "TELEGRAPHING" OF LINES, RIDGES, FLAKES, ETC., THROUGH NEW SURFACING IS PERMITTED. WHERE THIS OCCURS, SAND SMOOTH AND RE-FINISH UNTIL SURFACE MEETS COR'S APPROVAL. IN EXISTING ROOM OR AREAS WHERE ALTERATIONS BETWEEN NEW AND EXISTING FINISH WILL NOT SHOW IN FINISHED WORK, APPLY ONE (1) PRIME AND TWO (2) FINISH COATS OF PAINT TO MATCH ADJACENT SURFACES AND FINISHES.
 - REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.

- KEY NOTES:**
- ◇ DEMOLISH EXISTING PUBLIC ADDRESS SYSTEM CABLING, CONNECTIVITY AND ENSURE REMOVE 100% BACK TO SOURCE. REMOVE AND RETURN PUBLIC ADDRESS SYSTEM AMPLIFIER(S) AND NETWORK SWITCH TO OWNER. REMOVAL OF EXISTING SYSTEM SHALL OCCUR AFTER THE NEW PUBLIC ADDRESS SYSTEM IS INSTALLED AND TESTED PER PROJECT REQUIREMENTS.
 - ◇ SALVAGE AND REINSTALL. REMOVE PUBLIC ADDRESS SYSTEM NETWORK SWITCH AND ASSOCIATED COMPONENTS. RETURN TO OWNER. REMOVAL OF EQUIPMENT SHALL OCCUR AFTER THE NEW PUBLIC ADDRESS SYSTEM IS INSTALLED AND TESTED PER PROJECT REQUIREMENTS.



1 BUILDING 28 - PAGING SPEAKER DEMOLITION FLOOR PLAN - BASEMENT
1/8" = 1'-0"

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)
DUNHAM
50 South Sixth Street / Suite 1100
Minneapolis, Minnesota 55402-1540
Phone: 612-465-7550 Fax: 612-465-7551
www.dunhaminc.com
mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD
ANDERSON ENGINEERING
ENGINEERING • ARCHITECTURE • LAND SURVEYING
ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
Anderson Engineering of Minnesota, LLC
13605 1st Avenue North
Suite 100
Plymouth, MN 55441
763-412-4000 (o) 763-412-4090 (f)
www.ae-mn.com
AE PROJECT NUMBER: Project Number

STAMP
I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
Signature: *Chris M. Pilliod*
Name: Chris M. Pilliod, P.E.
Date: 1/24/19
Registration Number: 50826


APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE BUILDING 28 - PAGING SPEAKER DEMOLITION FLOOR PLAN - BASEMENT	
APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR	
DATE:	
APPROVED: CHIEF OF STAFF	DATE:
APPROVED: HEALTH CARE SYSTEM DIRECTOR	
DATE:	

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PROJECT NO.:	
BUILDING No.:	CHECKED BY:	DRAWN:	ISSUE DATE:
CP	CG	CG	1/24/19
LOCATION VA MEDICAL CENTER ST. CLOUD, MN 56303		DATE:	DRAWING NO. ED28-00

VA U.S. Department of Veterans Affairs
Veterans Health Administration
St. Cloud VA Health Care System

C:\Revit\Projects\VA ST CLOUD PAGING_Elec_R1E.dwg 1/24/2019 1:20:38 PM

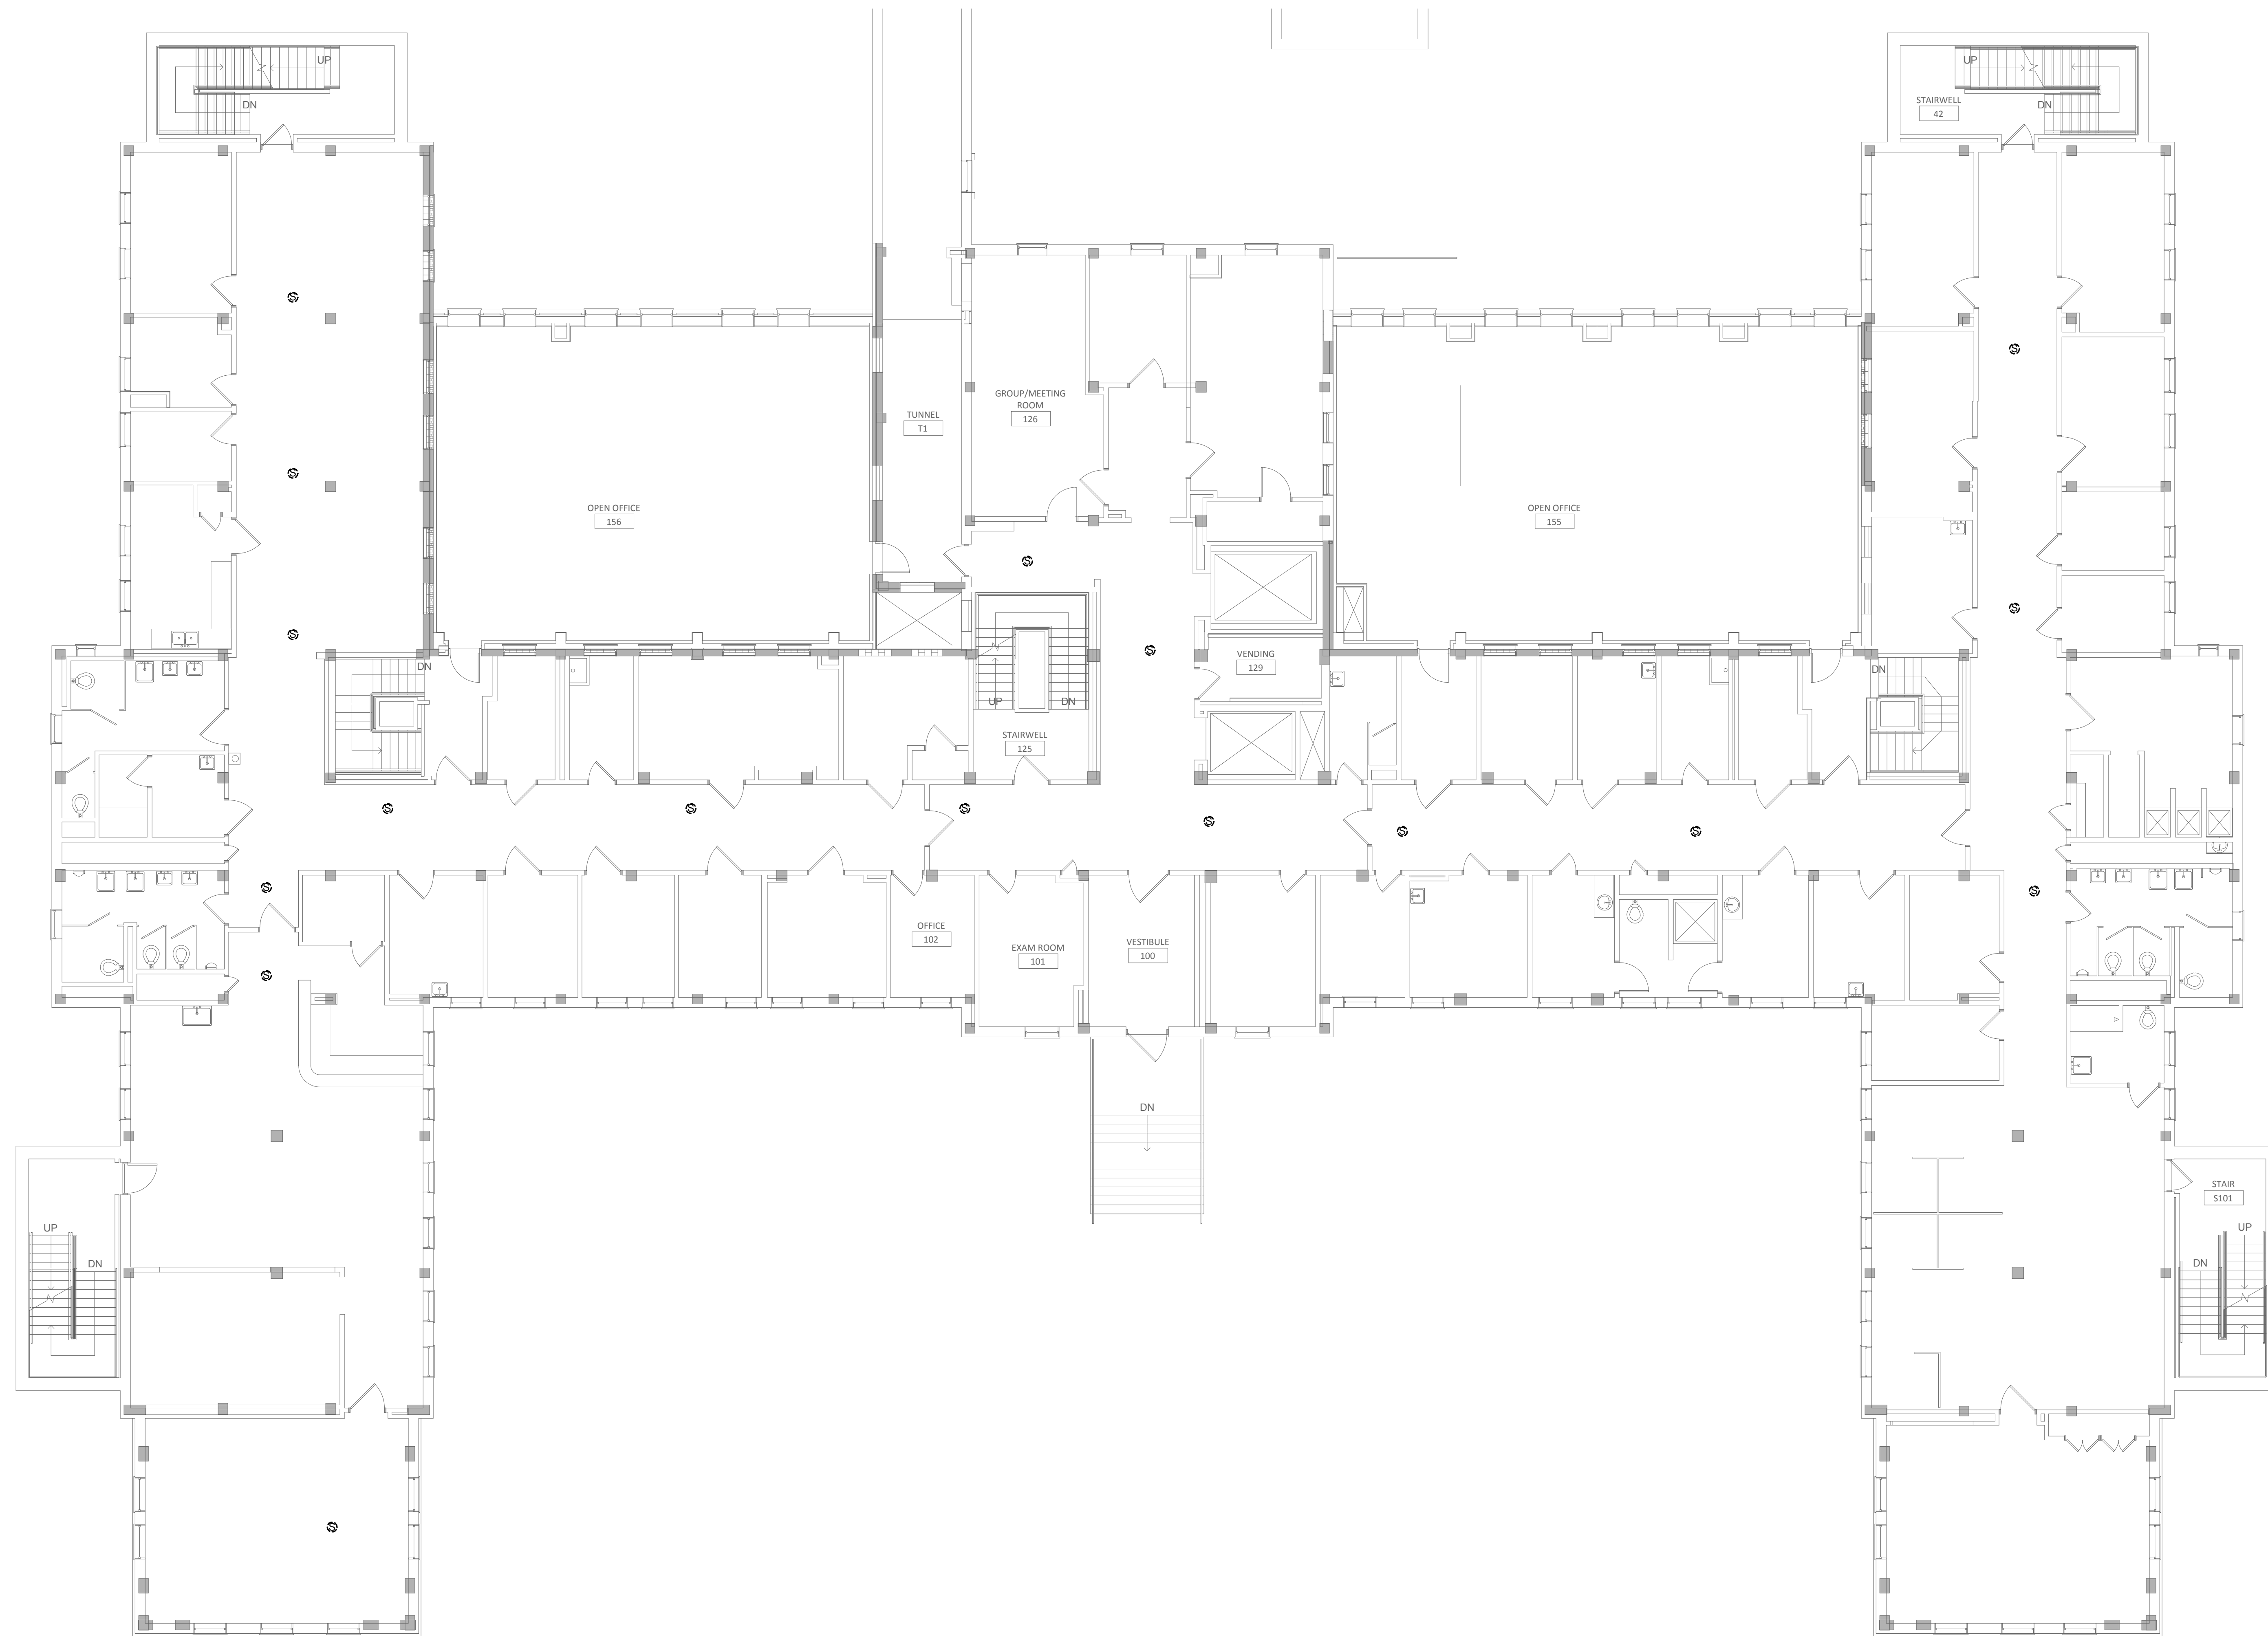

- GENERAL NOTES:**
- A. REFER TO SHEET ET.101 FOR LOCATION OF BUILDING ON CAMPUS.
 - B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE INACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
 - C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
 - D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
 - E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
 - F. CONTRACTOR RESPONSIBLE FOR PROVIDING REPLACEMENT CEILING TILES AFTER REMOVAL OF SPEAKERS. REPLACE CEILING TILE TO MATCH EXISTING ADJACENT CEILING TILE.
 - G. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
 - H. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
 - I. REPAIR OF EXISTING PAINTED AND FINISHED SURFACES: CLEAN, PATCH AND REPAIR EXISTING SURFACES DAMAGED OR ALTERED BY THIS WORK. NO "TELEGRAPHING" OF LINES, RIDGES, FLAKES, ETC. THROUGH NEW SURFACING IS PERMITTED. WHERE THIS OCCURS, SAND SMOOTH AND RE-FINISH UNTIL SURFACE MEETS COR'S APPROVAL. IN EXISTING ROOM OR AREAS WHERE ALTERATIONS BETWEEN NEW AND EXISTING FINISH WILL NOT SHOW IN FINISHED WORK, APPLY ONE (1) PRIME AND TWO (2) FINISH COATS OF PAINT TO MATCH ADJACENT SURFACES AND FINISHES.
 - J. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.

1 BUILDING 28 - PAGING SPEAKER DEMOLITION FLOOR PLAN - FIRST FLOOR
1/8" = 1'-0"

C:\Revit\Projects\VA ST CLOUD PAGING_Elec_R12.dwg 1/24/2019 1:20:38 PM

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com


STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Piliod*
 Name: Chris M. Piliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE
BUILDING 28 - PAGING SPEAKER DEMOLITION FLOOR PLAN - FIRST FLOOR
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:
 APPROVED: CHIEF OF STAFF
 DATE:
 APPROVED: HEALTH CARE SYSTEM DIRECTOR
 DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PLOT SCALE	
PROJECT NO.		PROJECT NO.	
BUILDING No.	CHECKED BY	DRAWN	ISSUE DATE
	CP	CG	1/24/19
LOCATION	DATE	DRAWING NO.	
VA MEDICAL CENTER ST. CLOUD, MN 56303		ED28-01	

VA **U.S. Department of Veterans Affairs**
 Veterans Health Administration
 St. Cloud VA Health Care System

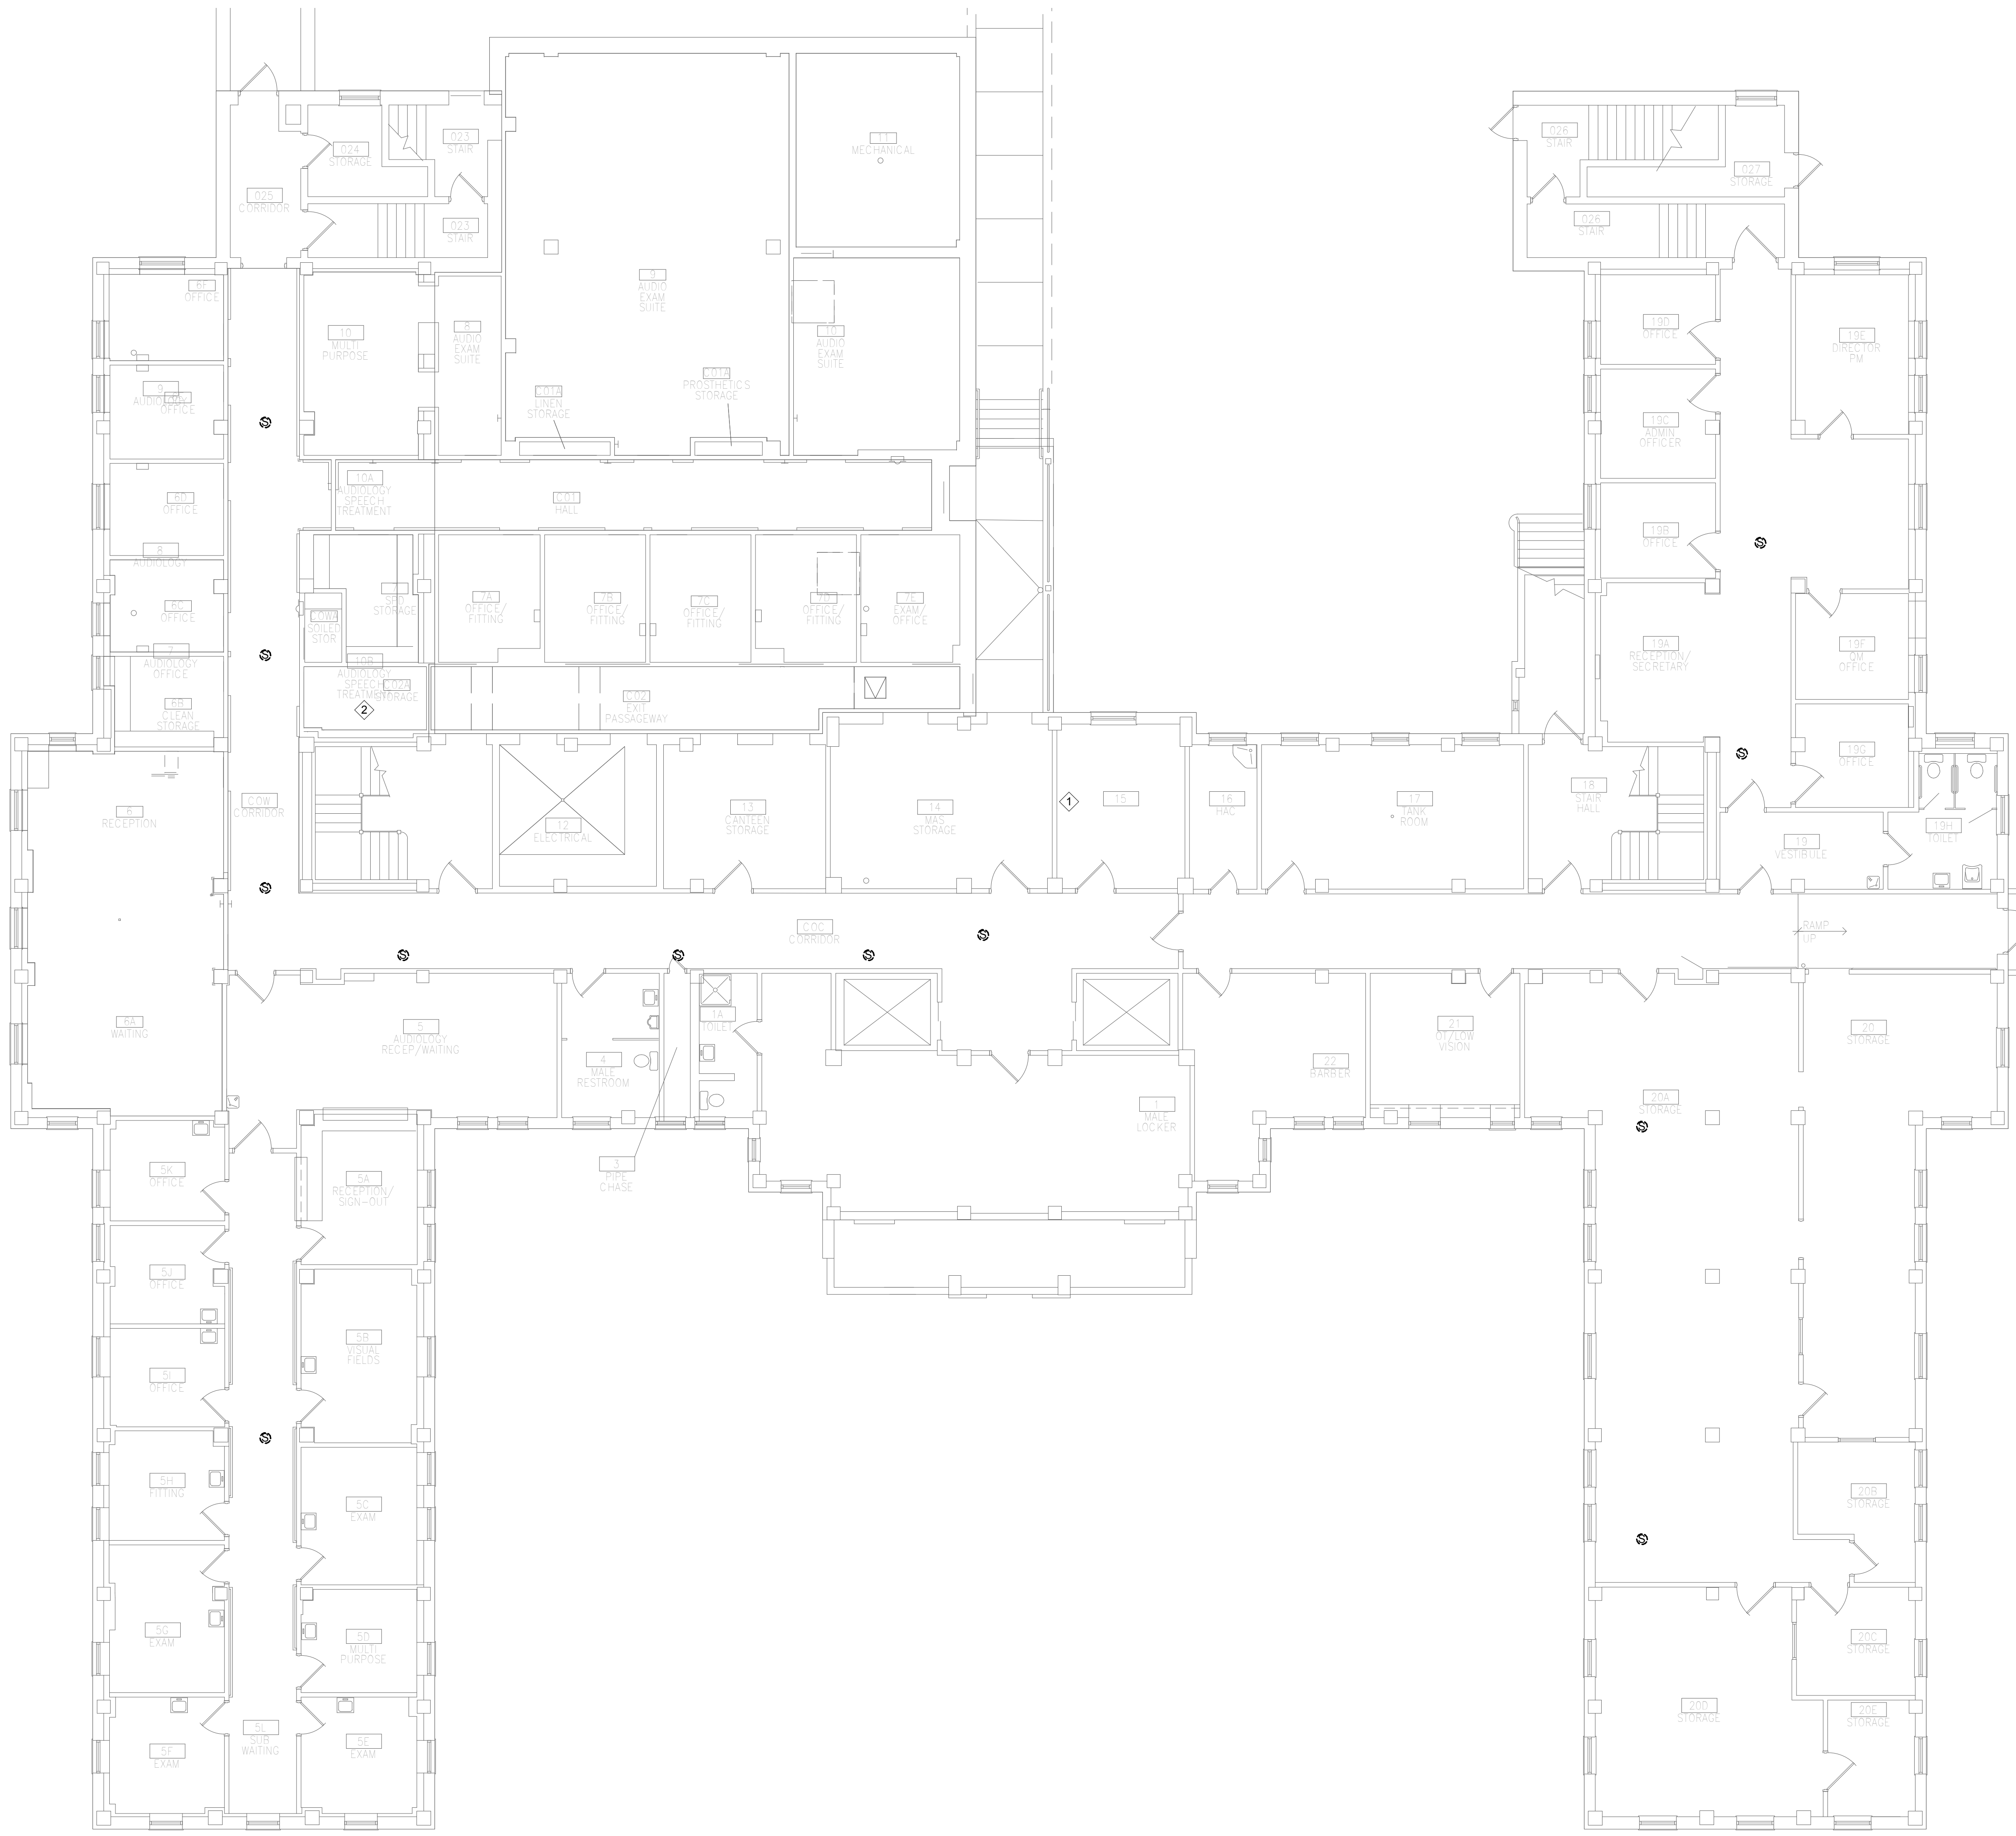

GENERAL NOTES:

- A. REFER TO SHEET ET.101 FOR LOCATION OF BUILDING ON CAMPUS.
- B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE INACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
- C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
- D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
- E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
- F. CONTRACTOR RESPONSIBLE FOR PROVIDING REPLACEMENT CEILING TILES AFTER REMOVAL OF SPEAKERS. REPLACE CEILING TILE TO MATCH EXISTING ADJACENT CEILING TILE.
- G. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
- H. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
- I. REPAIR OF EXISTING PAINTED AND FINISHED SURFACES: CLEAN, PATCH AND REPAIR EXISTING SURFACES DAMAGED OR ALTERED BY THIS WORK. NO "TELEGRAPHING" OF LINES, RIDGES, FLAKES, ETC. THROUGH NEW SURFACING IS PERMITTED. WHERE THIS OCCURS, SAND SMOOTH AND RE-FINISH UNTIL SURFACE MEETS COR'S APPROVAL. IN EXISTING ROOM OR AREAS WHERE ALTERATIONS BETWEEN NEW AND EXISTING FINISH WILL NOT SHOW IN FINISHED WORK, APPLY ONE (1) PRIME AND TWO (2) FINISH COATS OF PAINT TO MATCH ADJACENT SURFACES AND FINISHES.
- J. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.

KEY NOTES:

- ① DEMOLISH EXISTING PUBLIC ADDRESS SYSTEM CABLING, CONNECTIVITY AND ENCLOSURE. REMOVE 120VAC BACK TO SOURCE. REMOVE AND RETURN PUBLIC ADDRESS SYSTEM AMPLIFIER(S) TO OWNER. REMOVAL OF EXISTING SYSTEM SHALL OCCUR AFTER THE NEW PUBLIC ADDRESS SYSTEM IS INSTALLED AND TESTED PER PROJECT REQUIREMENTS.
- ② SALVAGE AND REINSTALL EXISTING PUBLIC ADDRESS SYSTEM NETWORK SWITCH AND ASSOCIATED COMPONENTS. RETURN TO OWNER. REMOVAL OF EQUIPMENT SHALL OCCUR AFTER THE NEW PUBLIC ADDRESS SYSTEM IS INSTALLED AND TESTED PER PROJECT REQUIREMENTS.

1 BUILDING 29 - PAGING SPEAKER DEMOLITION FLOOR PLAN - BASEMENT
1/8" = 1'-0"

C:\Revit\Projects\VA ST CLOUD PAGING_Bldg_R12.dwg 1/24/2019 1:26:38 PM

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com


STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE BUILDING 29 - PAGING SPEAKER DEMOLITION FLOOR PLAN - BASEMENT	DATE:
APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR	DATE:
APPROVED: CHIEF OF STAFF	DATE:
APPROVED: HEALTH CARE SYSTEM DIRECTOR	DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM	PROJECT NO.:
BUILDING NO.:	CHECKED BY: CP
DATE:	DRAWN: CG
ISSUE DATE: 1/24/19	DRAWING NO. ED29-00
LOCATION: VA MEDICAL CENTER ST. CLOUD, MN 56303	DATE:

VA
U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

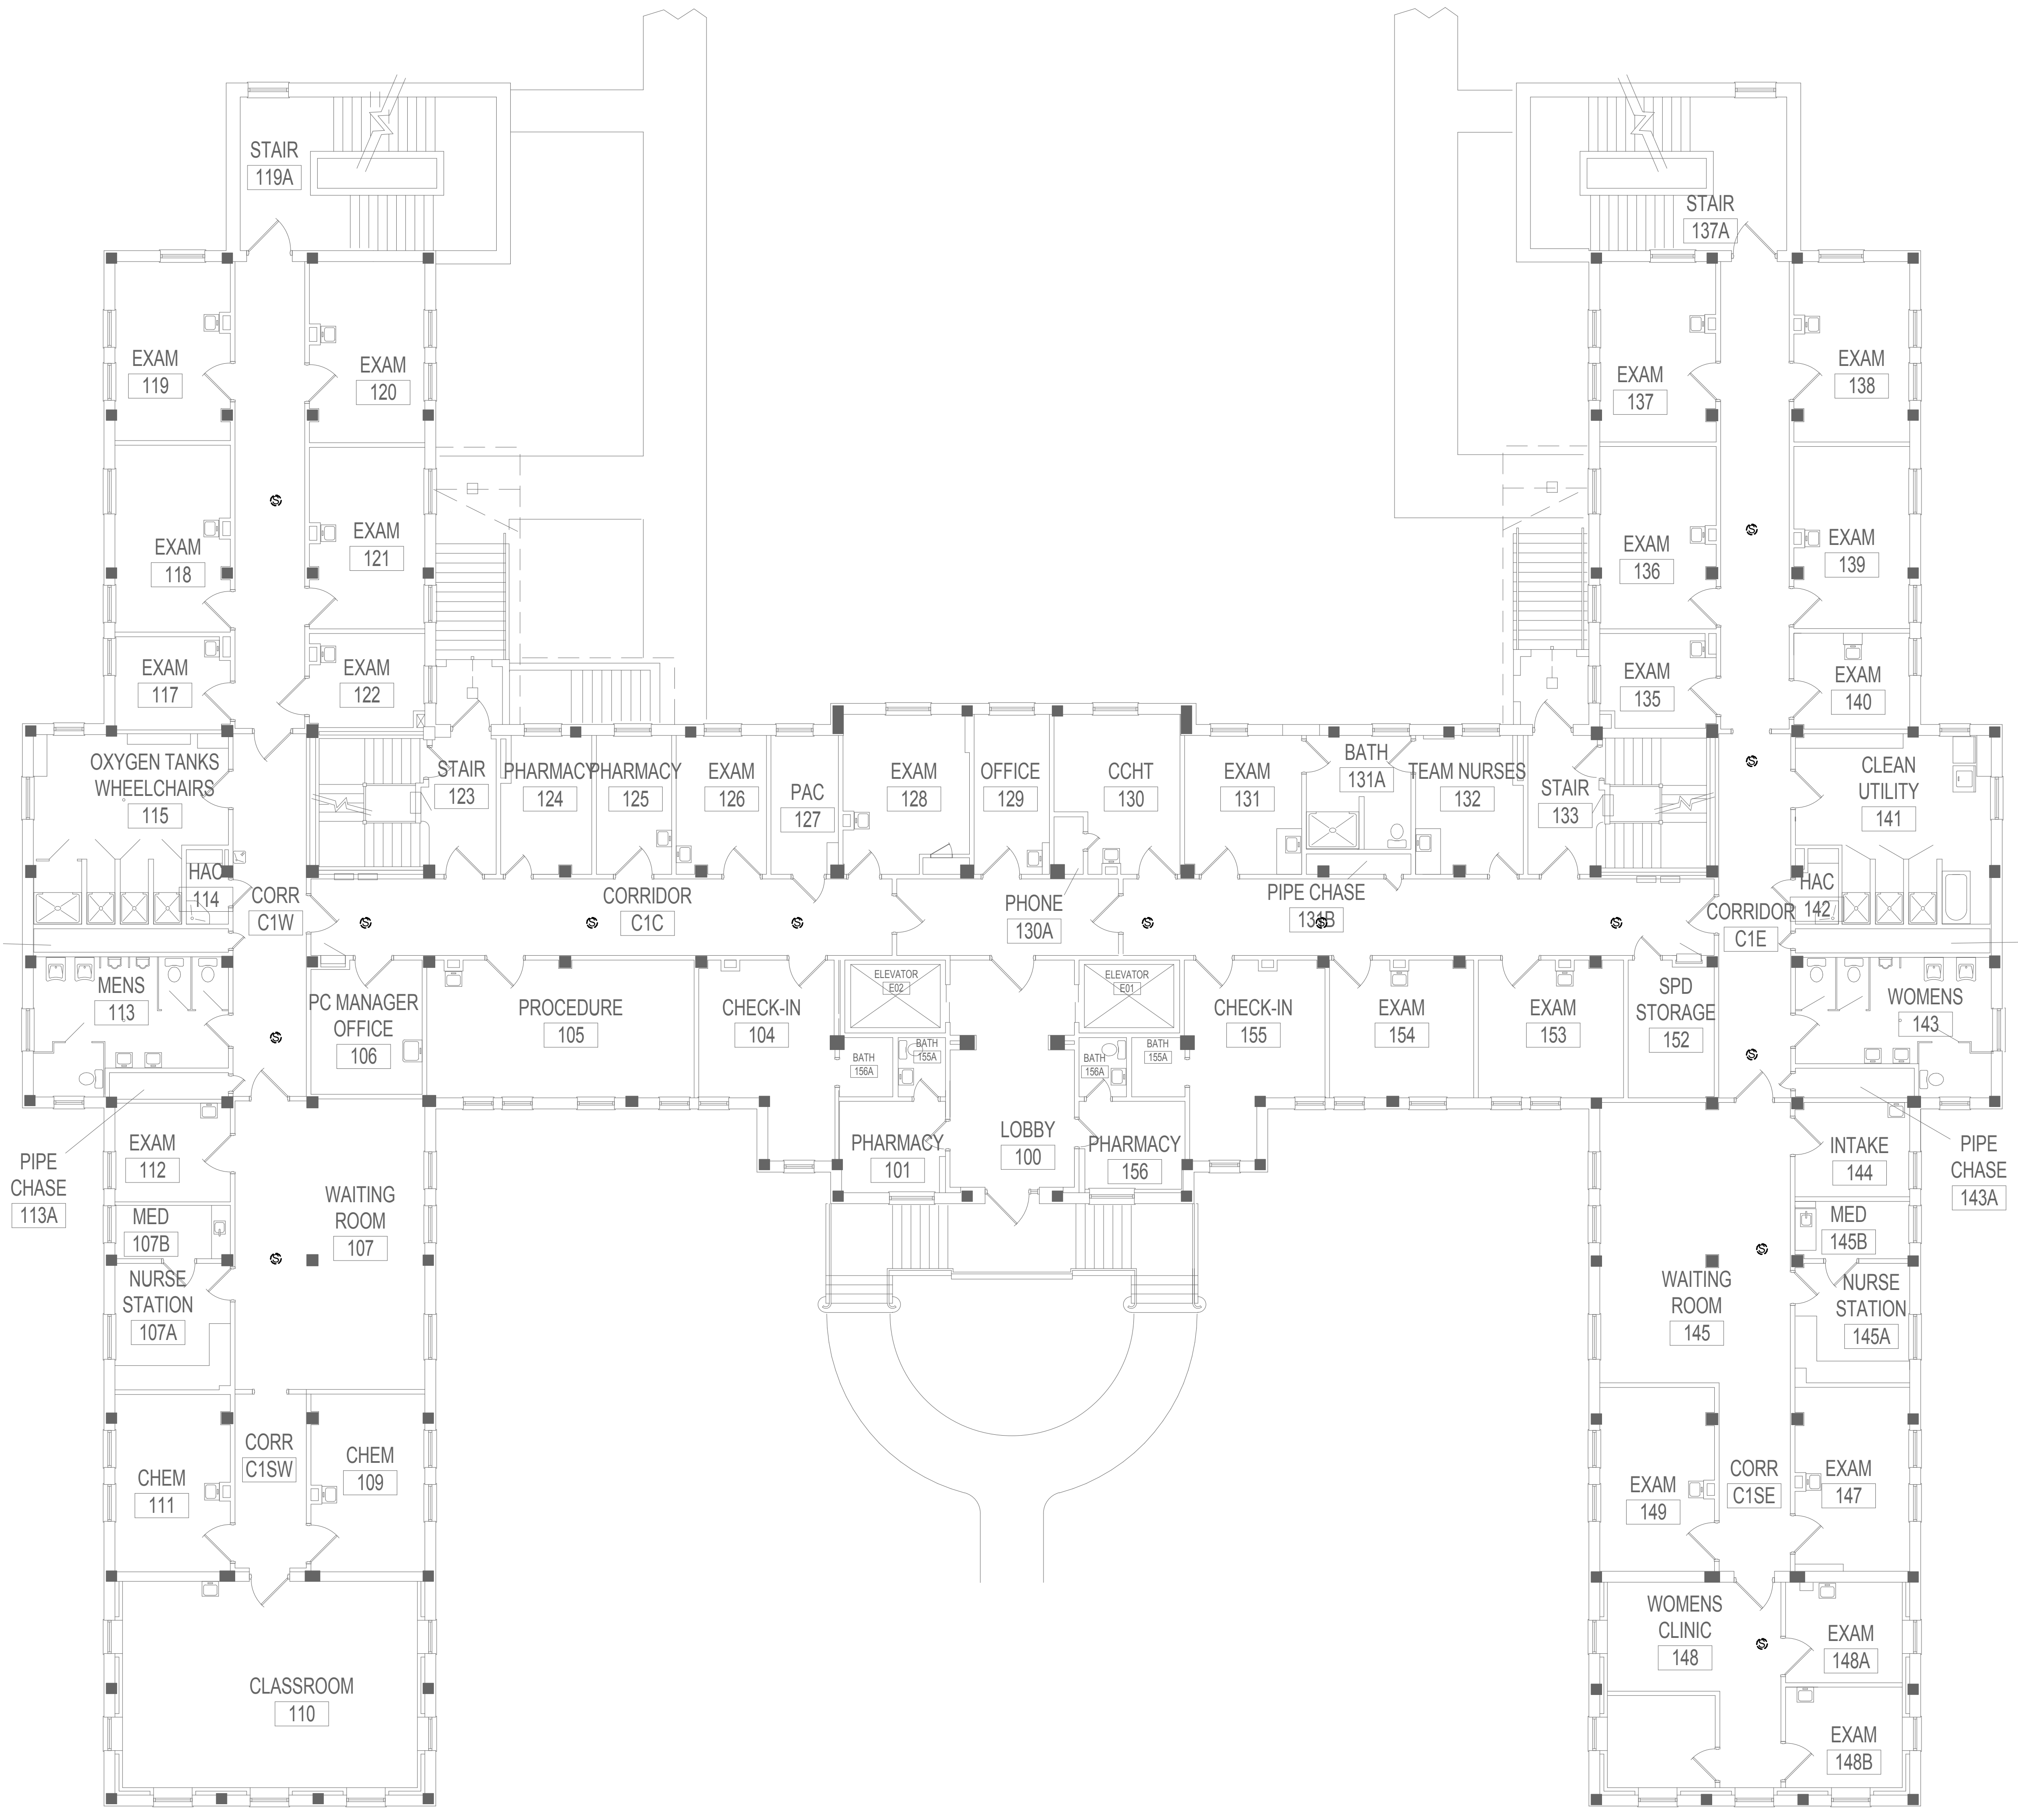

- GENERAL NOTES:**
- A. REFER TO SHEET ET.101 FOR LOCATION OF BUILDING ON CAMPUS.
 - B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE UNACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
 - C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
 - D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
 - E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
 - F. CONTRACTOR RESPONSIBLE FOR PROVIDING REPLACEMENT CEILING TILES AFTER REMOVAL OF SPEAKERS. REPLACE CEILING TILE TO MATCH EXISTING ADJACENT CEILING TILE.
 - G. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
 - H. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
 - I. REPAIR OF EXISTING PAINTED AND FINISHED SURFACES: CLEAN, PATCH AND REPAIR EXISTING SURFACES DAMAGED OR ALTERED BY THIS WORK. NO "TELEGRAPHING" OF LINES, RIDGES, FLAKES, ETC. THROUGH NEW SURFACING IS PERMITTED. WHERE THIS OCCURS, SAND SMOOTH AND RE-FINISH UNTIL SURFACE MEETS COR'S APPROVAL. IN EXISTING ROOM OR AREAS WHERE ALTERATIONS BETWEEN NEW AND EXISTING FINISH WILL NOT SHOW IN FINISHED WORK, APPLY ONE (1) PRIME AND TWO (2) FINISH COATS OF PAINT TO MATCH ADJACENT SURFACES AND FINISHES.
 - J. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.

1 BUILDING 29 - PAGING SPEAKER DEMOLITION FLOOR PLAN - FIRST FLOOR
1/8" = 1'-0"

1/24/2019 1:26:37 PM
C:\Revit\Projects\VA ST CL CLD\CLD_PAGING_Elec_R12.dwg.rvt

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com


STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilioud*
 Name: Chris M. Pilioud, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE BUILDING 29 - PAGING SPEAKER DEMOLITION FLOOR PLAN - FIRST FLOOR	PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM
APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR	DATE:
APPROVED: CHIEF OF STAFF	DATE:
APPROVED: HEALTH CARE SYSTEM DIRECTOR	DATE:

BUILDING NO.	CHECKED BY	DRAWN	ISSUE DATE
	CP	CG	1/24/19
LOCATION VA MEDICAL CENTER ST. CLOUD, MN 56303	DATE	DRAWING NO.	ED29-01

VA
U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

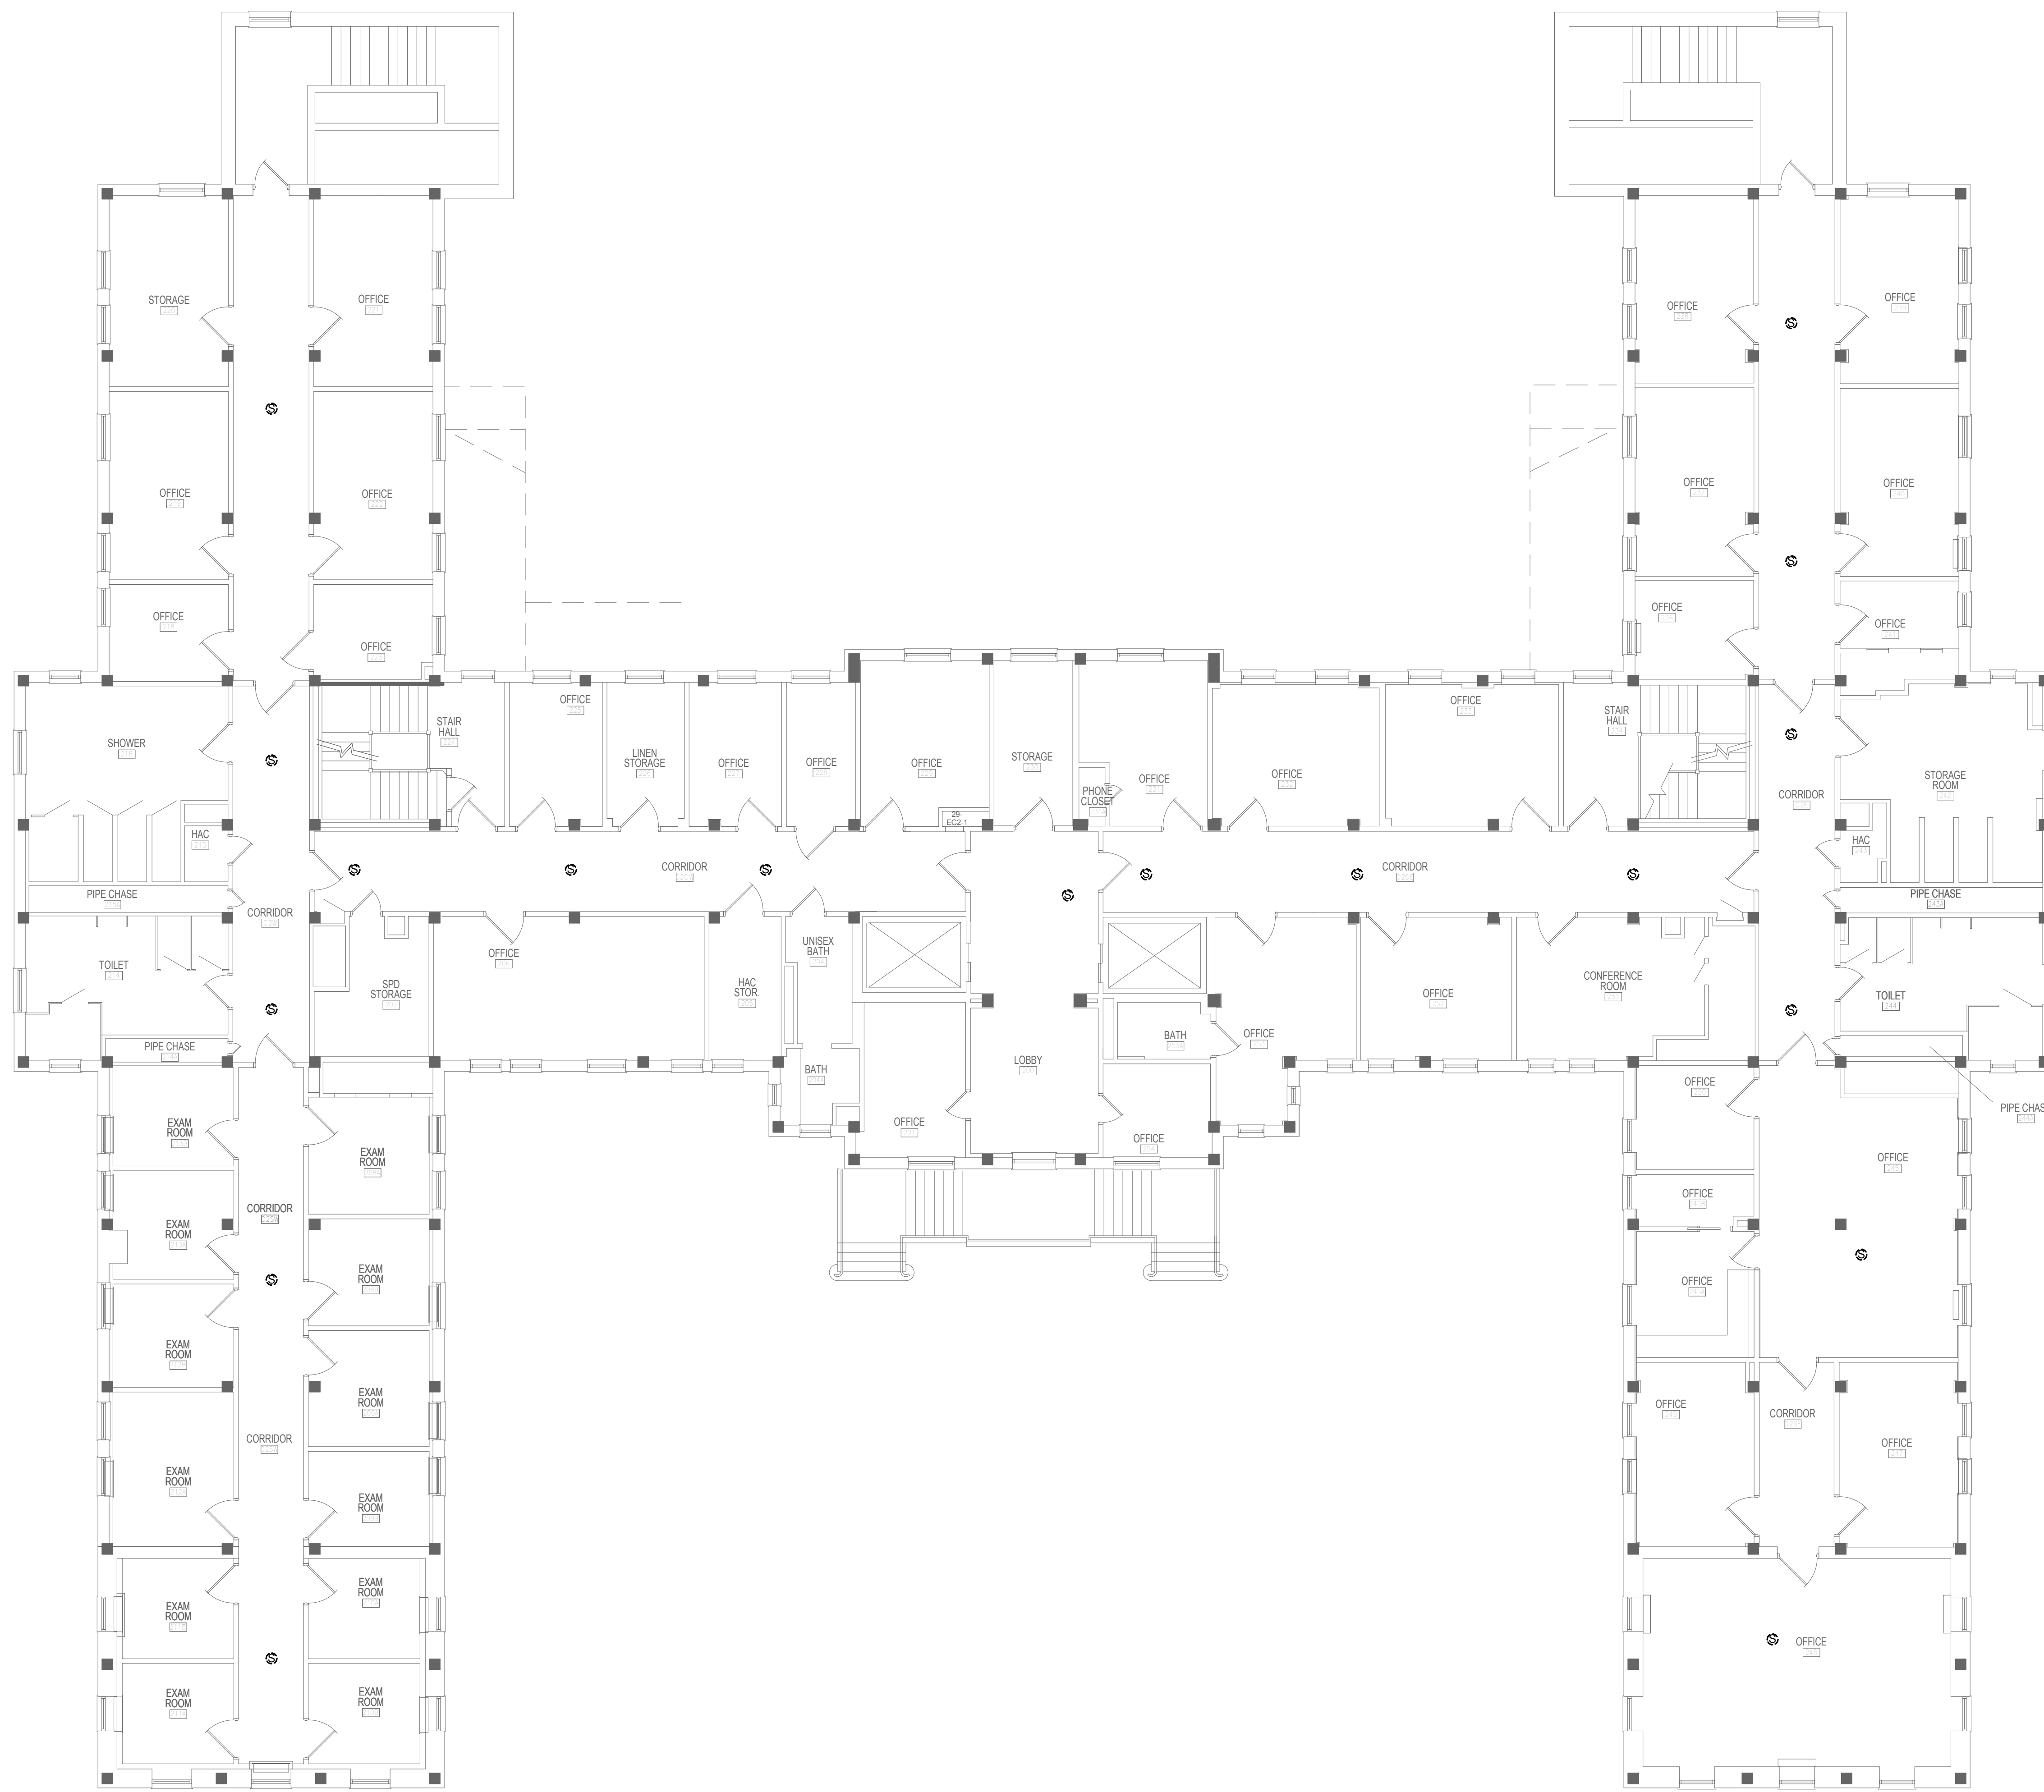

- GENERAL NOTES:**
- A. REFER TO SHEET ET.101 FOR LOCATION OF BUILDING ON CAMPUS.
 - B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE INACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
 - C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
 - D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
 - E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
 - F. CONTRACTOR RESPONSIBLE FOR PROVIDING REPLACEMENT CEILING TILES AFTER REMOVAL OF SPEAKERS. REPLACE CEILING TILE TO MATCH EXISTING ADJACENT CEILING TILE.
 - G. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
 - H. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
 - I. REPAIR OF EXISTING PAINTED AND FINISHED SURFACES: CLEAN, PATCH AND REPAIR EXISTING SURFACES DAMAGED OR ALTERED BY THIS WORK. NO "TELEGRAPHING" OF LINES, RIDGES, FLAKES, ETC. THROUGH NEW SURFACING IS PERMITTED. WHERE THIS OCCURS, SAND SMOOTH AND RE-FINISH UNTIL SURFACE MEETS COR'S APPROVAL. IN EXISTING ROOM OR AREAS WHERE ALTERATIONS BETWEEN NEW AND EXISTING FINISH WILL NOT SHOW IN FINISHED WORK, APPLY ONE (1) PRIME AND TWO (2) FINISH COATS OF PAINT TO MATCH ADJACENT SURFACES AND FINISHES.
 - J. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.

1 BUILDING 29 - PAGING SPEAKER DEMOLITION FLOOR PLAN - SECOND FLOOR
1/8" = 1'-0"

C:\Revit\Projects\VA ST CLCLOUD PAGING_Elec_R12.dwg 1/24/2019 1:20:38 PM

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:


DRAWING TITLE BUILDING 29 - PAGING SPEAKER DEMOLITION FLOOR PLAN - SECOND FLOOR	DATE:
APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR	DATE:
APPROVED: CHIEF OF STAFF	DATE:
APPROVED: HEALTH CARE SYSTEM DIRECTOR	DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM	PROJECT NO.:
BUILDING No.:	CHECKED BY: CP
DATE:	CG
ISSUE DATE: 1/24/19	DRAWING NO. ED29-02
LOCATION: VA MEDICAL CENTER ST. CLOUD, MN 56303	DATE:

VA
U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

- GENERAL NOTES:**
- A. REFER TO SHEET ET-101 FOR LOCATION OF BUILDING ON CAMPUS.
 - B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE, INACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
 - C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
 - D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
 - E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
 - F. CONTRACTOR RESPONSIBLE FOR PROVIDING REPLACEMENT CEILING TILES AFTER REMOVAL OF SPEAKERS. REPLACE CEILING TILE TO MATCH EXISTING ADJACENT CEILING TILE.
 - G. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
 - H. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
 - I. REPAIR OF EXISTING PAINTED AND FINISHED SURFACES: CLEAN, PATCH AND REPAIR EXISTING SURFACES DAMAGED OR ALTERED BY THIS WORK. NO "TELEGRAPHING" OF LINES, RIDGES, FLAKES, ETC., THROUGH NEW SURFACING IS PERMITTED. WHERE THIS OCCURS, SAND SMOOTH AND RE-FINISH UNTIL SURFACE MEETS COR'S APPROVAL. IN EXISTING ROOM OR AREAS WHERE ALTERATIONS BETWEEN NEW AND EXISTING FINISH WILL NOT SHOW IN FINISHED WORK, APPLY ONE (1) PRIME AND TWO (2) FINISH COATS OF PAINT TO MATCH ADJACENT SURFACES AND FINISHES.
 - J. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.

- KEY NOTES:**
- 1. DEMOLISH EXISTING PUBLIC ADDRESS SYSTEM CABLING, CONNECTIVITY AND ENSURE REMOVE 120VAC BACK TO SOURCE. REMOVE AND RETURN PUBLIC ADDRESS SYSTEM AMPLIFIER(S) TO OWNER. REMOVAL OF EXISTING SYSTEM SHALL OCCUR AFTER THE NEW PUBLIC ADDRESS SYSTEM IS INSTALLED AND TESTED PER PROJECT REQUIREMENTS.
 - 2. SALVAGE AND REINSTALL. REMOVE PUBLIC ADDRESS SYSTEM NETWORK SWITCH AND ASSOCIATED COMPONENTS. RETURN TO OWNER. REMOVAL OF EQUIPMENT SHALL OCCUR AFTER THE NEW PUBLIC ADDRESS SYSTEM IS INSTALLED AND TESTED PER PROJECT REQUIREMENTS.

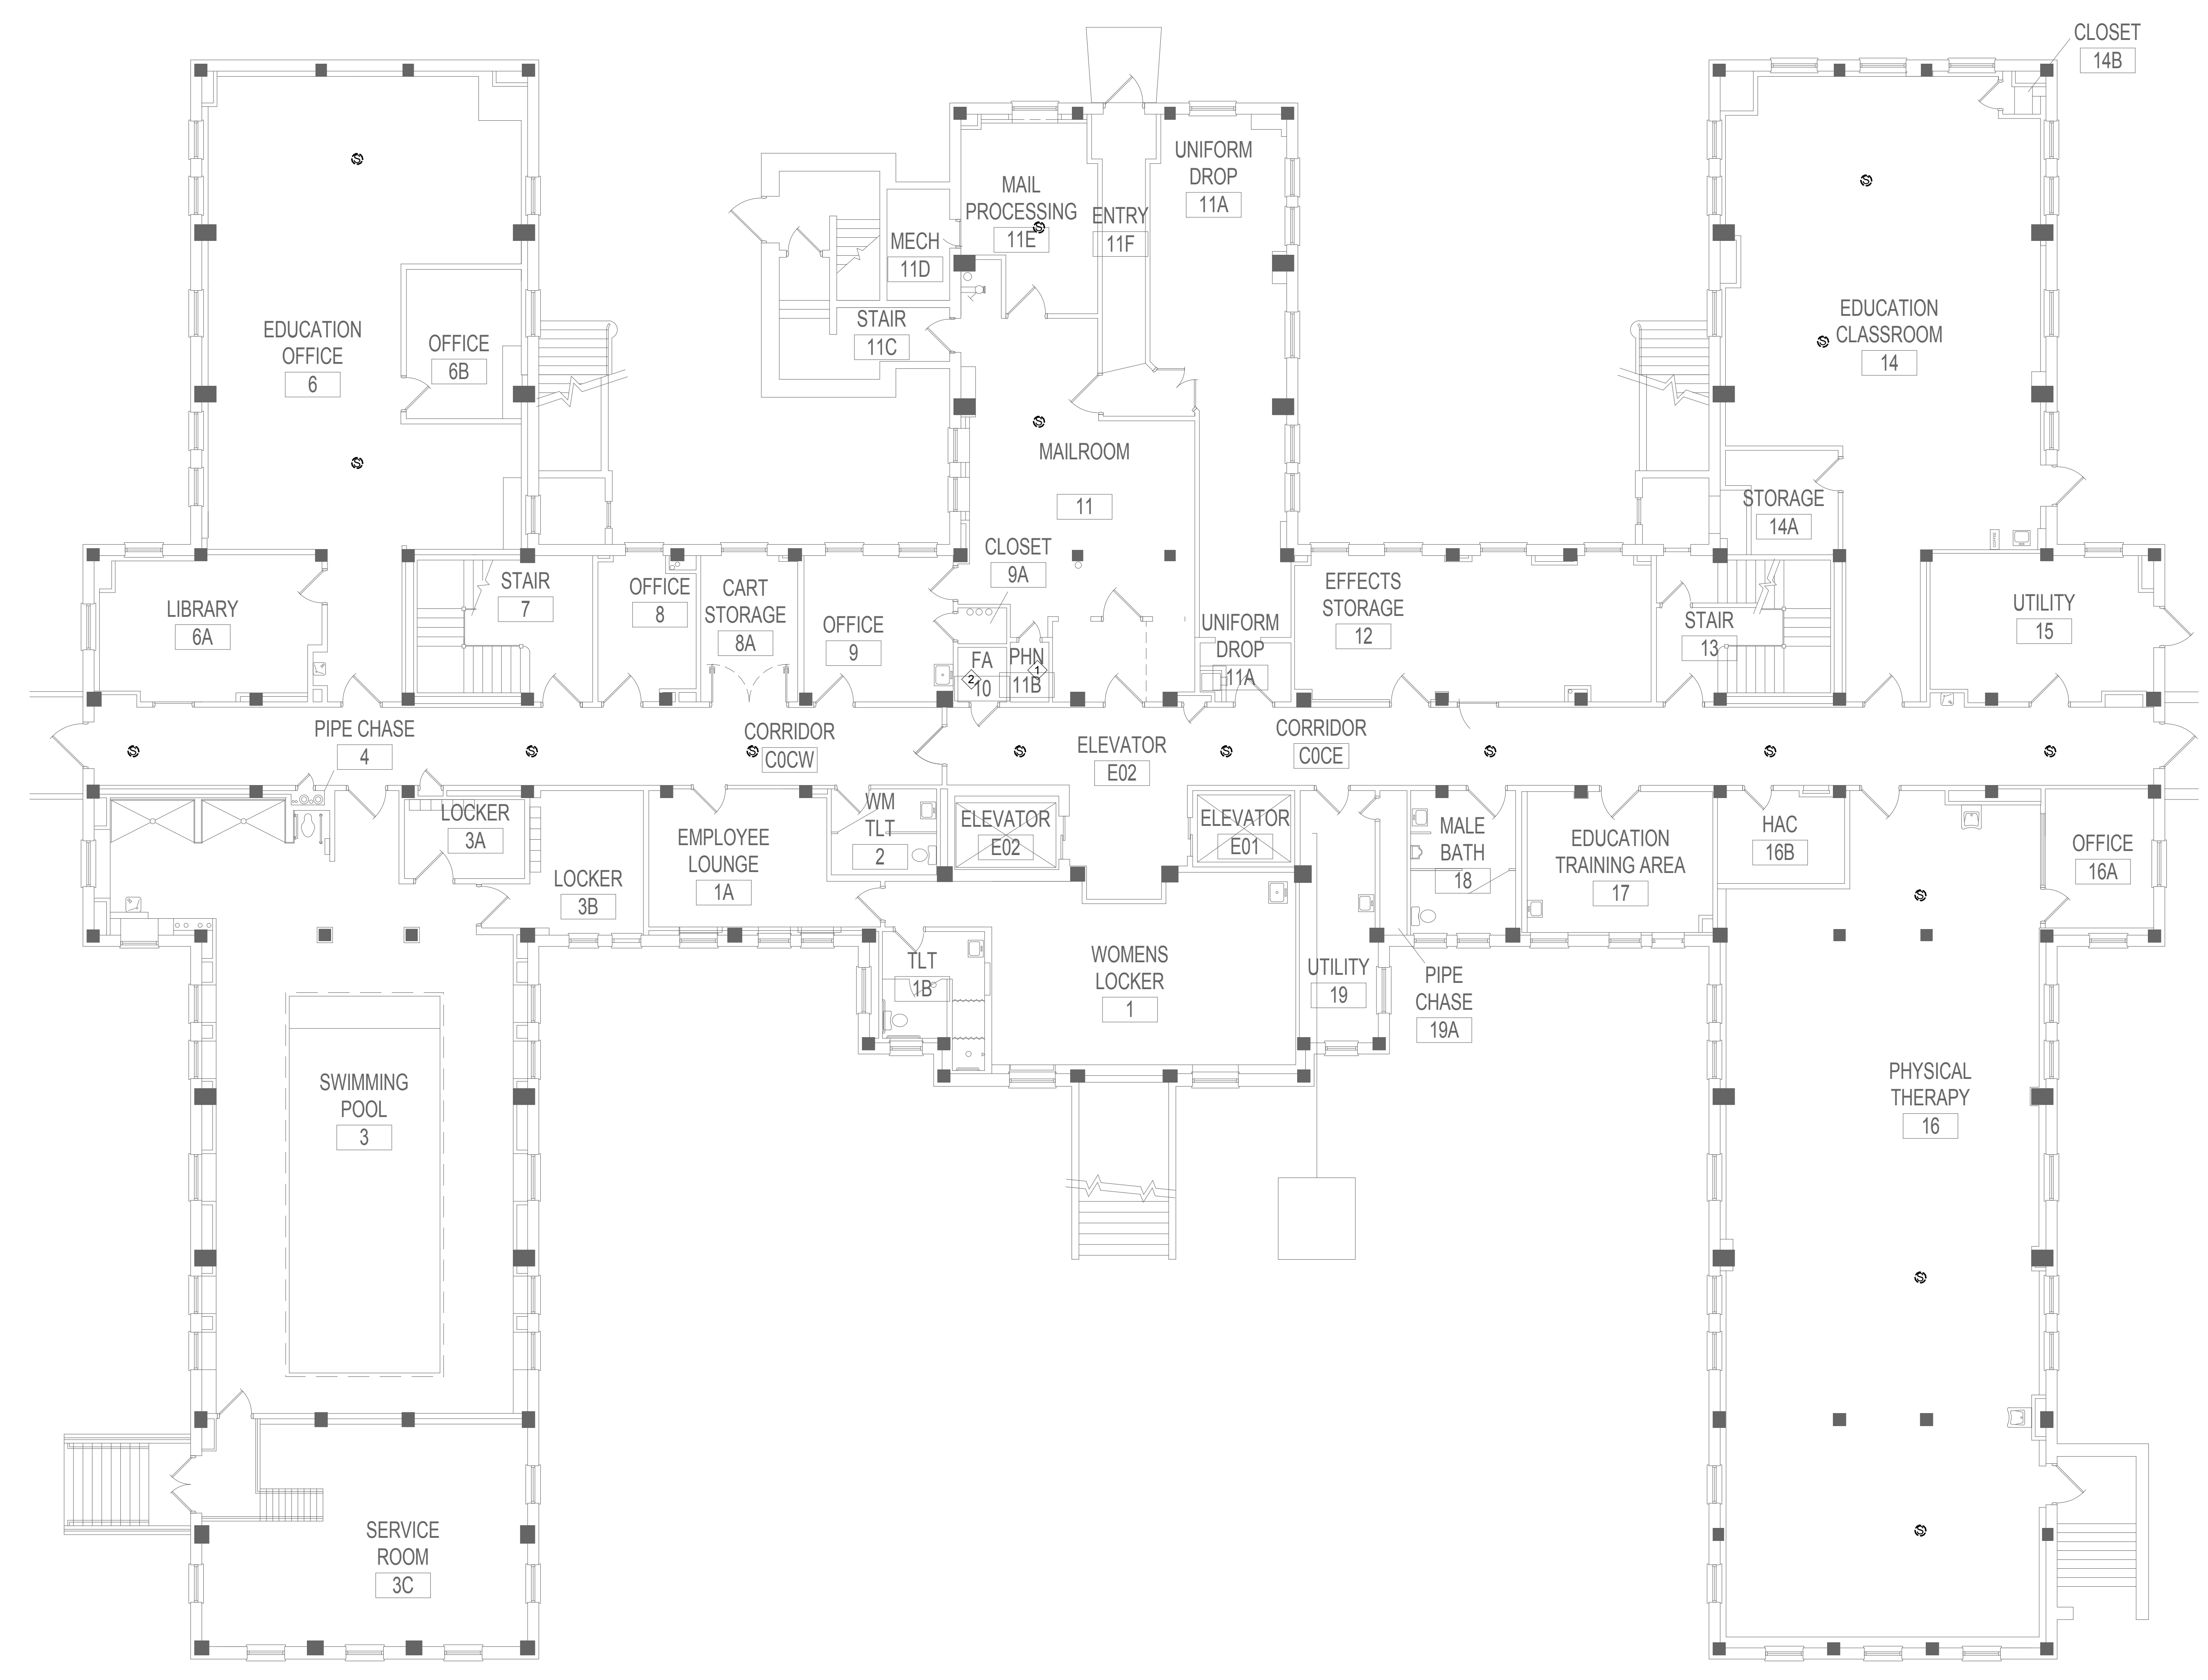

1. BUILDING 48 - PAGING SPEAKER DEMOLITION FLOOR PLAN - BASEMENT FLOOR
1/8" = 1'-0"

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)
DUNHAM
50 South Sixth Street / Suite 1100
Minneapolis, Minnesota 55402-1540
Phone: 612-465-7550 Fax: 612-465-7551
www.dunhaminc.com
mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD
ANDERSON ENGINEERING
ENGINEERING • ARCHITECTURE • LAND SURVEYING
ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
Anderson Engineering of Minnesota, LLC
13605 1st Avenue North
Suite 100
Plymouth, MN 55441
763-412-4000 (o) 763-412-4090 (f)
www.ae-mn.com
AE PROJECT NUMBER: Project Number

STAMP
I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
Signature: *Chris M. Pilliod*
Name: Chris M. Pilliod, P.E.
Date: 1/24/19
Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE BUILDING 48 - PAGING SPEAKER DEMOLITION FLOOR PLAN - BASEMENT	PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM
APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR	DATE:
APPROVED: CHIEF OF STAFF	DATE:
APPROVED: HEALTH CARE SYSTEM DIRECTOR	DATE:


BUILDING No.	CHECKED BY	DRAWN	ISSUE DATE
	CP	CG	1/24/19
LOCATION VA MEDICAL CENTER ST. CLOUD, MN 56303	DATE	DRAWING NO.	ED48-00

VA U.S. Department of Veterans Affairs
Veterans Health Administration
St. Cloud VA Health Care System

1/24/2019 11:26:38 PM C:\Revit\Projects\VA ST CLOUD PAGING_Elec_R12.dwg.plt

GENERAL NOTES:

- A. REFER TO SHEET ET.101 FOR LOCATION OF BUILDING ON CAMPUS.
- B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE INACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
- C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
- D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
- E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
- F. CONTRACTOR RESPONSIBLE FOR PROVIDING REPLACEMENT CEILING TILES AFTER REMOVAL OF SPEAKERS. REPLACE CEILING TILE TO MATCH EXISTING ADJACENT CEILING TILE.
- G. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
- H. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
- I. REPAIR OF EXISTING PAINTED AND FINISHED SURFACES: CLEAN, PATCH AND REPAIR EXISTING SURFACES DAMAGED OR ALTERED BY THIS WORK. NO "TELEGRAPHING" OF LINES, RIDGES, FLAKES, ETC. THROUGH NEW SURFACING IS PERMITTED. WHERE THIS OCCURS, SAND SMOOTH AND RE-FINISH UNTIL SURFACE MEETS COR'S APPROVAL. IN EXISTING ROOM OR AREAS WHERE ALTERATIONS BETWEEN NEW AND EXISTING FINISH WILL NOT SHOW IN FINISHED WORK, APPLY ONE (1) PRIME AND TWO (2) FINISH COATS OF PAINT TO MATCH ADJACENT SURFACES AND FINISHES.
- J. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.

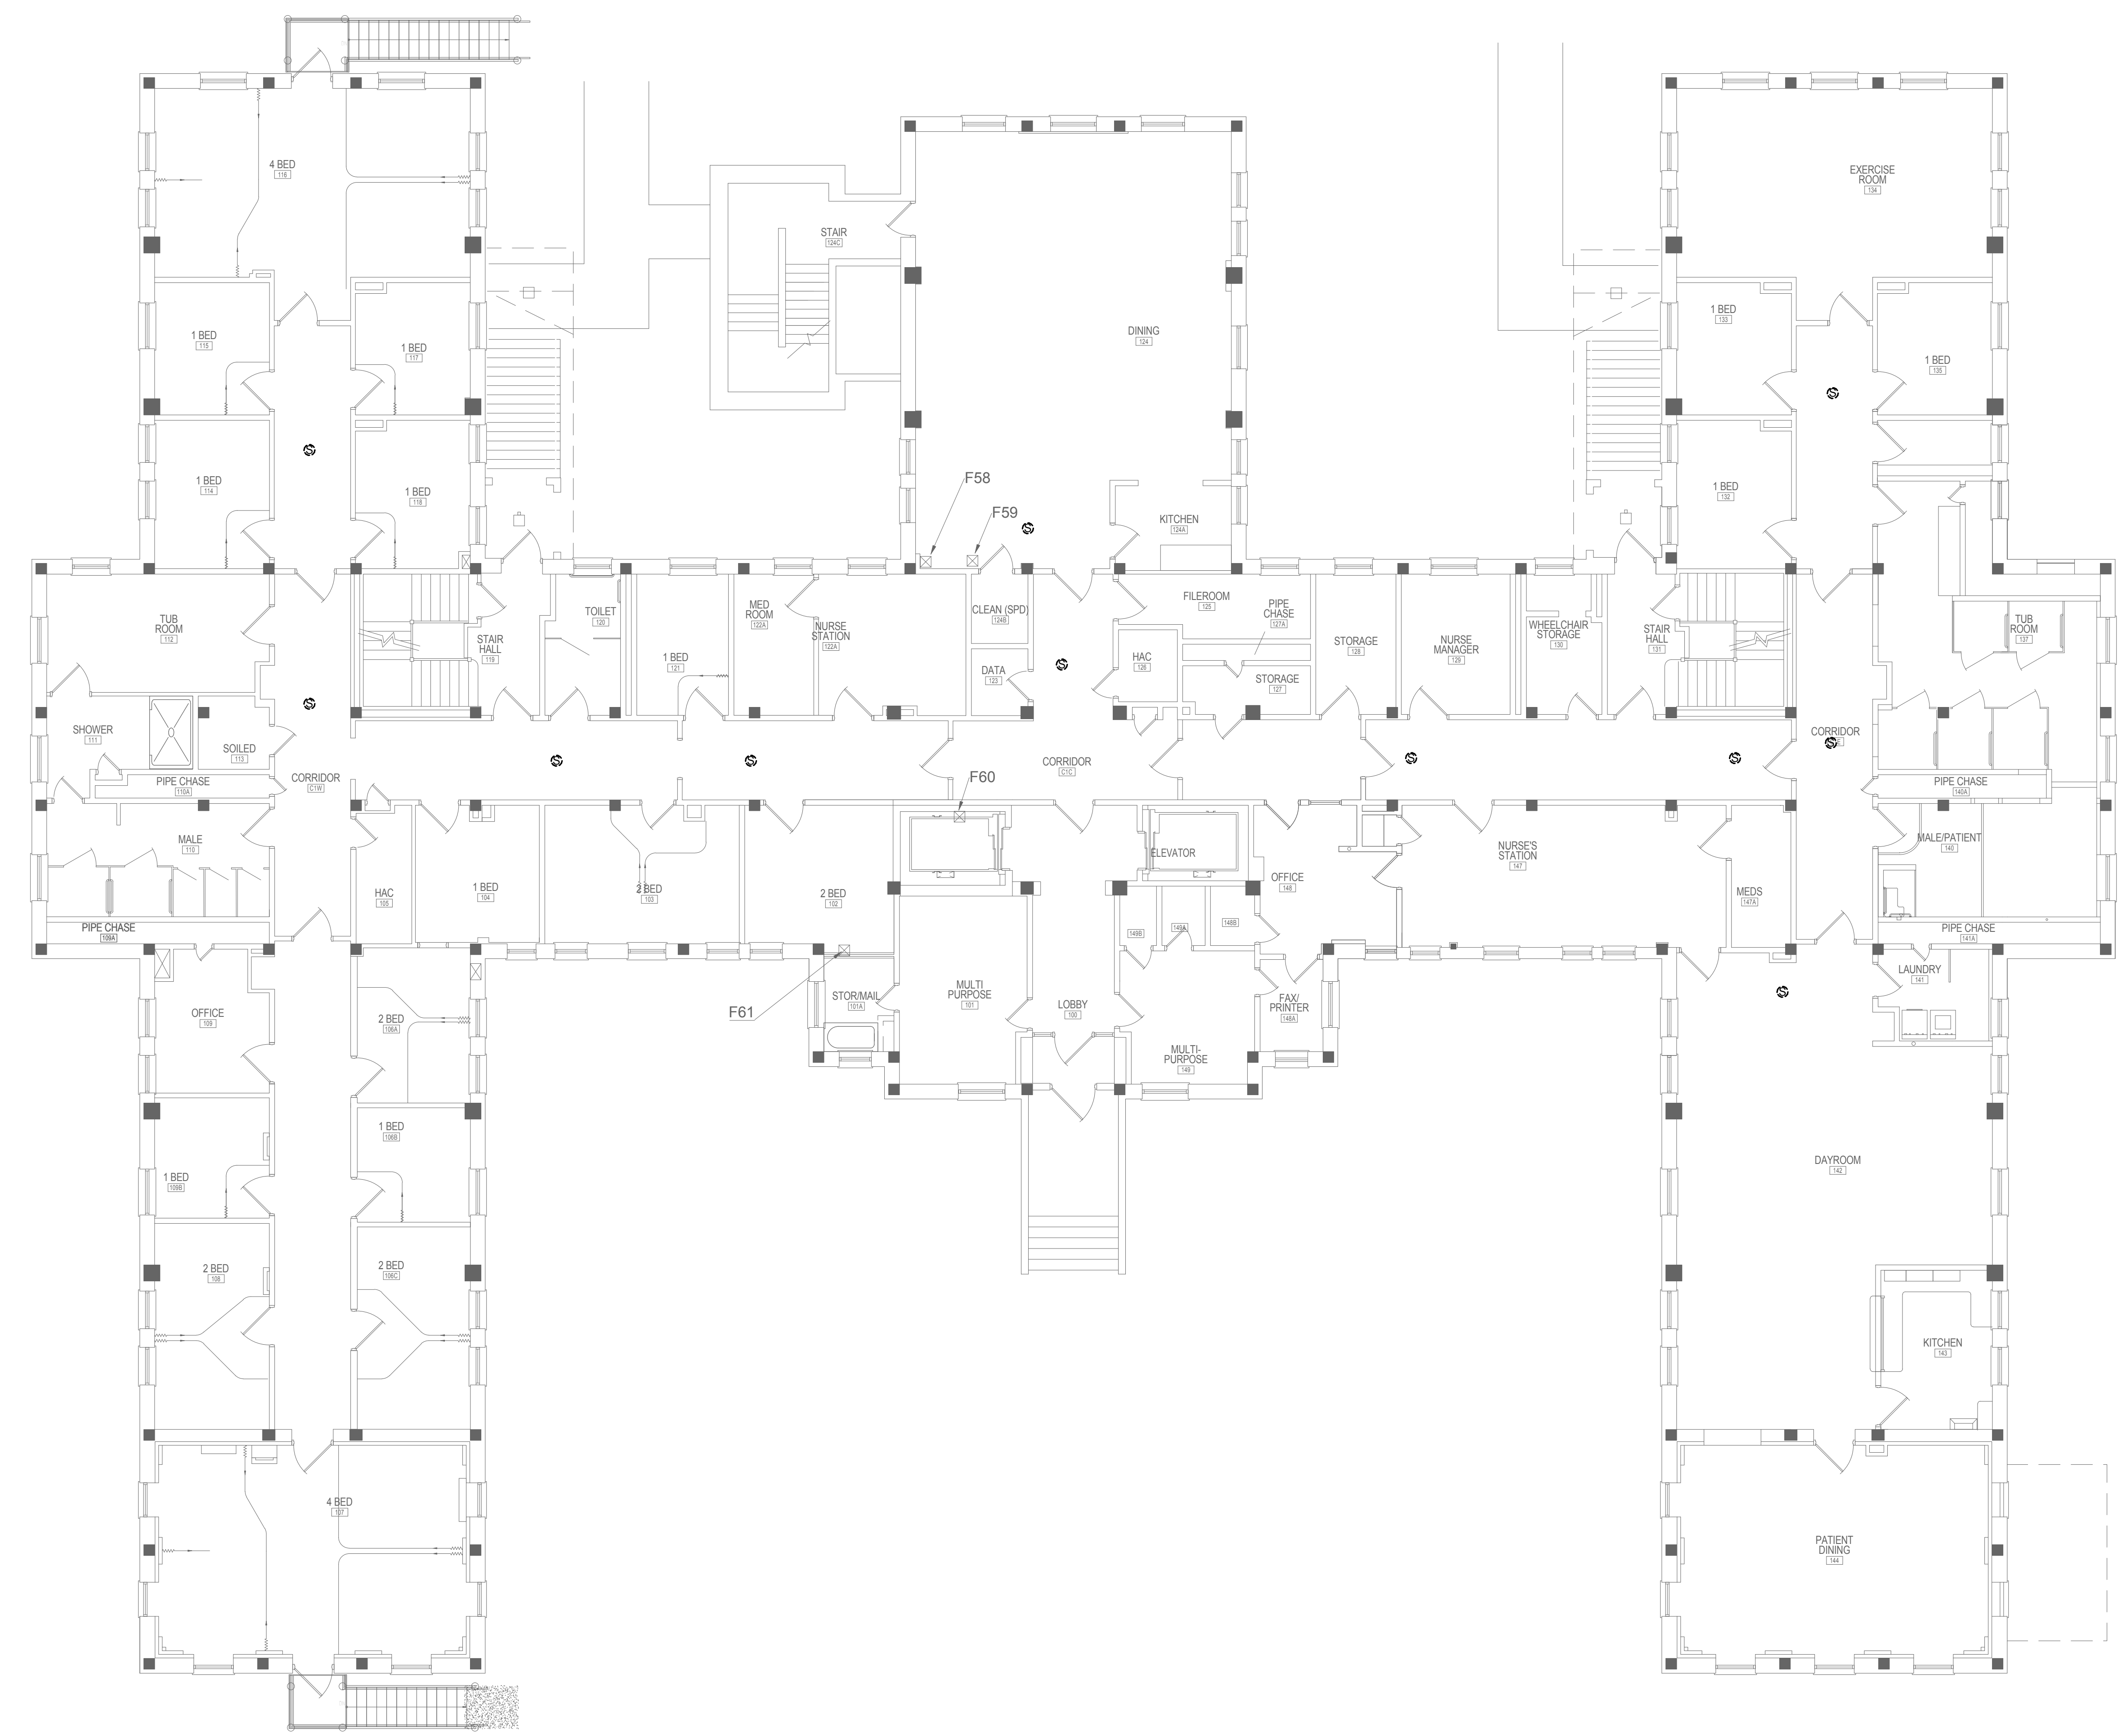

1 BUILDING 48- PAGING SPEAKER DEMOLITION FLOOR PLAN - FIRST FLOOR
1/8" = 1'-0"

C:\Revit\Projects\VA ST CLOUD\PAGING_Elec_R12.dwg 1/24/2019 1:26:39 PM

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826


APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE
BUILDING 48 - PAGING SPEAKER DEMOLITION FLOOR PLAN - FIRST FLOOR
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:
 APPROVED: CHIEF OF STAFF
 DATE:
 APPROVED: HEALTH CARE SYSTEM DIRECTOR
 DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PLOT SCALE	
PROJECT NO.		PROJECT NO.	
BUILDING No.	CHECKED BY	DRAWN	ISSUE DATE
	CP	CG	1/24/19
LOCATION	DATE	DRAWING NO.	
VA MEDICAL CENTER ST. CLOUD, MN 56303		ED48-01	

VA
U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

- GENERAL NOTES:**
- A. REFER TO SHEET ET.101 FOR LOCATION OF BUILDING ON CAMPUS.
 - B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE UNACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
 - C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
 - D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
 - E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
 - F. CONTRACTOR RESPONSIBLE FOR PROVIDING REPLACEMENT CEILING TILES AFTER REMOVAL OF SPEAKERS. REPLACE CEILING TILE TO MATCH EXISTING ADJACENT CEILING TILE.
 - G. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
 - H. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
 - I. REPAIR OF EXISTING PAINTED AND FINISHED SURFACES: CLEAN, PATCH AND REPAIR EXISTING SURFACES DAMAGED OR ALTERED BY THIS WORK. NO "TELEGRAPHING" OF LINES, RIDGES, FLAKES, ETC. THROUGH NEW SURFACING IS PERMITTED. WHERE THIS OCCURS, SAND SMOOTH AND RE-FINISH UNTIL SURFACE MEETS COR'S APPROVAL. IN EXISTING ROOM OR AREAS WHERE ALTERATIONS BETWEEN NEW AND EXISTING FINISH WILL NOT SHOW IN FINISHED WORK, APPLY ONE (1) PRIME AND TWO (2) FINISH COATS OF PAINT TO MATCH ADJACENT SURFACES AND FINISHES.
 - J. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.

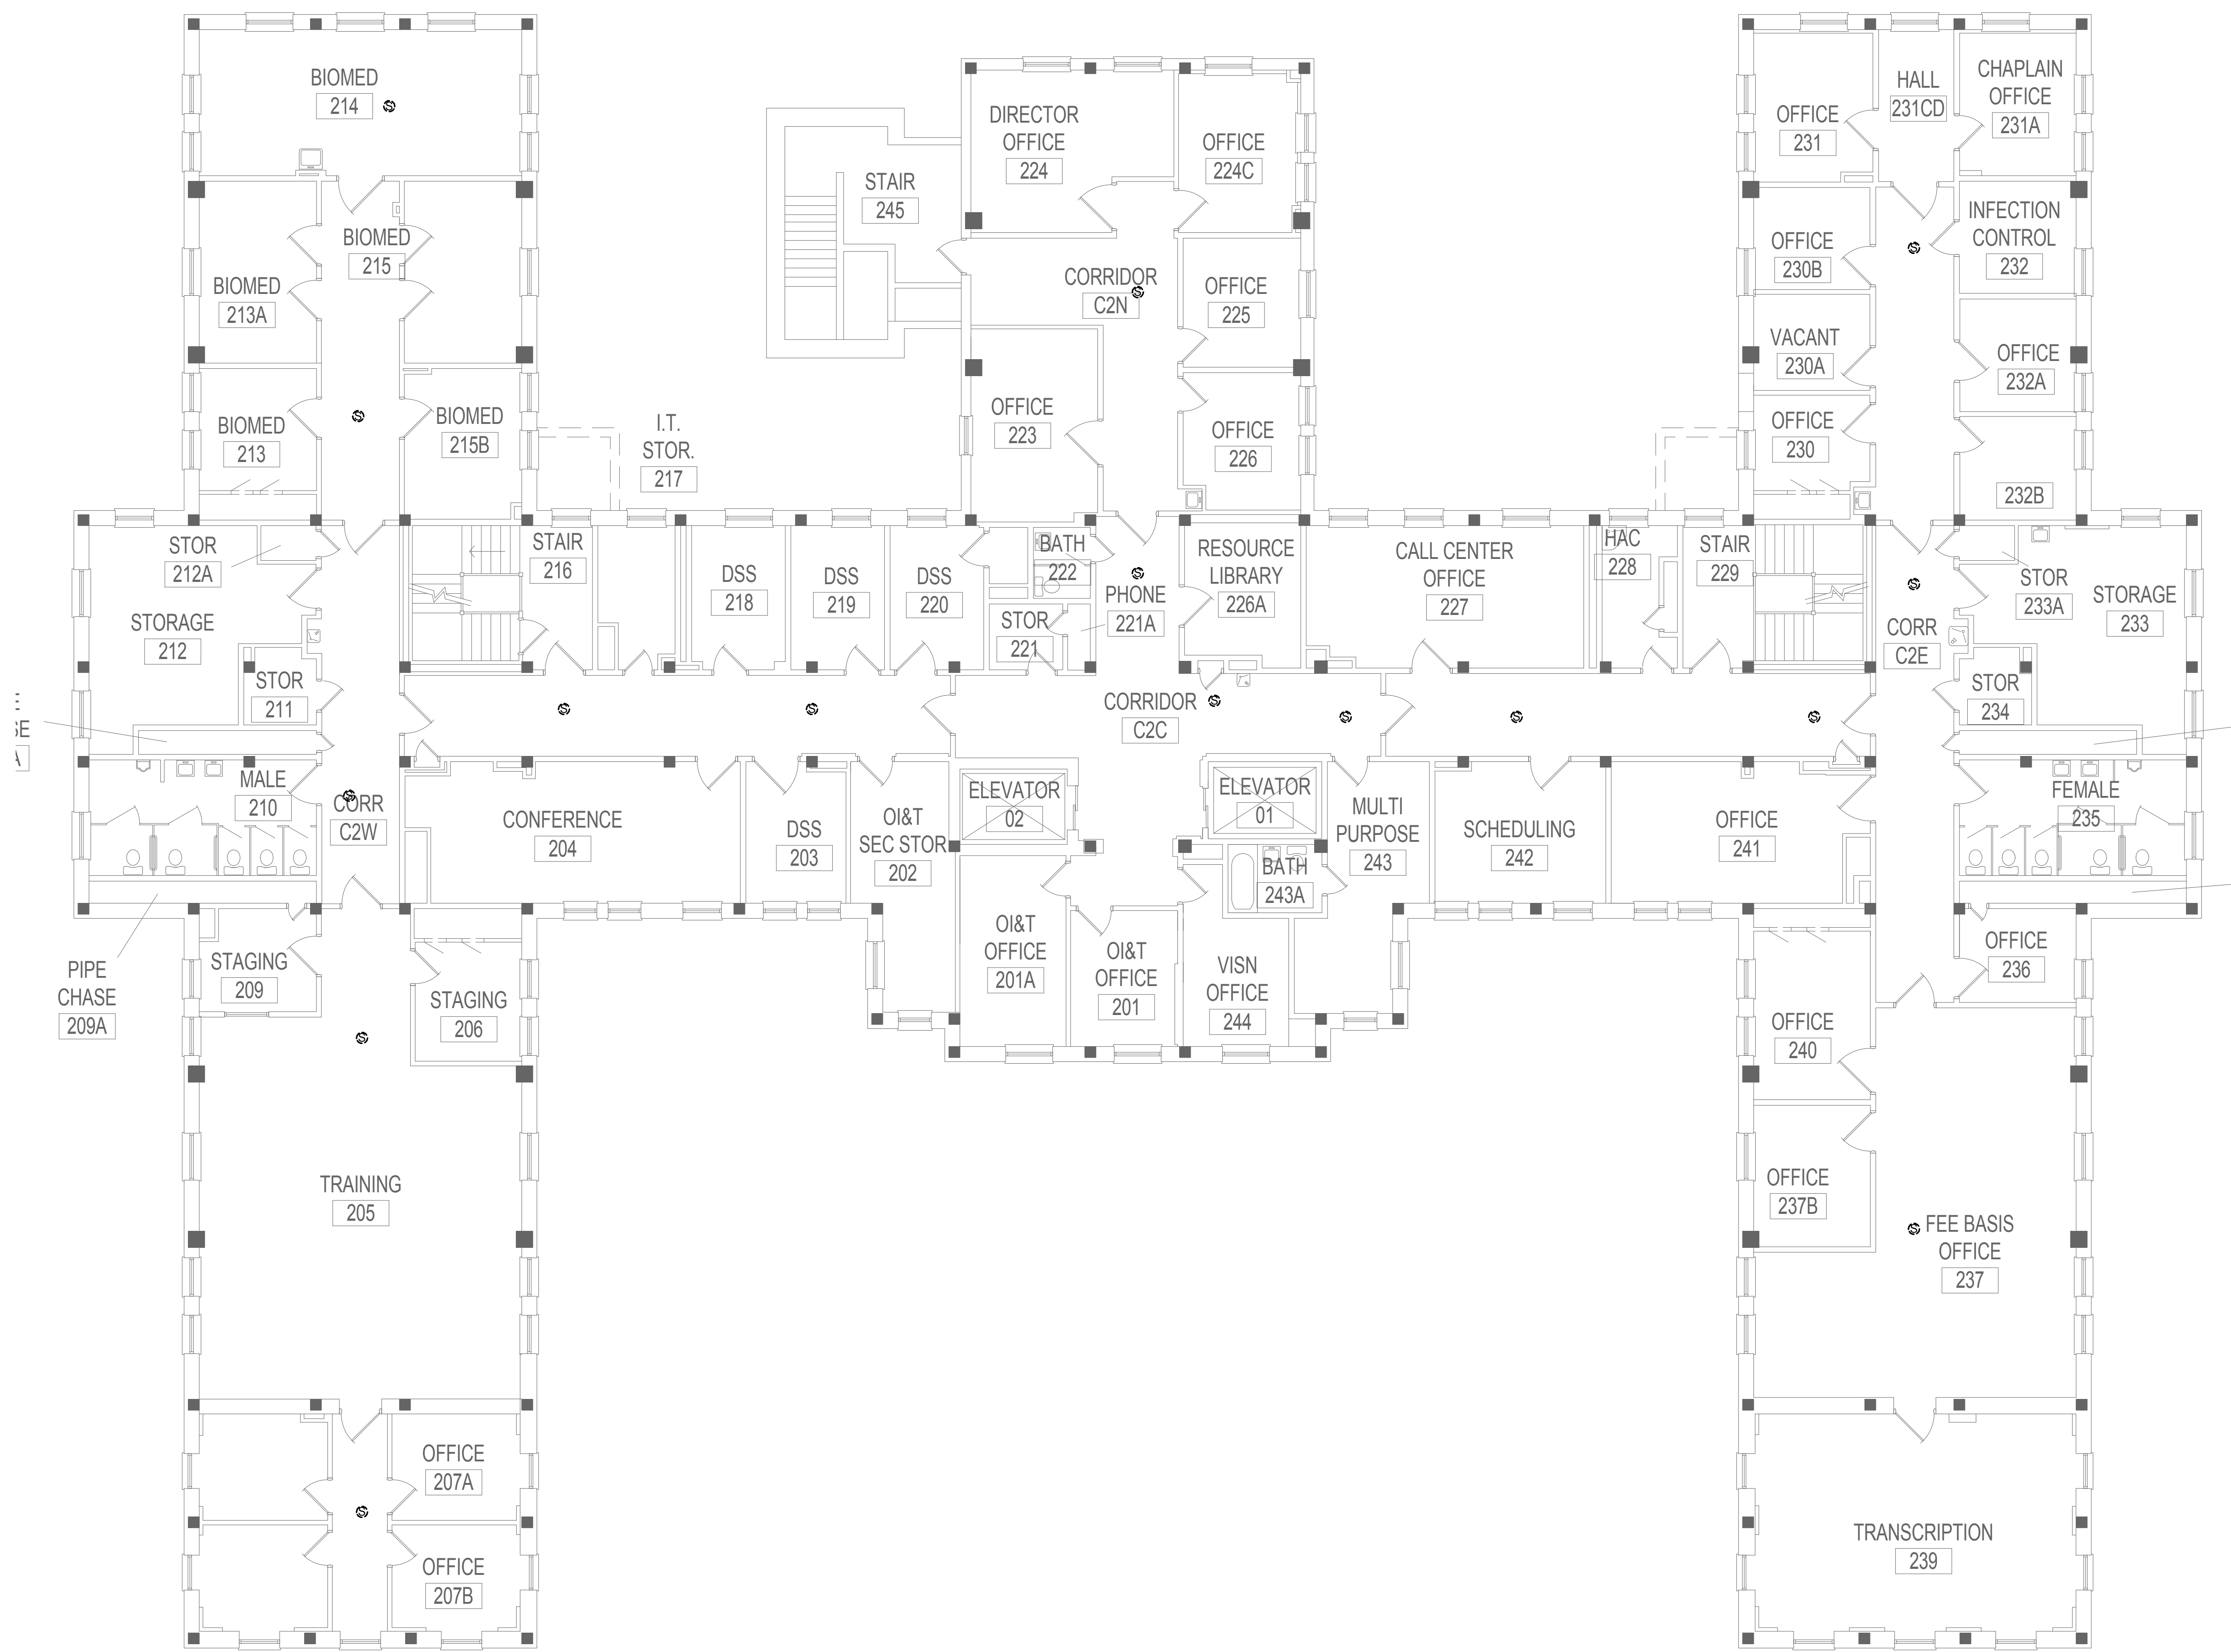

1 BUILDING 08 - PAGING SPEAKER FLOOR PLAN - SECOND FLOOR
1/8" = 1'-0"

C:\Revit\Projects\VA ST CLOUD PAGING_Elec_R12.dwg 1/24/2018 11:29:40 PM

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE
BUILDING 48 - PAGING SPEAKER DEMOLITION FLOOR PLAN - SECOND FLOOR
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:
 APPROVED: CHIEF OF STAFF
 DATE:
 APPROVED: HEALTH CARE SYSTEM DIRECTOR
 DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PLOT SCALE	
PROJECT NO.		PROJECT NO.	
BUILDING No.	CHECKED BY	DRAWN	ISSUE DATE
	CP	CG	1/24/19
LOCATION	DATE	DRAWING NO.	
VA MEDICAL CENTER ST. CLOUD, MN 56303		ED48-02	

VA
U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System



GENERAL NOTES:

- A. REFER TO SHEET ET.101 FOR LOCATION OF BUILDING ON CAMPUS.
- B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE UNACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
- C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
- D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
- E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
- F. CONTRACTOR RESPONSIBLE FOR PROVIDING REPLACEMENT CEILING TILES AFTER REMOVAL OF SPEAKERS. REPLACE CEILING TILE TO MATCH EXISTING ADJACENT CEILING TILE.
- G. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
- H. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
- I. PREPARE OF EXISTING PAINTED AND FINISHED SURFACES: CLEAN, PATCH AND REPAIR EXISTING SURFACES DAMAGED OR ALTERED BY THIS WORK. NO TELEGRAPHING OF LINES, RIDGES, FLAKES, ETC. THROUGH NEW SURFACING IS PERMITTED. WHERE THIS OCCURS, SAND SMOOTH AND RE-FINISH UNTIL SURFACE MEETS COR'S APPROVAL. IN EXISTING ROOM OR AREAS WHERE ALTERATIONS BETWEEN NEW AND EXISTING FINISH WILL NOT SHOW IN FINISHED WORK, APPLY ONE (1) PRIME AND TWO (2) FINISH COATS OF PAINT TO MATCH ADJACENT SURFACES AND FINISHES.
- J. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.

KEY NOTES:

- ① DEMOLISH EXISTING PUBLIC ADDRESS SYSTEM CABLING, CONNECTIVITY AND ENCLOSURE. REMOVE 120VAC BACK TO SOURCE. REMOVE AND RETURN PUBLIC ADDRESS SYSTEM AMPLIFIER(S) TO OWNER. REMOVAL OF EXISTING SYSTEM SHALL OCCUR AFTER THE NEW PUBLIC ADDRESS SYSTEM IS INSTALLED AND TESTED PER PROJECT REQUIREMENTS.
- ② SALVAGE AND REINSTALL REMOVE PUBLIC ADDRESS SYSTEM NETWORK SWITCH AND ASSOCIATED COMPONENTS. RETURN TO OWNER. REMOVAL OF EQUIPMENT SHALL OCCUR AFTER THE NEW PUBLIC ADDRESS SYSTEM IS INSTALLED AND TESTED PER PROJECT REQUIREMENTS.

① BUILDING 49 - PAGING SPEAKER DEMOLITION FLOOR PLAN - BASEMENT
1/8" = 1'-0"

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

 DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:


DRAWING TITLE BUILDING 49 - PAGING SPEAKER DEMOLITION FLOOR PLAN - BASEMENT	
APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR	
DATE:	DATE:
APPROVED: CHIEF OF STAFF	DATE:
APPROVED: HEALTH CARE SYSTEM DIRECTOR	DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM	
PROJECT NO.:	PROJECT NO.:
FLAT SCALE:	FLAT SCALE:
BUILDING NO.:	CHECKED BY: CP
DATE:	DRAWN: CG
ISSUE DATE: 1/24/19	DRAWING NO. ED49-00
LOCATION: VA MEDICAL CENTER ST. CLOUD, MN 56303	DATE:

VA
U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

GENERAL NOTES:

- A. REFER TO SHEET ET.101 FOR LOCATION OF BUILDING ON CAMPUS.
- B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE INACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
- C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
- D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
- E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
- F. CONTRACTOR RESPONSIBLE FOR PROVIDING REPLACEMENT CEILING TILES AFTER REMOVAL OF SPEAKERS. REPLACE CEILING TILE TO MATCH EXISTING ADJACENT CEILING TILE.
- G. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
- H. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
- I. REPAIR OF EXISTING PAINTED AND FINISHED SURFACES: CLEAN, PATCH AND REPAIR EXISTING SURFACES DAMAGED OR ALTERED BY THIS WORK. NO "TELEGRAPHING" OF LINES, RIDGES, FLAKES, ETC. THROUGH NEW SURFACING IS PERMITTED. WHERE THIS OCCURS, SAND SMOOTH AND RE-FINISH UNTIL SURFACE MEETS COR'S APPROVAL. IN EXISTING ROOM OR AREAS WHERE ALTERATIONS BETWEEN NEW AND EXISTING FINISH WILL NOT SHOW IN FINISHED WORK, APPLY ONE (1) PRIME AND TWO (2) FINISH COATS OF PAINT TO MATCH ADJACENT SURFACES AND FINISHES.
- J. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.

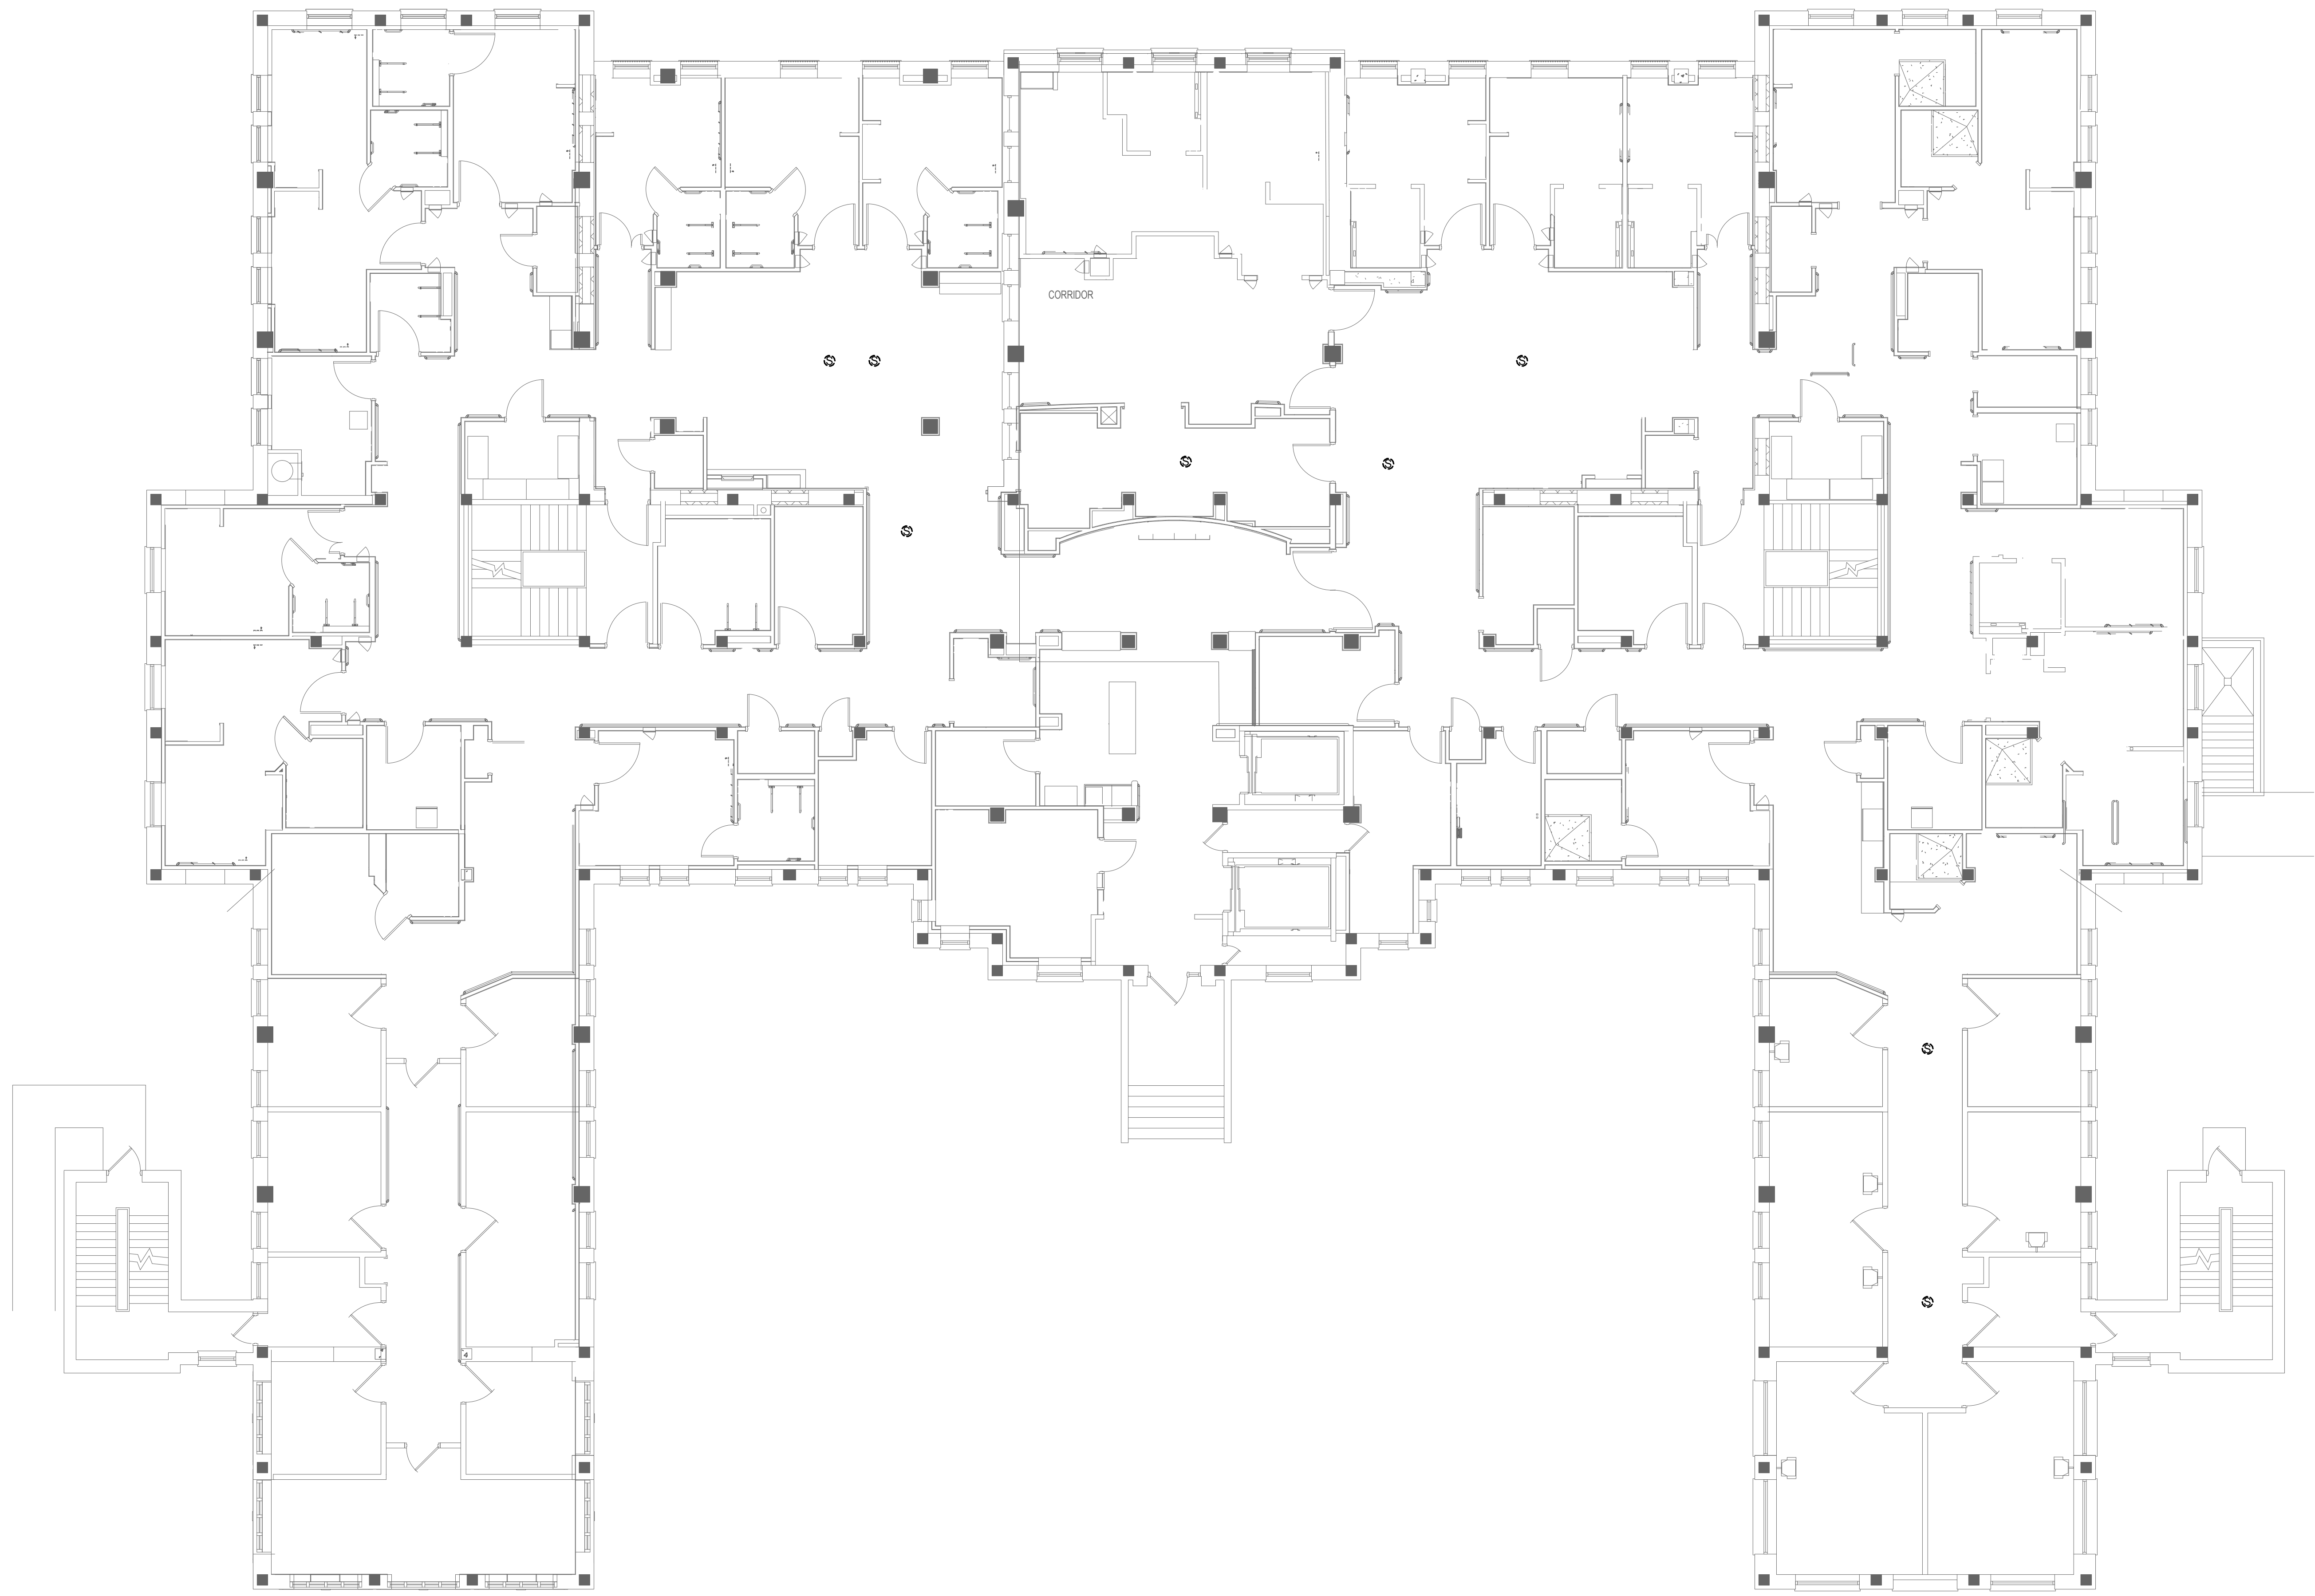

1 BUILDING 49 - PAGING SPEAKER DEMOLITION FLOOR PLAN - FIRST FLOOR
1/8" = 1'-0"

C:\Revit\Projects\VA ST CLOUD PAGING_Elec_R12.dwg 1/24/2019 1:26:41 PM

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 phone: 612-465-7550 fax: 612-465-7551
 web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:


DRAWING TITLE BUILDING 49 - PAGING SPEAKER DEMOLITION FLOOR PLAN - FIRST FLOOR	
APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR	
DATE:	
APPROVED: CHIEF OF STAFF	DATE:
APPROVED: HEALTH CARE SYSTEM DIRECTOR	DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM	
BUILDING No.	CHECKED BY
CP	CG
DATE	ISSUE DATE
1/24/19	1/24/19
LOCATION	DRAWING NO.
VA MEDICAL CENTER ST. CLOUD, MN 56303	ED49-01

VA
U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

GENERAL NOTES:

- A. REFER TO SHEET ET.101 FOR LOCATION OF BUILDING ON CAMPUS.
- B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE INACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
- C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
- D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
- E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
- F. CONTRACTOR RESPONSIBLE FOR PROVIDING REPLACEMENT CEILING TILES AFTER REMOVAL OF SPEAKERS. REPLACE CEILING TILE TO MATCH EXISTING ADJACENT CEILING TILE.
- G. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
- H. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
- I. REPAIR OF EXISTING PAINTED AND FINISHED SURFACES: CLEAN, PATCH AND REPAIR EXISTING SURFACES DAMAGED OR ALTERED BY THIS WORK. NO "TELEGRAPHING" OF LINES, RIDGES, FLAKES, ETC. THROUGH NEW SURFACING IS PERMITTED. WHERE THIS OCCURS, SAND SMOOTH AND RE-FINISH UNTIL SURFACE MEETS COR'S APPROVAL. IN EXISTING ROOM OR AREAS WHERE ALTERATIONS BETWEEN NEW AND EXISTING FINISH WILL NOT SHOW IN FINISHED WORK, APPLY ONE (1) PRIME AND TWO (2) FINISH COATS OF PAINT TO MATCH ADJACENT SURFACES AND FINISHES.
- J. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.

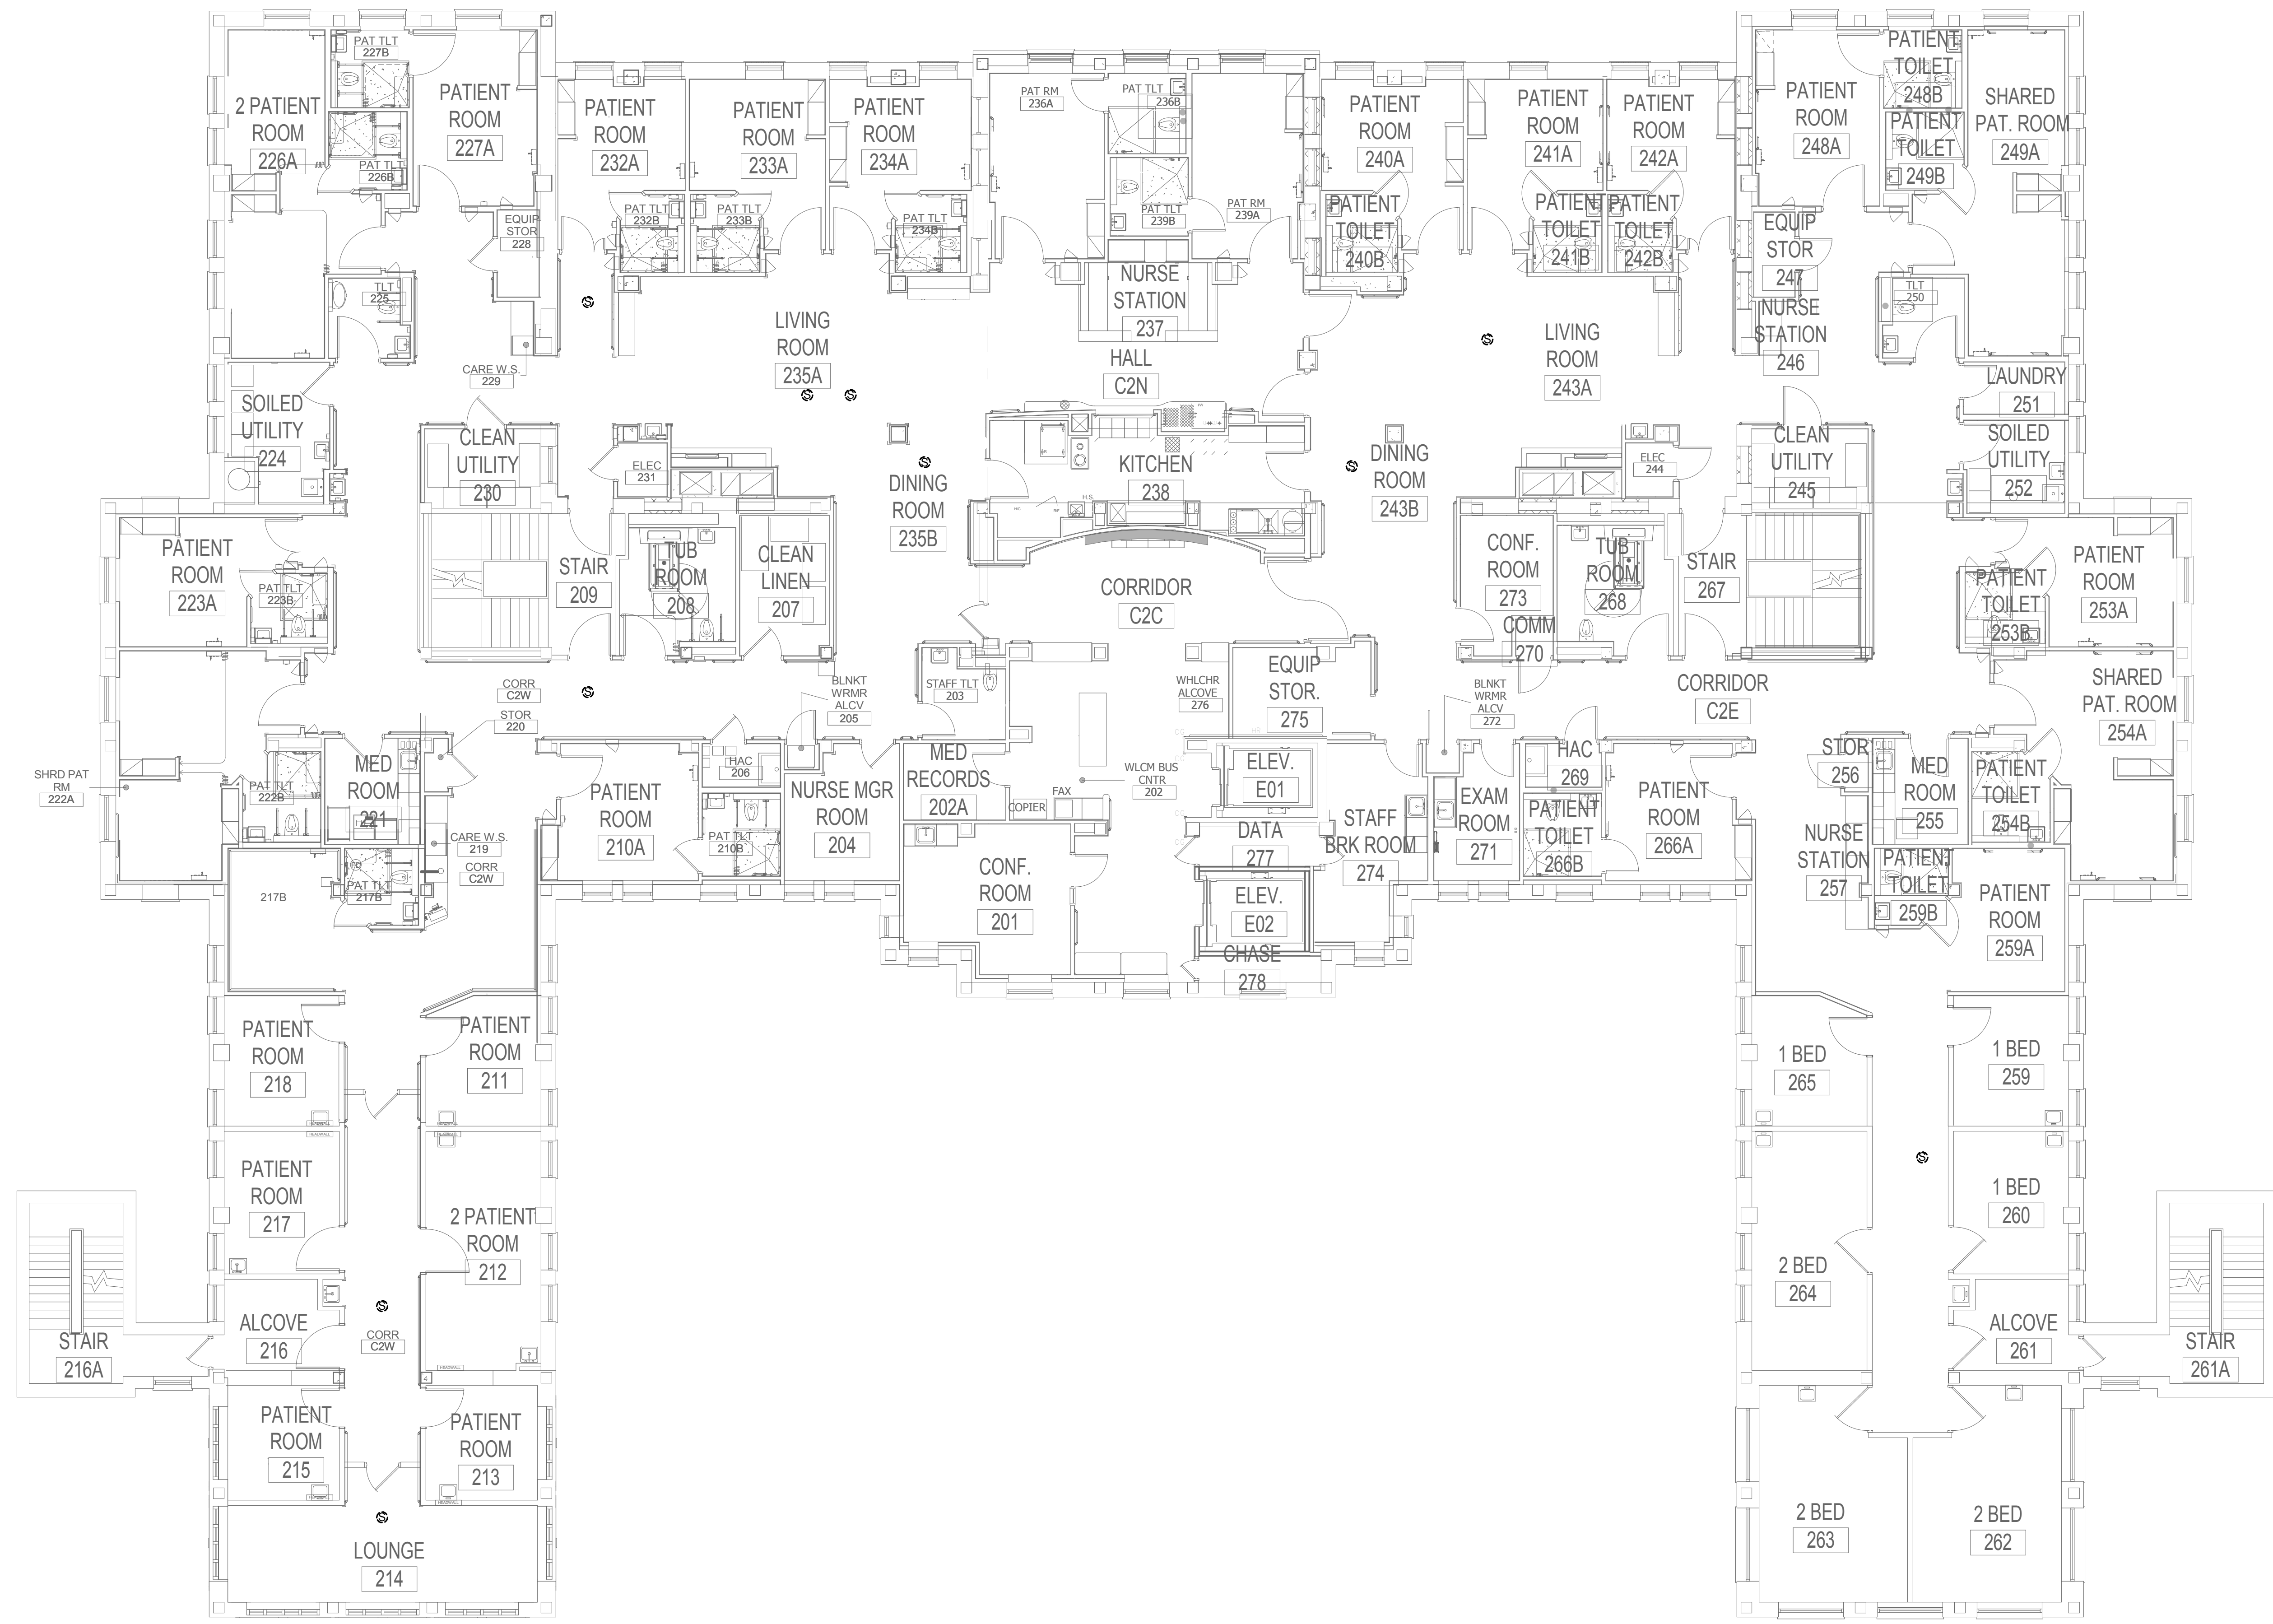

1 BUILDING 49 - PAGING SPEAKER DEMOLITION FLOOR PLAN - SECOND FLOOR
1/8" = 1'-0"

C:\Revit\Projects\VA ST CL CLOUD PAGING_Elec_R12.dwg

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

 DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com
 AE PROJECT NUMBER: Project Number

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE
BUILDING 49 - PAGING SPEAKER DEMOLITION FLOOR PLAN - SECOND FLOOR
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:
 APPROVED: CHIEF OF STAFF
 DATE:
 APPROVED: HEALTH CARE SYSTEM DIRECTOR
 DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PLOT SCALE	
PROJECT NO.		ISSUE DATE	
BUILDING No.	CHECKED BY	DRAWN	DATE
	CP	CG	1/24/19
LOCATION	DATE	DRAWING NO.	
VA MEDICAL CENTER ST. CLOUD, MN 56303		ED49-02	


VA
U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

GENERAL NOTES:

- A. REFER TO SHEET ET.101 FOR LOCATION OF BUILDING ON CAMPUS.
- B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE INACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
- C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
- D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
- E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
- F. CONTRACTOR RESPONSIBLE FOR PROVIDING REPLACEMENT CEILING TILES AFTER REMOVAL OF SPEAKERS. REPLACE CEILING TILE TO MATCH EXISTING ADJACENT CEILING TILE.
- G. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
- H. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
- I. REPAIR OF EXISTING PAINTED AND FINISHED SURFACES: CLEAN, PATCH AND REPAIR EXISTING SURFACES DAMAGED OR ALTERED BY THIS WORK. NO "TELEGRAPHING" OF LINES, RIDGES, FLAKES, ETC. THROUGH NEW SURFACING IS PERMITTED. WHERE THIS OCCURS, SAND SMOOTH AND RE-FINISH UNTIL SURFACE MEETS COR'S APPROVAL. IN EXISTING ROOM OR AREAS WHERE ALTERATIONS BETWEEN NEW AND EXISTING FINISH WILL NOT SHOW IN FINISHED WORK, APPLY ONE (1) PRIME AND TWO (2) FINISH COATS OF PAINT TO MATCH ADJACENT SURFACES AND FINISHES.
- J. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.

KEY NOTES:

- ① DEMOLISH EXISTING PUBLIC ADDRESS SYSTEM CABLING, CONNECTIVITY AND ENCLOSURE. REMOVE 120VAC BACK TO SOURCE. **SALVAGE AND REINSTALL** - REMOVE AND RETURN PUBLIC ADDRESS SYSTEM AMPLIFIER(S) TO OWNER. REMOVAL OF EXISTING SYSTEM SHALL OCCUR AFTER THE NEW PUBLIC ADDRESS SYSTEM IS INSTALLED AND TESTED PER PROJECT REQUIREMENTS.
- ② **SALVAGE AND REINSTALL** - REMOVE PUBLIC ADDRESS SYSTEM NETWORK SWITCH AND ASSOCIATED COMPONENTS. RETURN TO OWNER. REMOVAL OF EQUIPMENT SHALL OCCUR AFTER THE NEW PUBLIC ADDRESS SYSTEM IS INSTALLED AND TESTED PER PROJECT REQUIREMENTS.

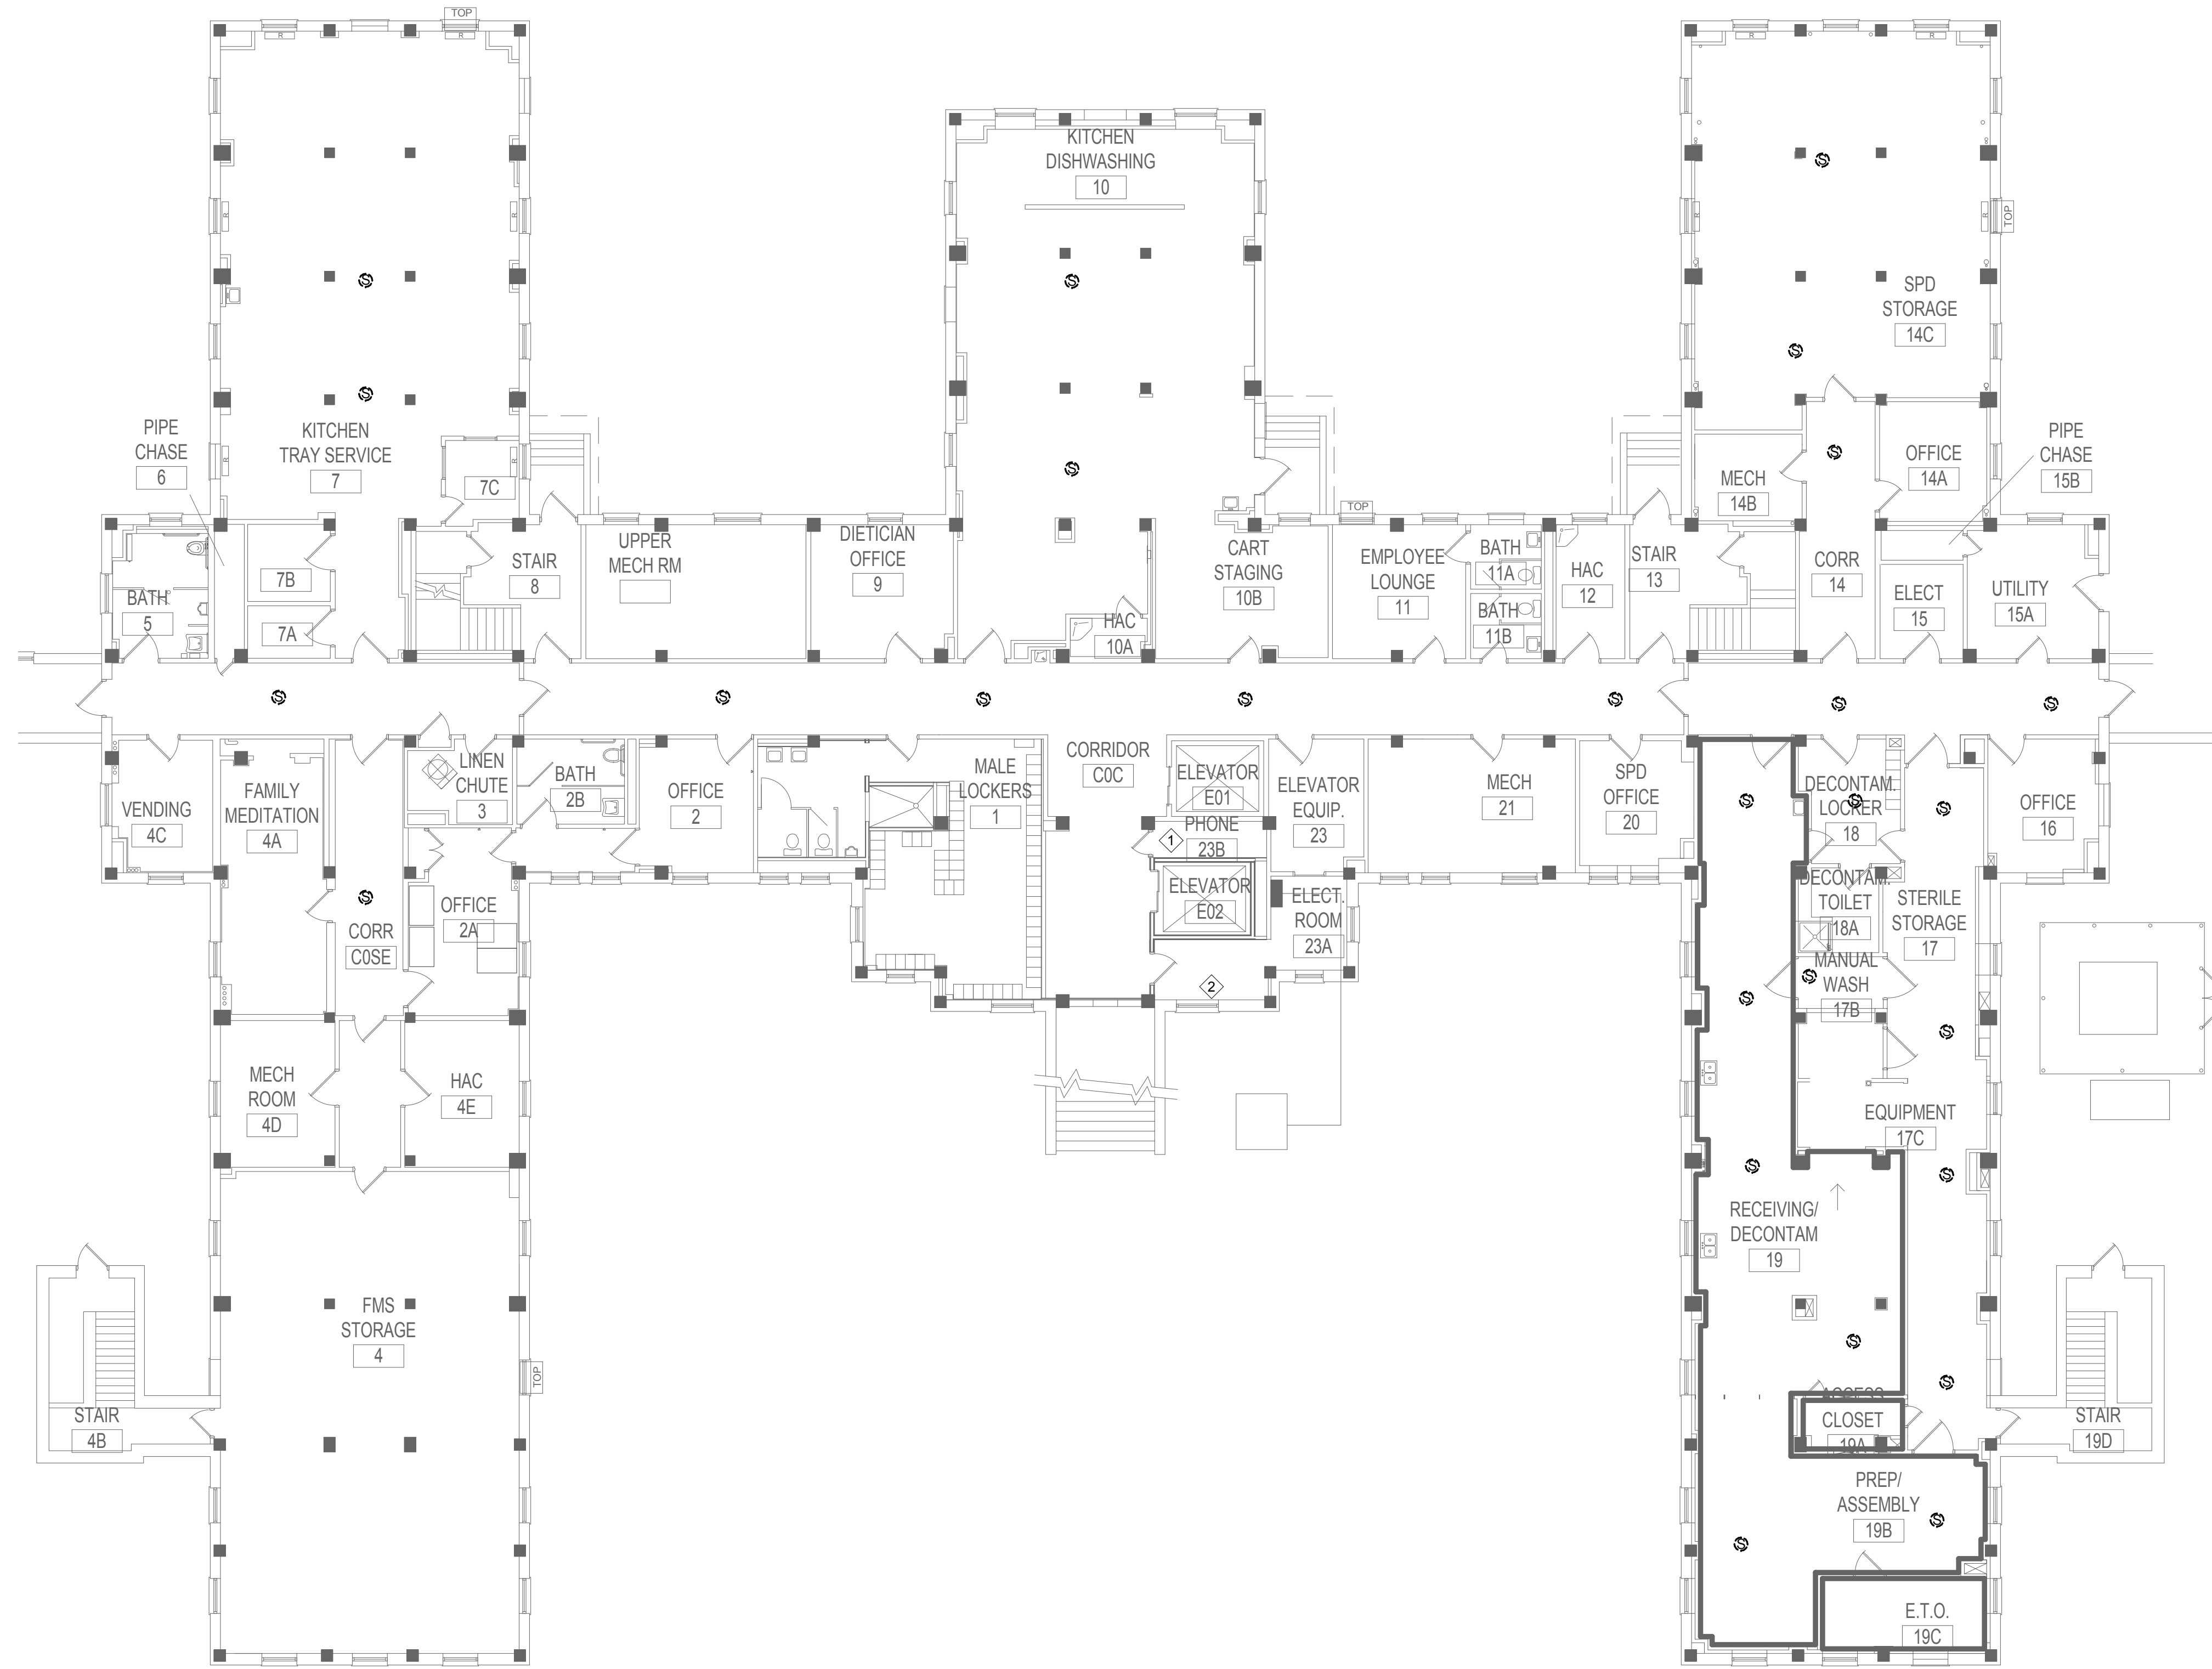

① 00 - 3/32" Signal - Demolition - BLDG 50
3/32" = 1'-0"

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.

 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE
BUILDING 50 - PAGING SPEAKER
DEMOLITION FLOOR PLAN - BASEMENT
 DATE:
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:
 APPROVED: CHIEF OF STAFF
 DATE:
 APPROVED: HEALTH CARE SYSTEM DIRECTOR
 DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PLOT SCALE	
PROJECT NO.		ISSUE DATE	
BUILDING No.	CHECKED BY	DRAWN	DATE
	CP	CG	1/24/19
LOCATION	DATE	DRAWING NO.	
VA MEDICAL CENTER ST. CLOUD, MN 56303		ED50-00	


VA
U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

1/24/2019 1:29:42 PM
C:\Revit\Projects\VA ST CLOUD\PAGING_SPEAKER_R12.dwg

A
B
C
D
E
F

GENERAL NOTES:

- A. REFER TO SHEET ET.101 FOR LOCATION OF BUILDING ON CAMPUS.
- B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE UNACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
- C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
- D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
- E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
- F. CONTRACTOR RESPONSIBLE FOR PROVIDING REPLACEMENT CEILING TILES AFTER REMOVAL OF SPEAKERS. REPLACE CEILING TILE TO MATCH EXISTING ADJACENT CEILING TILE.
- G. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
- H. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
- I. REPAIR OF EXISTING PAINTED AND FINISHED SURFACES: CLEAN, PATCH AND REPAIR EXISTING SURFACES DAMAGED OR ALTERED BY THIS WORK. NO "TELEGRAPHING" OF LINES, RIDGES, FLAKES, ETC. THROUGH NEW SURFACING IS PERMITTED. WHERE THIS OCCURS, SAND SMOOTH AND RE-FINISH UNTIL SURFACE MEETS COR'S APPROVAL. IN EXISTING ROOM OR AREAS WHERE ALTERATIONS BETWEEN NEW AND EXISTING FINISH WILL NOT SHOW IN FINISHED WORK, APPLY ONE (1) PRIME AND TWO (2) FINISH COATS OF PAINT TO MATCH ADJACENT SURFACES AND FINISHES.
- J. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.

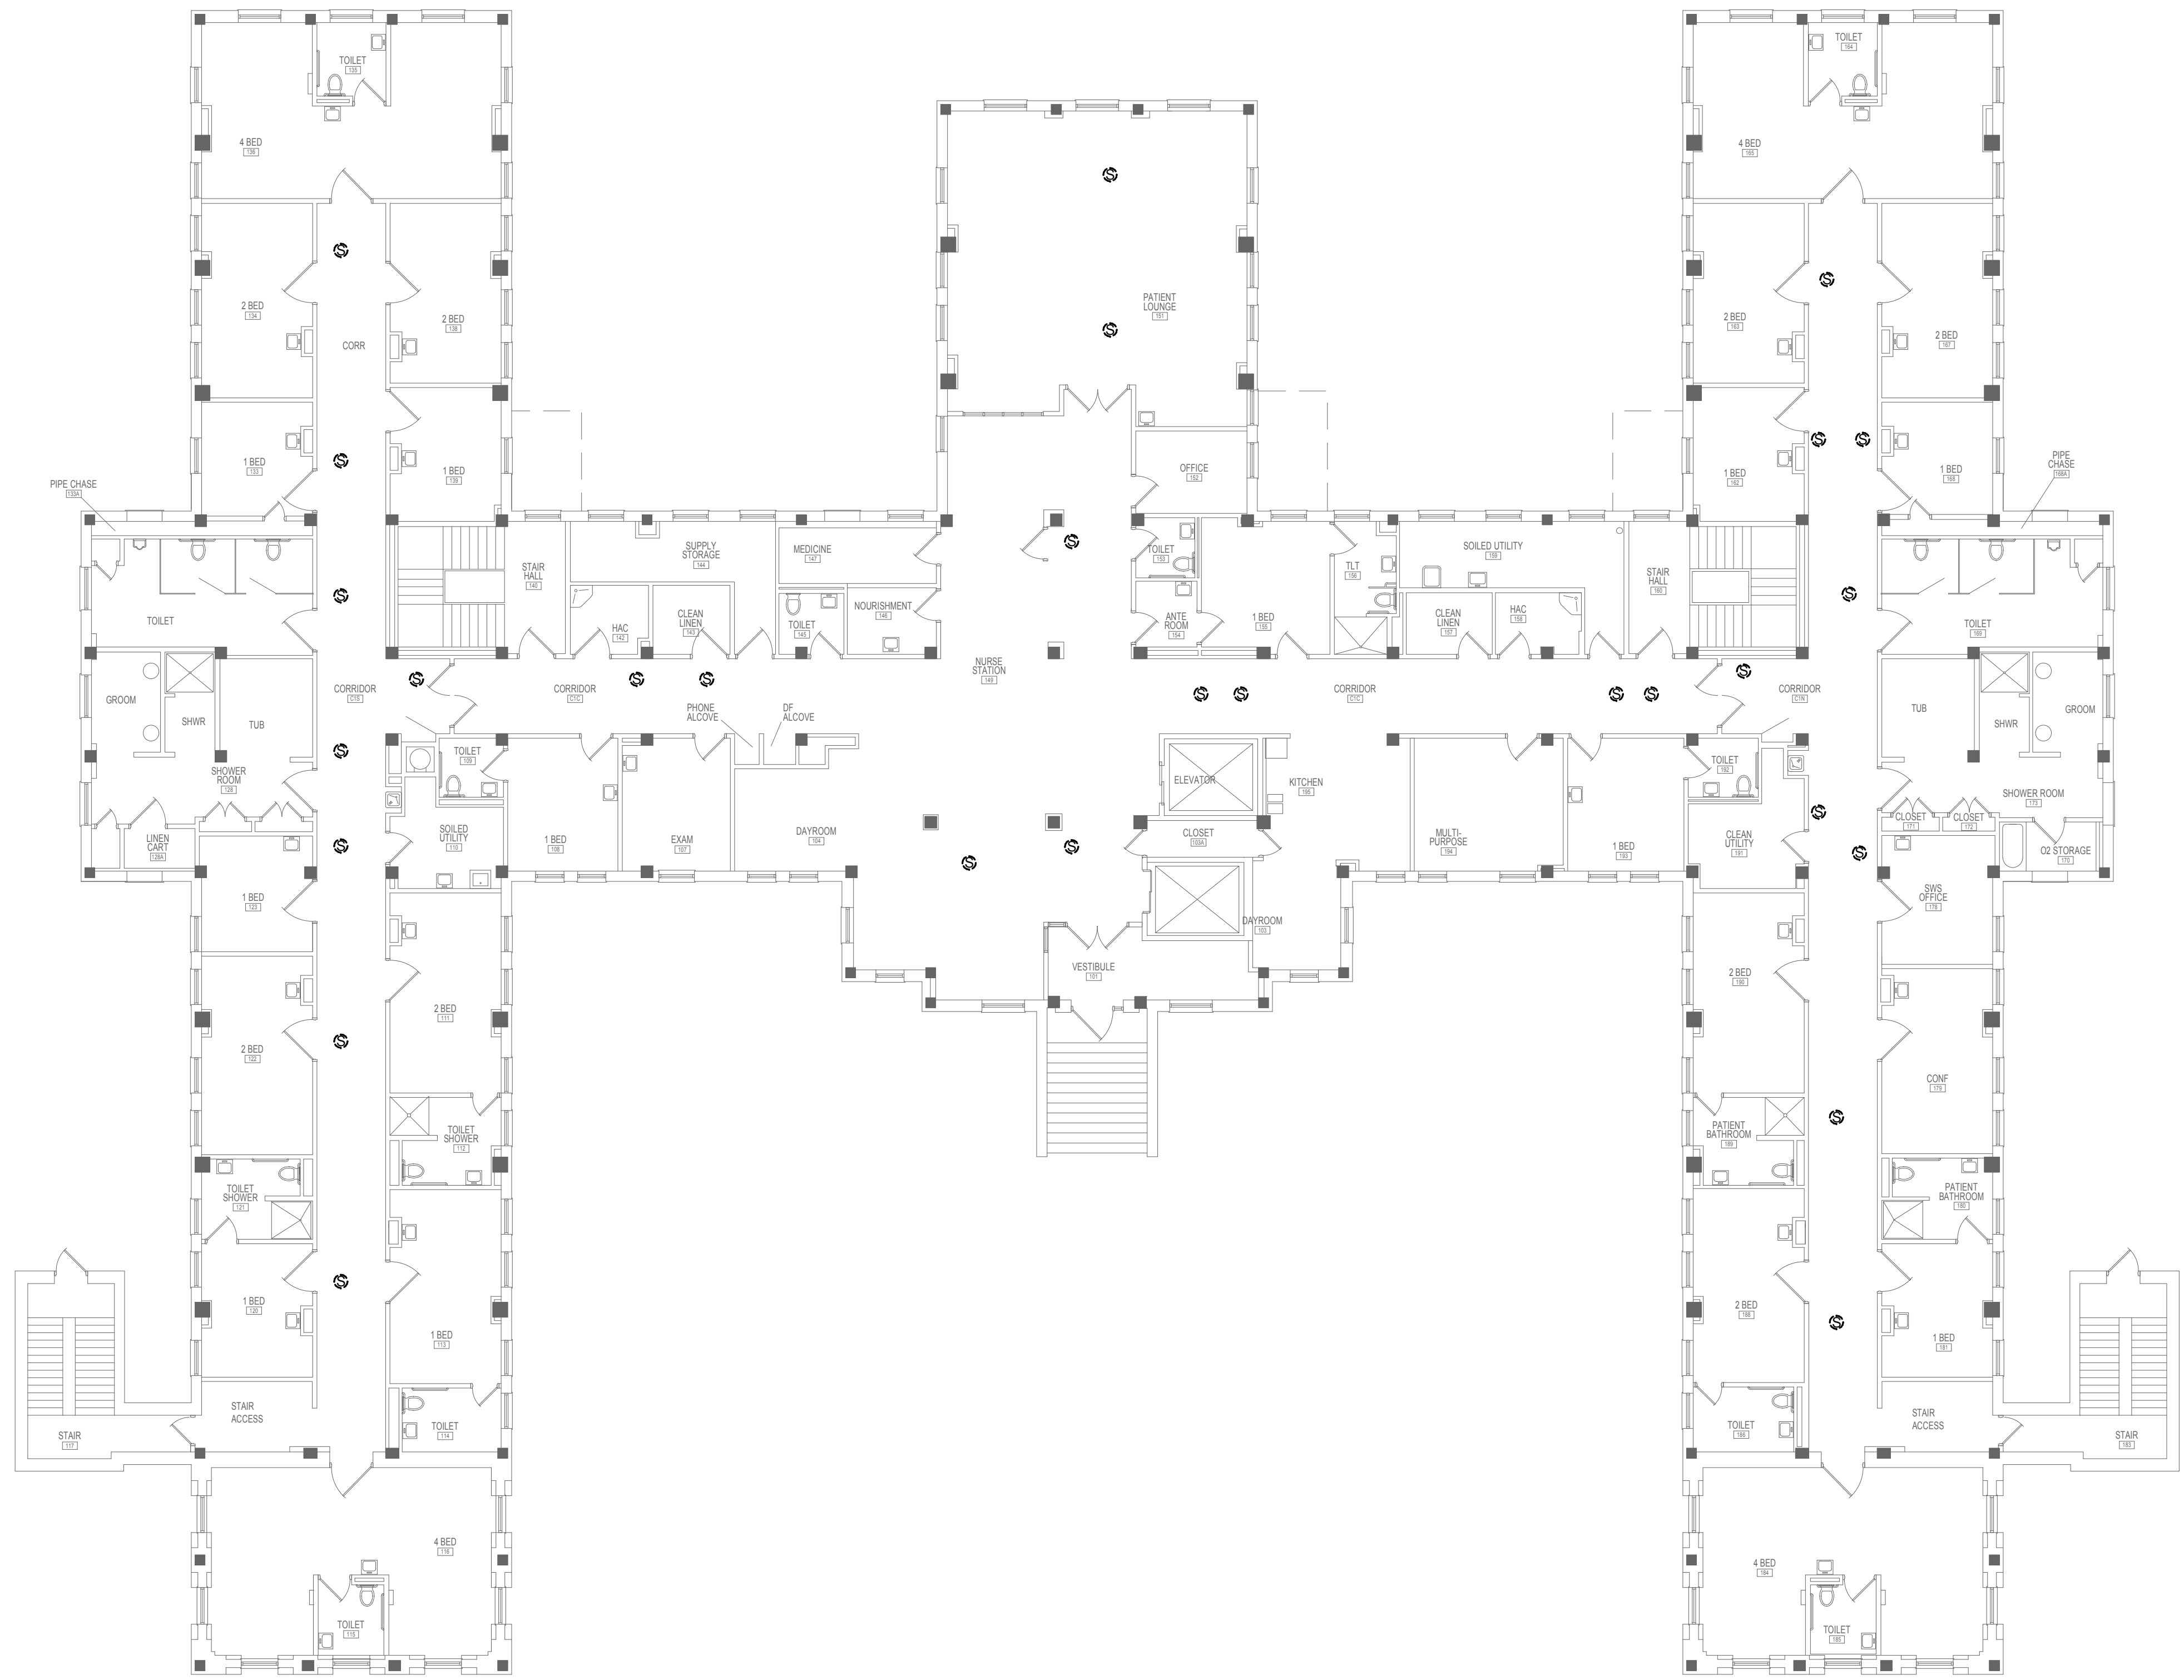

1 01 - 3/32" Signal - Demolition - BLDG 50
3/32" = 1'-0"

C:\Revit\Projects\VA ST CLOUD\PAGING_Elec_Bldg_R12.dwg 1/24/2019 1:29:43 PM

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE
BUILDING 50 - PAGING SPEAKER DEMOLITION FLOOR PLAN - FIRST FLOOR
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:
 APPROVED: CHIEF OF STAFF
 DATE:
 APPROVED: HEALTH CARE SYSTEM DIRECTOR
 DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PLOT SCALE	
PROJECT NO.		ISSUE DATE	
BUILDING No.	CHECKED BY	DRAWN	DATE
	CP	CG	1/24/19
LOCATION	VA MEDICAL CENTER ST. CLOUD, MN 56303	DRAWING NO.	ED50-01

VA
U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

A

B

C


D

E

F

GENERAL NOTES:

- A. REFER TO SHEET ET.101 FOR LOCATION OF BUILDING ON CAMPUS.
- B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE UNACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
- C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
- D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
- E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
- F. CONTRACTOR RESPONSIBLE FOR PROVIDING REPLACEMENT CEILING TILES AFTER REMOVAL OF SPEAKERS. REPLACE CEILING TILE TO MATCH EXISTING ADJACENT CEILING TILE.
- G. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
- H. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
- I. REPAIR OF EXISTING PAINTED AND FINISHED SURFACES: CLEAN, PATCH AND REPAIR EXISTING SURFACES DAMAGED OR ALTERED BY THIS WORK. NO "TELEGRAPHING" OF LINES, RIDGES, FLAKES, ETC. THROUGH NEW SURFACING IS PERMITTED. WHERE THIS OCCURS, SAND SMOOTH AND RE-FINISH UNTIL SURFACE MEETS COR'S APPROVAL. IN EXISTING ROOM OR AREAS WHERE ALTERATIONS BETWEEN NEW AND EXISTING FINISH WILL NOT SHOW IN FINISHED WORK, APPLY ONE (1) PRIME AND TWO (2) FINISH COATS OF PAINT TO MATCH ADJACENT SURFACES AND FINISHES.
- J. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.

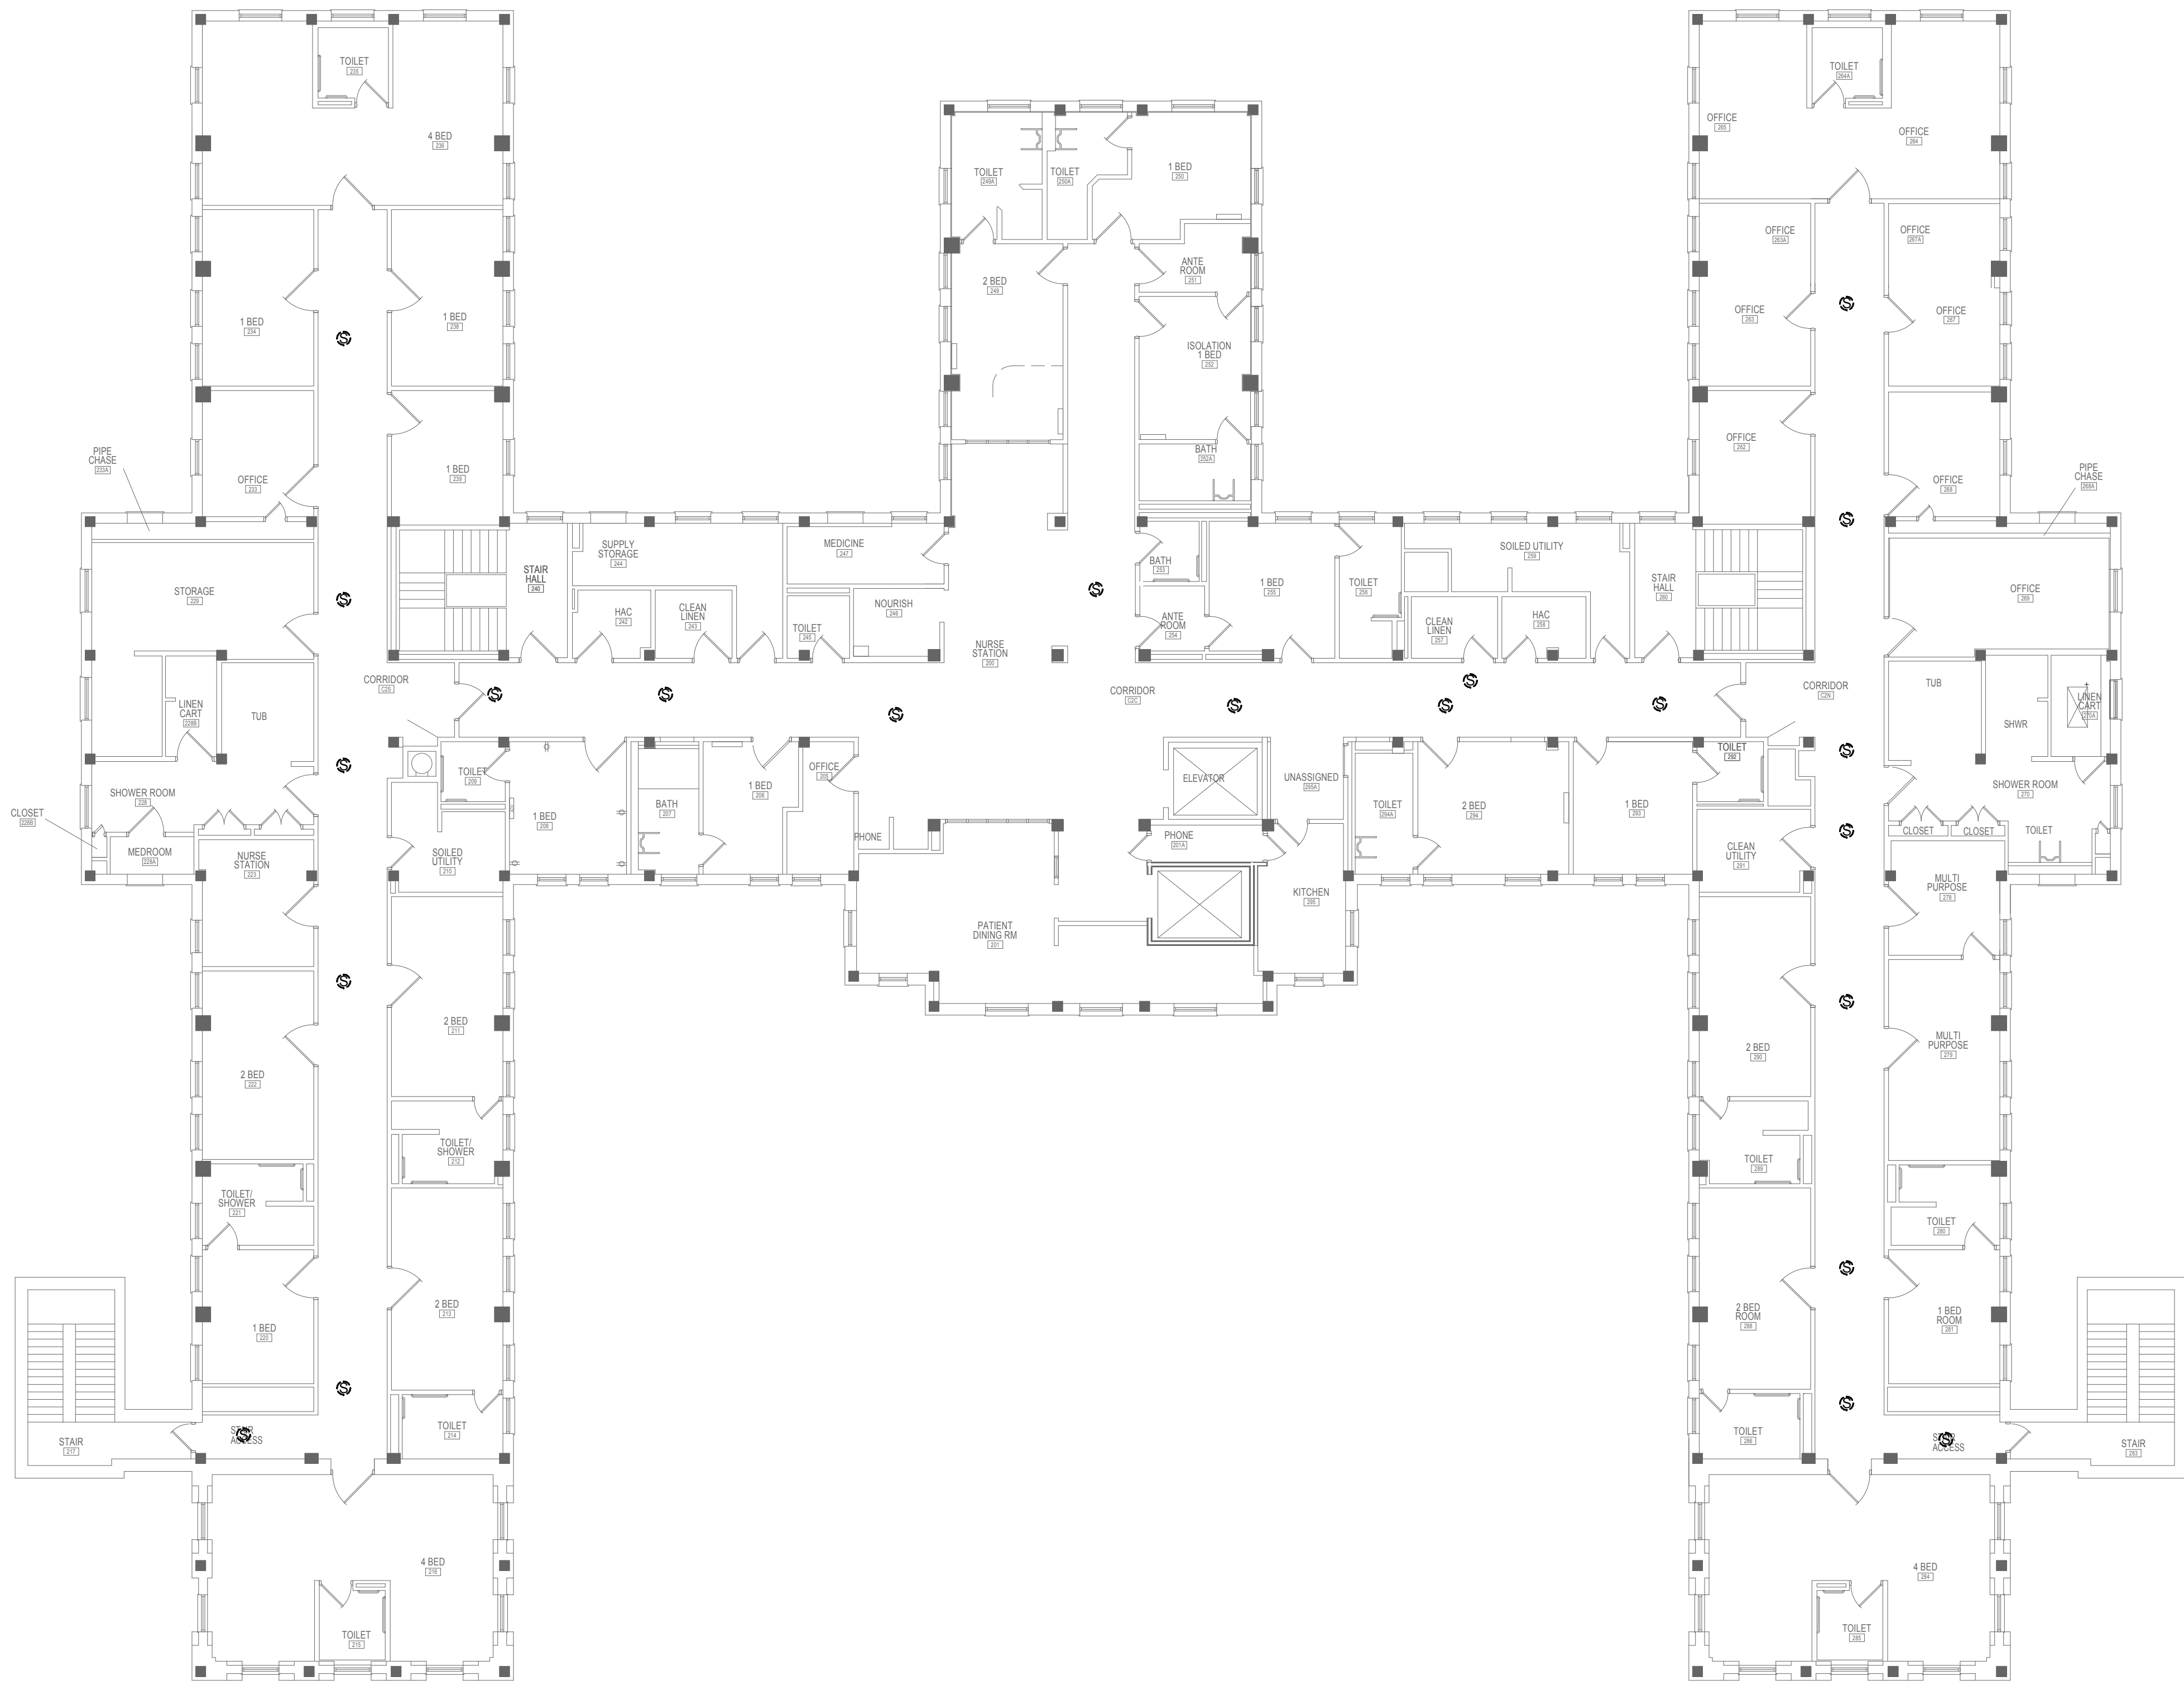

1 02 - 3/32" Signal - Demolition - BLDG 50
3/32" = 1'-0"

1/24/2019 1:29:43 PM

C:\Revit\Projects\VA ST CLOUD\PAGING\Bldg_50_212.dwg

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826


APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE
BUILDING 50 - PAGING SPEAKER DEMOLITION FLOOR PLAN - SECOND FLOOR
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:
 APPROVED: CHIEF OF STAFF
 DATE:
 APPROVED: HEALTH CARE SYSTEM DIRECTOR
 DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PLOT SCALE	
PROJECT NO.		ISSUE DATE	
BUILDING No.	CHECKED BY	DRAWN	DATE
	CP	CG	1/24/19
LOCATION VA MEDICAL CENTER ST. CLOUD, MN 56303		DRAWING NO. ED50-02	

VA
U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

VA FORM 08 - 6231

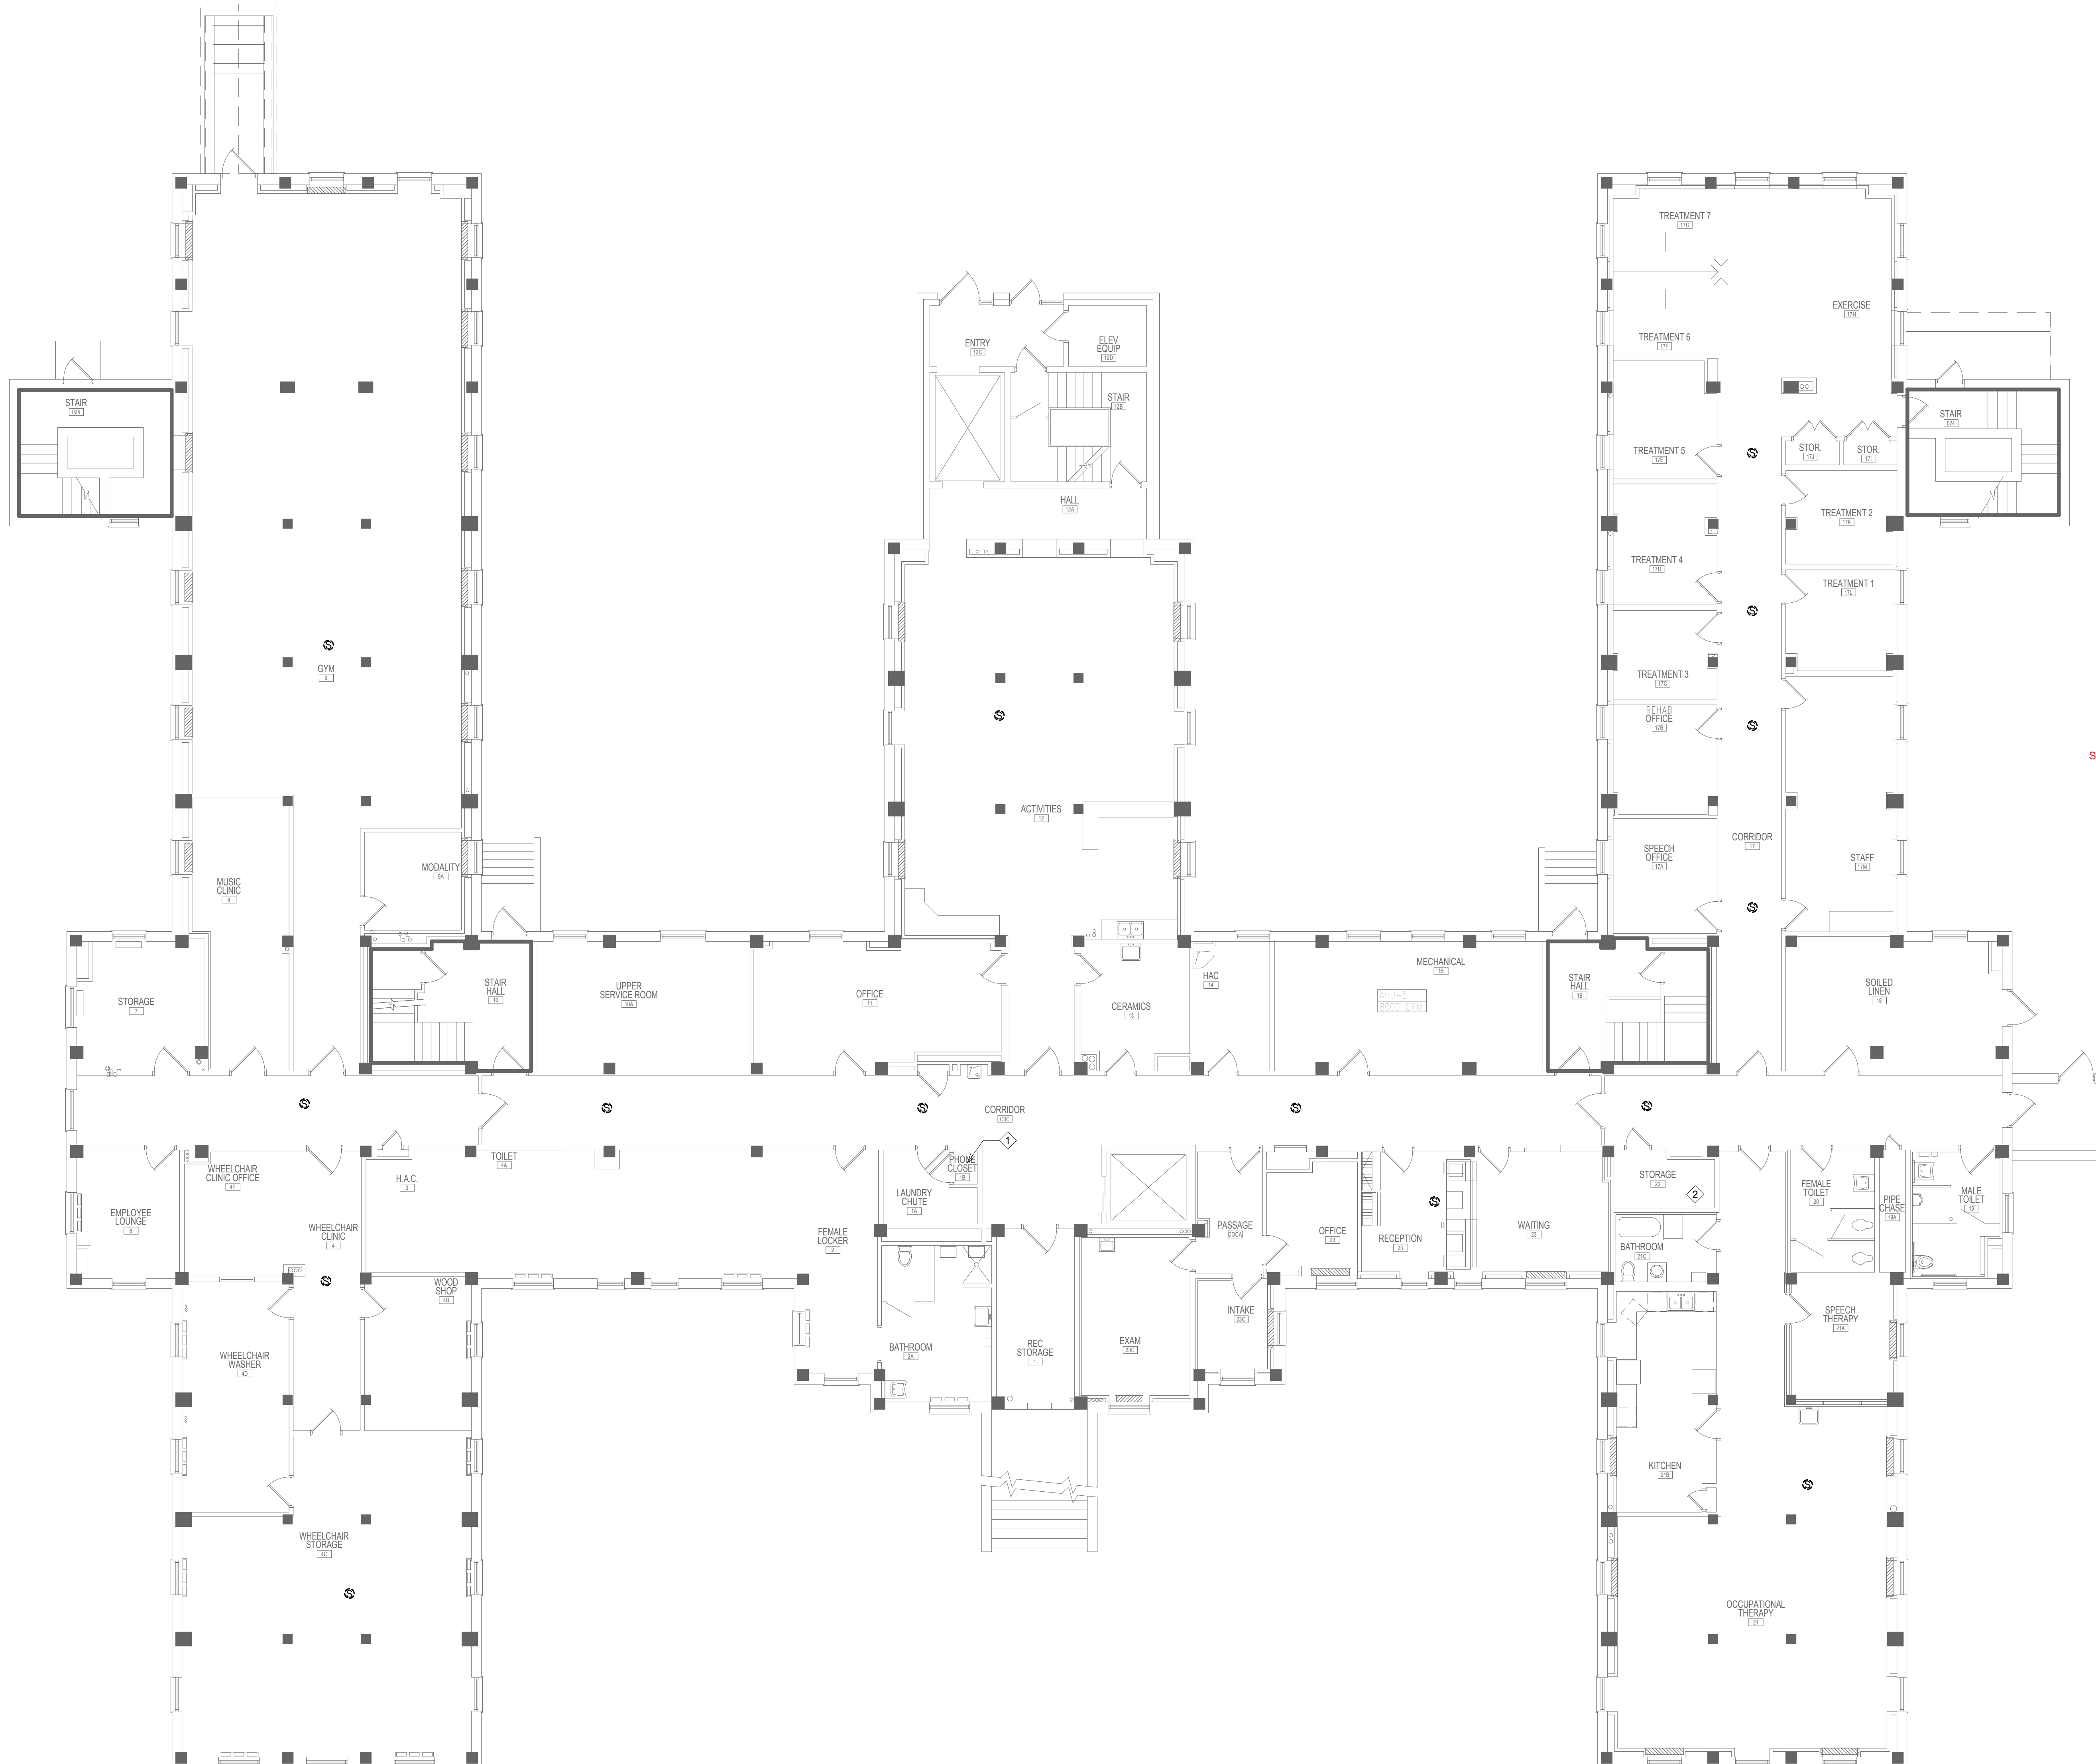

GENERAL NOTES:

- A. REFER TO SHEET ET-101 FOR LOCATION OF BUILDING ON CAMPUS.
- B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE INACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
- C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
- D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
- E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
- F. CONTRACTOR RESPONSIBLE FOR PROVIDING REPLACEMENT CEILING TILES AFTER REMOVAL OF SPEAKERS. REPLACE CEILING TILE TO MATCH EXISTING ADJACENT CEILING TILE.
- G. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
- H. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
- I. REPAIR OF EXISTING PAINTED AND FINISHED SURFACES: CLEAN, PATCH AND REPAIR EXISTING SURFACES DAMAGED OR ALTERED BY THIS WORK. NO "TELEGRAPHING" OF LINES, RIDGES, FLAKES, ETC., THROUGH NEW SURFACING IS PERMITTED. WHERE THIS OCCURS, SAND SMOOTH AND RE-FINISH UNTIL SURFACE MEETS COR'S APPROVAL. IN EXISTING ROOM OR AREAS WHERE ALTERATIONS BETWEEN NEW AND EXISTING FINISH WILL NOT SHOW IN FINISHED WORK, APPLY ONE (1) PRIME AND TWO (2) FINISH COATS OF PAINT TO MATCH ADJACENT SURFACES AND FINISHES.
- J. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.

KEY NOTES:

- ① DEMOLISH EXISTING PUBLIC ADDRESS SYSTEM CABLING, CONNECTIVITY AND ENCLOSURE. REMOVE 120VAC BACK TO SOURCE. REMOVE AND RETURN PUBLIC ADDRESS SYSTEM AMPLIFIER(S) TO OWNER. REMOVAL OF EXISTING SYSTEM SHALL OCCUR AFTER THE NEW PUBLIC ADDRESS SYSTEM IS INSTALLED AND TESTED PER PROJECT REQUIREMENTS.
- ② SALVAGE AND REINSTALL REMOVE PUBLIC ADDRESS SYSTEM NETWORK SWITCH AND ASSOCIATED COMPONENTS. RETURN TO OWNER. REMOVAL OF EQUIPMENT SHALL OCCUR AFTER THE NEW PUBLIC ADDRESS SYSTEM IS INSTALLED AND TESTED PER PROJECT REQUIREMENTS.

1 BUILDING 51 - PAGING SPEAKER DEMOLITION FLOOR PLAN - BASEMENT
1/8" = 1'-0"

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.

 Name: Chris M. Pillod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:


DRAWING TITLE
BUILDING 51 - PAGING SPEAKER DEMOLITION FLOOR PLAN - BASEMENT
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:
 APPROVED: CHIEF OF STAFF
 DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		FLOT SCALE	
APPROVED: CHIEF OF STAFF		PROJECT NO.	
BUILDING No.	CHECKED BY	DRAWN	ISSUE DATE
	CP	CG	1/24/19
LOCATION	DATE	DRAWING NO.	
VA MEDICAL CENTER ST. CLOUD, MN 56303		ED51-00	

U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

GENERAL NOTES:

- A. REFER TO SHEET ET.101 FOR LOCATION OF BUILDING ON CAMPUS.
- B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE UNACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
- C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
- D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
- E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
- F. CONTRACTOR RESPONSIBLE FOR PROVIDING REPLACEMENT CEILING TILES AFTER REMOVAL OF SPEAKERS. REPLACE CEILING TILE TO MATCH EXISTING ADJACENT CEILING TILE.
- G. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
- H. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
- I. REPAIR OF EXISTING PAINTED AND FINISHED SURFACES: CLEAN, PATCH AND REPAIR EXISTING SURFACES DAMAGED OR ALTERED BY THIS WORK. NO "TELEGRAPHING" OF LINES, RIDGES, FLAKES, ETC. THROUGH NEW SURFACING IS PERMITTED. WHERE THIS OCCURS, SAND SMOOTH AND RE-FINISH UNTIL SURFACE MEETS COR'S APPROVAL. IN EXISTING ROOM OR AREAS WHERE ALTERATIONS BETWEEN NEW AND EXISTING FINISH WILL NOT SHOW IN FINISHED WORK, APPLY ONE (1) PRIME AND TWO (2) FINISH COATS OF PAINT TO MATCH ADJACENT SURFACES AND FINISHES.
- J. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.

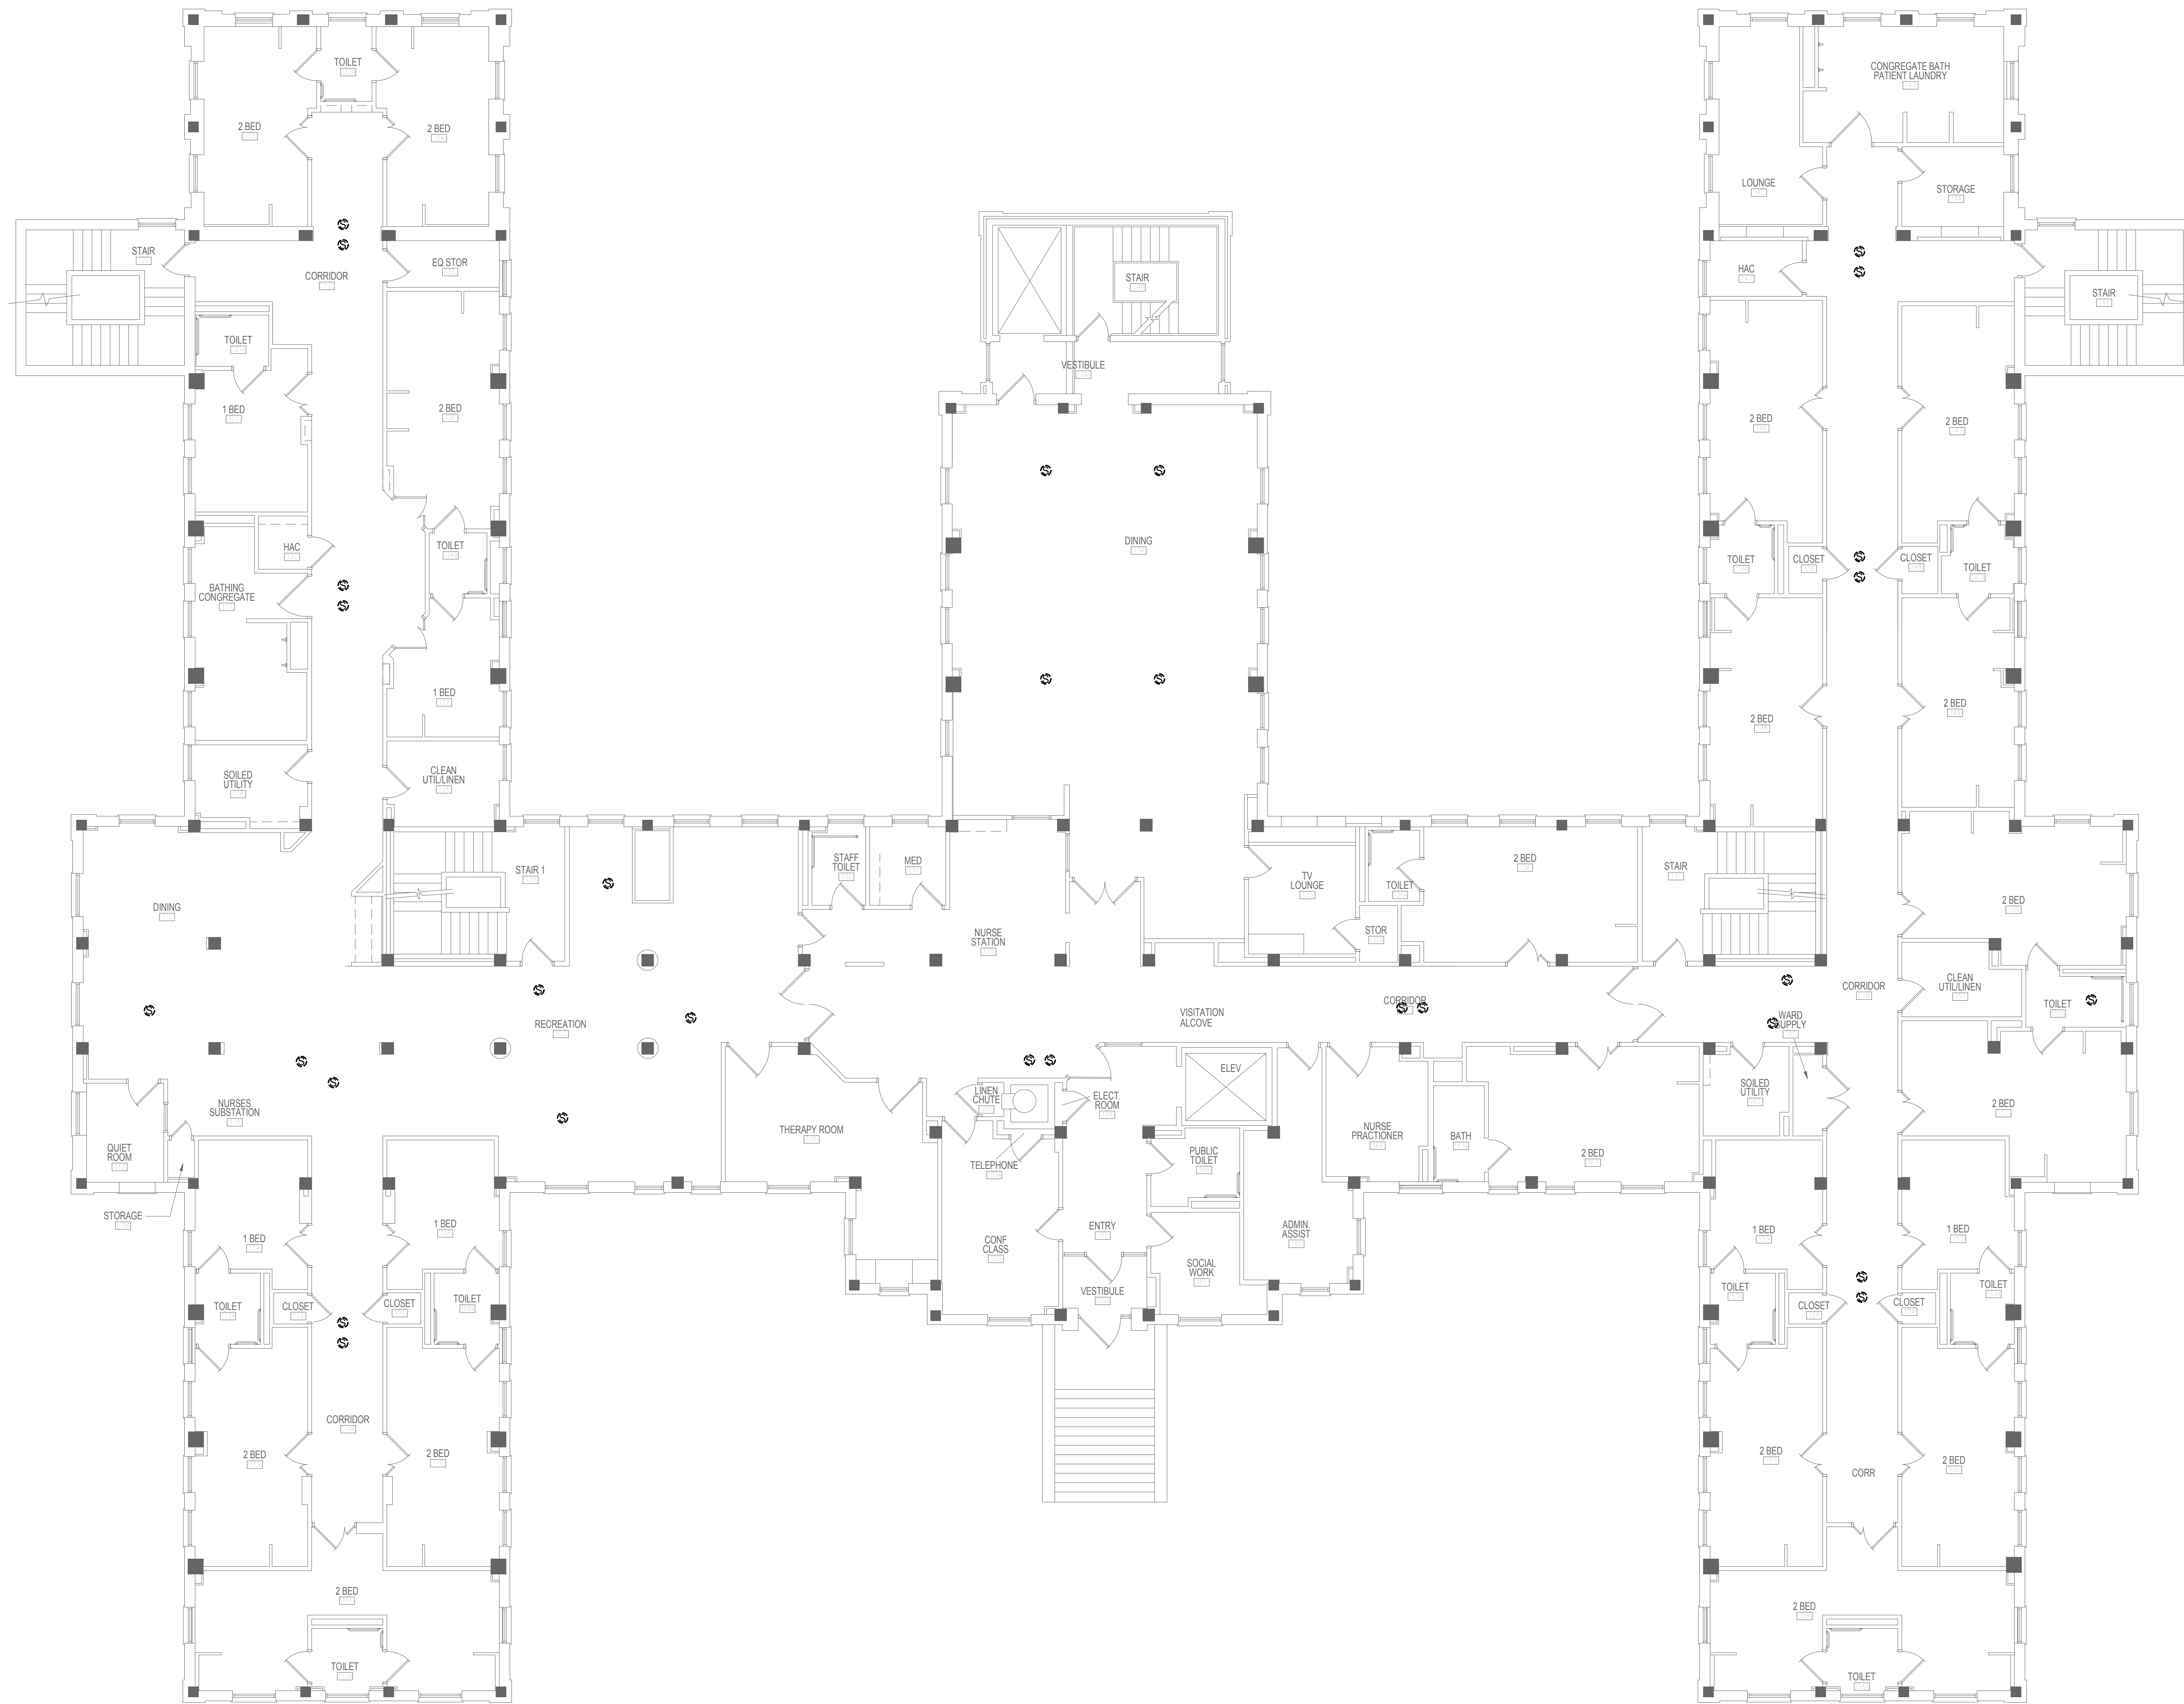

1 BUILDING 51 - PAGING SPEAKER DEMOLITION FLOOR PLAN - FIRST FLOOR
1/8" = 1'-0"

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.

 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:


DRAWING TITLE BUILDING 51 - PAGING SPEAKER DEMOLITION FLOOR PLAN - FIRST FLOOR	PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM
APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR	DATE:
APPROVED: CHIEF OF STAFF	DATE:
APPROVED: HEALTH CARE SYSTEM DIRECTOR	DATE:

BUILDING No.	CHECKED BY	DRAWN	ISSUE DATE
	CP	CG	1/24/19
LOCATION	DATE	DRAWING NO.	
VA MEDICAL CENTER ST. CLOUD, MN 56303		ED51-01	



GENERAL NOTES:

- A. REFER TO SHEET ET.101 FOR LOCATION OF BUILDING ON CAMPUS.
- B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE INACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
- C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
- D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
- E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
- F. CONTRACTOR RESPONSIBLE FOR PROVIDING REPLACEMENT CEILING TILES AFTER REMOVAL OF SPEAKERS. REPLACE CEILING TILE TO MATCH EXISTING ADJACENT CEILING TILE.
- G. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
- H. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
- I. REPAIR OF EXISTING PAINTED AND FINISHED SURFACES: CLEAN, PATCH AND REPAIR EXISTING SURFACES DAMAGED OR ALTERED BY THIS WORK. NO "TELEGRAPHING" OF LINES, RIDGES, FLAKES, ETC. THROUGH NEW SURFACING IS PERMITTED. WHERE THIS OCCURS, SAND SMOOTH AND RE-FINISH UNTIL SURFACE MEETS COR'S APPROVAL. IN EXISTING ROOM OR AREAS WHERE ALTERATIONS BETWEEN NEW AND EXISTING FINISH WILL NOT SHOW IN FINISHED WORK, APPLY ONE (1) PRIME AND TWO (2) FINISH COATS OF PAINT TO MATCH ADJACENT SURFACES AND FINISHES.
- J. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.

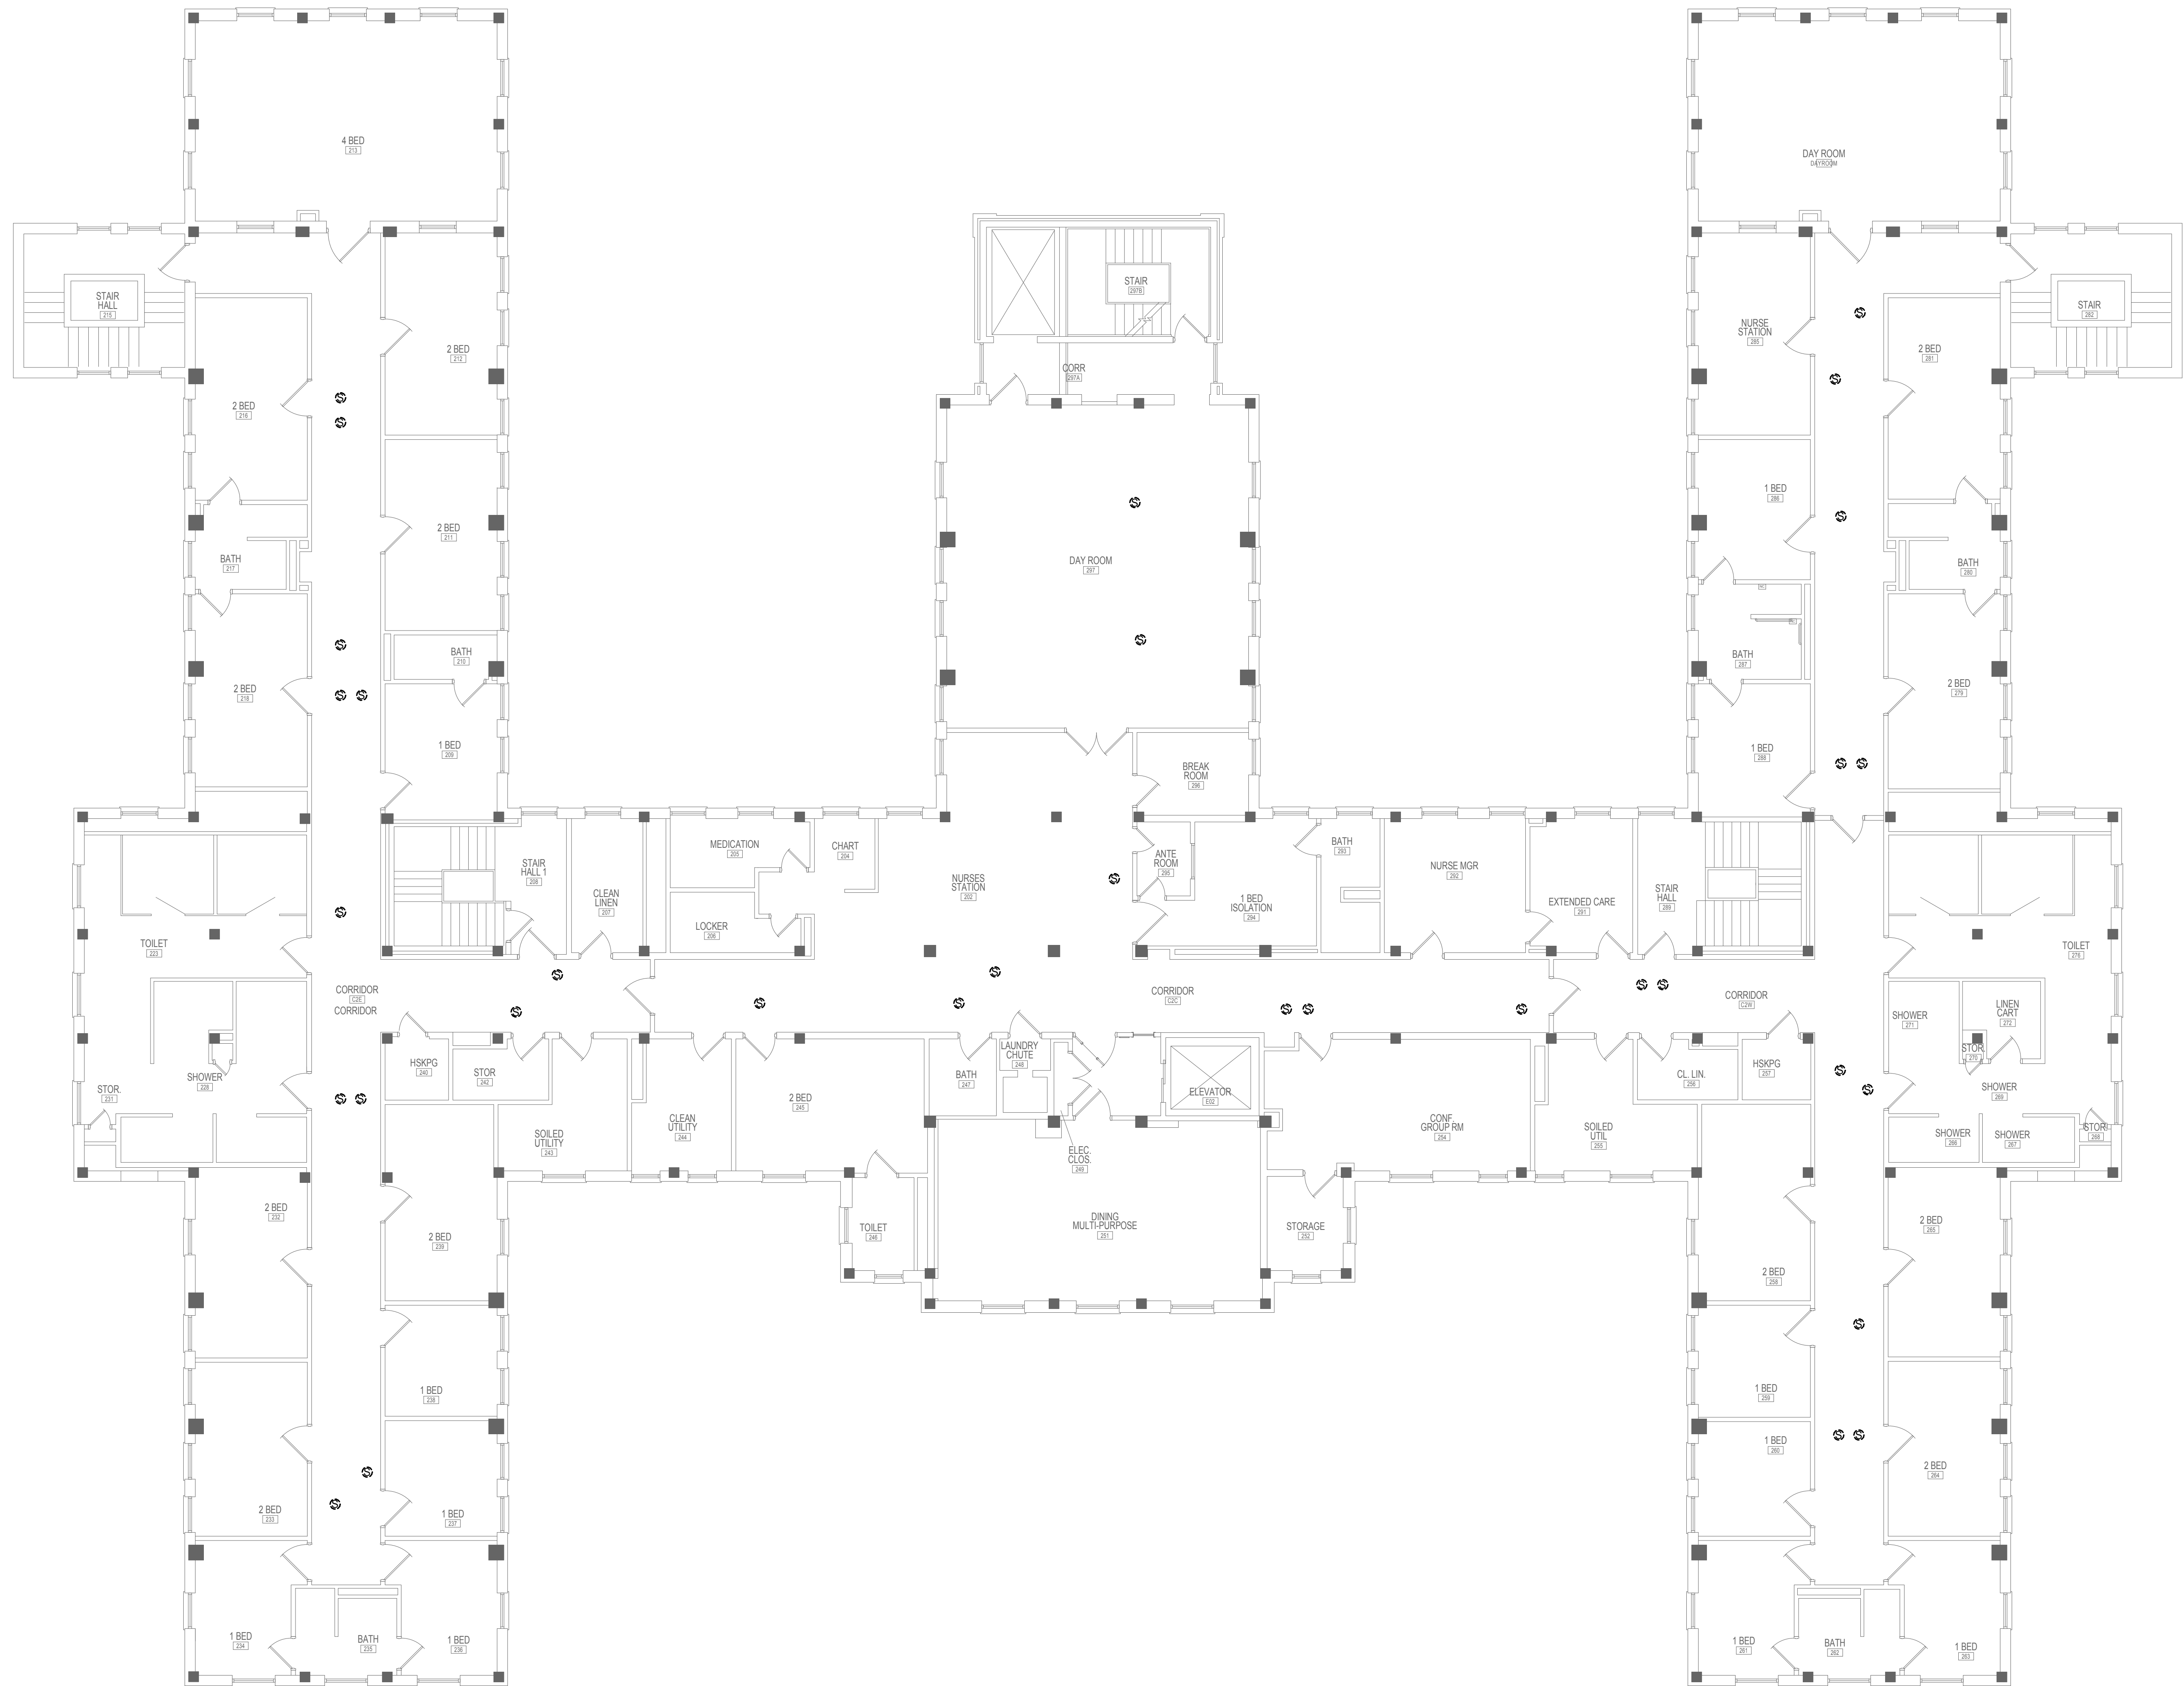

1 BUILDING 51 - PAGING SPEAKER DEMOLITION FLOOR PLAN - SECOND FLOOR
1/8" = 1'-0"

C:\Revit\Projects\VA ST CL CLOUD PAGING_Elec_R12.dwg 1/24/2019 1:20:46 PM

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com
AE PROJECT NUMBER: Project Number

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE
BUILDING 51 - PAGING SPEAKER DEMOLITION FLOOR PLAN - SECOND FLOOR
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:
 APPROVED: CHIEF OF STAFF
 DATE:
 APPROVED: HEALTH CARE SYSTEM DIRECTOR
 DATE:


PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PLOT SCALE	
PROJECT NO.		ISSUE DATE	
BUILDING No.	CHECKED BY	DRAWN	DATE
	CP	CG	1/24/19
LOCATION	DATE	DRAWING NO.	
VA MEDICAL CENTER ST. CLOUD, MN 56303		ED51-02	

VA
U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

A
B
C
D
E
F

GENERAL NOTES:

- A. REFER TO SHEET ET.101 FOR LOCATION OF BUILDING ON CAMPUS.
- B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE INACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
- C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
- D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
- E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
- F. CONTRACTOR RESPONSIBLE FOR PROVIDING REPLACEMENT CEILING TILES AFTER REMOVAL OF SPEAKERS. REPLACE CEILING TILE TO MATCH EXISTING ADJACENT CEILING TILE.
- G. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
- H. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
- I. REPAIR OF EXISTING PAINTED AND FINISHED SURFACES: CLEAN, PATCH AND REPAIR EXISTING SURFACES DAMAGED OR ALTERED BY THIS WORK. NO "TELEGRAPHING" OF LINES, RIDGES, FLAKES, ETC. THROUGH NEW SURFACING IS PERMITTED. WHERE THIS OCCURS, SAND SMOOTH AND RE-FINISH UNTIL SURFACE MEETS COR'S APPROVAL. IN EXISTING ROOM OR AREAS WHERE ALTERATIONS BETWEEN NEW AND EXISTING FINISH WILL NOT SHOW IN FINISHED WORK, APPLY ONE (1) PRIME AND TWO (2) FINISH COATS OF PAINT TO MATCH ADJACENT SURFACES AND FINISHES.
- J. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.

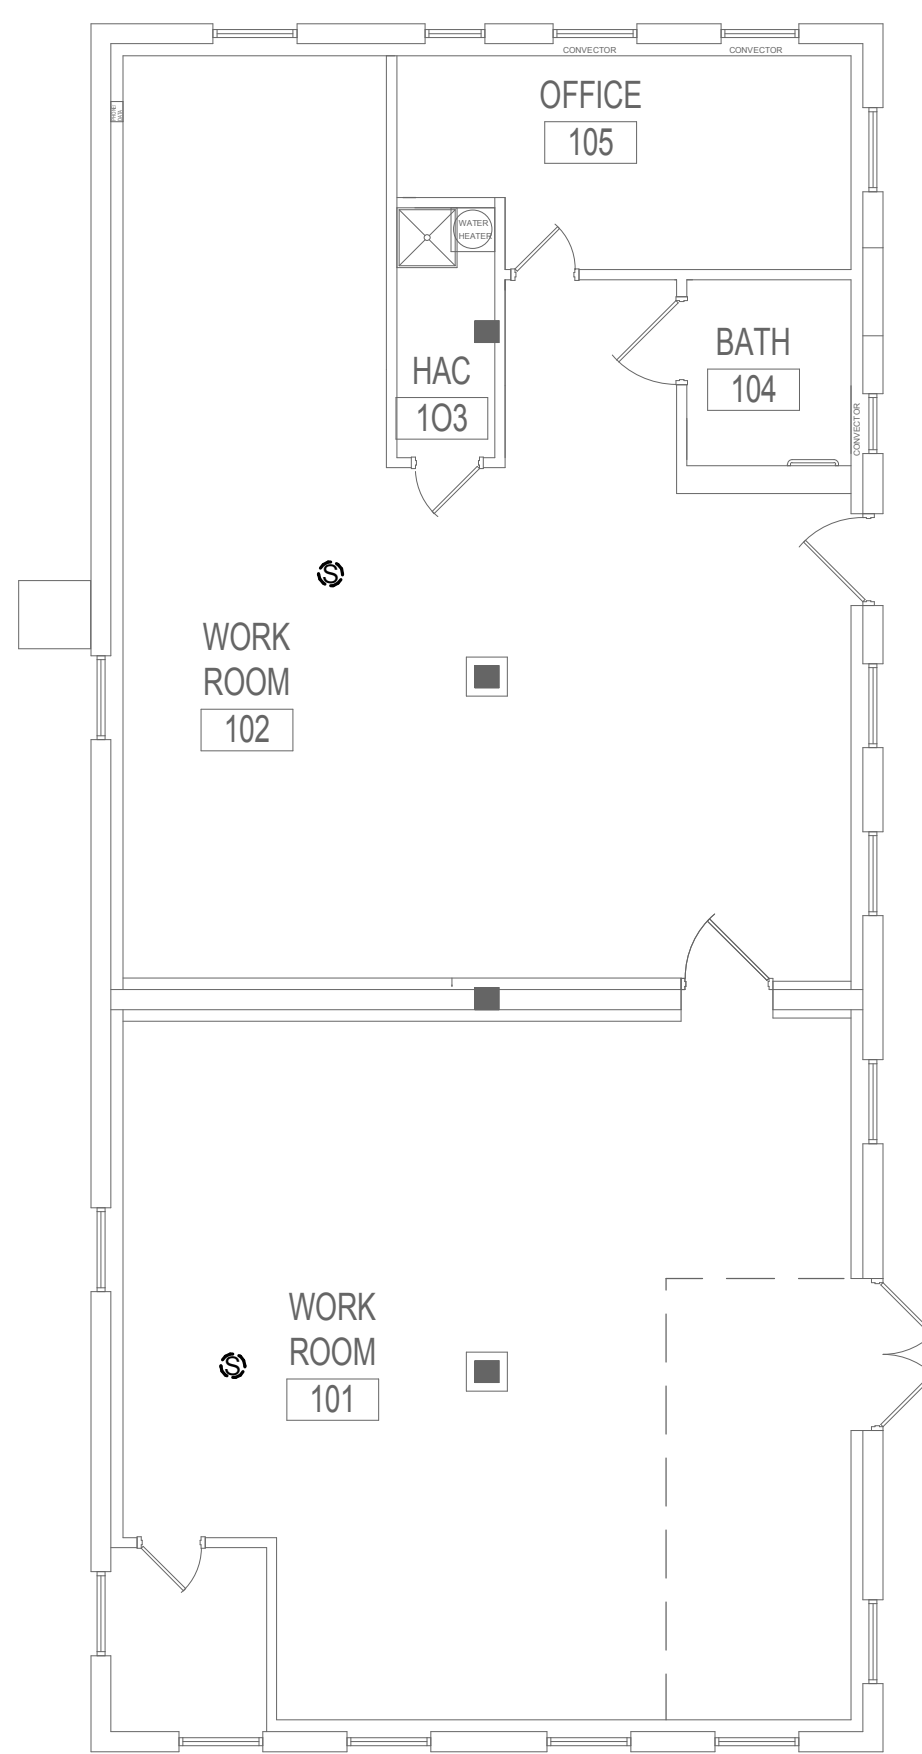

1 BUILDING 57 - PAGING SPEAKER FLOOR PLAN - FIRST FLOOR
1/8" = 1'-0"

1/24/2019 11:29:46 PM

C:\Revit\Projects\VA ST CLOUD PAGING_Elec_Bldg_R12.dwg

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:


DRAWING TITLE
BUILDING 57 - PAGING SPEAKER DEMOLITION FLOOR PLAN - FIRST FLOOR
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:
 APPROVED: CHIEF OF STAFF
 DATE:
 APPROVED: HEALTH CARE SYSTEM DIRECTOR
 DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PROJECT NO.:	
BUILDING No.:	CHECKED BY: CP	DRAWN: CG	ISSUE DATE: 1/24/19
LOCATION: VA MEDICAL CENTER ST. CLOUD, MN 56303	DATE:	DRAWING NO.:	ED57-01


VA
U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

GENERAL NOTES:

- A. REFER TO SHEET ET.101 FOR LOCATION OF BUILDING ON CAMPUS.
- B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE INACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
- C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
- D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
- E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
- F. CONTRACTOR RESPONSIBLE FOR PROVIDING REPLACEMENT CEILING TILES AFTER REMOVAL OF SPEAKERS. REPLACE CEILING TILE TO MATCH EXISTING ADJACENT CEILING TILE.
- G. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
- H. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
- I. REPAIR OF EXISTING PAINTED AND FINISHED SURFACES: CLEAN, PATCH AND REPAIR EXISTING SURFACES DAMAGED OR ALTERED BY THIS WORK. NO "TELEGRAPHING" OF LINES, RIDGES, FLAKES, ETC. THROUGH NEW SURFACING IS PERMITTED. WHERE THIS OCCURS, SAND SMOOTH AND RE-FINISH UNTIL SURFACE MEETS COR'S APPROVAL. IN EXISTING ROOM OR AREAS WHERE ALTERATIONS BETWEEN NEW AND EXISTING FINISH WILL NOT SHOW IN FINISHED WORK, APPLY ONE (1) PRIME AND TWO (2) FINISH COATS OF PAINT TO MATCH ADJACENT SURFACES AND FINISHES.
- J. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.

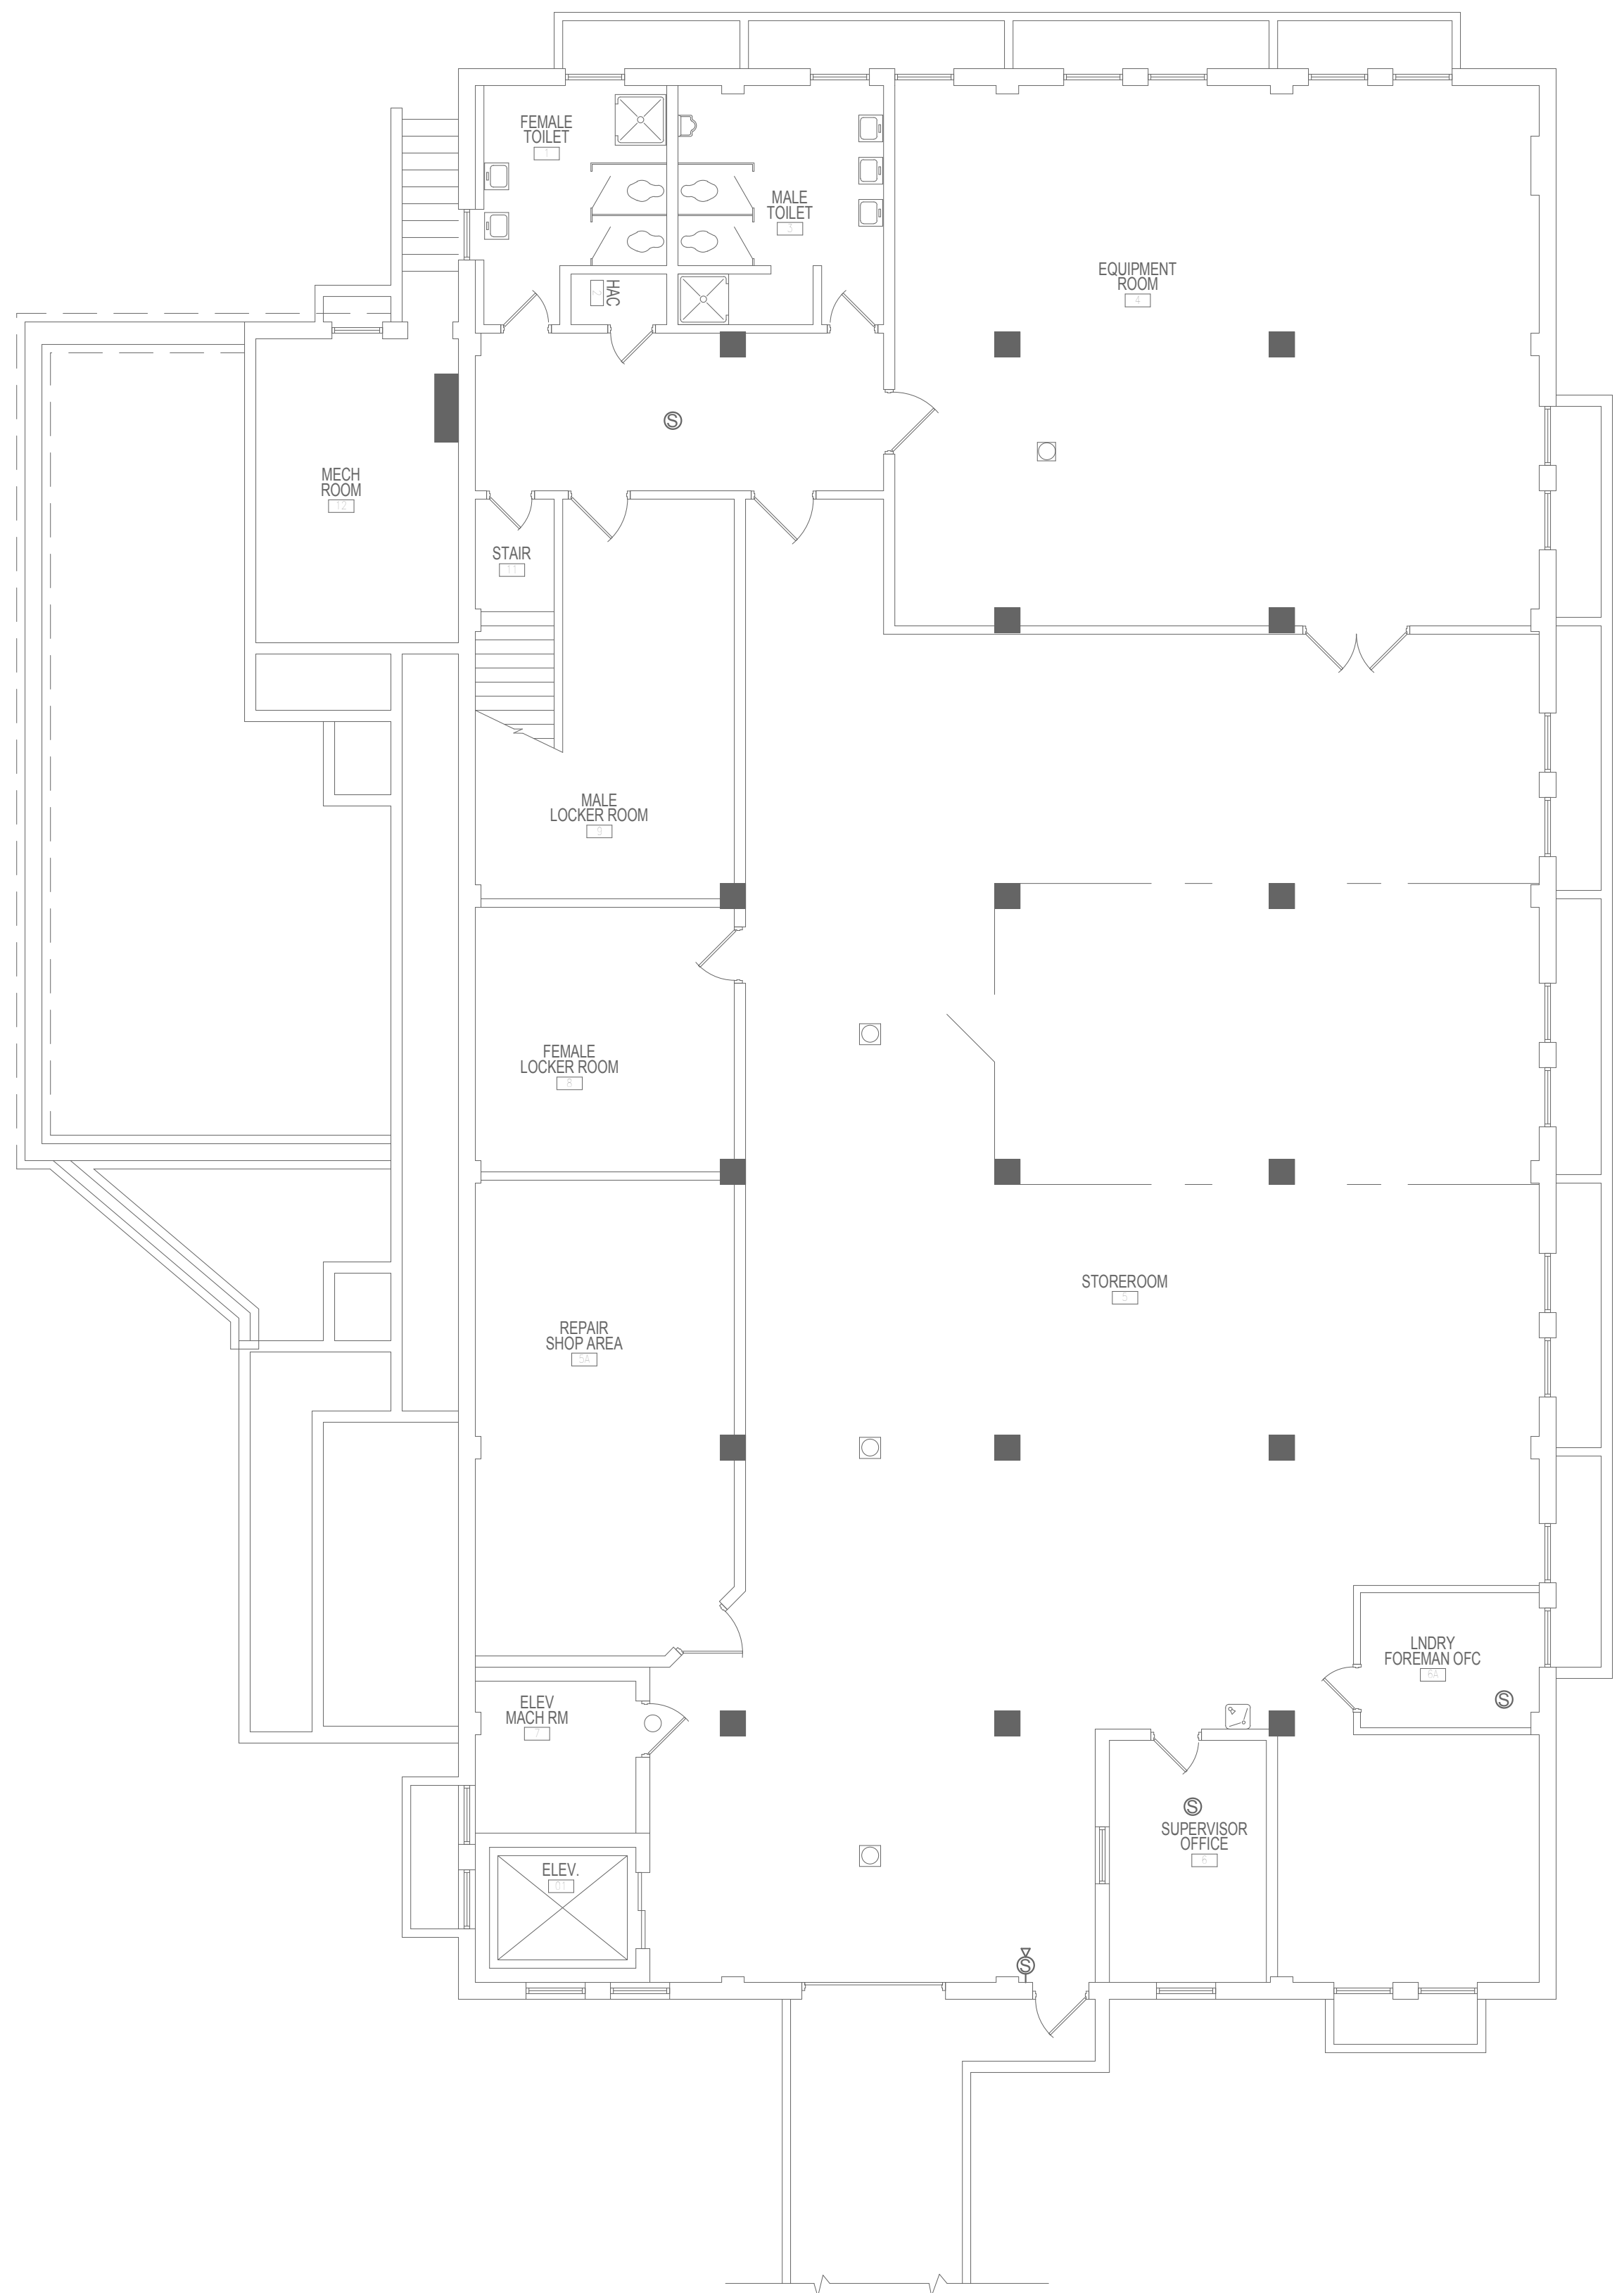

① BUILDING 59 - PAGING SPEAKER DEMOLITION FLOOR PLAN - BASEMENT
1/8" = 1'-0"

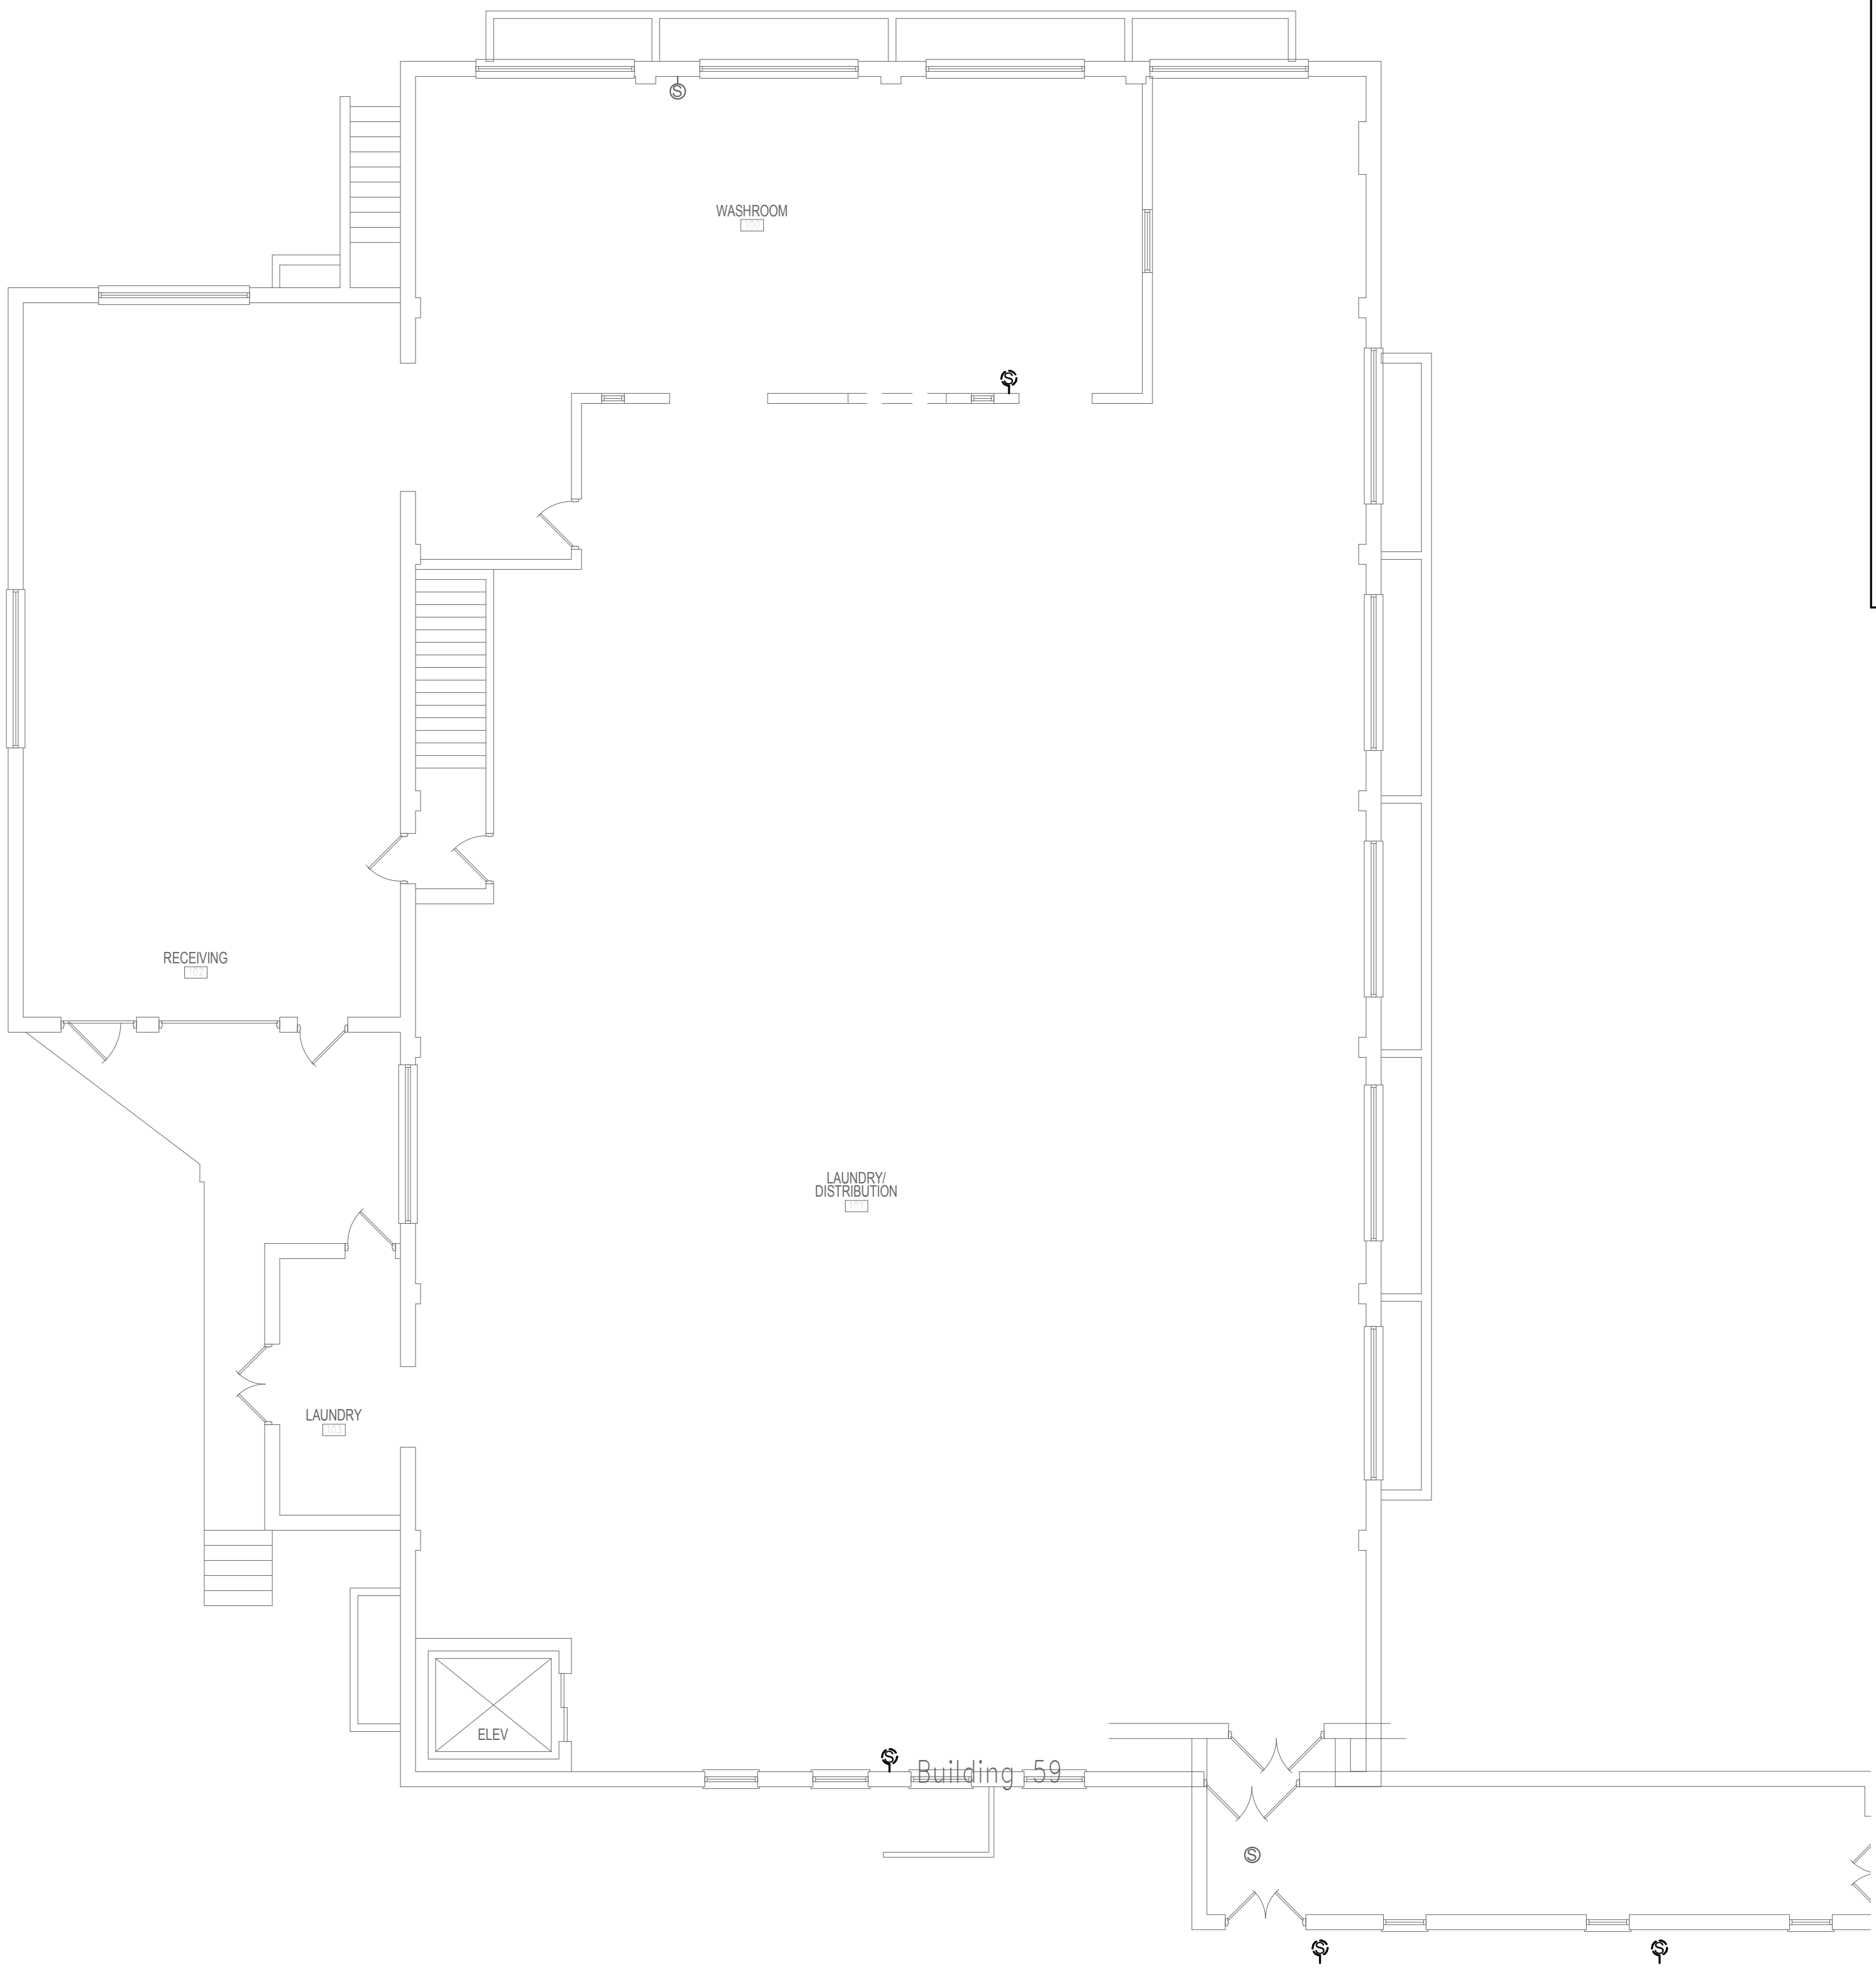

② BUILDING 59 - PAGING SPEAKER DEMOLITION FLOOR PLAN - FIRST FLOOR
1/8" = 1'-0"

C:\Revit\Projects\VA ST CLOUD\BUILDING_59\Bldg_R12.dwg 1/24/2019 1:26:47 PM

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:


DRAWING TITLE
BUILDING 59 - PAGING SPEAKER DEMOLITION FLOOR PLAN - BASEMENT
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:
 APPROVED: CHIEF OF STAFF
 DATE:
 APPROVED: HEALTH CARE SYSTEM DIRECTOR
 DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PLOT SCALE	
PROJECT NO.		DATE	
BUILDING No.	CHECKED BY	DRAWN	ISSUE DATE
	CP	CG	1/24/19
LOCATION VA MEDICAL CENTER ST. CLOUD, MN 56303		DRAWING NO. ED59-00	

VA **U.S. Department of Veterans Affairs**
 Veterans Health Administration
 St. Cloud VA Health Care System

GENERAL NOTES:

- A. REFER TO SHEET ET.101 FOR LOCATION OF BUILDING ON CAMPUS.
- B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE INACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
- C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
- D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
- E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
- F. CONTRACTOR RESPONSIBLE FOR PROVIDING REPLACEMENT CEILING TILES AFTER REMOVAL OF SPEAKERS. REPLACE CEILING TILE TO MATCH EXISTING ADJACENT CEILING TILE.
- G. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
- H. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
- I. REPAIR OF EXISTING PAINTED AND FINISHED SURFACES: CLEAN, PATCH AND REPAIR EXISTING SURFACES DAMAGED OR ALTERED BY THIS WORK. NO "TELEGRAPHING" OF LINES, RIDGES, FLAKES, ETC. THROUGH NEW SURFACING IS PERMITTED. WHERE THIS OCCURS, SAND SMOOTH AND RE-FINISH UNTIL SURFACE MEETS COR'S APPROVAL. IN EXISTING ROOM OR AREAS WHERE ALTERATIONS BETWEEN NEW AND EXISTING FINISH WILL NOT SHOW IN FINISHED WORK, APPLY ONE (1) PRIME AND TWO (2) FINISH COATS OF PAINT TO MATCH ADJACENT SURFACES AND FINISHES.
- J. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.

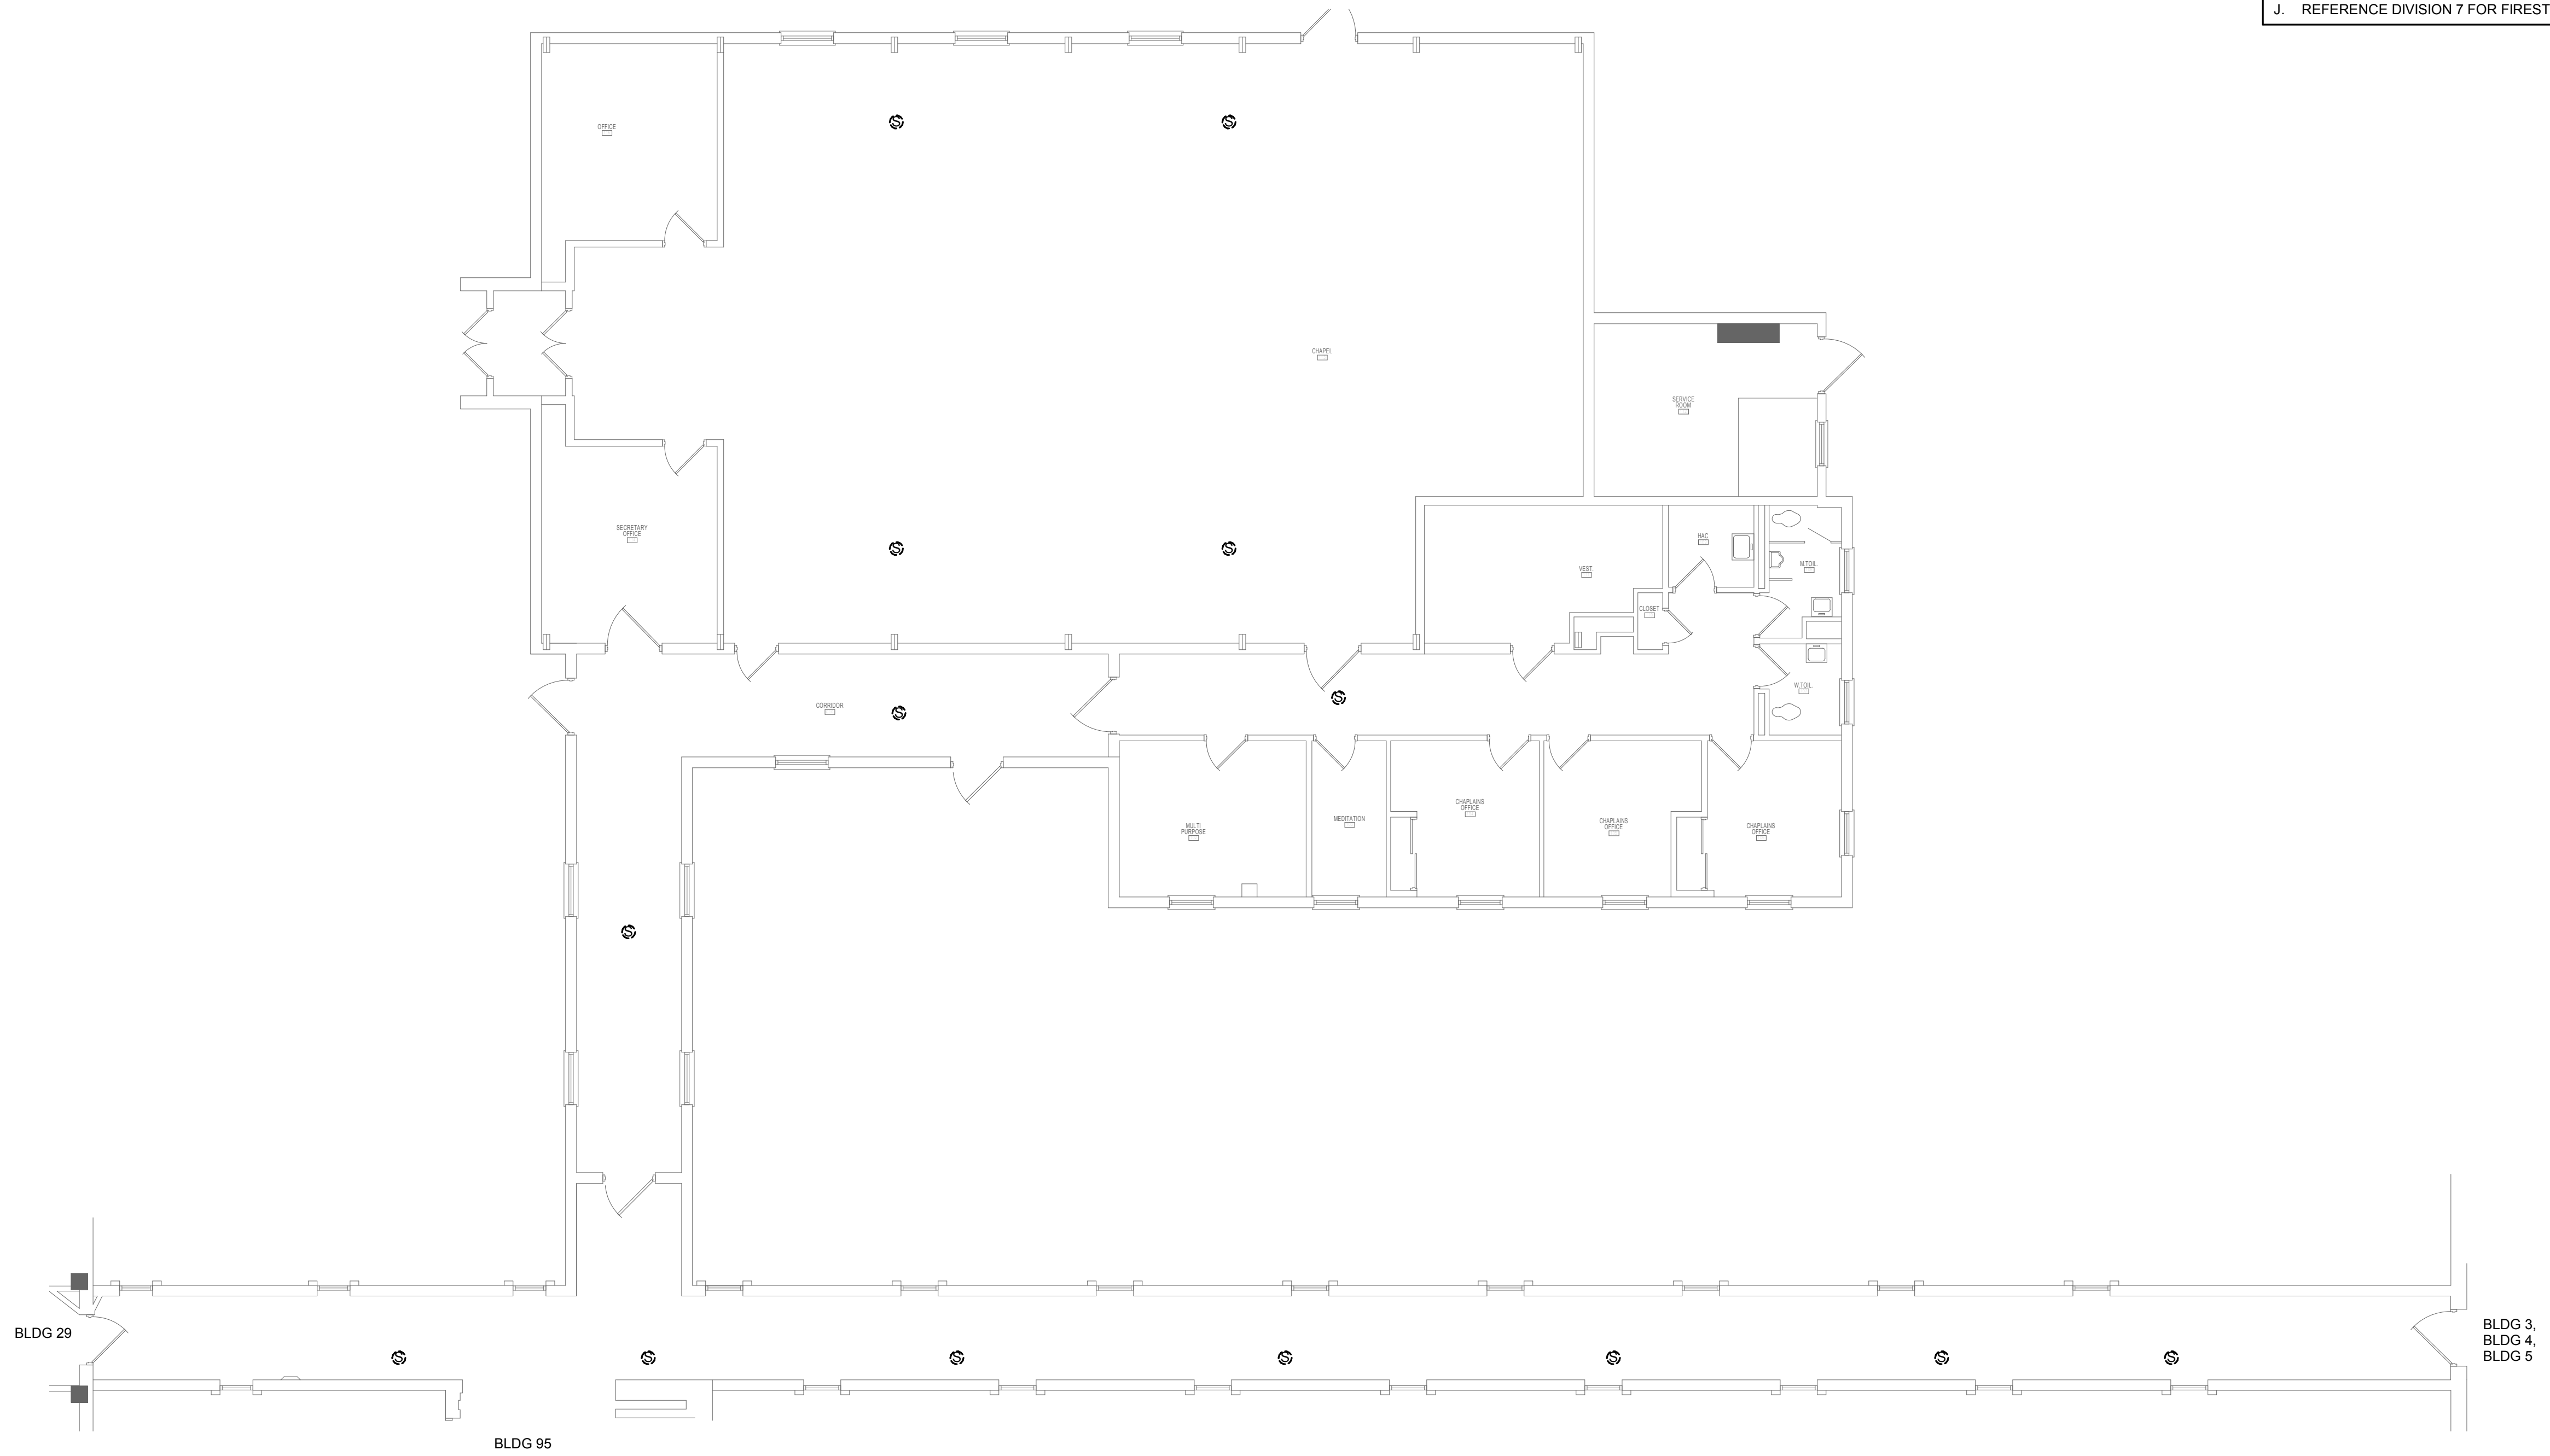


1 BUILDING 88 - PAGING SPEAKER DEMOLITION FLOOR PLAN - FIRST FLOOR
 1/8" = 1'-0"

1/24/2019 1:26:47 PM

C:\Revit\Projects\VA ST CLOUD PAGING_Bldg_R12_cmg.rvt

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD


ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:


DRAWING TITLE
BUILDING 88 - PAGING SPEAKER DEMOLITION FLOOR PLAN - FIRST FLOOR
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:
 APPROVED: CHIEF OF STAFF
 DATE:
 APPROVED: HEALTH CARE SYSTEM DIRECTOR
 DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PROJECT NO.:	
BUILDING No.:	CHECKED BY:	DRAWN:	ISSUE DATE:
	CP	CG	1/24/19
LOCATION	VA MEDICAL CENTER ST. CLOUD, MN 56303	DRAWING NO.:	ED88-01

VA 
U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

GENERAL NOTES:

- A. REFER TO SHEET ET.101 FOR LOCATION OF BUILDING ON CAMPUS.
- B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE INACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
- C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
- D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
- E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
- F. CONTRACTOR RESPONSIBLE FOR PROVIDING REPLACEMENT CEILING TILES AFTER REMOVAL OF SPEAKERS. REPLACE CEILING TILE TO MATCH EXISTING ADJACENT CEILING TILE.
- G. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
- H. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
- I. REPAIR OF EXISTING PAINTED AND FINISHED SURFACES: CLEAN, PATCH AND REPAIR EXISTING SURFACES DAMAGED OR ALTERED BY THIS WORK. NO "TELEGRAPHING" OF LINES, RIDGES, FLAKES, ETC. THROUGH NEW SURFACING IS PERMITTED. WHERE THIS OCCURS, SAND SMOOTH AND RE-FINISH UNTIL SURFACE MEETS COR'S APPROVAL. IN EXISTING ROOM OR AREAS WHERE ALTERATIONS BETWEEN NEW AND EXISTING FINISH WILL NOT SHOW IN FINISHED WORK, APPLY ONE (1) PRIME AND TWO (2) FINISH COATS OF PAINT TO MATCH ADJACENT SURFACES AND FINISHES.
- J. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.

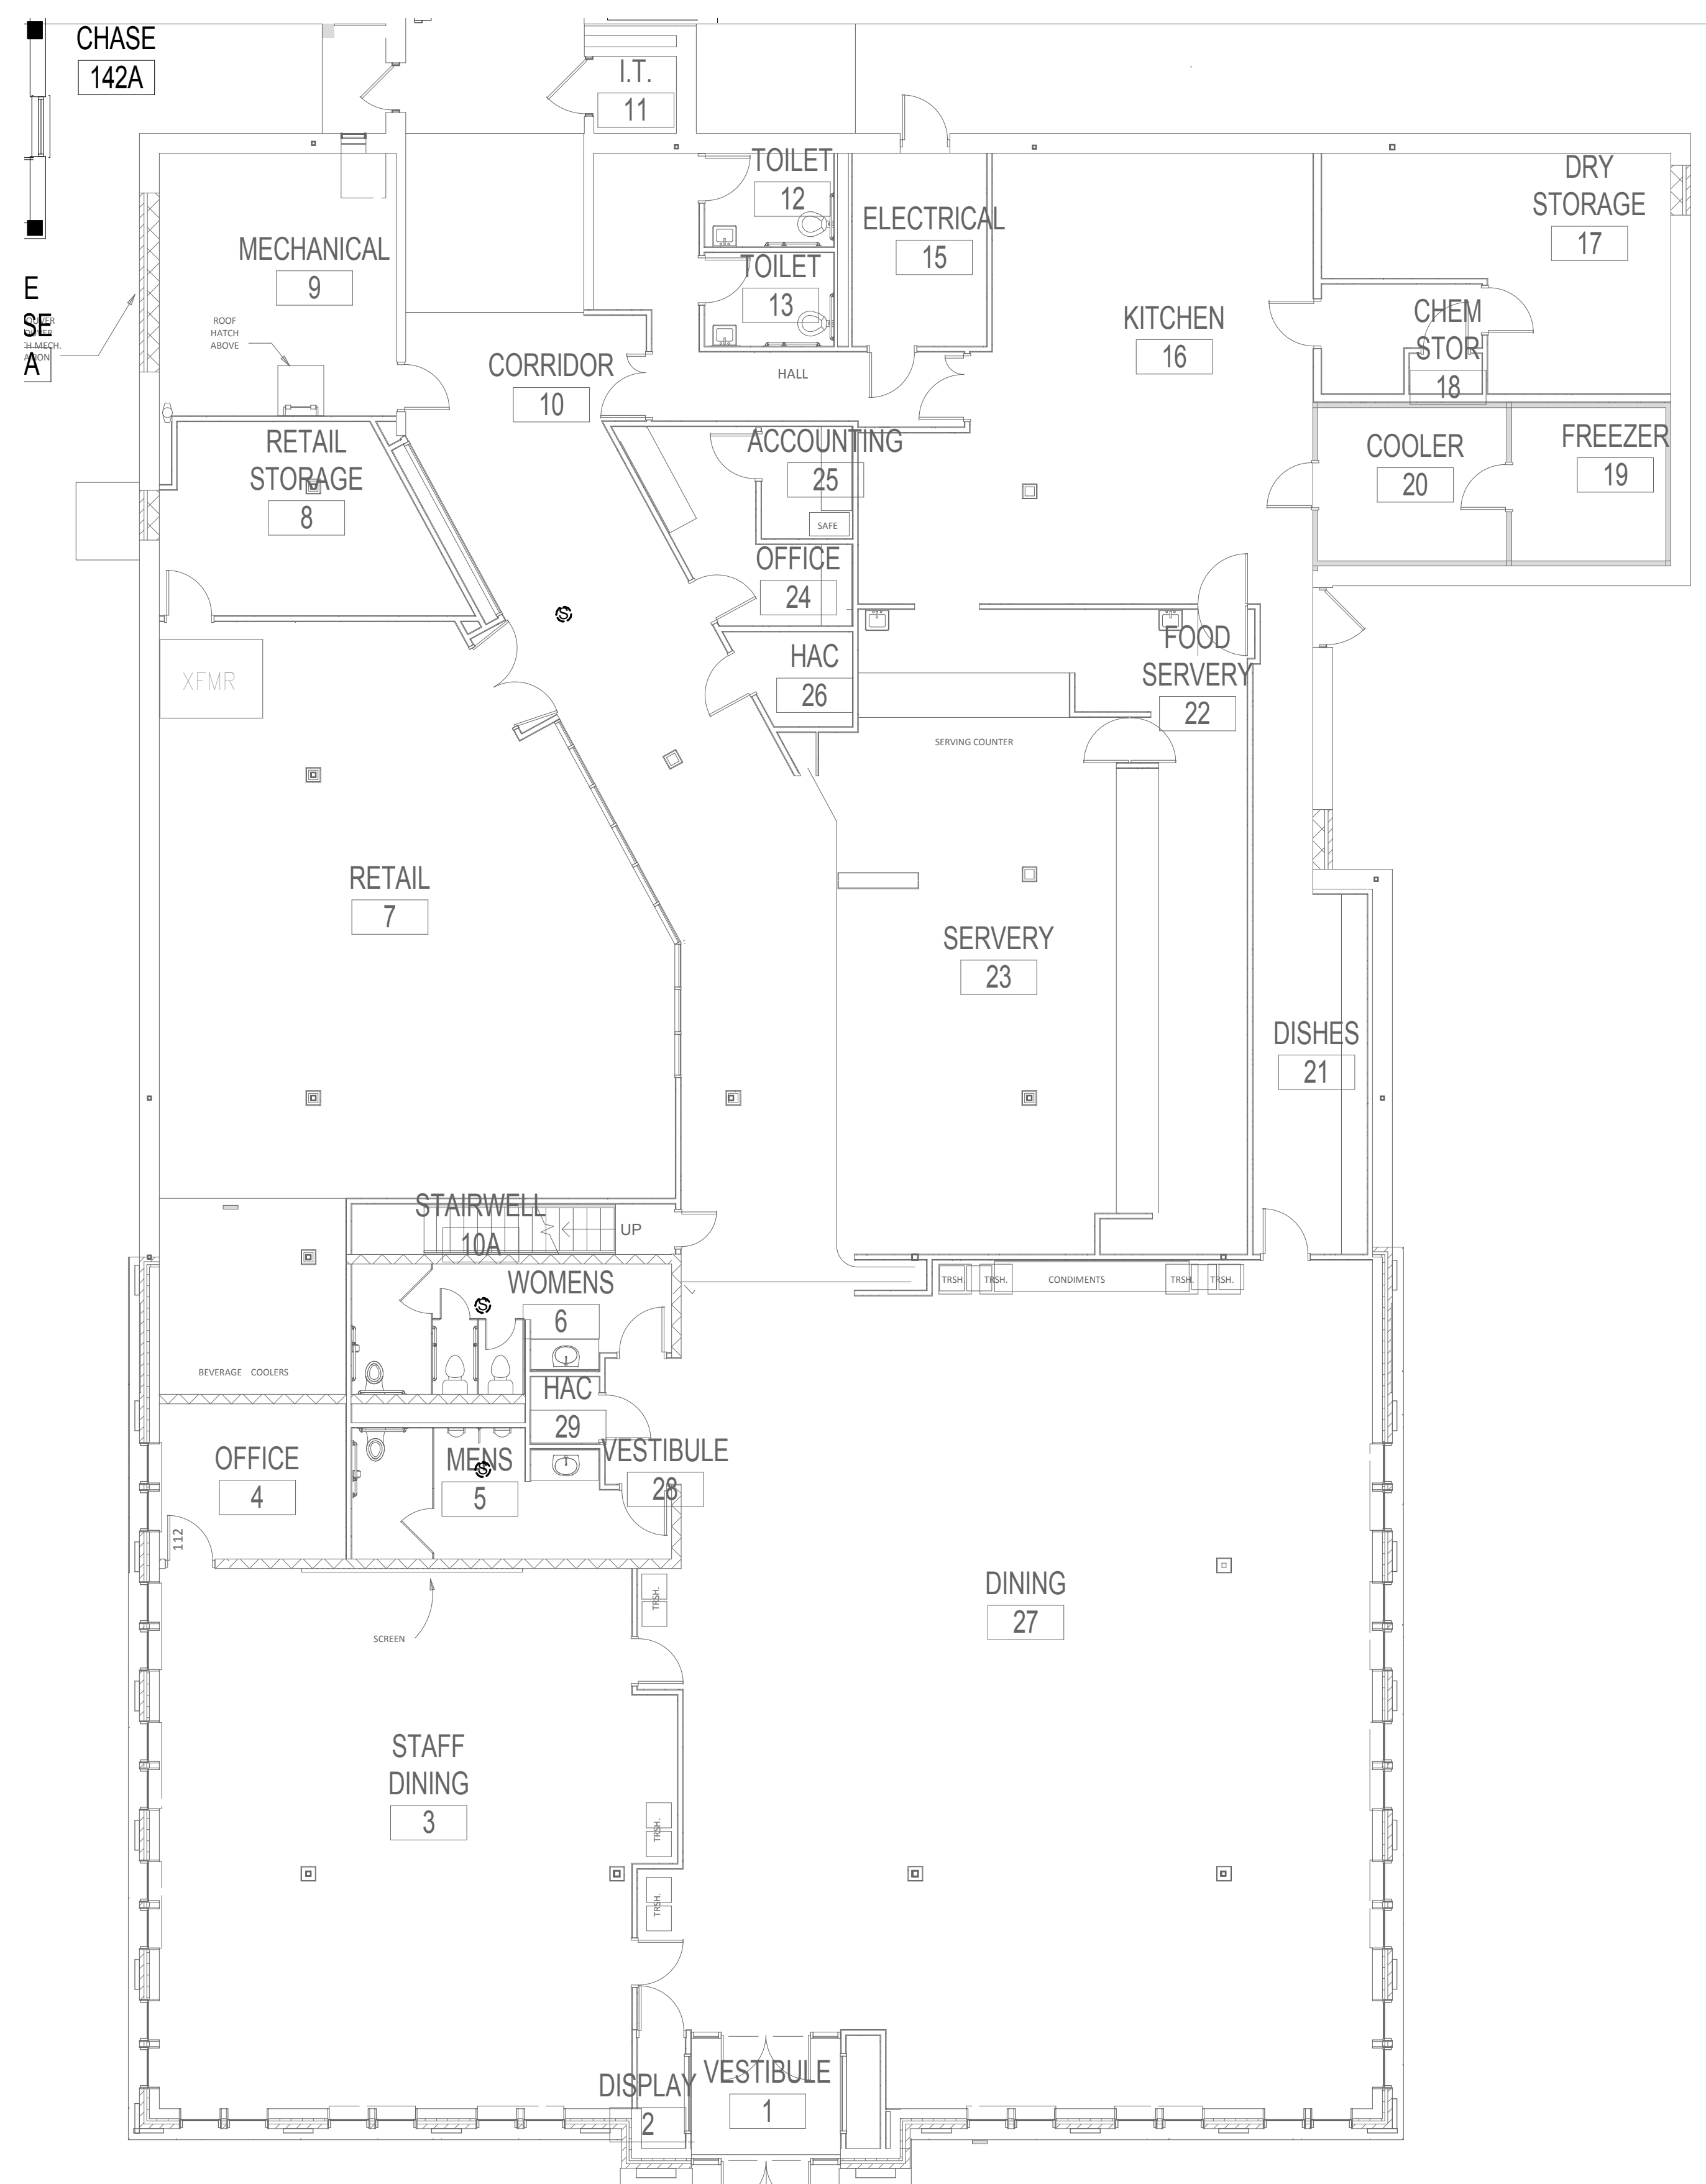

1 BUILDING 95 - PAGING SPEAKER DEMOLITION FLOOR PLAN - FIRST FLOOR
1/8" = 1'-0"

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Piliod*
 Name: Chris M. Piliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE
BUILDING 95 - PAGING SPEAKER DEMOLITION FLOOR PLAN - FIRST FLOOR
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:
 APPROVED: CHIEF OF STAFF
 DATE:
 APPROVED: HEALTH CARE SYSTEM DIRECTOR
 DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM				PLLOT SCALE
PROJECT NO.				
BUILDING No.	CHECKED BY	DRAWN	ISSUE DATE	
	CP	CG	1/24/19	
LOCATION VA MEDICAL CENTER ST. CLOUD, MN 56303			DRAWING NO.	ED95-01


VA
U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

C:\Revit\Projects\VA ST CLOUD PAGING_Elec_R12.dwg 1/24/2019 1:29:48 PM

A
B
C
D
E
F

GENERAL NOTES:

- A. REFER TO SHEET ET.101 FOR LOCATION OF BUILDING ON CAMPUS.
- B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE INACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
- C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
- D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
- E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
- F. CONTRACTOR RESPONSIBLE FOR PROVIDING REPLACEMENT CEILING TILES AFTER REMOVAL OF SPEAKERS. REPLACE CEILING TILE TO MATCH EXISTING ADJACENT CEILING TILE.
- G. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
- H. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
- I. REPAIR OF EXISTING PAINTED AND FINISHED SURFACES: CLEAN, PATCH AND REPAIR EXISTING SURFACES DAMAGED OR ALTERED BY THIS WORK. NO "TELEGRAPHING" OF LINES, RIDGES, FLAKES, ETC. THROUGH NEW SURFACING IS PERMITTED. WHERE THIS OCCURS, SAND SMOOTH AND RE-FINISH UNTIL SURFACE MEETS COR'S APPROVAL. IN EXISTING ROOM OR AREAS WHERE ALTERATIONS BETWEEN NEW AND EXISTING FINISH WILL NOT SHOW IN FINISHED WORK, APPLY ONE (1) PRIME AND TWO (2) FINISH COATS OF PAINT TO MATCH ADJACENT SURFACES AND FINISHES.
- J. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.

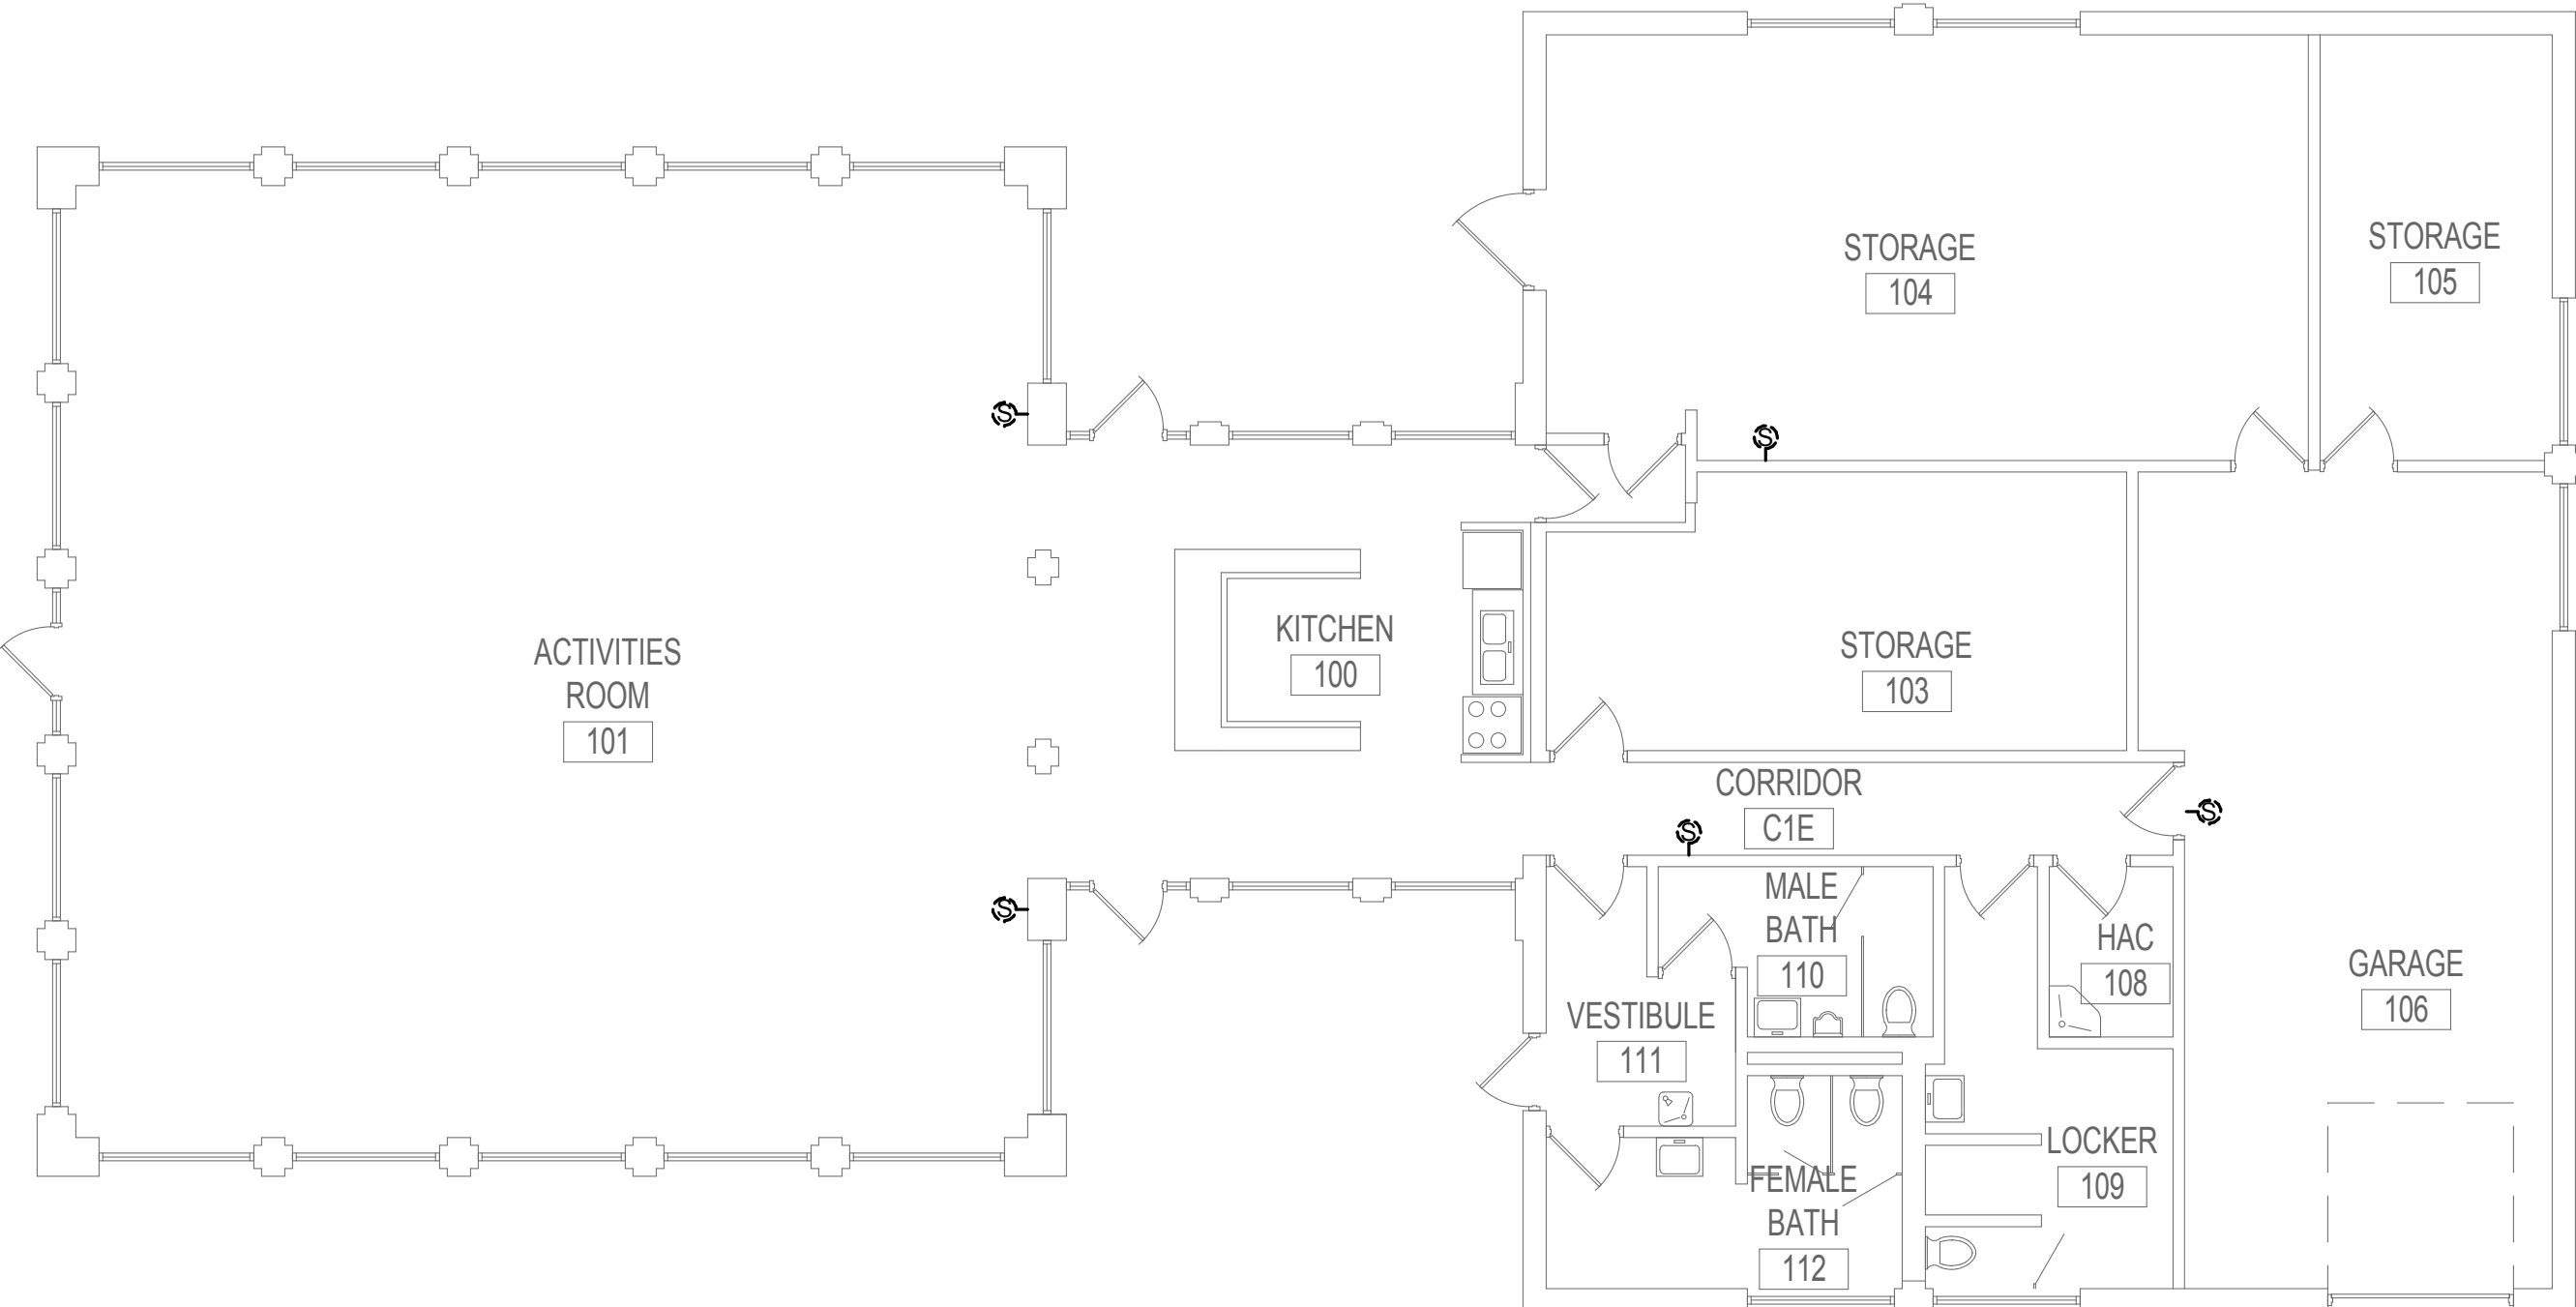

1 BUILDING 96 - PAGING SPEAKER DEMOLITION FLOOR PLAN - FIRST FLOOR
1/8" = 1'-0"

1/24/2019 11:29:49 PM
C:\Revit\Projects\VA ST CLOUD PAGING\Bldg_96\R12_cmg.rvt

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE
BUILDING 96 - PAGING SPEAKER DEMOLITION FLOOR PLAN - FIRST FLOOR
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:
 APPROVED: CHIEF OF STAFF
 DATE:
 APPROVED: HEALTH CARE SYSTEM DIRECTOR
 DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PLOT SCALE	
PROJECT NO.		ISSUE DATE	
BUILDING No.	CHECKED BY	CG	DATE
	CP	CG	1/24/19
LOCATION	VA MEDICAL CENTER ST. CLOUD, MN 56303	DRAWING NO.	ED96-01

VA
U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System


A
B
C
D
E
F

GENERAL NOTES:

- A. REFER TO SHEET ET.101 FOR LOCATION OF BUILDING ON CAMPUS.
- B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE INACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
- C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
- D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
- E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
- F. CONTRACTOR RESPONSIBLE FOR PROVIDING REPLACEMENT CEILING TILES AFTER REMOVAL OF SPEAKERS. REPLACE CEILING TILE TO MATCH EXISTING ADJACENT CEILING TILE.
- G. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
- H. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
- I. REPAIR OF EXISTING PAINTED AND FINISHED SURFACES: CLEAN, PATCH AND REPAIR EXISTING SURFACES DAMAGED OR ALTERED BY THIS WORK. NO "TELEGRAPHING" OF LINES, RIDGES, FLAKES, ETC. THROUGH NEW SURFACING IS PERMITTED. WHERE THIS OCCURS, SAND SMOOTH AND RE-FINISH UNTIL SURFACE MEETS COR'S APPROVAL. IN EXISTING ROOM OR AREAS WHERE ALTERATIONS BETWEEN NEW AND EXISTING FINISH WILL NOT SHOW IN FINISHED WORK, APPLY ONE (1) PRIME AND TWO (2) FINISH COATS OF PAINT TO MATCH ADJACENT SURFACES AND FINISHES.
- J. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.

KEY NOTES:

- ◆ DEMOLISH PAGING ADDRESS SYSTEM CAMPUS HEADEND EQUIPMENT AND ASSOCIATED CABLING AND CONNECTIVITY. REMOVE TO/BACK TO SOURCE. REMOVE AND RETURN HEADEND ELECTRONICS, AMPLIFIERS AND JOD EQUIPMENT TO OWNER. COORDINATE WITH QUINER TO CONFIRM ITEMS TO BE SALVAGED.
- PA SYSTEM HEAD END IN BUILDING 108 HAS ALREADY BEEN DEMOLISHED. EXISTING PA SPEAKER CIRCUITS HAVE BEEN EXTENDED FROM BUILDING 108 TO THE NEW PA HEAD END IN THE BUILDING 4 DATA CENTER. AFTER THE EXISTING PA SPEAKER CIRCUITS HAVE BEEN DISCONNECTED FROM THE PA HEAD END, THE CONTRACTOR SHALL DEMOLISH THESE EXTENDED CIRCUITS BETWEEN BUILDING 108 AND BUILDING 4.

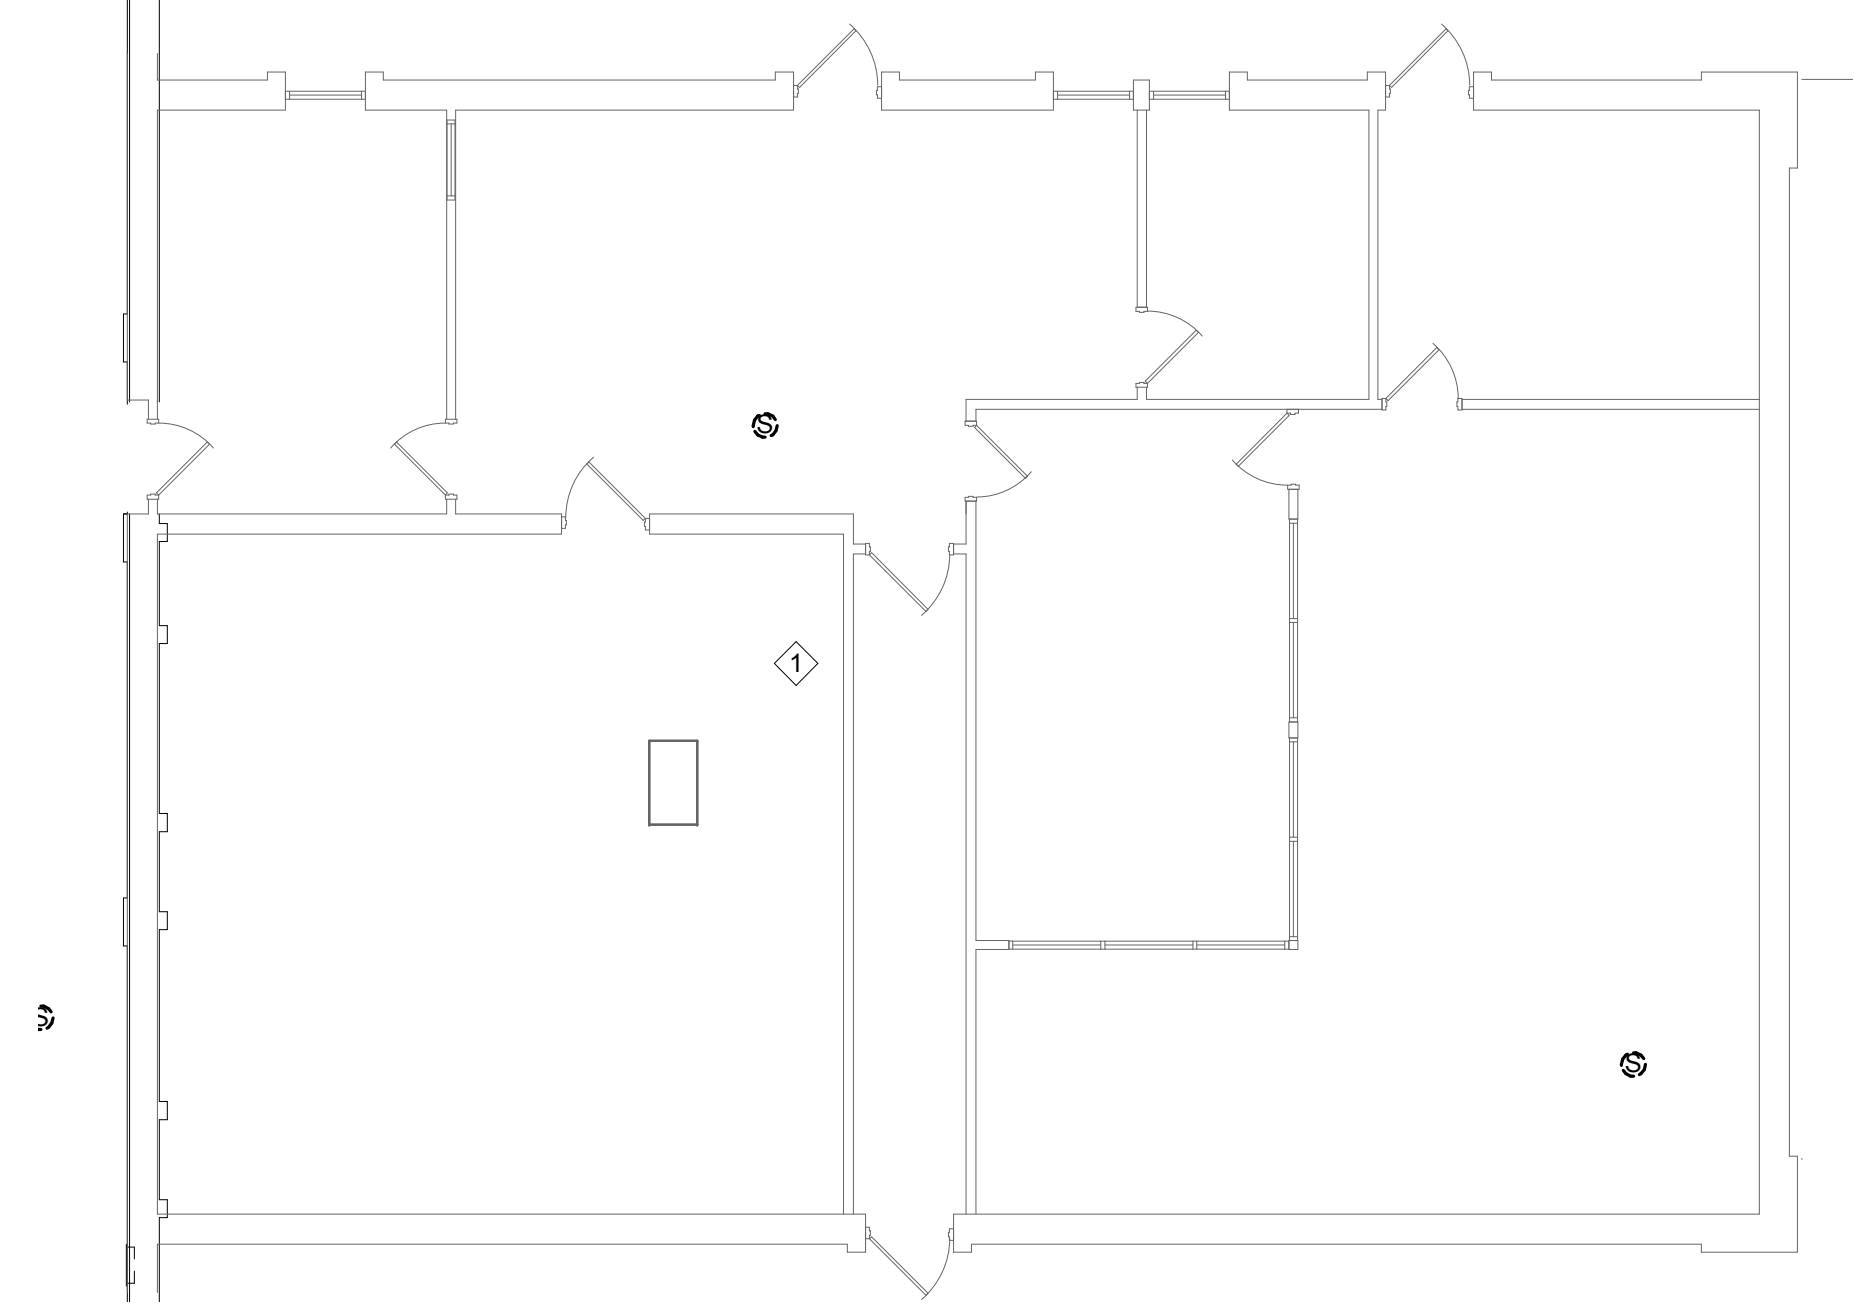

1 BUILDING 108 - PAGING SPEAKER DEMOLITION FLOOR PLAN - FIRST FLOOR
1/8" = 1'-0"

1/24/2019 11:29:49 PM
C:\Revit\Projects\VA ST CLOUD PAGING_Elec_R12.dwg

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)
DUNHAM
50 South Sixth Street / Suite 1100
Minneapolis, Minnesota 55402-1540
Phone: 612-465-7550 Fax: 612-465-7551
www.dunhaminc.com
mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD
ANDERSON ENGINEERING
ENGINEERING • ARCHITECTURE • LAND SURVEYING
ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
Anderson Engineering of Minnesota, LLC
13605 1st Avenue North
Suite 100
Plymouth, MN 55441
763-412-4000 (o) 763-412-4090 (f)
www.ae-mn.com

STAMP
I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
Signature: *Chris M. Pilliod*
Name: Chris M. Pilliod, P.E.
Date: 1/24/19
Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:


DRAWING TITLE
BUILDING 108 - PAGING SPEAKER DEMOLITION FLOOR PLAN - FIRST FLOOR
APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
DATE:
APPROVED: CHIEF OF STAFF
DATE:
APPROVED: HEALTH CARE SYSTEM DIRECTOR
DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PROJECT NO.:	
BUILDING NO.:	CHECKED BY: CP	DRAWN: CG	ISSUE DATE: 1/24/19
LOCATION: VA MEDICAL CENTER ST. CLOUD, MN 56303	DATE:	DRAWING NO.:	ED108-01


VA U.S. Department of Veterans Affairs
Veterans Health Administration
St. Cloud VA Health Care System

GENERAL NOTES:

- A. REFER TO SHEET ET.101 FOR LOCATION OF BUILDING ON CAMPUS.
- B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE INACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
- C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
- D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
- E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
- F. CONTRACTOR RESPONSIBLE FOR PROVIDING REPLACEMENT CEILING TILES AFTER REMOVAL OF SPEAKERS. REPLACE CEILING TILE TO MATCH EXISTING ADJACENT CEILING TILE.
- G. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
- H. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
- I. REPAIR OF EXISTING PAINTED AND FINISHED SURFACES: CLEAN, PATCH AND REPAIR EXISTING SURFACES DAMAGED OR ALTERED BY THIS WORK. NO "TELEGRAPHING" OF LINES, RIDGES, FLAKES, ETC. THROUGH NEW SURFACING IS PERMITTED. WHERE THIS OCCURS, SAND SMOOTH AND RE-FINISH UNTIL SURFACE MEETS COR'S APPROVAL. IN EXISTING ROOM OR AREAS WHERE ALTERATIONS BETWEEN NEW AND EXISTING FINISH WILL NOT SHOW IN FINISHED WORK, APPLY ONE (1) PRIME AND TWO (2) FINISH COATS OF PAINT TO MATCH ADJACENT SURFACES AND FINISHES.
- J. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.

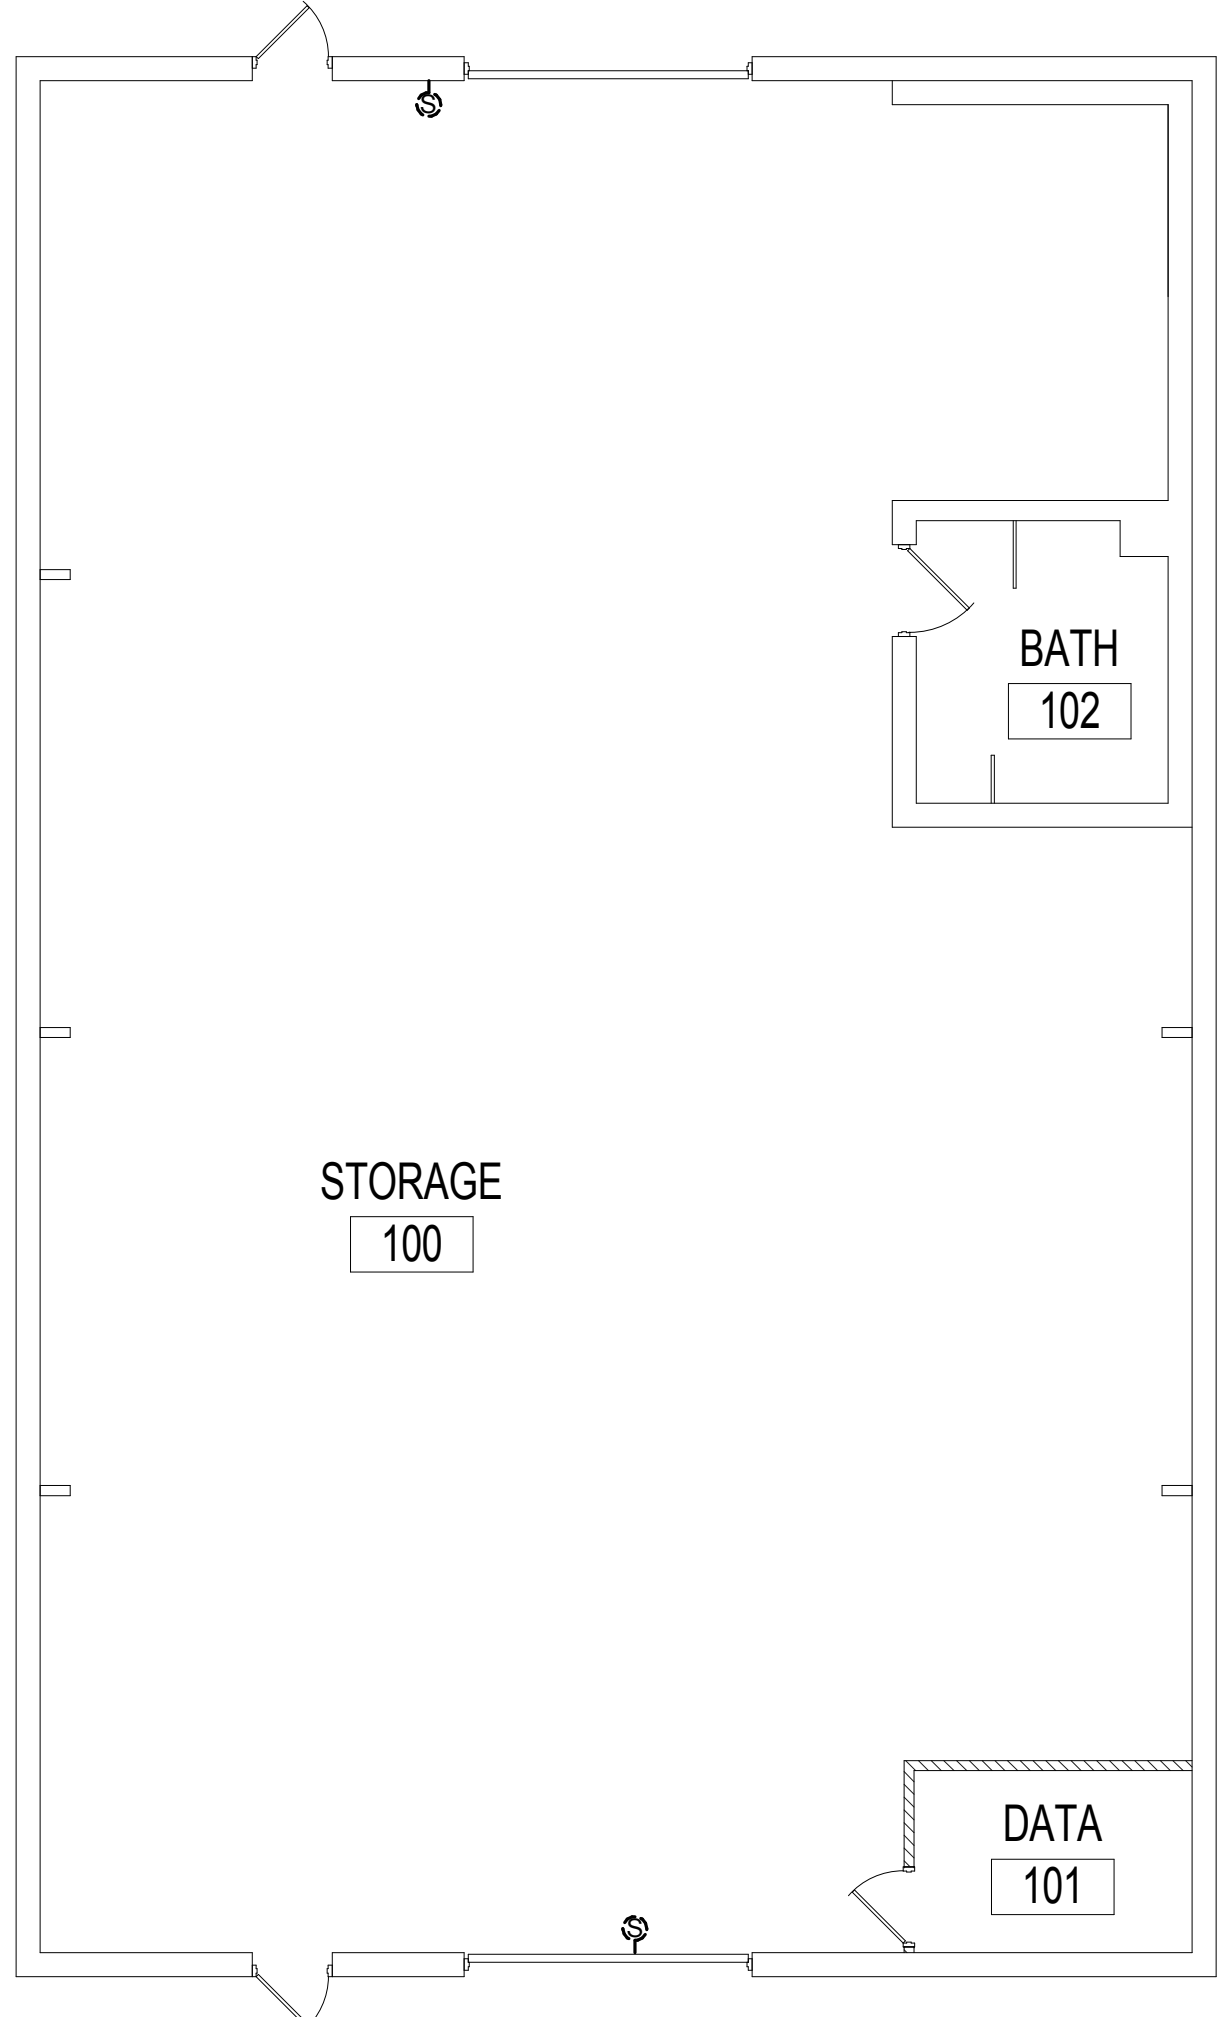


1 BUILDING 109 - PAGING SPEAKER DEMOLITION FLOOR PLAN - FIRST FLOOR
1/8" = 1'-0"

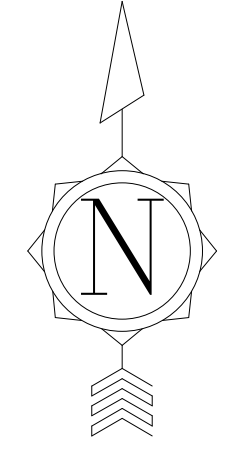

C:\Revit\Projects\VA ST CLOUD\PAGING_Elec_R12.dwg 1/24/2019 1:26:50 PM

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:


DRAWING TITLE
BUILDING 109 - PAGING SPEAKER DEMOLITION FLOOR PLAN - FIRST FLOOR
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:
 APPROVED: CHIEF OF STAFF
 DATE:
 APPROVED: HEALTH CARE SYSTEM DIRECTOR
 DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PROJECT NO.:	
BUILDING No.:	CHECKED BY: CP	DRAWN: CG	ISSUE DATE: 1/24/19
LOCATION: VA MEDICAL CENTER ST. CLOUD, MN 56303	DATE:	DRAWING NO.:	ED109-01

VA  **U.S. Department of Veterans Affairs**
 Veterans Health Administration
 St. Cloud VA Health Care System

GENERAL NOTES:

- A. REFER TO SHEET ET.101 FOR LOCATION OF BUILDING ON CAMPUS.
- B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE INACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
- C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
- D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
- E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
- F. CONTRACTOR RESPONSIBLE FOR PROVIDING REPLACEMENT CEILING TILES AFTER REMOVAL OF SPEAKERS. REPLACE CEILING TILE TO MATCH EXISTING ADJACENT CEILING TILE.
- G. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
- H. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
- I. REPAIR OF EXISTING PAINTED AND FINISHED SURFACES: CLEAN, PATCH AND REPAIR EXISTING SURFACES DAMAGED OR ALTERED BY THIS WORK. NO "TELEGRAPHING" OF LINES, RIDGES, FLAKES, ETC. THROUGH NEW SURFACING IS PERMITTED. WHERE THIS OCCURS, SAND SMOOTH AND RE-FINISH UNTIL SURFACE MEETS COR'S APPROVAL. IN EXISTING ROOM OR AREAS WHERE ALTERATIONS BETWEEN NEW AND EXISTING FINISH WILL NOT SHOW IN FINISHED WORK, APPLY ONE (1) PRIME AND TWO (2) FINISH COATS OF PAINT TO MATCH ADJACENT SURFACES AND FINISHES.
- J. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.

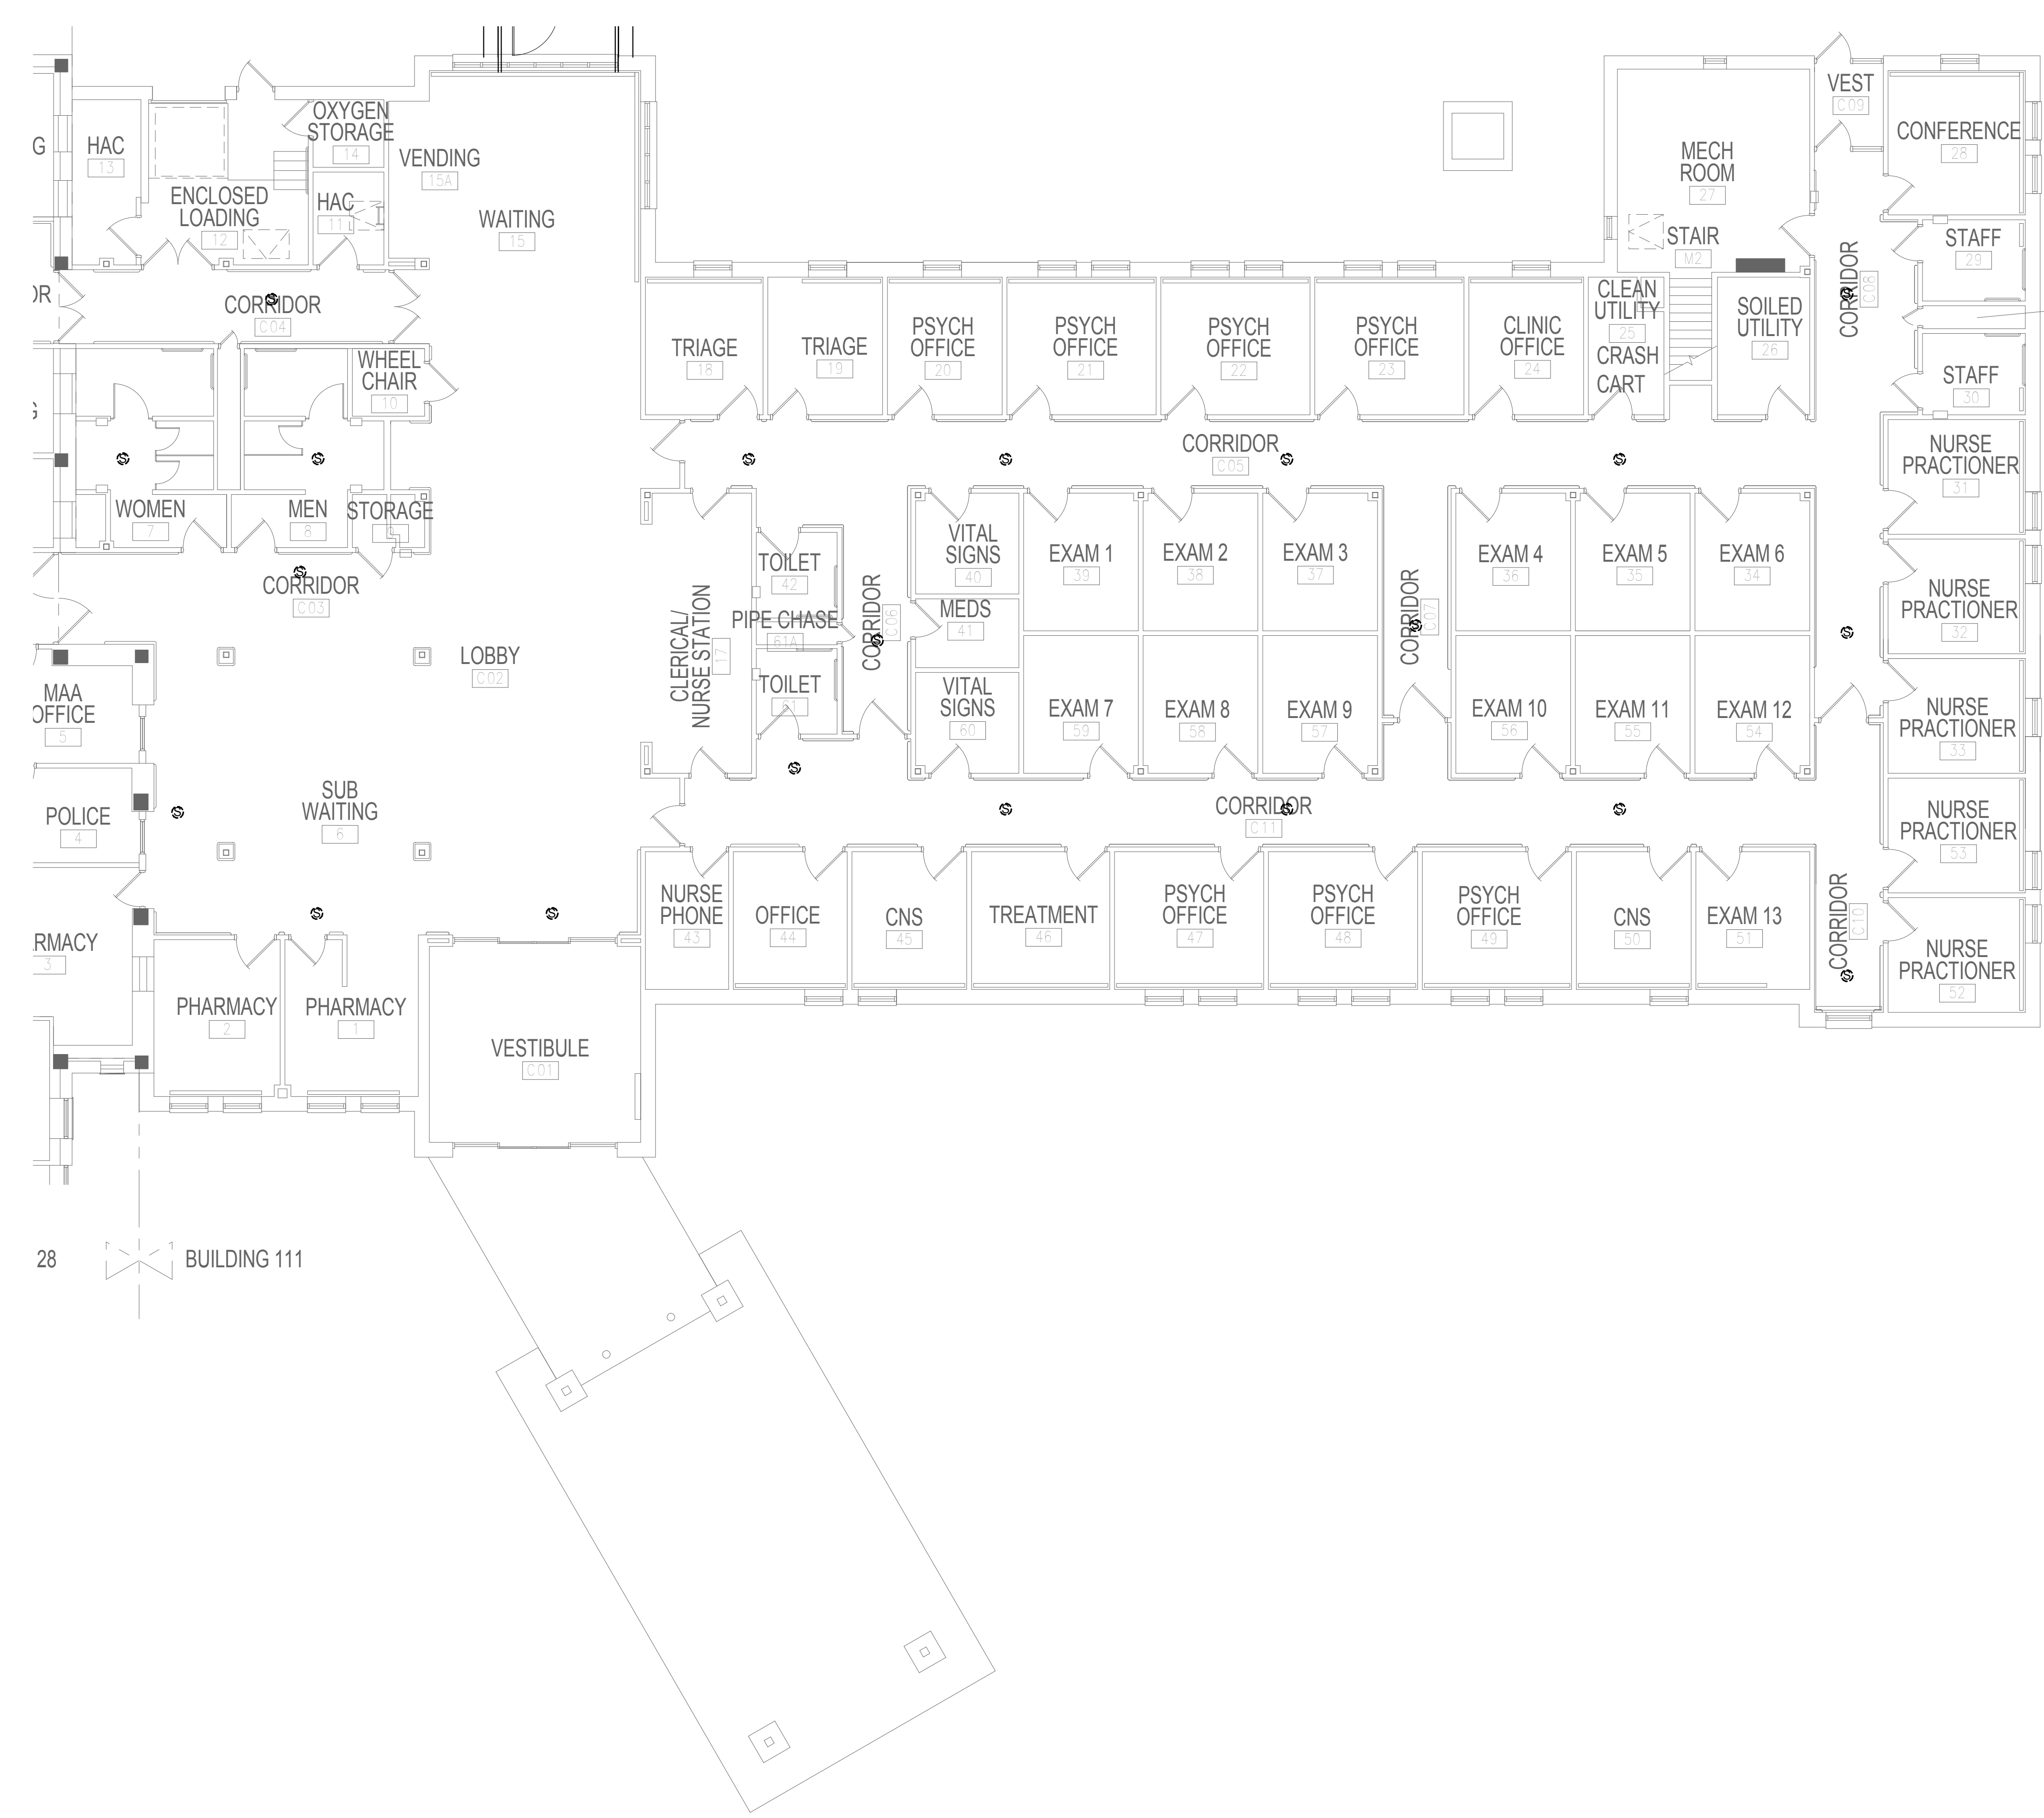

1 BUILDING 111 - PAGING SPEAKER DEMOLITION FLOOR PLAN - FIRST FLOOR
1/8" = 1'-0"

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

 DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com


STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE
BUILDING 111 - PAGING SPEAKER DEMOLITION FLOOR PLAN - FIRST FLOOR
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:
 APPROVED: CHIEF OF STAFF
 DATE:
 APPROVED: HEALTH CARE SYSTEM DIRECTOR
 DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PLOT SCALE	
PROJECT NO.		ISSUE DATE	
BUILDING No.	CHECKED BY	DRAWN	DATE
	CP	CG	1/24/19
LOCATION VA MEDICAL CENTER ST. CLOUD, MN 56303		DRAWING NO. ED111-01	

VA **U.S. Department of Veterans Affairs**
 Veterans Health Administration
 St. Cloud VA Health Care System

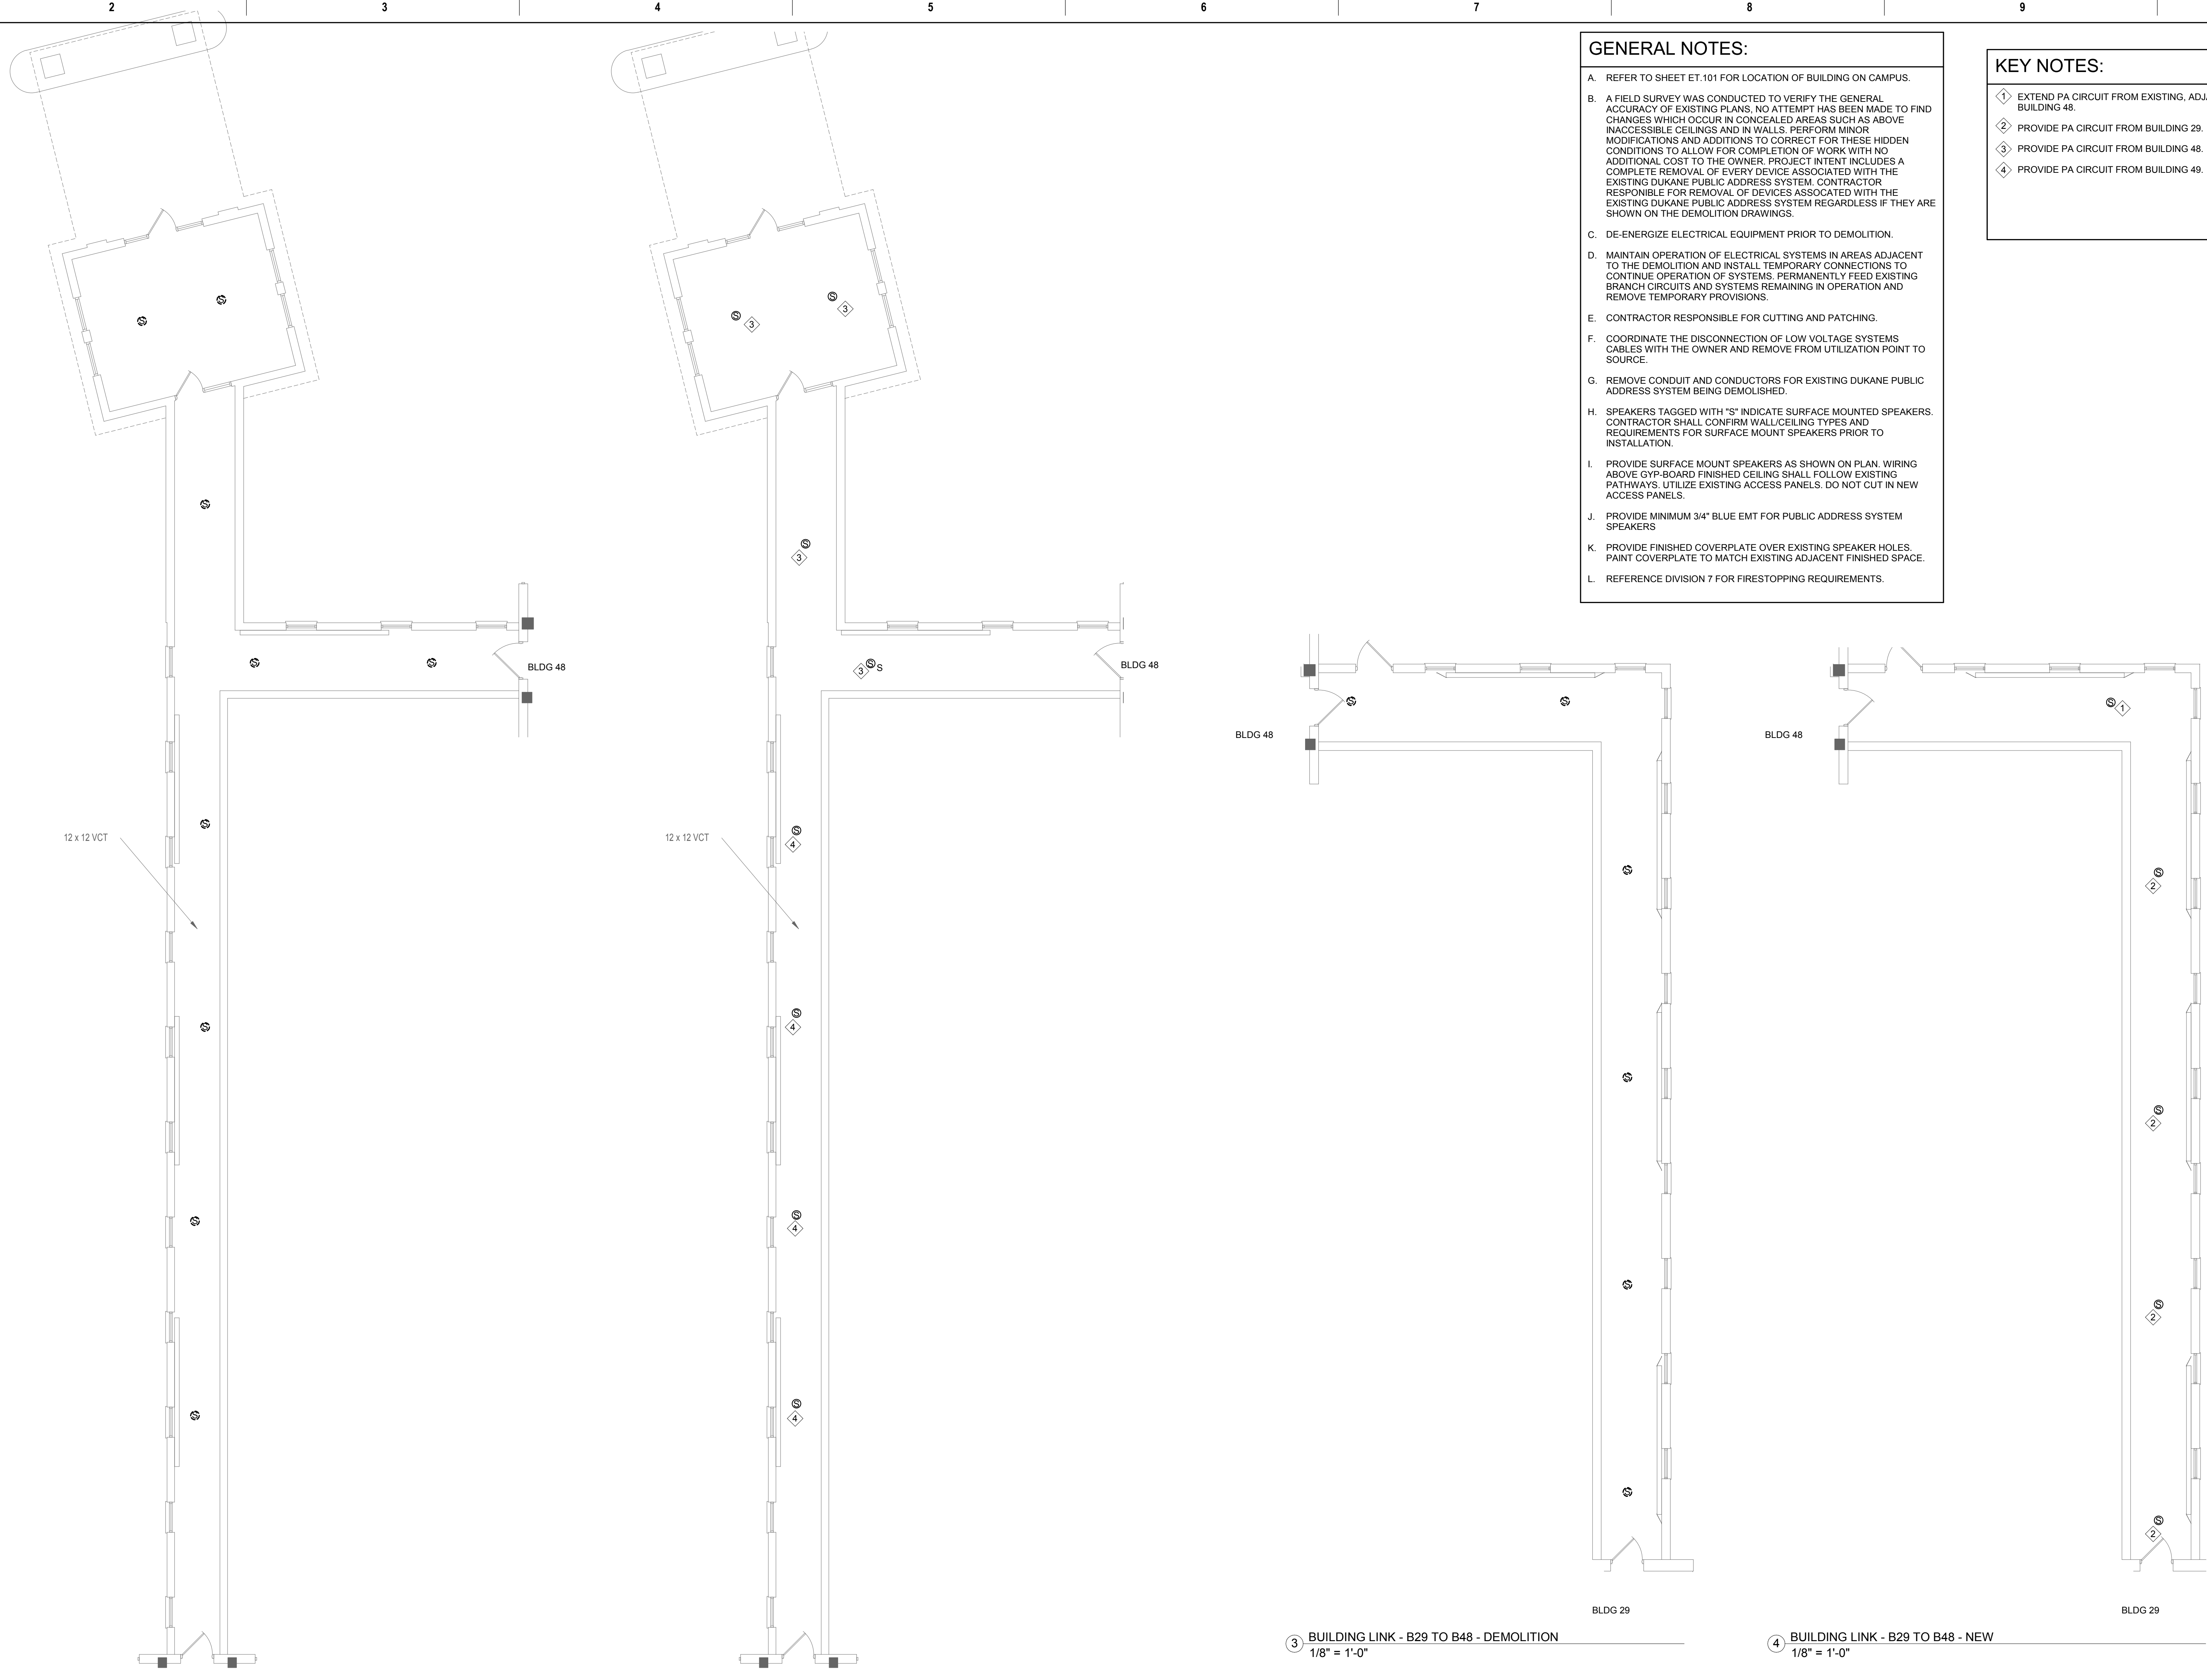

GENERAL NOTES:

- A. REFER TO SHEET ET-101 FOR LOCATION OF BUILDING ON CAMPUS.
- B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE INACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
- C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
- D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
- E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
- F. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
- G. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
- H. SPEAKERS TAGGED WITH "S" INDICATE SURFACE MOUNTED SPEAKERS. CONTRACTOR SHALL CONFIRM WALL/CEILING TYPES AND REQUIREMENTS FOR SURFACE MOUNT SPEAKERS PRIOR TO INSTALLATION.
- I. PROVIDE SURFACE MOUNT SPEAKERS AS SHOWN ON PLAN. WIRING ABOVE GYP-BOARD FINISHED CEILING SHALL FOLLOW EXISTING PATHWAYS. UTILIZE EXISTING ACCESS PANELS. DO NOT CUT IN NEW ACCESS PANELS.
- J. PROVIDE MINIMUM 3/4" BLUE EMT FOR PUBLIC ADDRESS SYSTEM SPEAKERS.
- K. PROVIDE FINISHED COVERPLATE OVER EXISTING SPEAKER HOLES. PAINT COVERPLATE TO MATCH EXISTING ADJACENT FINISHED SPACE.
- L. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.

KEY NOTES:

- ① EXTEND PA CIRCUIT FROM EXISTING, ADJACENT SPEAKER FROM BUILDING 48.
- ② PROVIDE PA CIRCUIT FROM BUILDING 29.
- ③ PROVIDE PA CIRCUIT FROM BUILDING 48.
- ④ PROVIDE PA CIRCUIT FROM BUILDING 49.

① BUILDING LINK - B48 TO B49 - DEMOLITION
1/8" = 1'-0"

② BUILDING LINK - B48 TO B49 - NEW
1/8" = 1'-0"

③ BUILDING LINK - B29 TO B48 - DEMOLITION
1/8" = 1'-0"

④ BUILDING LINK - B29 TO B48 - NEW
1/8" = 1'-0"

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com
AE PROJECT NUMBER: Project Number

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE BUILDING LINK - B29 TO B48 & B48 TO B49 - DEMOLITION AND NEW PLANS	DATE:
APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR	DATE:
APPROVED: CHIEF OF STAFF	DATE:
APPROVED: HEALTH CARE SYSTEM DIRECTOR	DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM	PROJECT NO.:
BUILDING NO.:	CHECKED BY: CP
ISSUE DATE: 1/24/19	DRAWN: CG
LOCATION: VA MEDICAL CENTER ST. CLOUD, MN 56303	DRAWING NO. EDT001





U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

GENERAL NOTES:

- A. REFER TO SHEET ET.101 FOR LOCATION OF BUILDING ON CAMPUS.
- B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE INACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
- C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
- D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
- E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
- F. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
- G. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
- H. SPEAKERS TAGGED WITH "S" INDICATE SURFACE MOUNTED SPEAKERS. CONTRACTOR SHALL CONFIRM WALL/CEILING TYPES AND REQUIREMENTS FOR SURFACE MOUNT SPEAKERS PRIOR TO INSTALLATION.
- I. PROVIDE SURFACE MOUNT SPEAKERS AS SHOWN ON PLAN. WIRING ABOVE GYP-BOARD FINISHED CEILING SHALL FOLLOW EXISTING PATHWAYS. UTILIZE EXISTING ACCESS PANELS. DO NOT CUT IN NEW ACCESS PANELS.
- J. PROVIDE MINIMUM 3/4" BLUE EMT FOR PUBLIC ADDRESS SYSTEM SPEAKERS
- K. PROVIDE FINISHED COVERPLATE OVER EXISTING SPEAKER HOLES. PAINT COVERPLATE TO MATCH EXISTING ADJACENT FINISHED SPACE.
- L. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.

KEY NOTES:

- ① PROVIDE PA CIRCUIT FROM BUILDING 49.
- ② PROVIDE PA CIRCUIT FROM BUILDING 50.

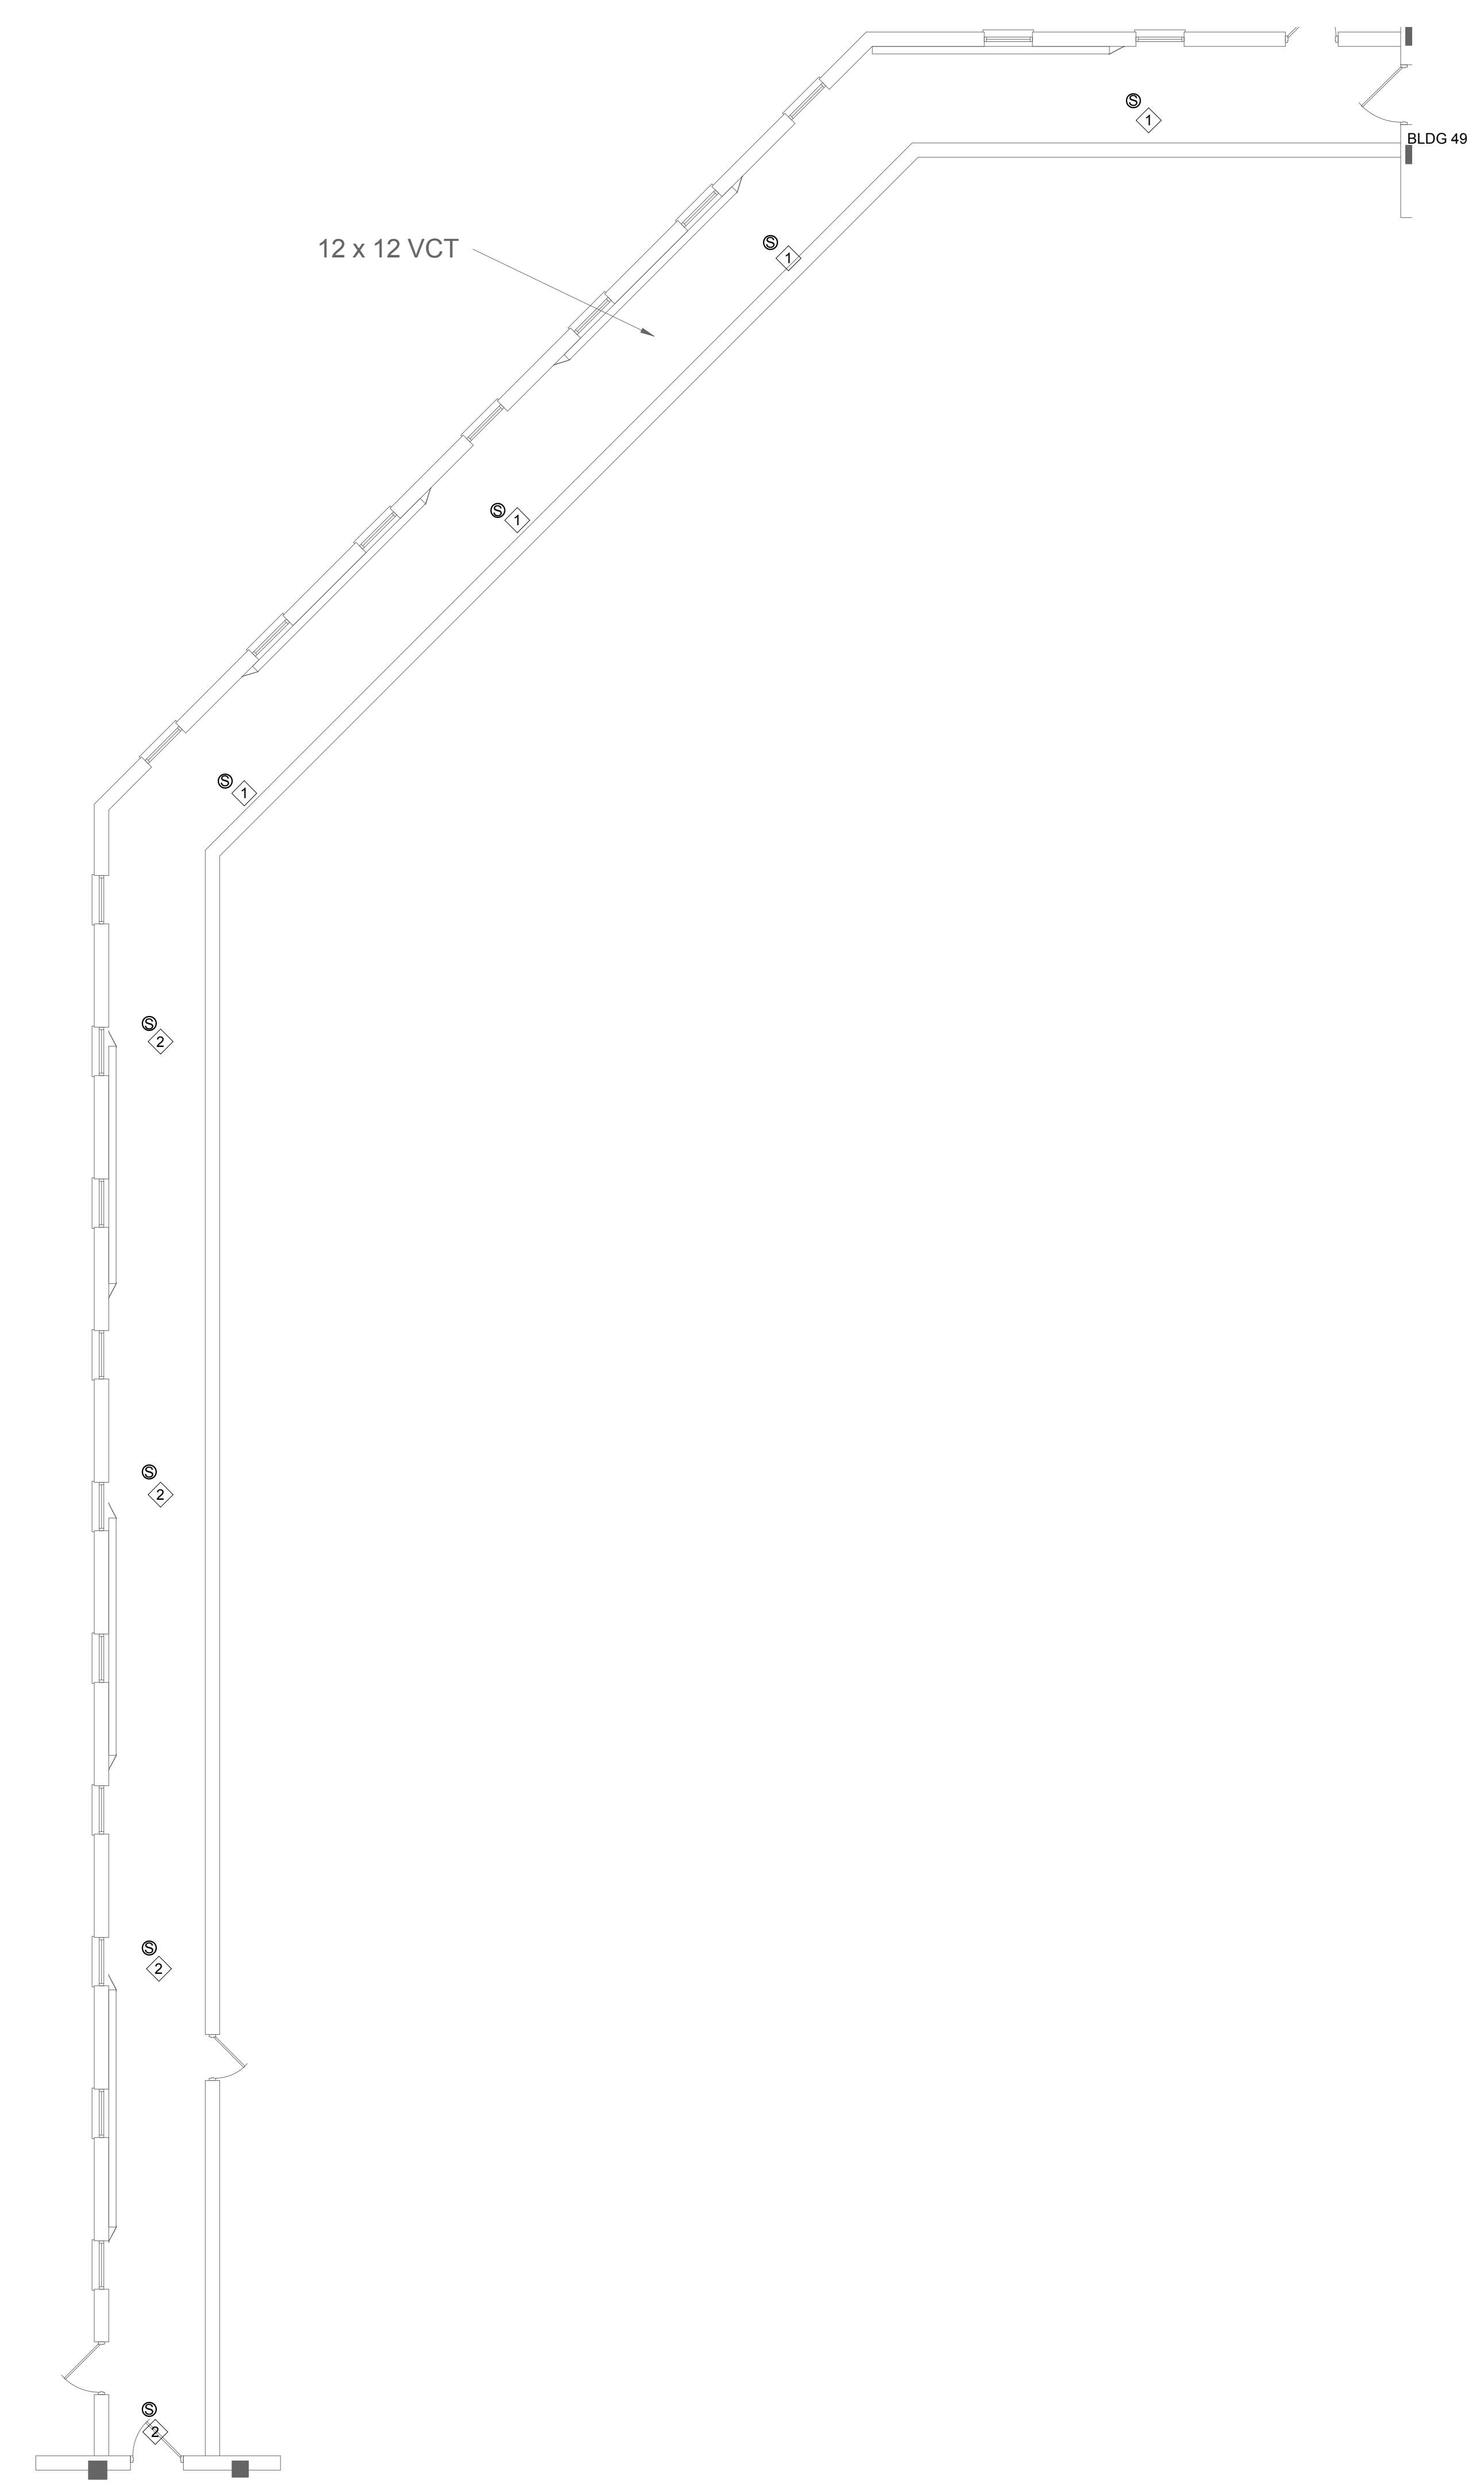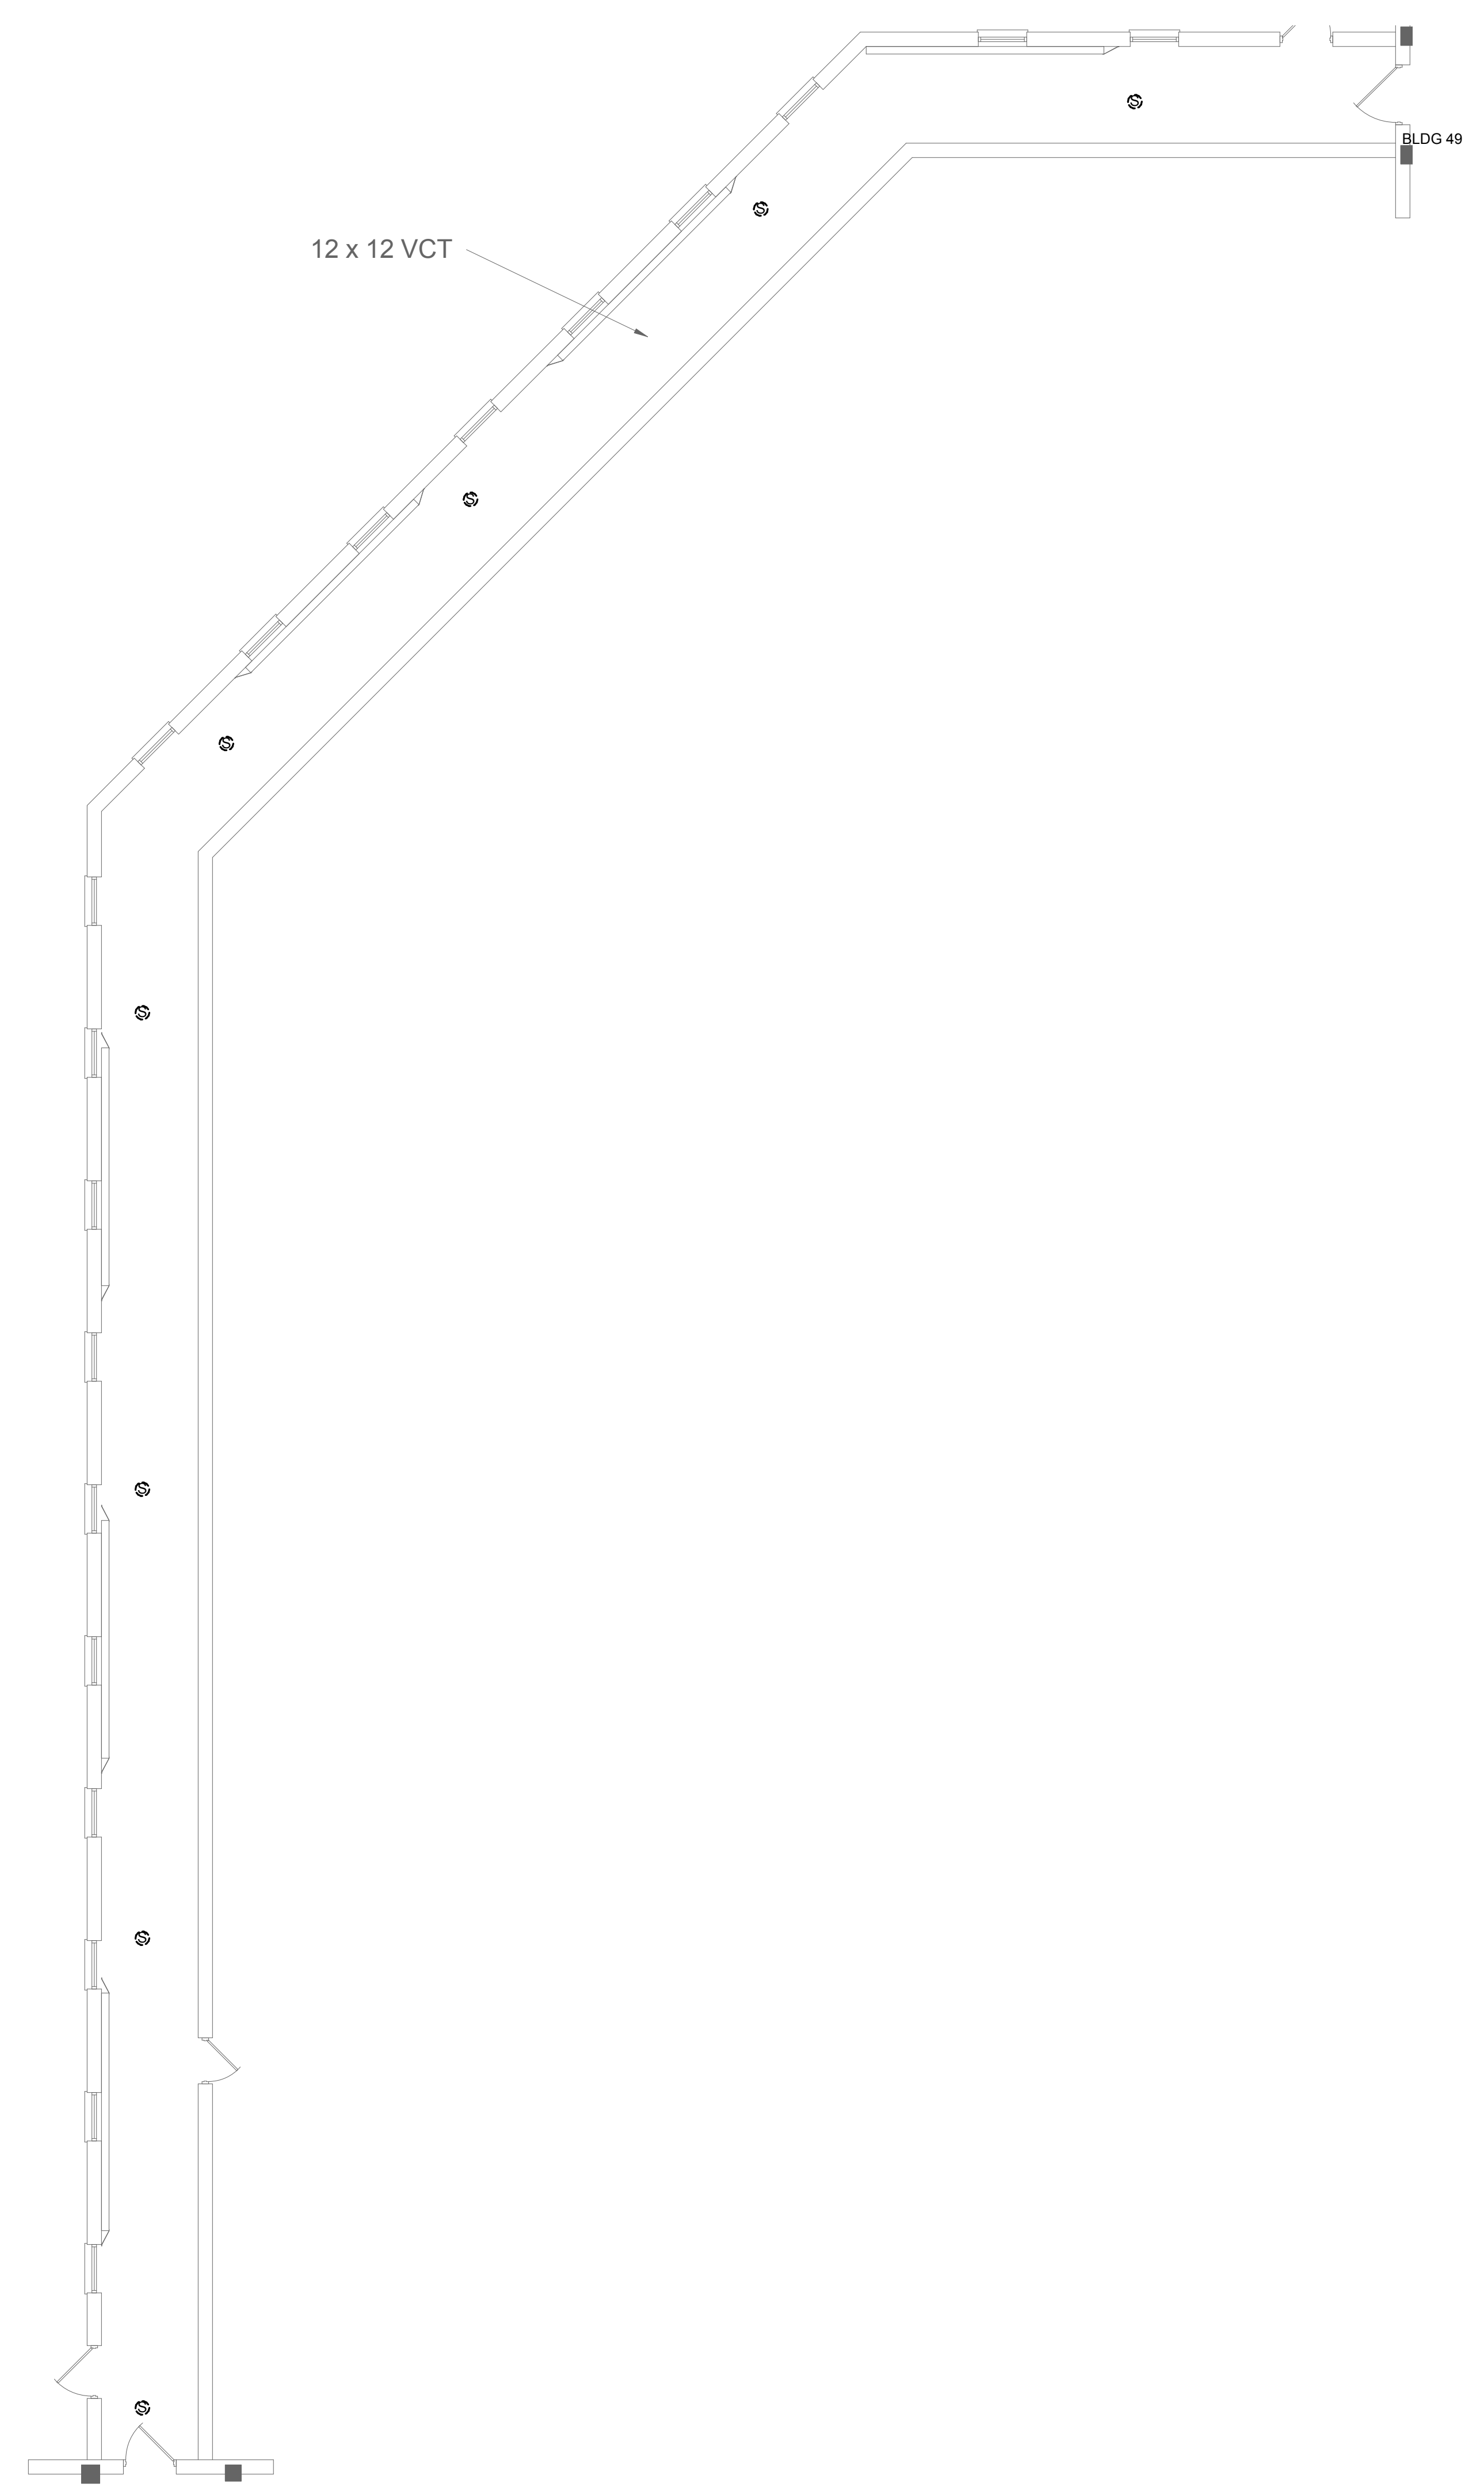

① BUILDING LINK - B49 TO B50 - DEMOLITION
1/8" = 1'-0"

② BUILDING LINK - B49 TO B50 - NEW
1/8" = 1'-0"

C:\Revit\Projects\VA ST CLOUD\FACING_Elec_Bldg_R1E.dwg 1/24/2019 1:26:52 PM

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com


STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pflod*
 Name: Chris M. Pflod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE
BUILDING LINK - B49 TO B50 - DEMOLITION AND NEW PLANS
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:
 APPROVED: CHIEF OF STAFF
 DATE:
 APPROVED: HEALTH CARE SYSTEM DIRECTOR
 DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PROJECT NO.:	
BUILDING No.:	CHECKED BY:	DRAWN:	ISSUE DATE:
	CP	CG	1/24/19
LOCATION	DATE:	DRAWING NO.:	
VA MEDICAL CENTER ST. CLOUD, MN 56303		EDT002	

VA
U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

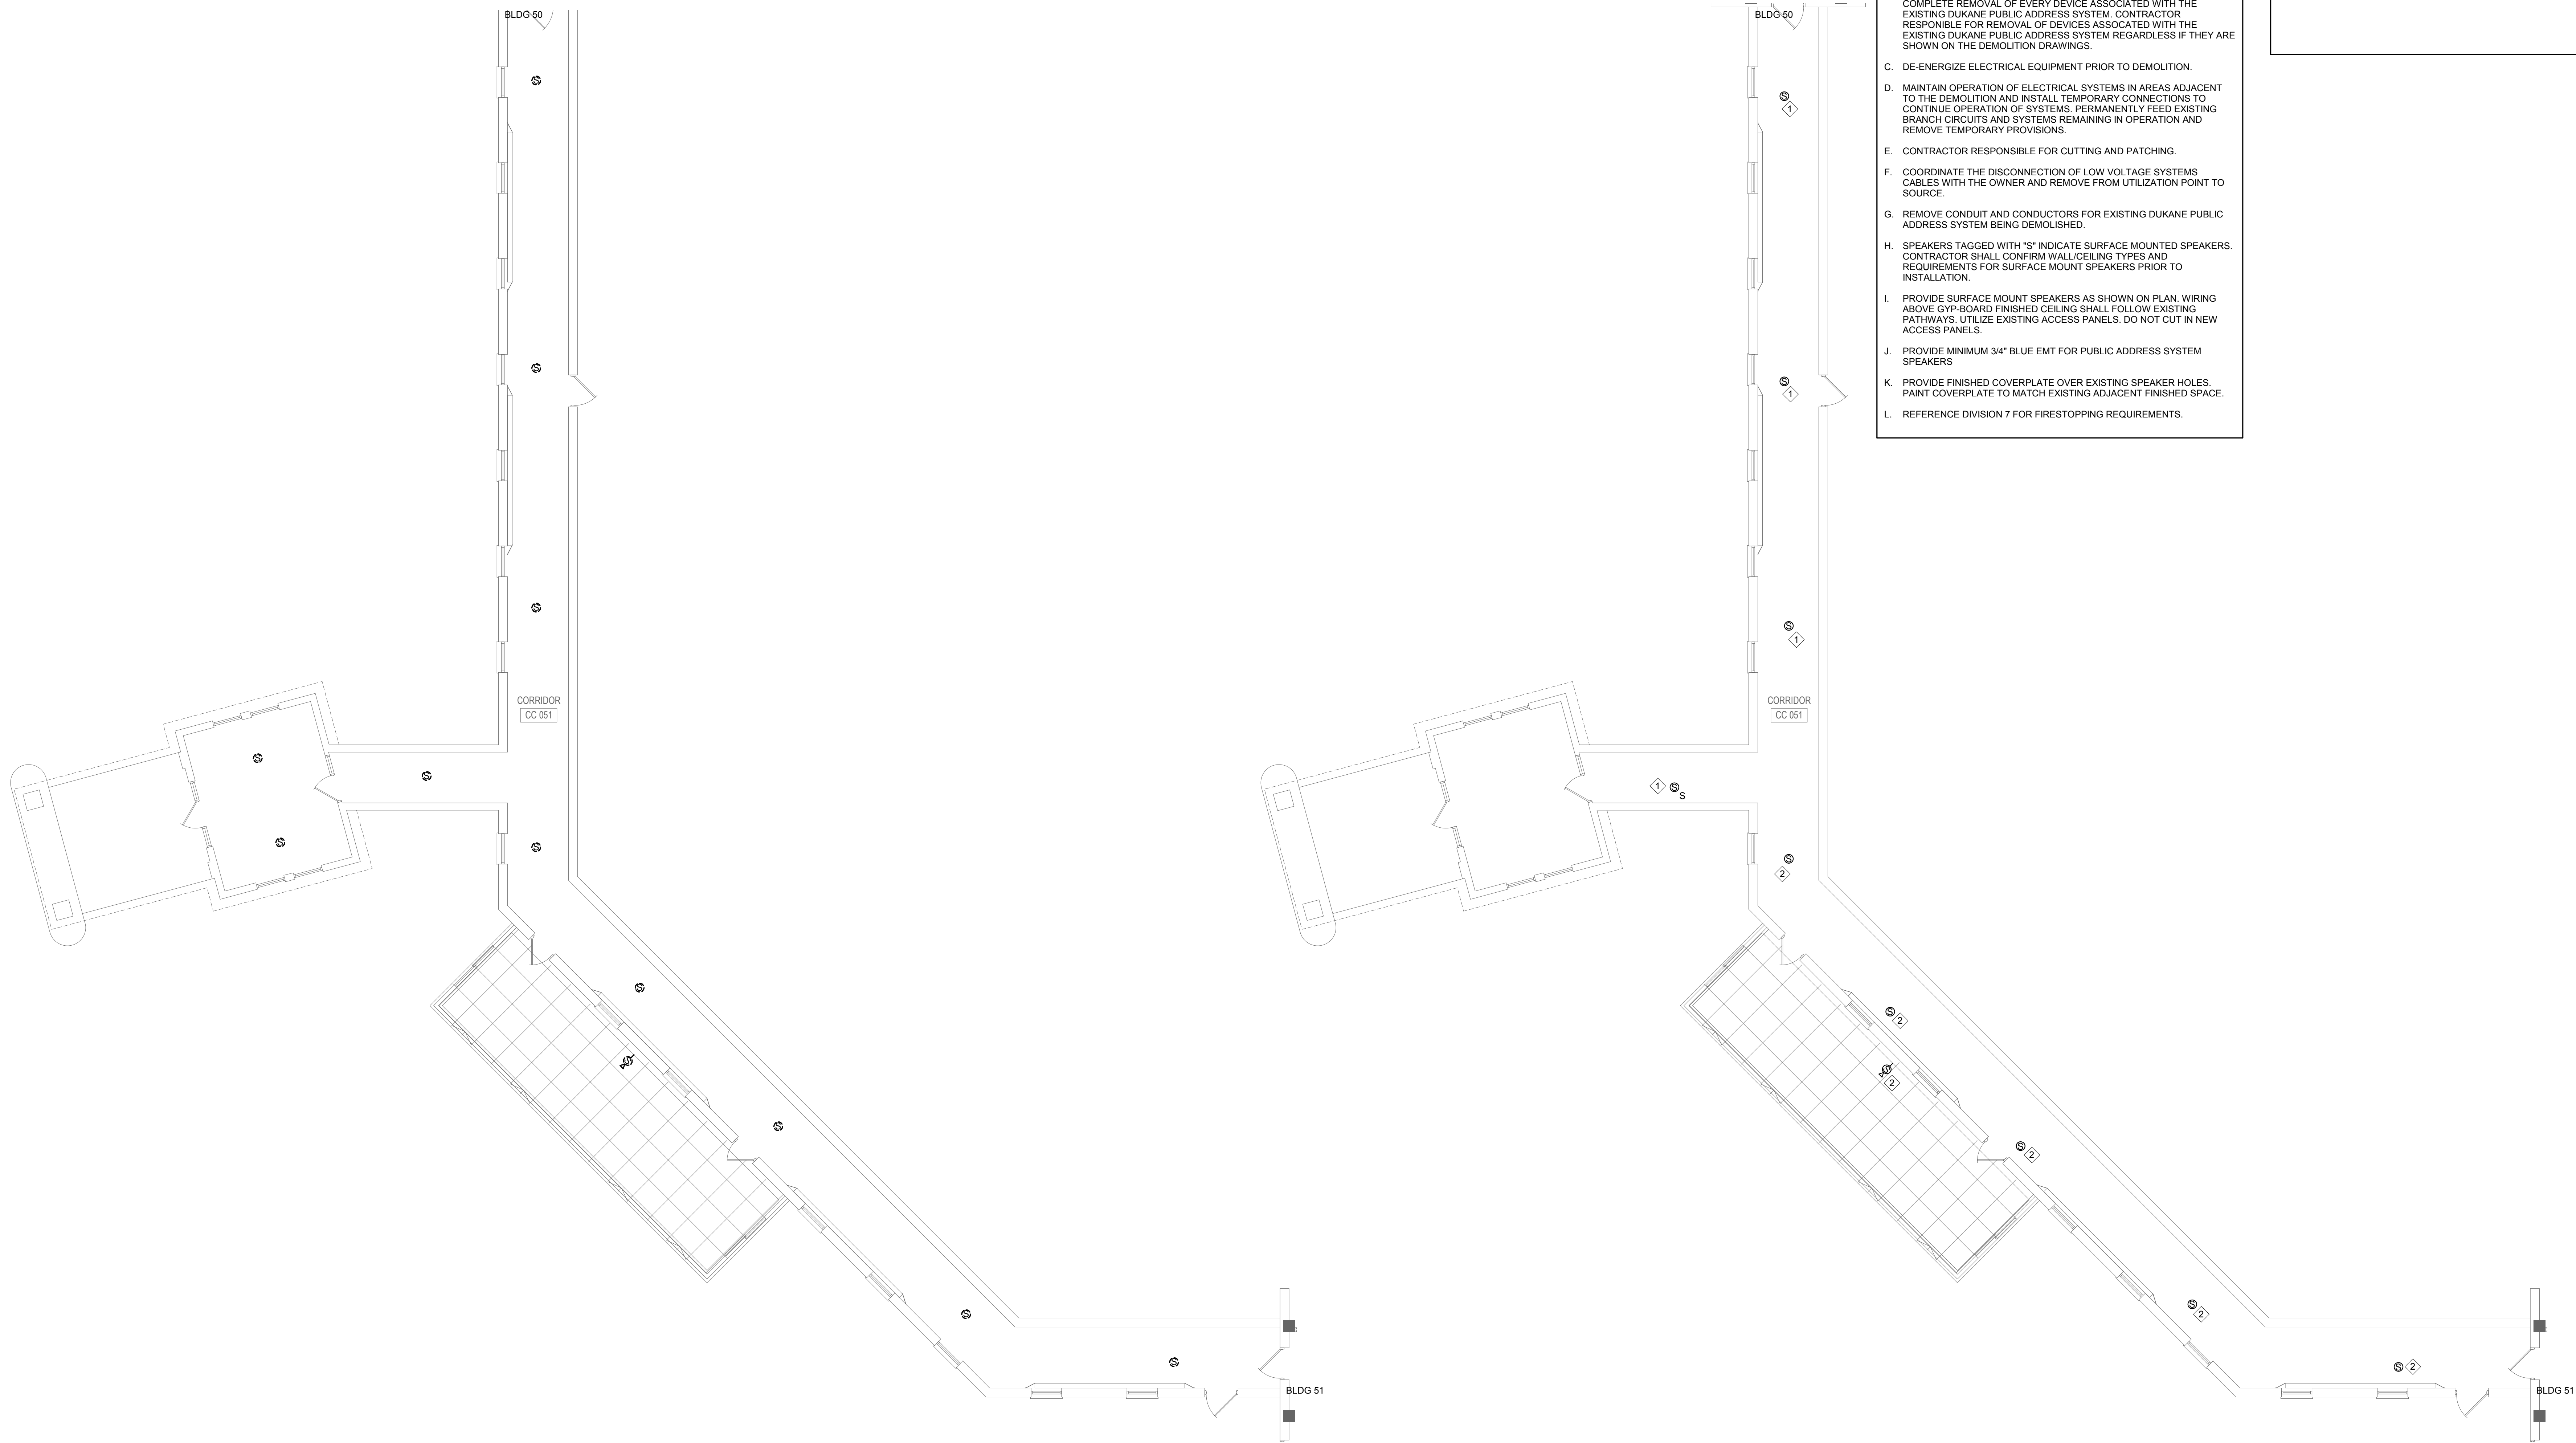

GENERAL NOTES:

- A. REFER TO SHEET ET-101 FOR LOCATION OF BUILDING ON CAMPUS.
- B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE INACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
- C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
- D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
- E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
- F. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
- G. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
- H. SPEAKERS TAGGED WITH "S" INDICATE SURFACE MOUNTED SPEAKERS. CONTRACTOR SHALL CONFIRM WALL/CEILING TYPES AND REQUIREMENTS FOR SURFACE MOUNT SPEAKERS PRIOR TO INSTALLATION.
- I. PROVIDE SURFACE MOUNT SPEAKERS AS SHOWN ON PLAN. WIRING ABOVE GYP-BOARD FINISHED CEILING SHALL FOLLOW EXISTING PATHWAYS. UTILIZE EXISTING ACCESS PANELS. DO NOT CUT IN NEW ACCESS PANELS.
- J. PROVIDE MINIMUM 3/4" BLUE EMT FOR PUBLIC ADDRESS SYSTEM SPEAKERS
- K. PROVIDE FINISHED COVERPLATE OVER EXISTING SPEAKER HOLES. PAINT COVERPLATE TO MATCH EXISTING ADJACENT FINISHED SPACE.
- L. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.

KEY NOTES:

- ① PROVIDE PA CIRCUIT FROM BUILDING 50.
- ② PROVIDE PA CIRCUIT FROM BUILDING 51.

① BUILDING LINK - B50 TO B51 - DEMOLITION
1/8" = 1'-0"

② BUILDING LINK - B50 TO B51 - NEW
1/8" = 1'-0"

C:\Revit\Projects\VA ST CLOUD\FACING_Elec_R1E_chgs.rvt 1/24/2019 1:26:53 PM

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE
BUILDING LINK - B50 TO B51 - DEMOLITION AND NEW PLANS
 DATE:
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:
 APPROVED: CHIEF OF STAFF
 DATE:
 APPROVED: HEALTH CARE SYSTEM DIRECTOR
 DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PROJECT NO.:	
PROJECT NO.:	CHECKED BY: CP	DRAWN: CG	ISSUE DATE: 1/24/19
LOCATION: VA MEDICAL CENTER ST. CLOUD, MN 56303	DRAWING NO.:	EDT003	


VA |
U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

GENERAL NOTES:

- A. REFER TO SHEET ET.101 FOR LOCATION OF BUILDING ON CAMPUS.
- B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE INACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
- C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
- D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
- E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
- F. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
- G. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
- H. SPEAKERS TAGGED WITH "S" INDICATE SURFACE MOUNTED SPEAKERS. CONTRACTOR SHALL CONFIRM WALL/CILING TYPES AND REQUIREMENTS FOR SURFACE MOUNT SPEAKERS PRIOR TO INSTALLATION.
- I. PROVIDE SURFACE MOUNT SPEAKERS AS SHOWN ON PLAN. WIRING ABOVE GYP-BOARD FINISHED CEILING SHALL FOLLOW EXISTING PATHWAYS. UTILIZE EXISTING ACCESS PANELS. DO NOT CUT IN NEW ACCESS PANELS.
- J. PROVIDE MINIMUM 3/4" BLUE EMT FOR PUBLIC ADDRESS SYSTEM SPEAKERS
- K. PROVIDE FINISHED COVERPLATE OVER EXISTING SPEAKER HOLES. PAINT COVERPLATE TO MATCH EXISTING ADJACENT FINISHED SPACE.
- L. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.

KEY NOTES:

- ① PROVIDE PA CIRCUIT FROM BUILDING 4.
- ② PROVIDE PA CIRCUIT FROM BUILDING 2.

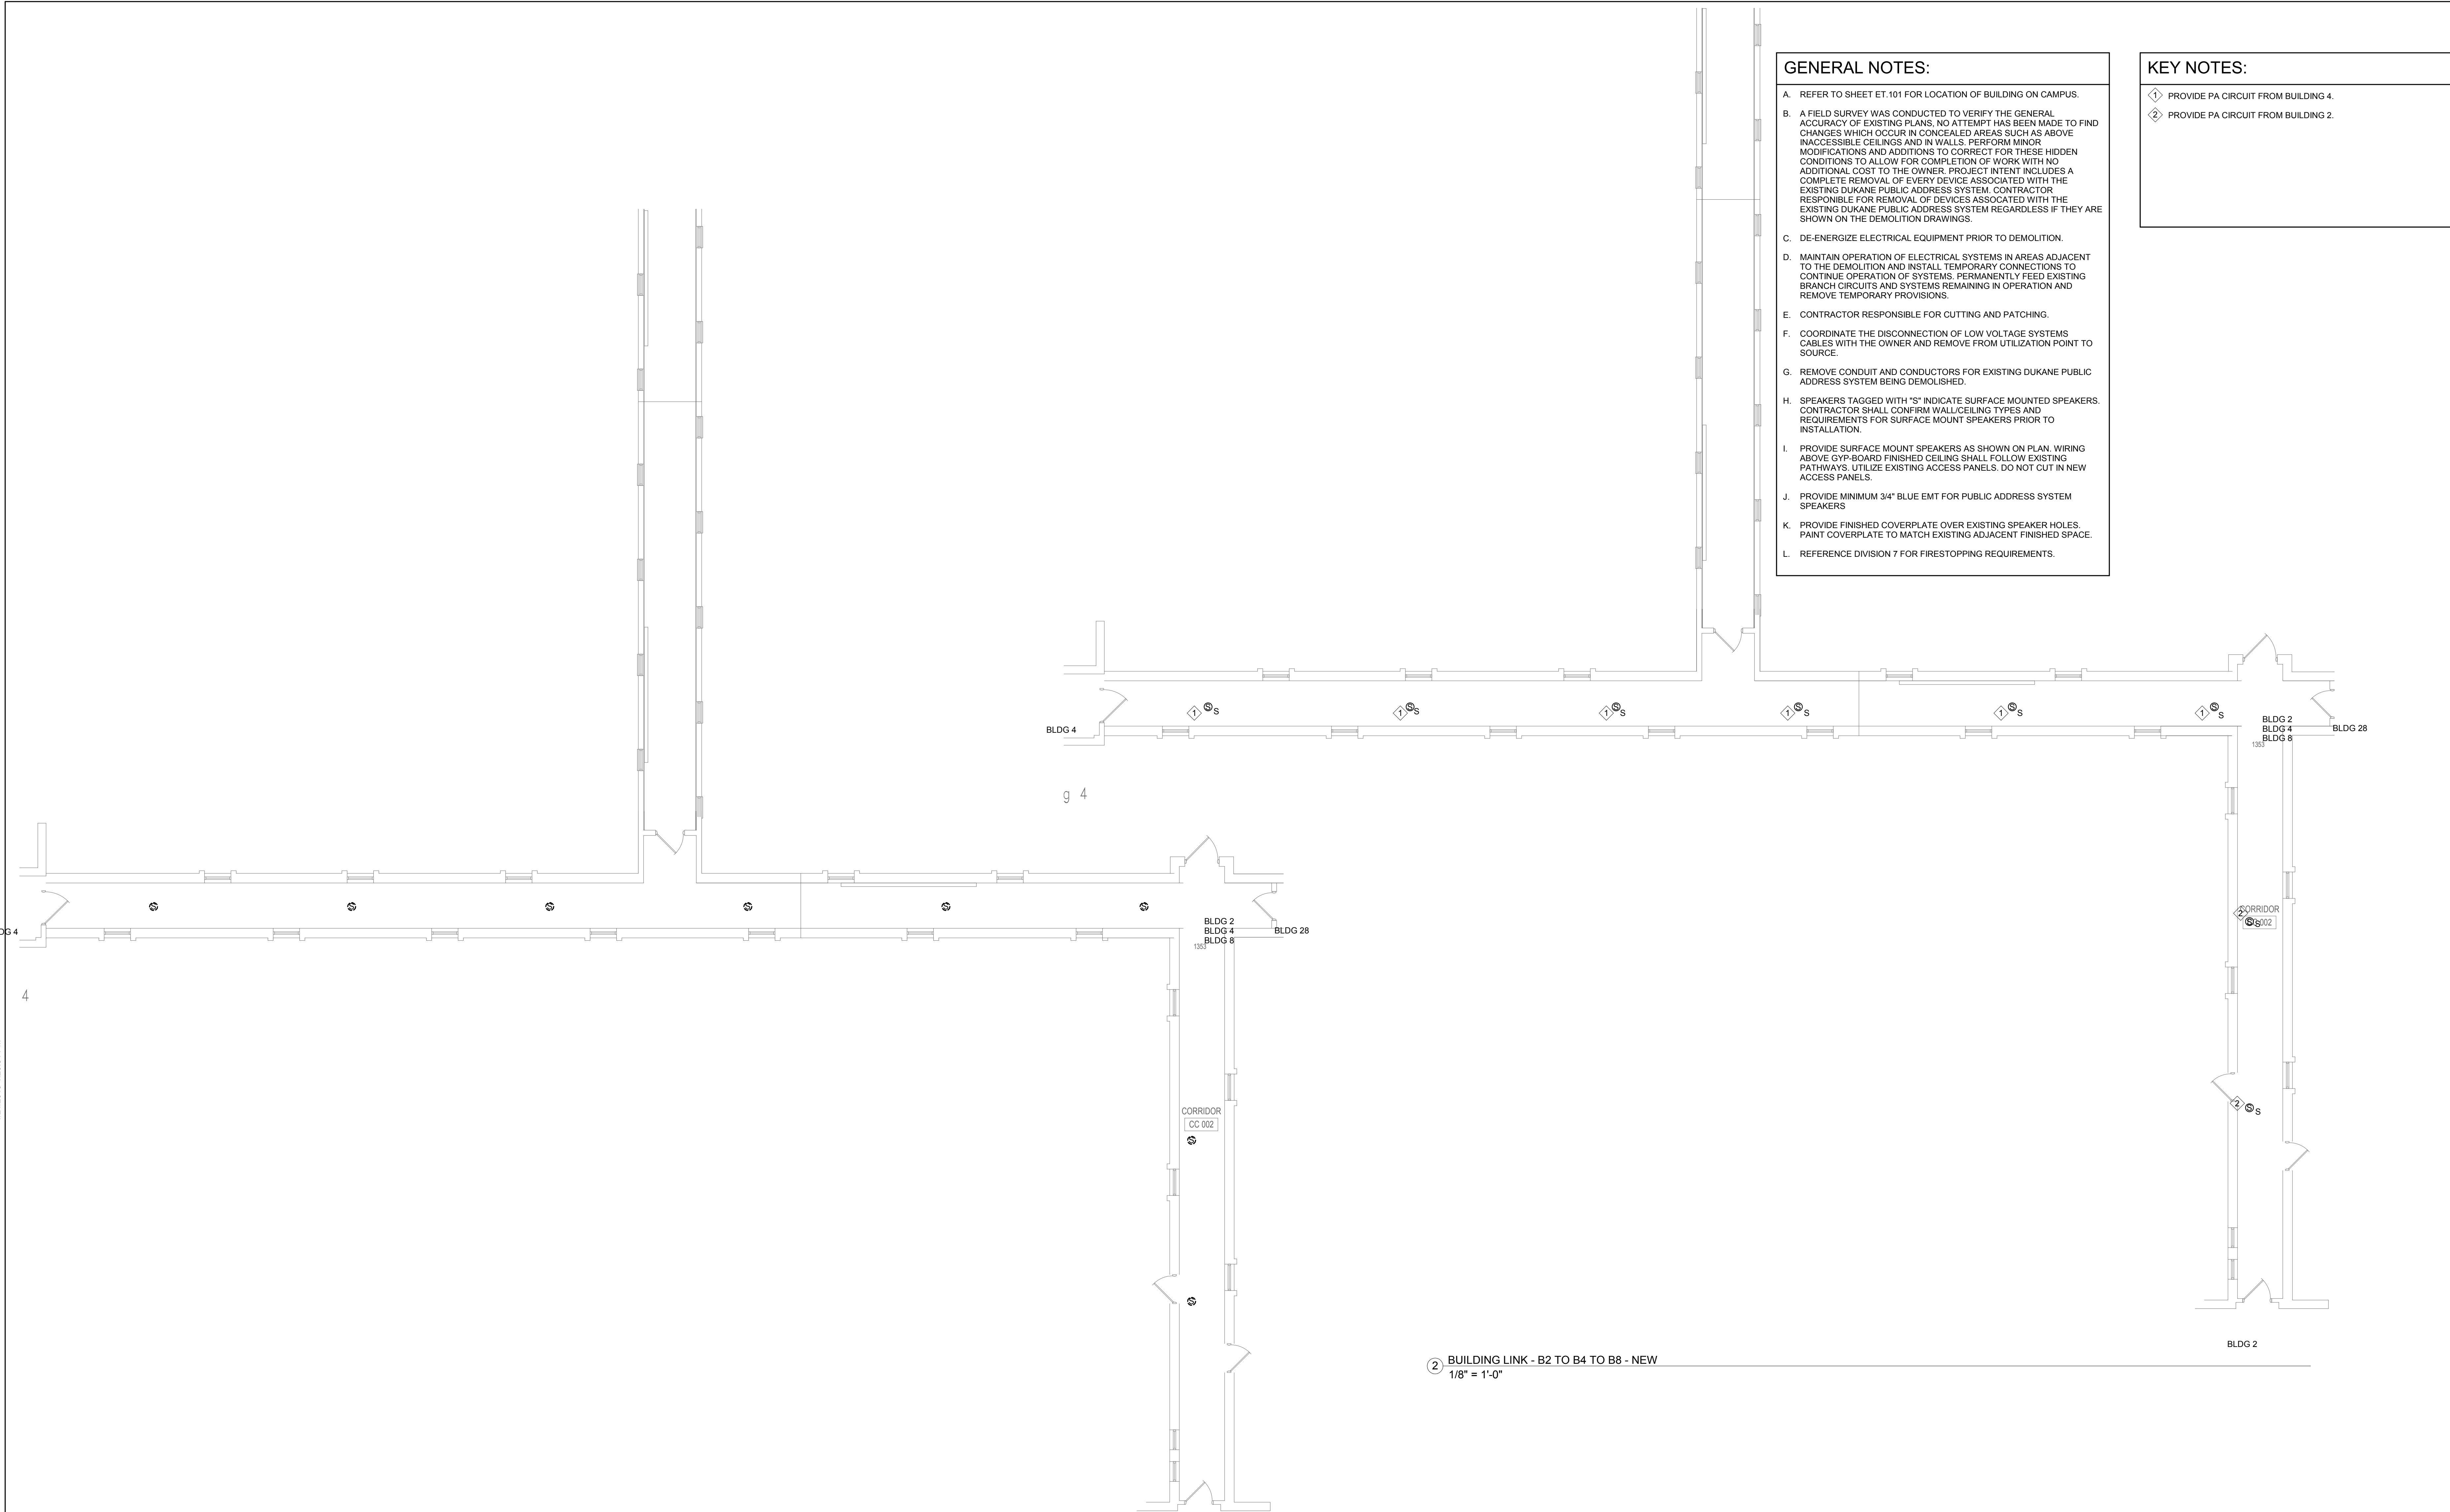

① BUILDING LINK - B2 TO B4 TO B8 - DEMOLITION
1/8" = 1'-0"

② BUILDING LINK - B2 TO B4 TO B8 - NEW
1/8" = 1'-0"

C:\Revit\Projects\VA ST CLOUD\FACING_Elec_R1E_cmg.rvt 1/24/2019 1:29:54 PM

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Piliod*
 Name: Chris M. Piliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE BUILDING LINK - B2 TO B4 TO B8 - DEMOLITION AND NEW PLANS	DATE:
APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR	DATE:
APPROVED: CHIEF OF STAFF	DATE:
APPROVED: HEALTH CARE SYSTEM DIRECTOR	DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM	PROJECT NO.:
BUILDING No.:	CHECKED BY: CP
DATE:	CG
ISSUE DATE 1/24/19	DRAWING NO. EDT004
LOCATION VA MEDICAL CENTER ST. CLOUD, MN 56303	DATE:

VA

U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

A

B

C

D

E

F

A


B

C

D

E

F

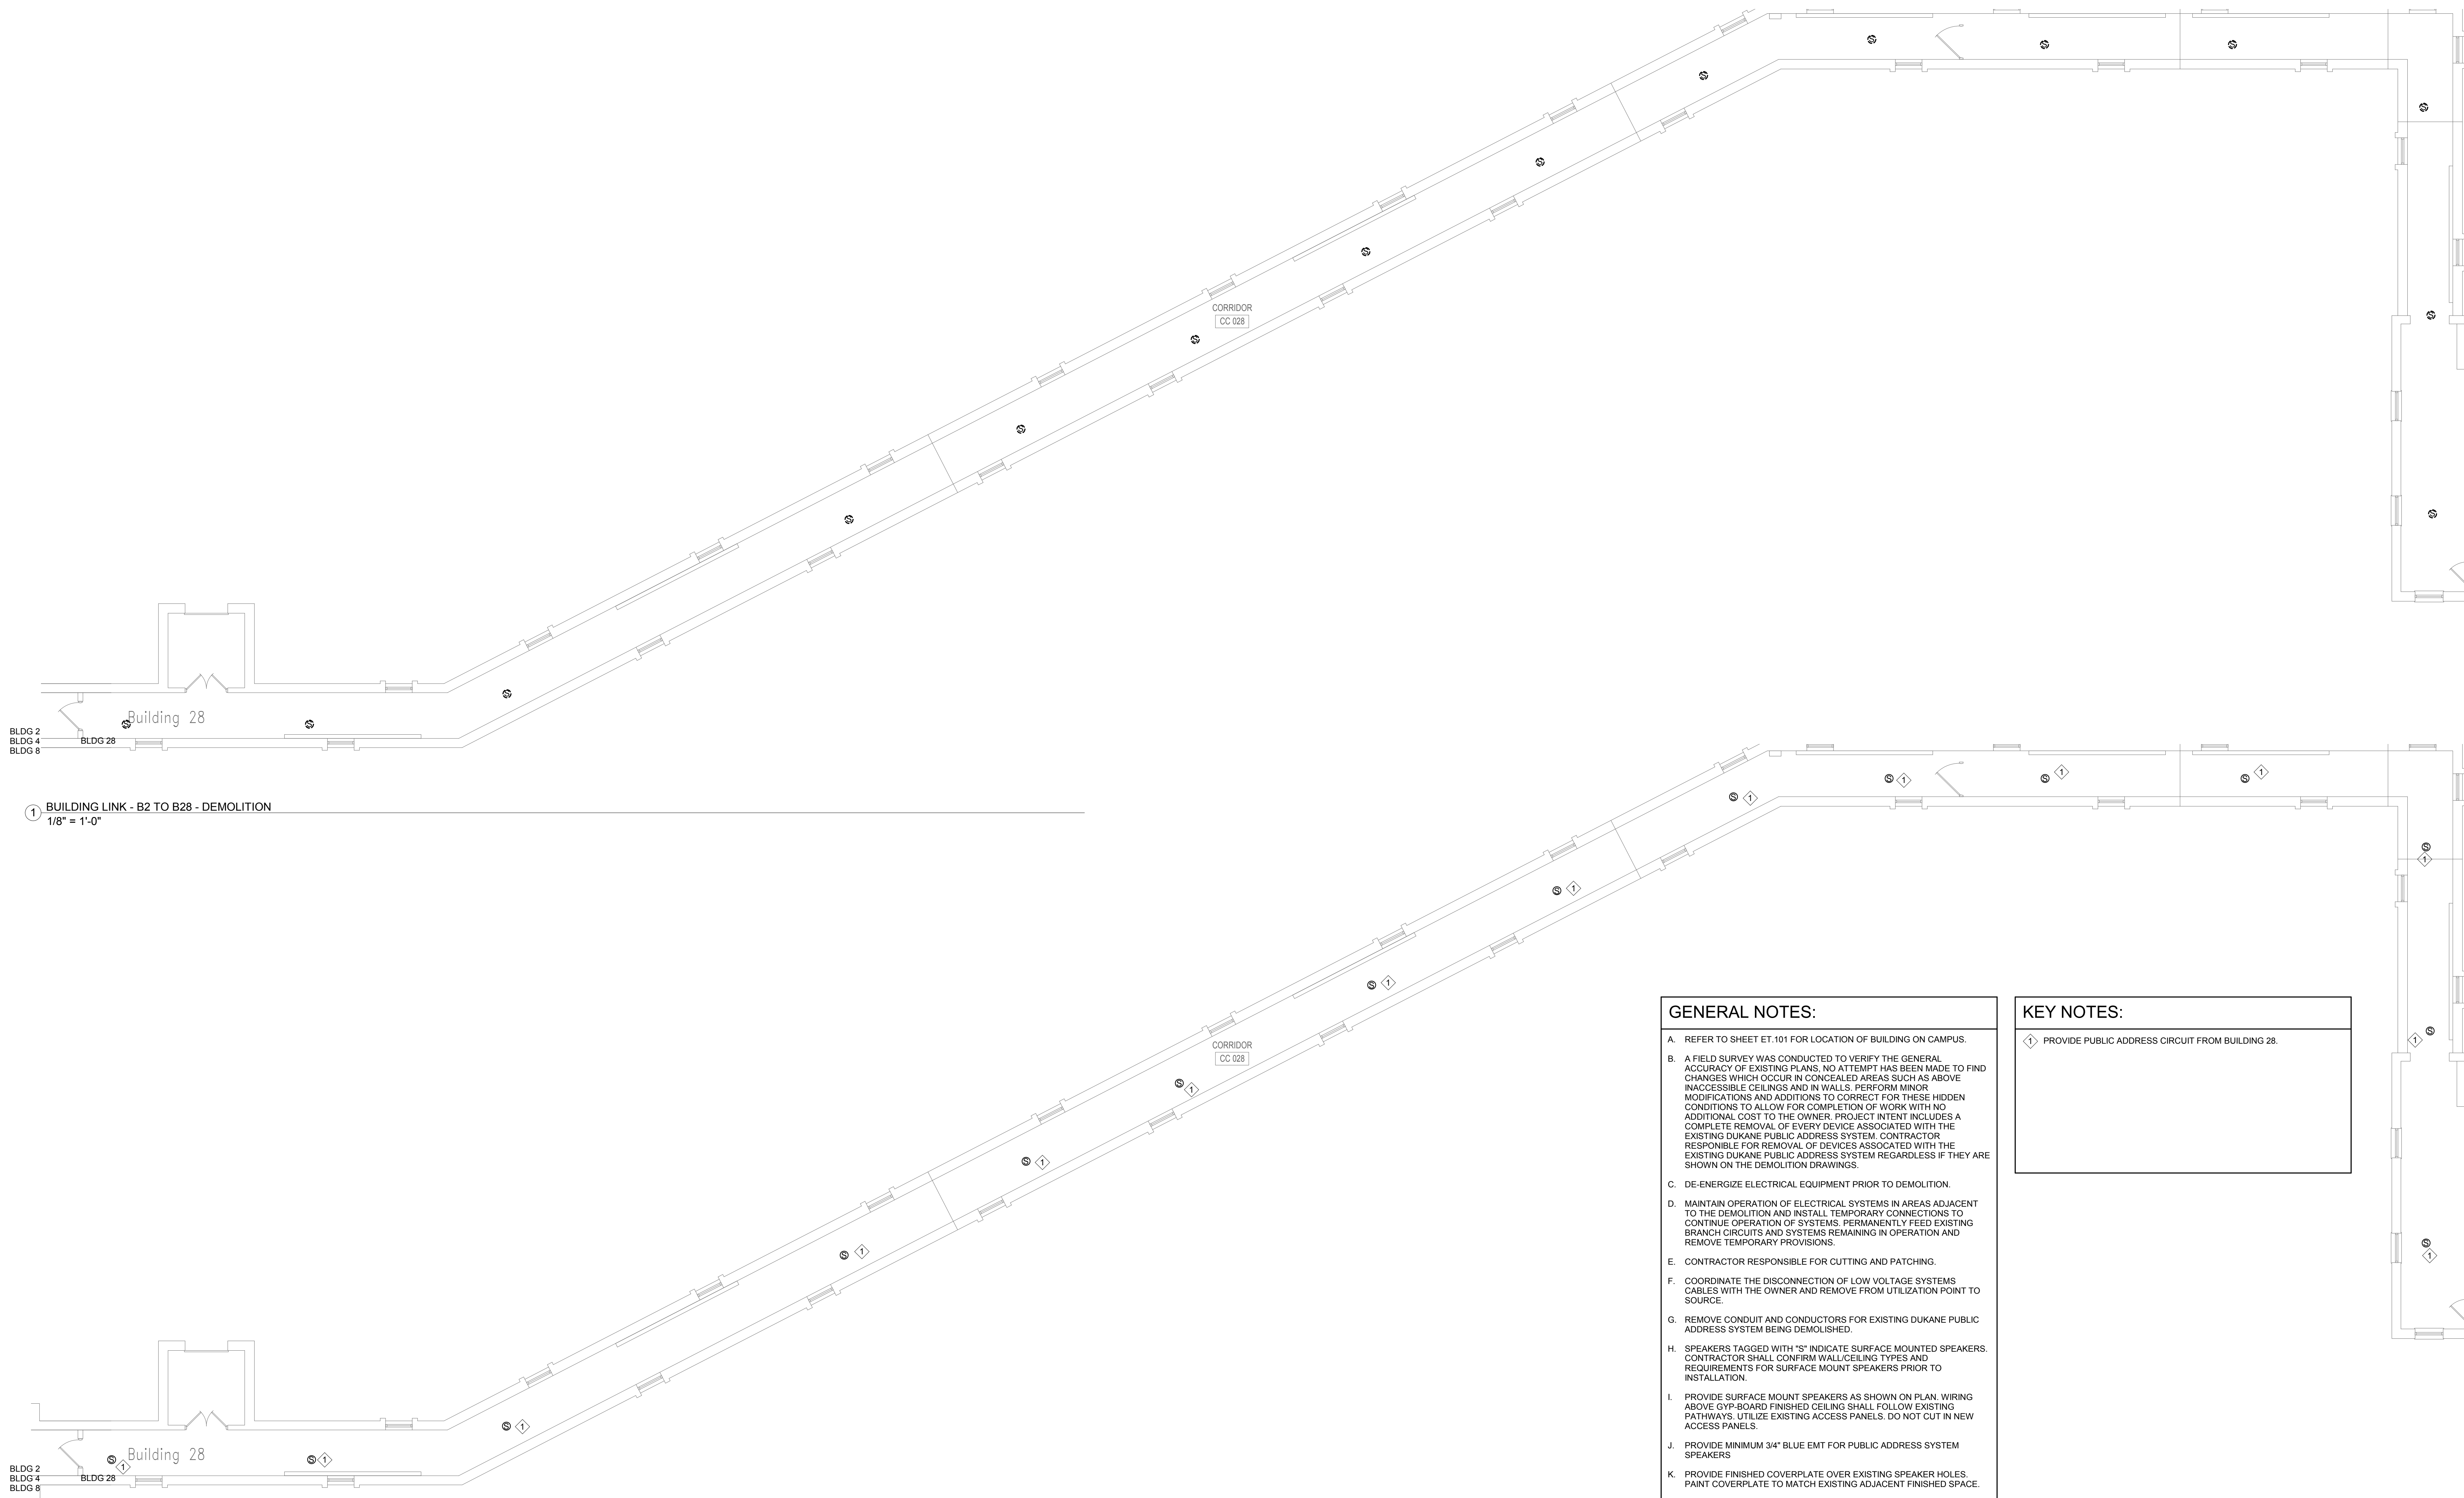

1 BUILDING LINK - B2 TO B28 - DEMOLITION
1/8" = 1'-0"

2 BUILDING LINK - B2 TO B28 - NEW
1/8" = 1'-0"

- GENERAL NOTES:**
- A. REFER TO SHEET ET-101 FOR LOCATION OF BUILDING ON CAMPUS.
 - B. A FIELD SURVEY WAS CONDUCTED TO VERIFY THE GENERAL ACCURACY OF EXISTING PLANS. NO ATTEMPT HAS BEEN MADE TO FIND CHANGES WHICH OCCUR IN CONCEALED AREAS SUCH AS ABOVE INACCESSIBLE CEILINGS AND IN WALLS. PERFORM MINOR MODIFICATIONS AND ADDITIONS TO CORRECT FOR THESE HIDDEN CONDITIONS TO ALLOW FOR COMPLETION OF WORK WITH NO ADDITIONAL COST TO THE OWNER. PROJECT INTENT INCLUDES A COMPLETE REMOVAL OF EVERY DEVICE ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM. CONTRACTOR RESPONSIBLE FOR REMOVAL OF DEVICES ASSOCIATED WITH THE EXISTING DUKANE PUBLIC ADDRESS SYSTEM REGARDLESS IF THEY ARE SHOWN ON THE DEMOLITION DRAWINGS.
 - C. DE-ENERGIZE ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION.
 - D. MAINTAIN OPERATION OF ELECTRICAL SYSTEMS IN AREAS ADJACENT TO THE DEMOLITION AND INSTALL TEMPORARY CONNECTIONS TO CONTINUE OPERATION OF SYSTEMS. PERMANENTLY FEED EXISTING BRANCH CIRCUITS AND SYSTEMS REMAINING IN OPERATION AND REMOVE TEMPORARY PROVISIONS.
 - E. CONTRACTOR RESPONSIBLE FOR CUTTING AND PATCHING.
 - F. COORDINATE THE DISCONNECTION OF LOW VOLTAGE SYSTEMS CABLES WITH THE OWNER AND REMOVE FROM UTILIZATION POINT TO SOURCE.
 - G. REMOVE CONDUIT AND CONDUCTORS FOR EXISTING DUKANE PUBLIC ADDRESS SYSTEM BEING DEMOLISHED.
 - H. SPEAKERS TAGGED WITH "S" INDICATE SURFACE MOUNTED SPEAKERS. CONTRACTOR SHALL CONFIRM WALL/CEILING TYPES AND REQUIREMENTS FOR SURFACE MOUNT SPEAKERS PRIOR TO INSTALLATION.
 - I. PROVIDE SURFACE MOUNT SPEAKERS AS SHOWN ON PLAN. WIRING ABOVE GYP-BOARD FINISHED CEILING SHALL FOLLOW EXISTING PATHWAYS. UTILIZE EXISTING ACCESS PANELS. DO NOT CUT IN NEW ACCESS PANELS.
 - J. PROVIDE MINIMUM 3/4" BLUE EMT FOR PUBLIC ADDRESS SYSTEM SPEAKERS.
 - K. PROVIDE FINISHED COVERPLATE OVER EXISTING SPEAKER HOLES. PAINT COVERPLATE TO MATCH EXISTING ADJACENT FINISHED SPACE.
 - L. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.

- KEY NOTES:**
- ◇ PROVIDE PUBLIC ADDRESS CIRCUIT FROM BUILDING 28.

C:\Revit\Projects\VA ST CLOUD\PAVING_Elec_RITL_chp.rvt 1/24/2019 1:26:54 PM

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE
BUILDING LINK - B2 TO B28 - DEMOLITION AND NEW PLANS
 DATE:
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:
 APPROVED: CHIEF OF STAFF
 DATE:
 APPROVED: HEALTH CARE SYSTEM DIRECTOR
 DATE:


PROJECT TITLE
UPGRADE PUBLIC ADDRESS SYSTEM
 PROJECT NO.:
 DATE:
 BUILDING No.:
 CHECKED BY: CP
 DRAWN: CG
 ISSUE DATE: 1/24/19
 LOCATION: VA MEDICAL CENTER ST. CLOUD, MN 56303
 DRAWING NO.: EDT005



U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

GENERAL NOTES:

- PRIOR TO BID, CONTRACTOR SHALL VISIT SITE AND REVIEW SCOPE OF WORK.
- DEMOLITION, INSTALLATION AND TESTING SHALL BE DONE IN ACCORDANCE WITH SPECIFICATIONS.
- PROVIDE PUBLIC ADDRESS SYSTEM MUTING RELAYS AT EACH LOCAL SOUND SYSTEM.
- SPEAKERS TAGGED WITH "S" INDICATE SURFACE MOUNTED SPEAKERS. CONTRACTOR SHALL CONFIRM WALL/CEILING TYPES AND REQUIREMENTS FOR SURFACE MOUNT SPEAKERS PRIOR TO INSTALLATION.
- REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.
- PROVIDE MINIMUM 3/4" BLUE EMT FOR PUBLIC ADDRESS SYSTEM SPEAKERS.

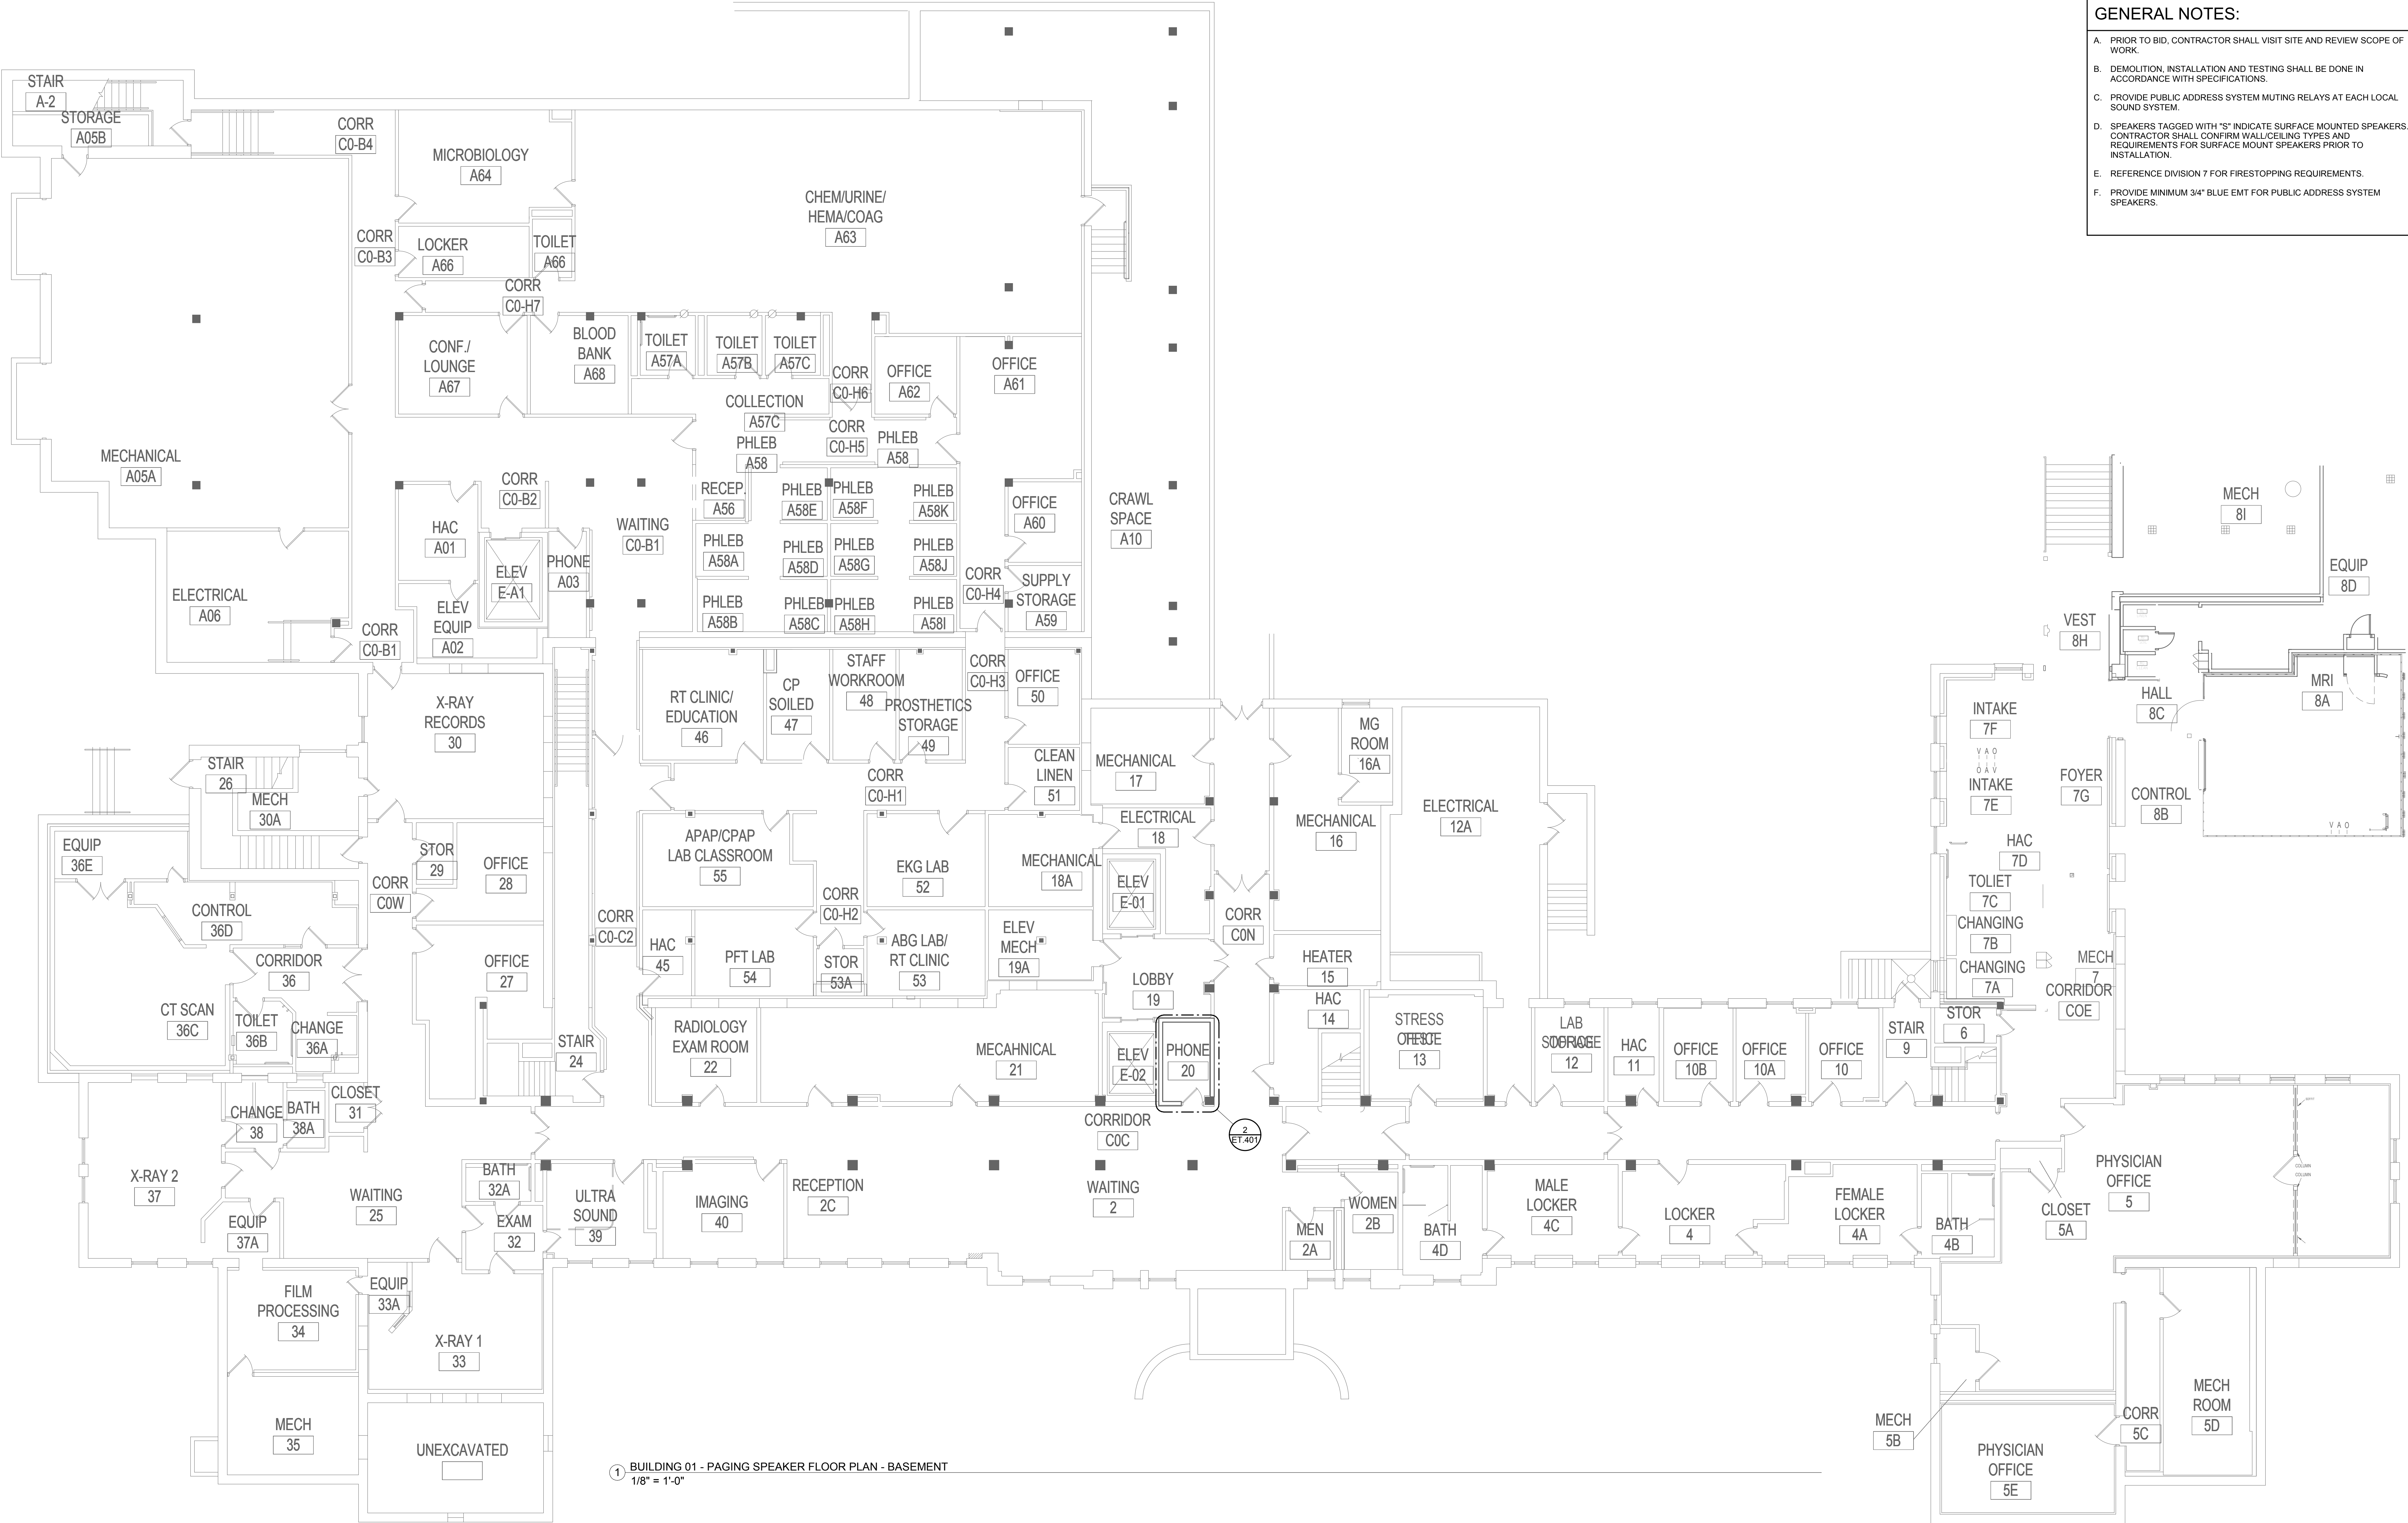

1 BUILDING 01 - PAGING SPEAKER FLOOR PLAN - BASEMENT
1/8" = 1'-0"

1/24/2019 1:26:58 PM
C:\Revit\Projects\VA ST CLOUD PAGING_Bldg_R1E.dwg

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)
DUNHAM
50 South Sixth Street / Suite 1100
Minneapolis, Minnesota 55402-1540
Phone: 612-465-7550 Fax: 612-465-7551
Web: dunhaminc.com
mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD
ANDERSON ENGINEERING
ENGINEERING • ARCHITECTURE • LAND SURVEYING
ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
Anderson Engineering of Minnesota, LLC
13605 1st Avenue North
Suite 100
Plymouth, MN 55441
763-412-4000 (o) 763-412-4090 (f)
www.ae-mn.com

STAMP
I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
Chris M. Piliod
Signature: Chris M. Piliod, P.E.
Name: Chris M. Piliod, P.E.
Date: 1/24/19
Registration Number: 50826


APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE
BUILDING 01 - PAGING SPEAKER FLOOR PLAN - BASEMENT
APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
DATE:
APPROVED: CHIEF OF STAFF
DATE:

PROJECT TITLE
UPGRADE PUBLIC ADDRESS SYSTEM
BUILDING No. _____ CHECKED BY: CP DRAWN: CG
DATE: 1/24/19
LOCATION: VA MEDICAL CENTER ST. CLOUD, MN 56303
ISSUE DATE: 1/24/19
DRAWING NO.: ET01-00

VA
U.S. Department of Veterans Affairs
Veterans Health Administration
St. Cloud VA Health Care System

A
B
C
D
E
F

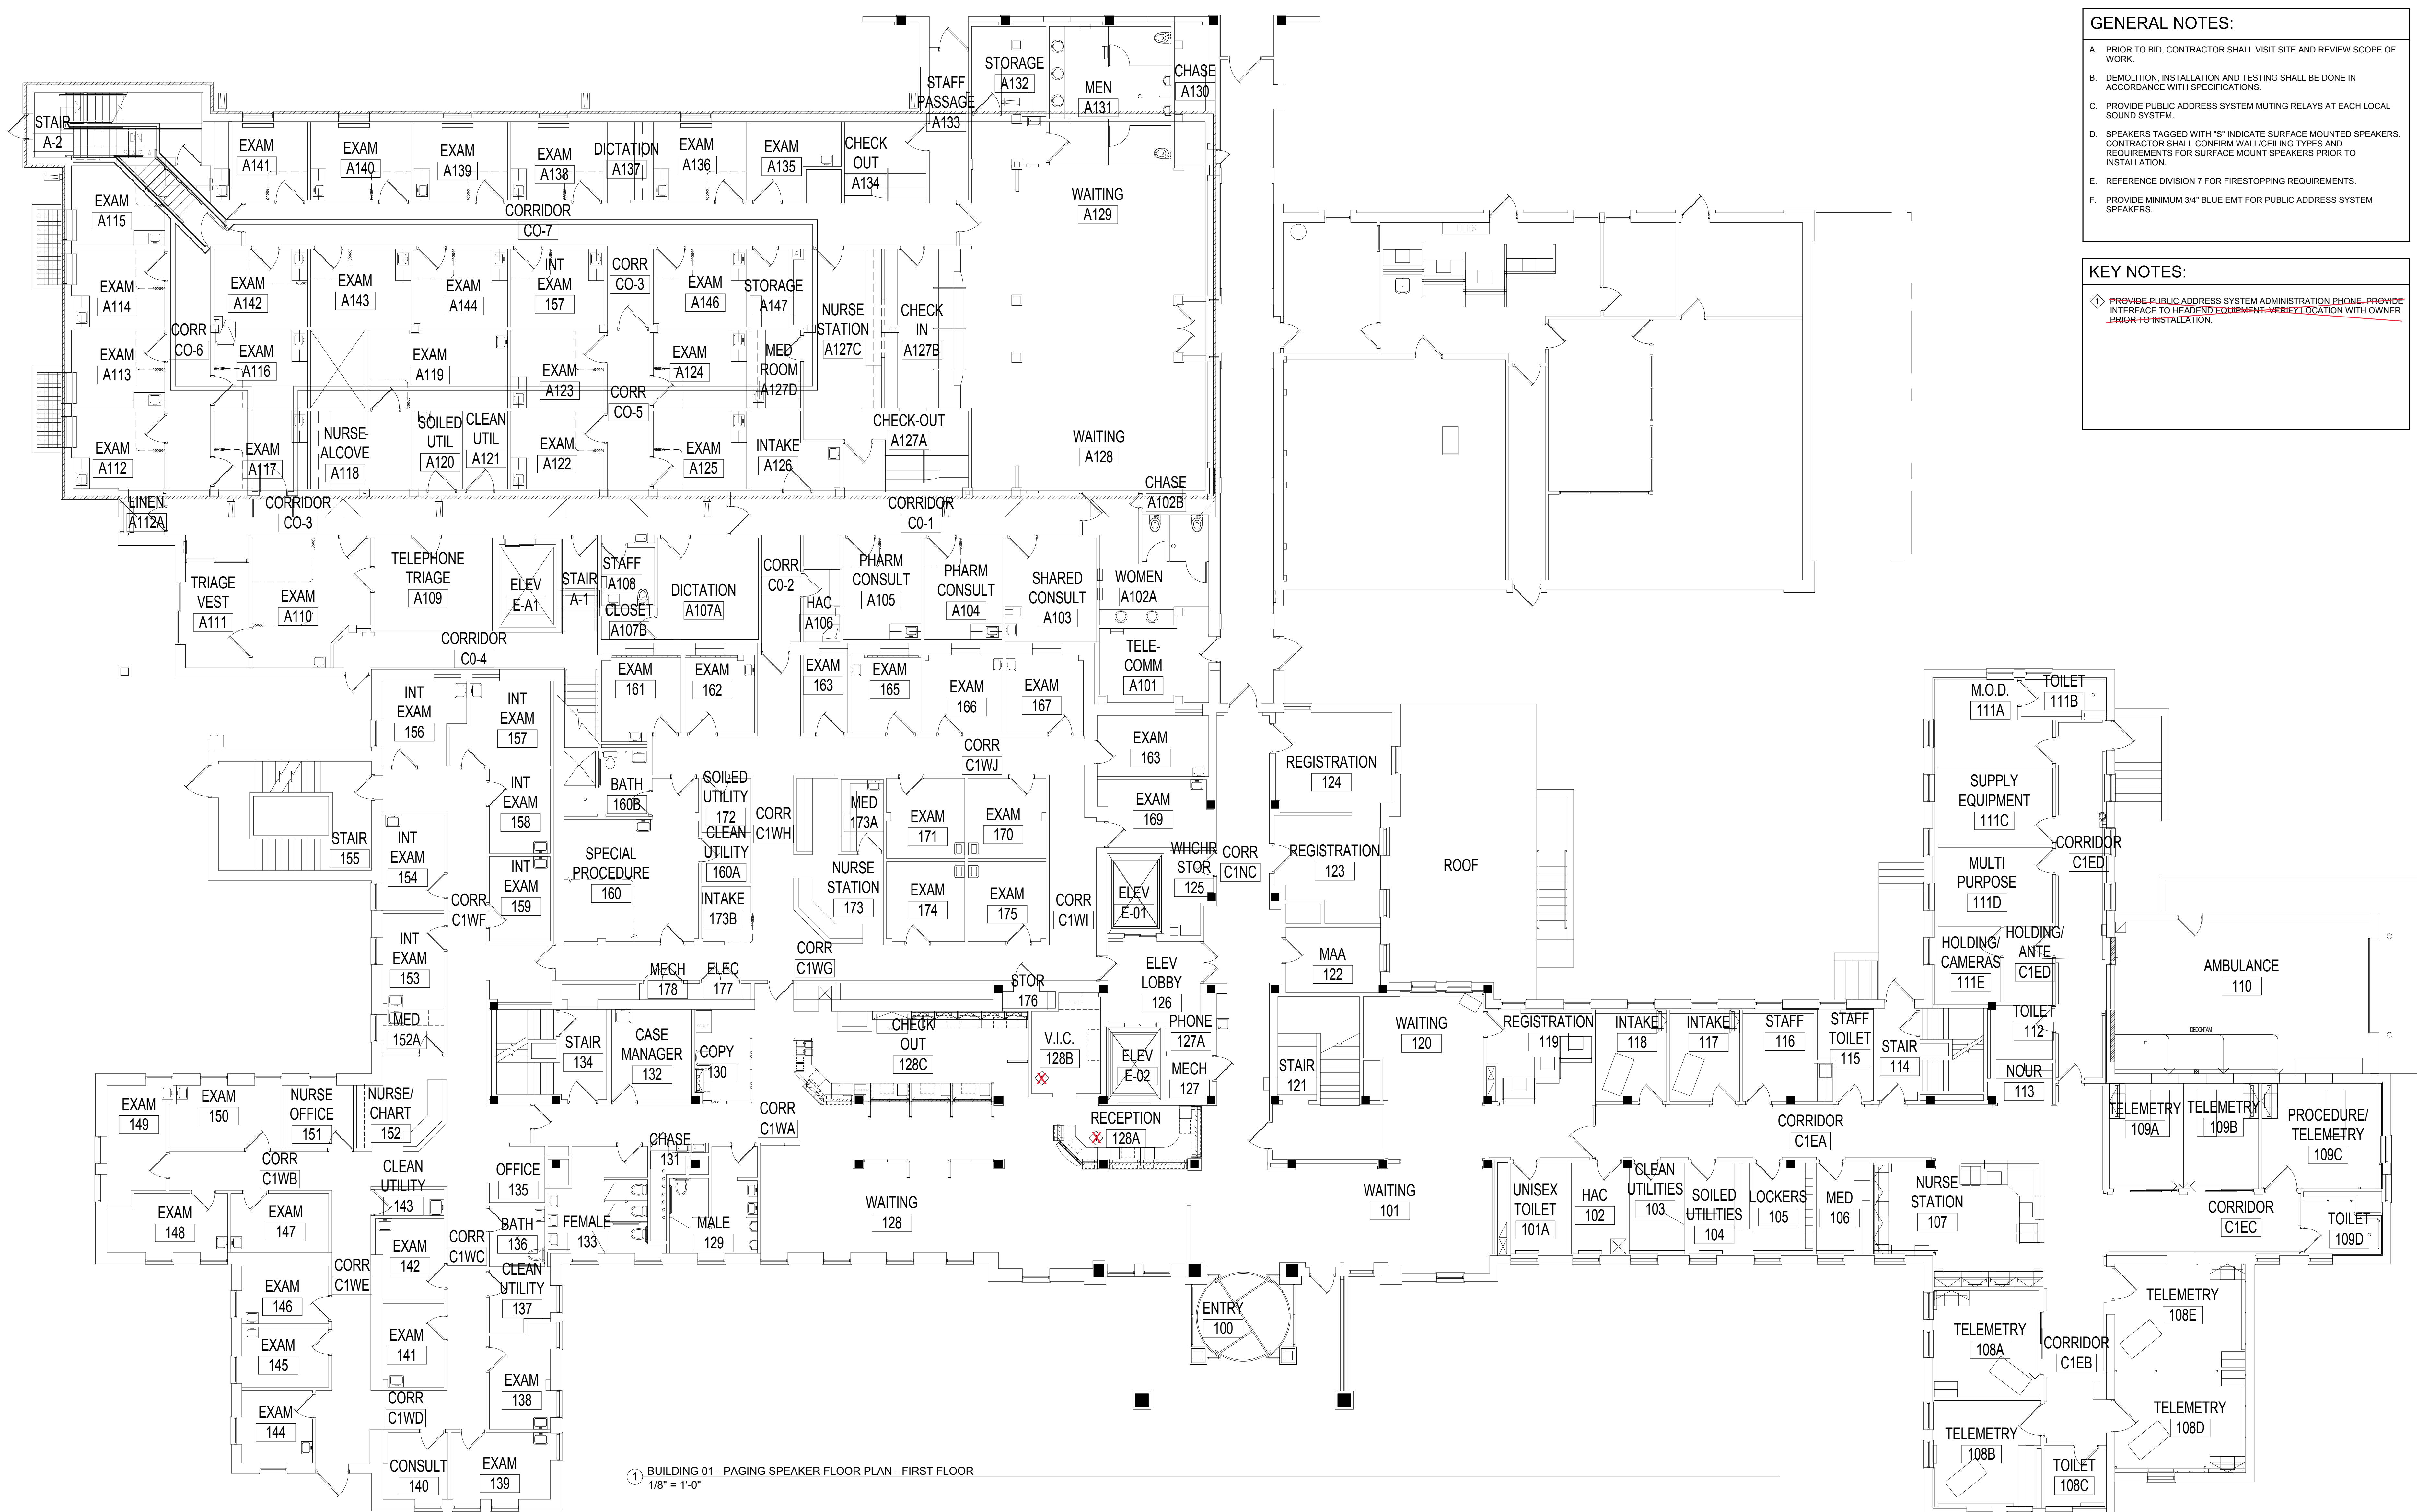

GENERAL NOTES:

- A. PRIOR TO BID, CONTRACTOR SHALL VISIT SITE AND REVIEW SCOPE OF WORK.
- B. DEMOLITION, INSTALLATION AND TESTING SHALL BE DONE IN ACCORDANCE WITH SPECIFICATIONS.
- C. PROVIDE PUBLIC ADDRESS SYSTEM MUTING RELAYS AT EACH LOCAL SOUND SYSTEM.
- D. SPEAKERS TAGGED WITH "S" INDICATE SURFACE MOUNTED SPEAKERS. CONTRACTOR SHALL CONFIRM WALL/CILING TYPES AND REQUIREMENTS FOR SURFACE MOUNT SPEAKERS PRIOR TO INSTALLATION.
- E. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.
- F. PROVIDE MINIMUM 3/4" BLUE EMT FOR PUBLIC ADDRESS SYSTEM SPEAKERS.

KEY NOTES:

- 1. PROVIDE PUBLIC ADDRESS SYSTEM ADMINISTRATION PHONE. PROVIDE INTERFACE TO HEADEND EQUIPMENT - VERIFY LOCATION WITH OWNER PRIOR TO INSTALLATION.

1 BUILDING 01 - PAGING SPEAKER FLOOR PLAN - FIRST FLOOR
1/8" = 1'-0"

1/24/2019 1:29:56 PM
C:\Revit\Projects\VA ST CLOUD PAGING_Bldg_R1E.dwg

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)
DUNHAM
50 South Sixth Street / Suite 1100
Minneapolis, Minnesota 55402-1540
Phone: 612-465-7550 Fax: 612-465-7551
Web: dunhaminc.com
mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD
ANDERSON ENGINEERING
ENGINEERING • ARCHITECTURE • LAND SURVEYING
ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
Anderson Engineering of Minnesota, LLC
13605 1st Avenue North
Suite 100
Plymouth, MN 55441
763-412-4000 (o) 763-412-4090 (f)
www.ae-mn.com
AE PROJECT NUMBER: Project Number

STAMP
I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
Chris M. Pilioud
Name: Chris M. Pilioud, P.E.
Date: 1/24/19
Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE BUILDING 01 - PAGING SPEAKER FLOOR PLAN - FIRST FLOOR	DATE:
APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR	DATE:
APPROVED: CHIEF OF STAFF	DATE:
APPROVED: HEALTH CARE SYSTEM DIRECTOR	DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM	PROJECT NO.:
BUILDING No.:	CHECKED BY:
CHECKER:	AUTHOR:
ISSUE DATE:	DRAWING NO.:
1/24/19	ET01-01
LOCATION VA MEDICAL CENTER ST. CLOUD, MN 56303	DATE:

VA
U.S. Department of Veterans Affairs
Veterans Health Administration
St. Cloud VA Health Care System


GENERAL NOTES:

- A. PRIOR TO BID, CONTRACTOR SHALL VISIT SITE AND REVIEW SCOPE OF WORK.
- B. DEMOLITION, INSTALLATION AND TESTING SHALL BE DONE IN ACCORDANCE WITH SPECIFICATIONS.
- C. PROVIDE PUBLIC ADDRESS SYSTEM MUTING RELAYS AT EACH LOCAL SOUND SYSTEM.
- D. SPEAKERS TAGGED WITH "S" INDICATE SURFACE MOUNTED SPEAKERS. CONTRACTOR SHALL CONFIRM WALL/CEILING TYPES AND REQUIREMENTS FOR SURFACE MOUNT SPEAKERS PRIOR TO INSTALLATION.
- E. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.
- F. PROVIDE MINIMUM 3/4" BLUE EMT FOR PUBLIC ADDRESS SYSTEM SPEAKERS.

KEY NOTES:

- ◇ PROVIDE PUBLIC ADDRESS SYSTEM WALL MOUNTED EQUIPMENT TO MOUNT VERTICALLY WITHIN SHALLOW ROOM. PROVIDE WALL BRACKETS FOR EACH PIECE OF EQUIPMENT REQUIRED. REMOVE AND RETURN EXISTING PA NETWORK SWITCH BACK-TO-OWNER UPON COMPLETION OF NEW PUBLIC ADDRESS SYSTEM.

SALVAGE AND REINSTALL

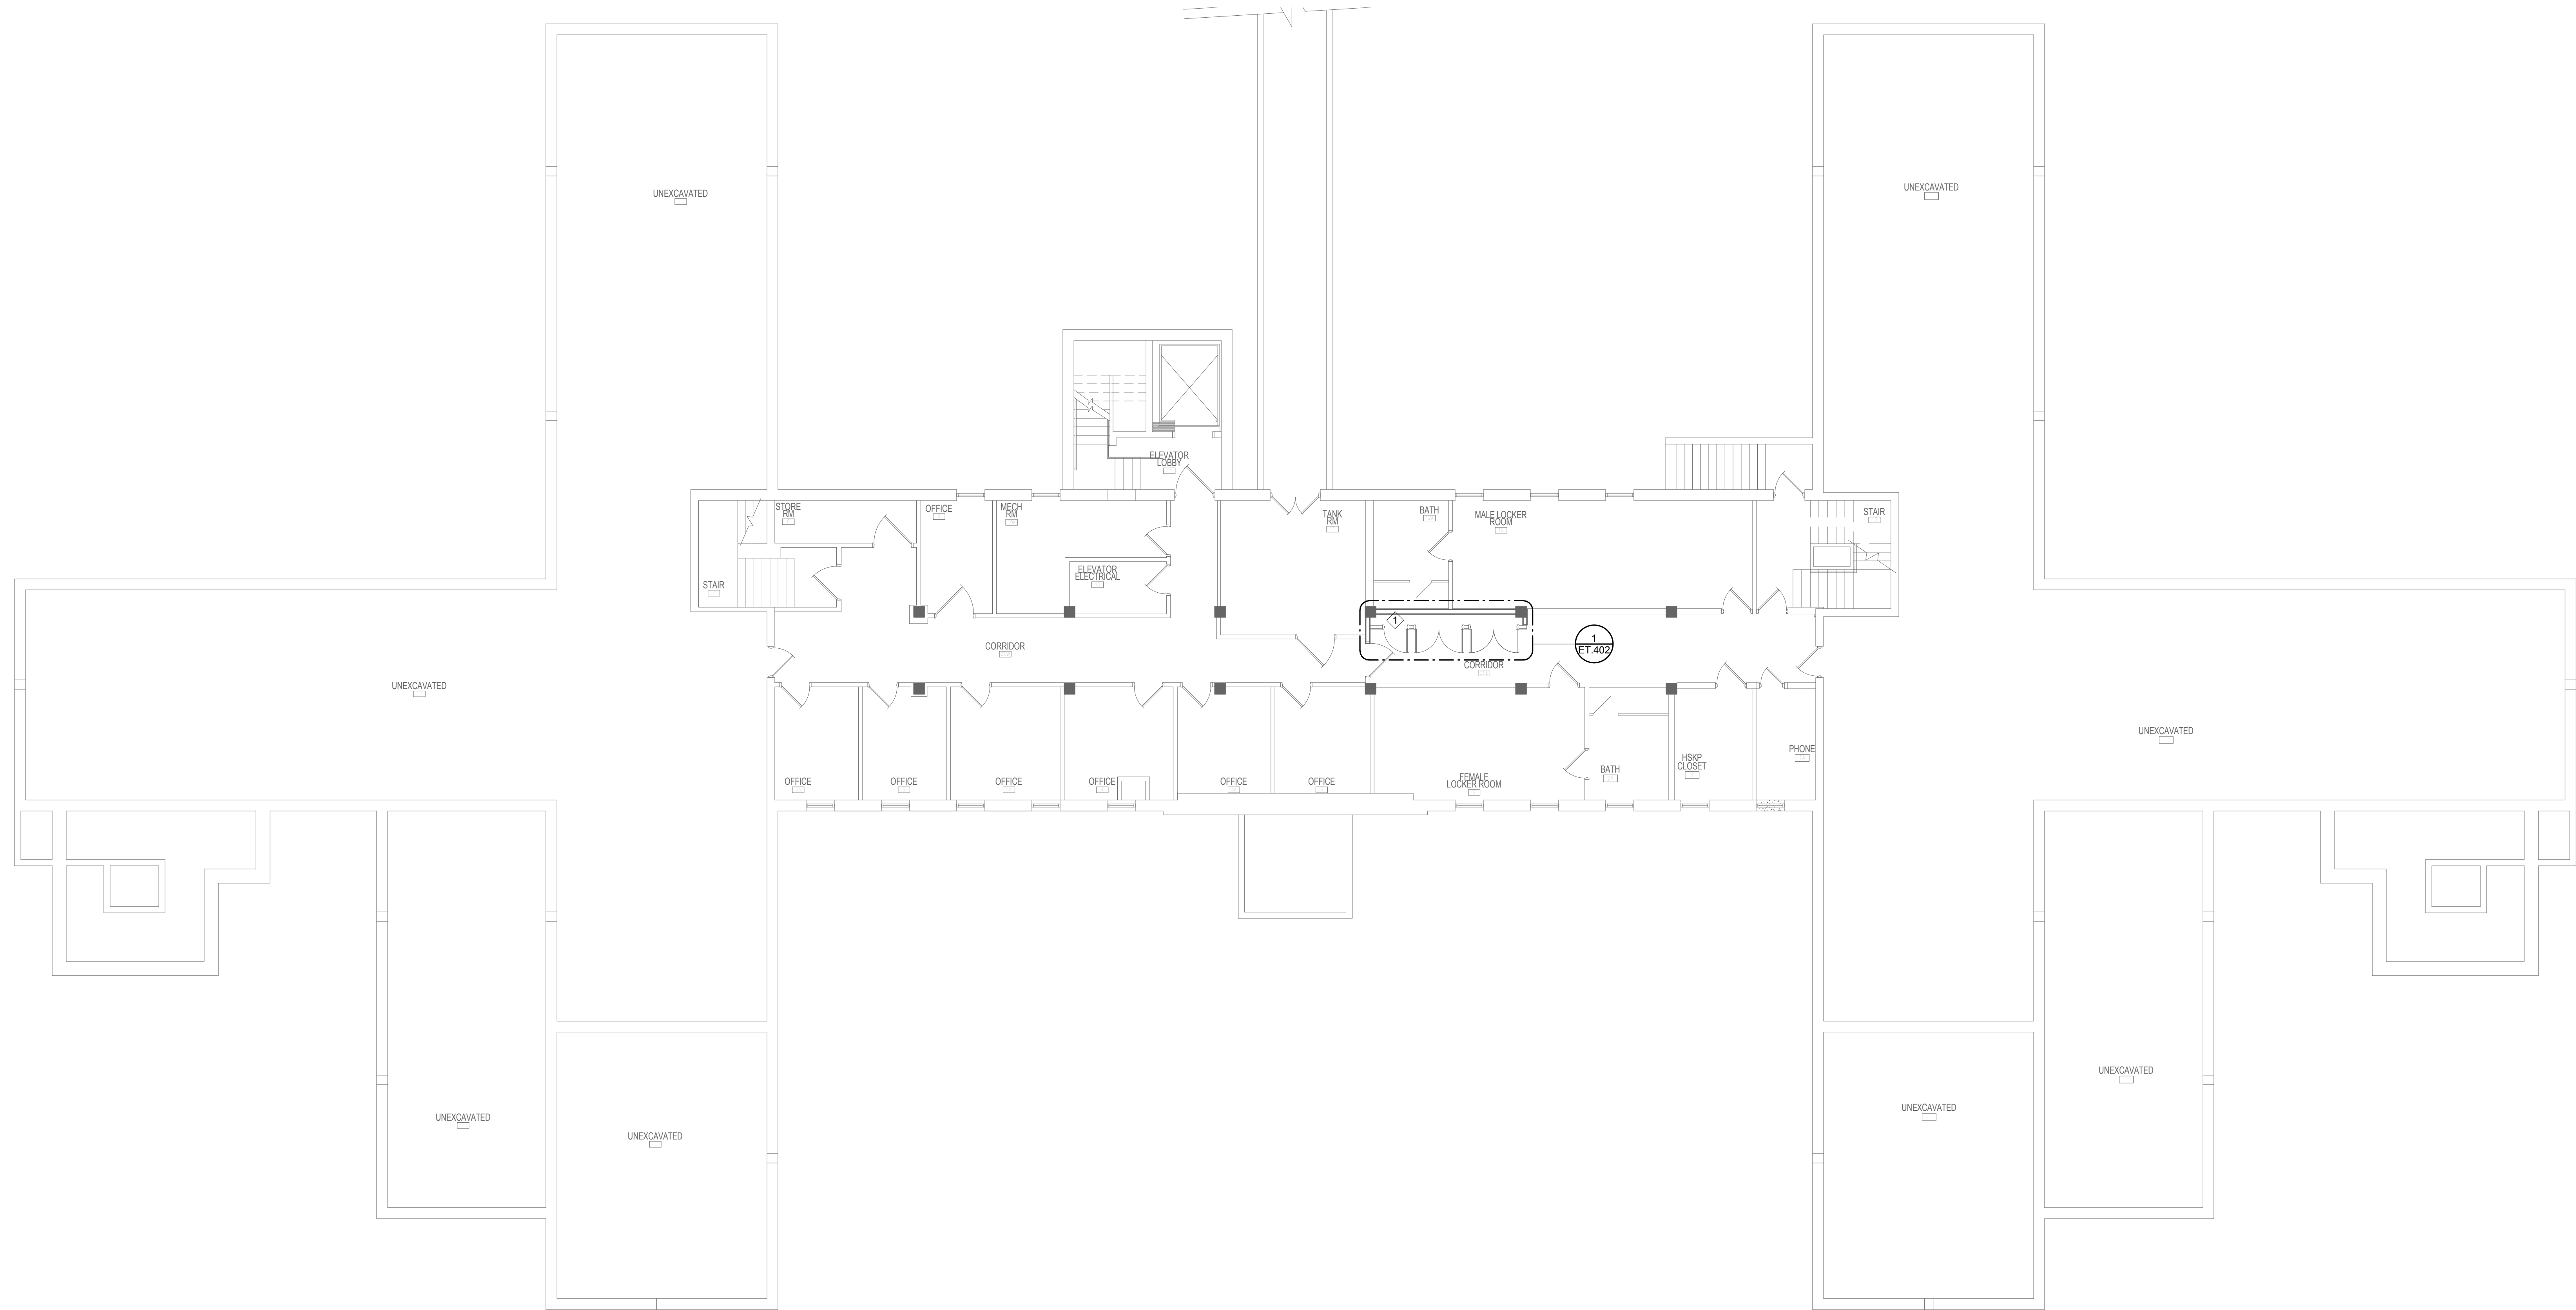

1 BUILDING 02 - PAGING SPEAKER FLOOR PLAN - BASEMENT
1/8" = 1'-0"

C:\Revit\Projects\VA ST CLOUD PAGING_Elec_R12.dwg.plt

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com
 AE PROJECT NUMBER: Project Number

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Piliod*
 Name: Chris M. Piliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE
BUILDING 02 - PAGING SPEAKER FLOOR PLAN - BASEMENT
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:
 APPROVED: CHIEF OF STAFF
 DATE:
 APPROVED: HEALTH CARE SYSTEM DIRECTOR
 DATE:


PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PLOT SCALE	
PROJECT NO.		DATE	
BUILDING No.	CHECKED BY	DRAWN	ISSUE DATE
	CP	CG	1/24/19
LOCATION	DATE	DRAWING NO.	
VA MEDICAL CENTER ST. CLOUD, MN 56303		ET02-00	



U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

GENERAL NOTES:

- A. PRIOR TO BID, CONTRACTOR SHALL VISIT SITE AND REVIEW SCOPE OF WORK.
- B. DEMOLITION, INSTALLATION AND TESTING SHALL BE DONE IN ACCORDANCE WITH SPECIFICATIONS.
- C. PROVIDE PUBLIC ADDRESS SYSTEM MUTING RELAYS AT EACH LOCAL SOUND SYSTEM.
- D. SPEAKERS TAGGED WITH "S" INDICATE SURFACE MOUNTED SPEAKERS. CONTRACTOR SHALL CONFIRM WALL/CEILING TYPES AND REQUIREMENTS FOR SURFACE MOUNT SPEAKERS PRIOR TO INSTALLATION.
- E. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.
- F. PROVIDE MINIMUM 3/4" BLUE EMT FOR PUBLIC ADDRESS SYSTEM SPEAKERS.

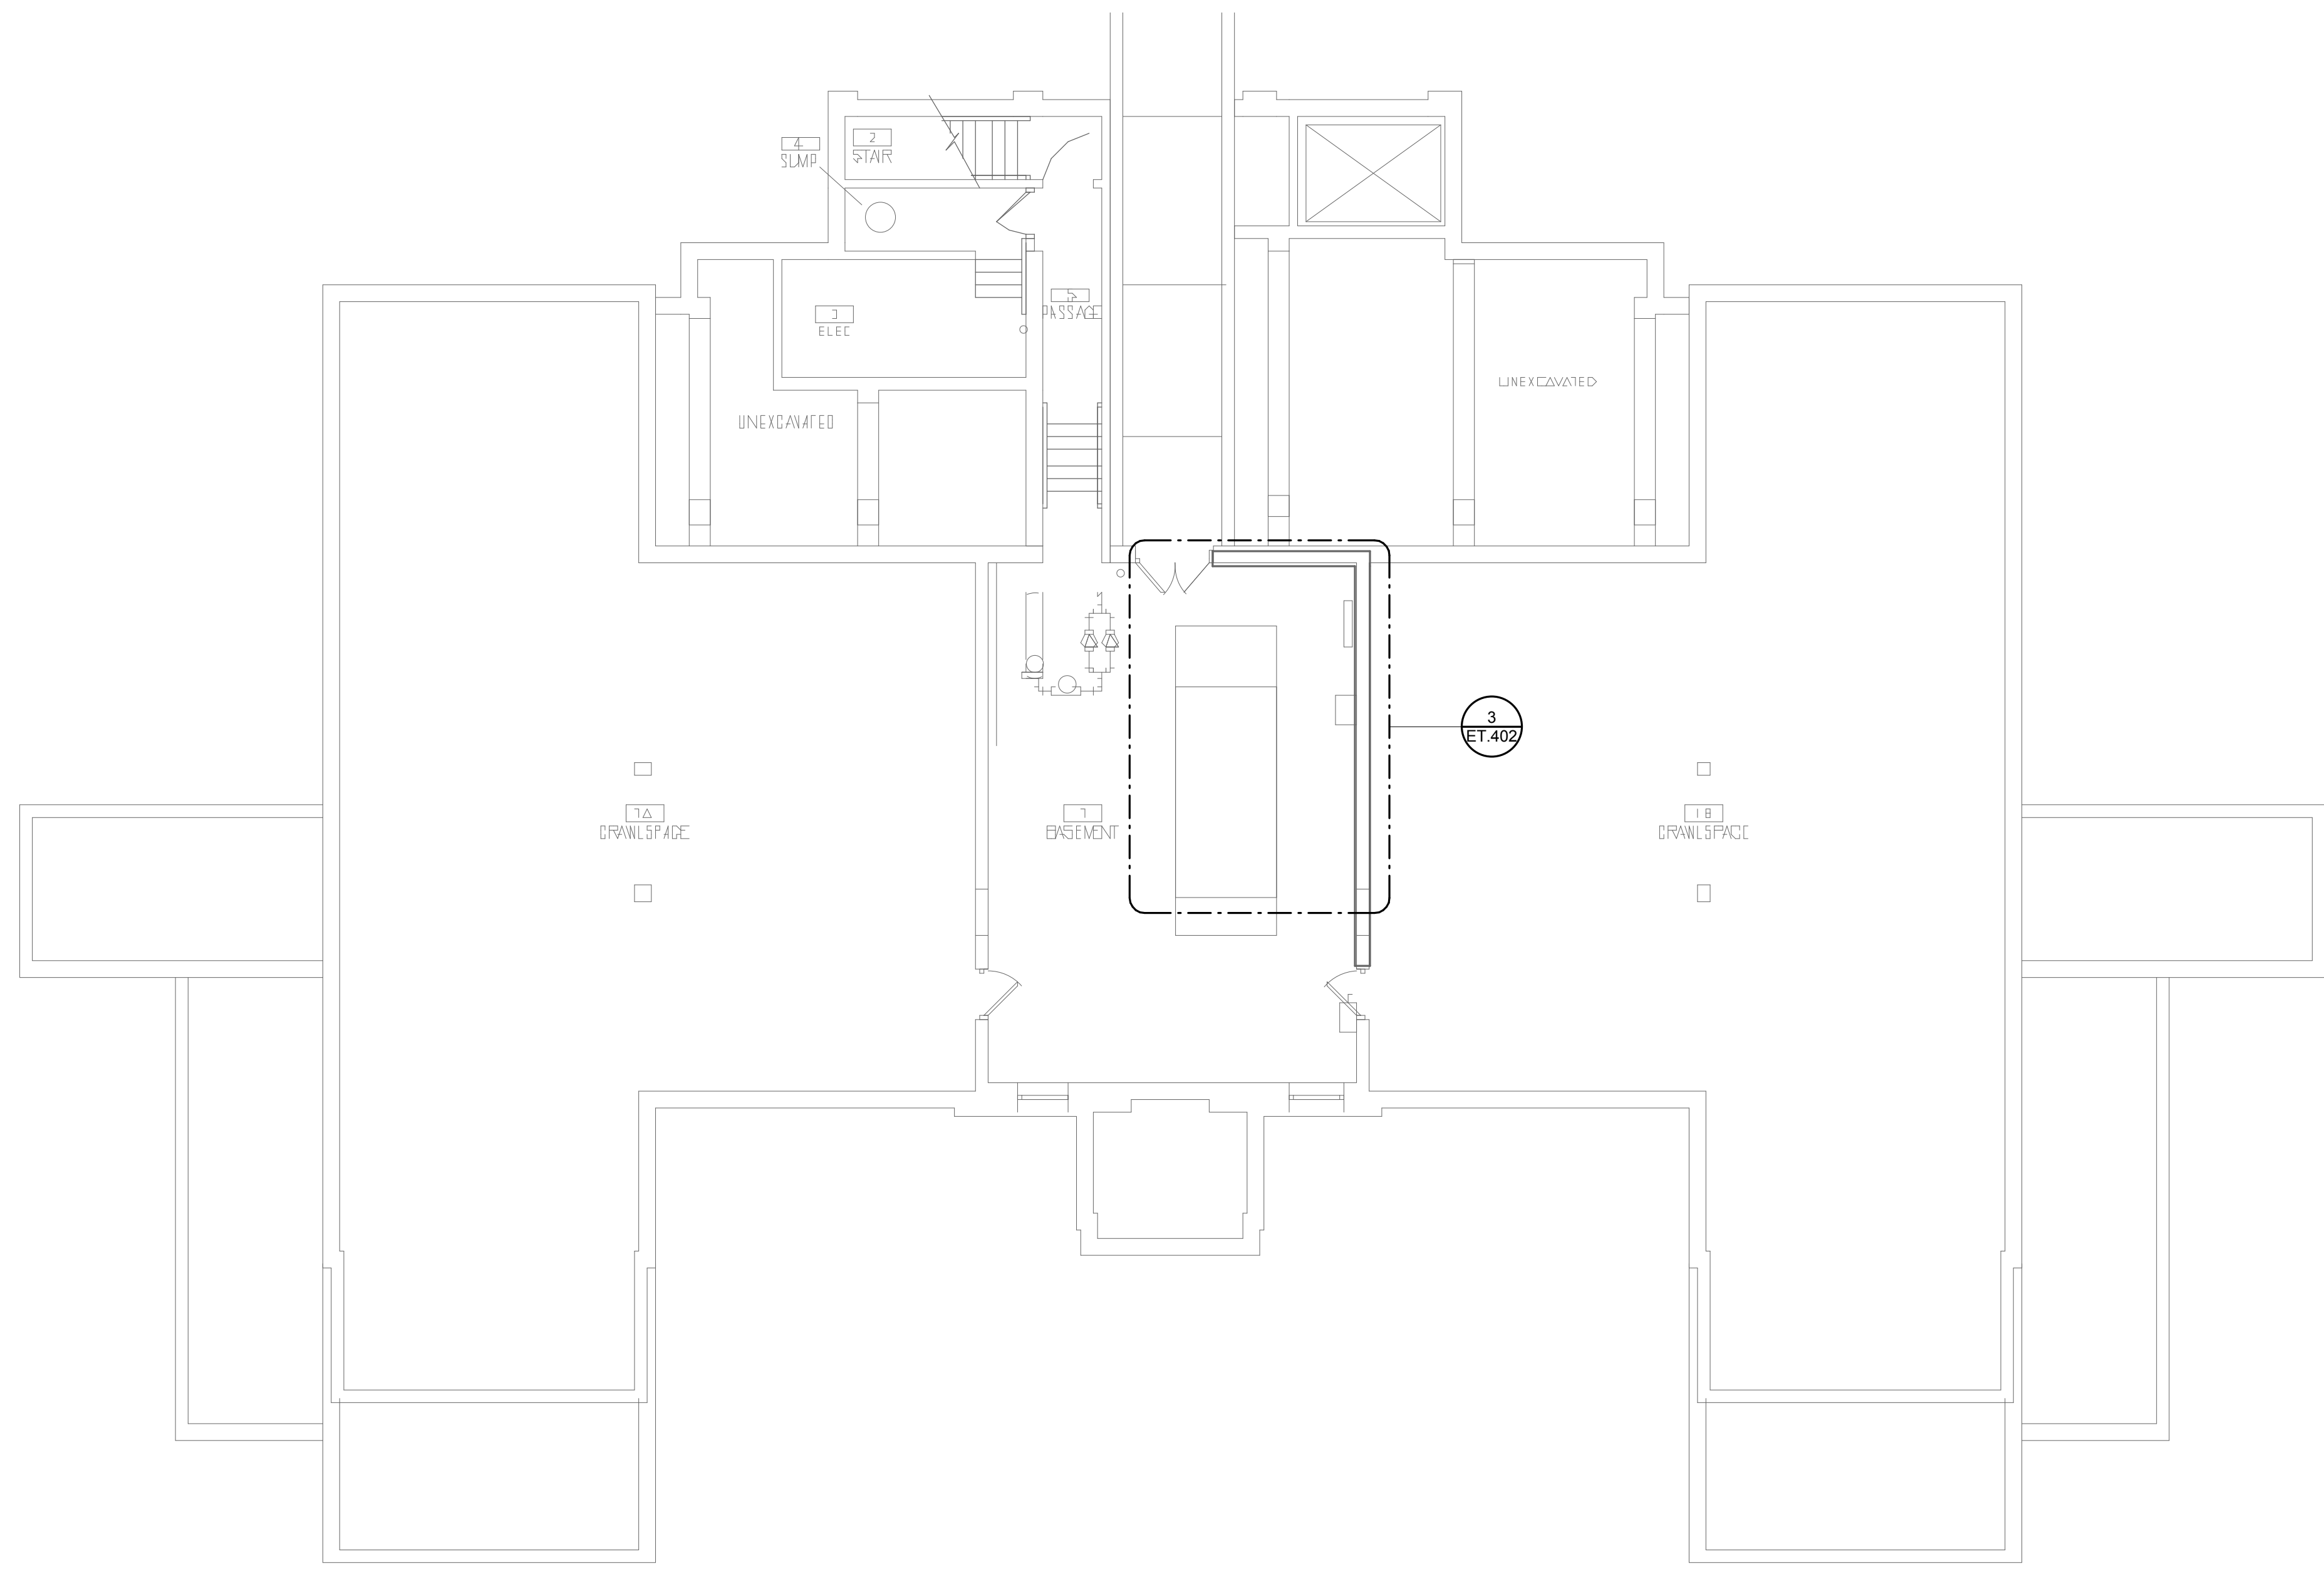

1 BUILDING 03 - PAGING SPEAKER FLOOR PLAN - BASEMENT
1/8" = 1'-0"

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)
DUNHAM
50 South Sixth Street / Suite 1100
Minneapolis, Minnesota 55402-1540
Phone: 612-465-7550 Fax: 612-465-7551
Web: dunhaminc.com
mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD
ANDERSON ENGINEERING
ENGINEERING • ARCHITECTURE • LAND SURVEYING
ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
Anderson Engineering of Minnesota, LLC
13605 1st Avenue North
Suite 100
Plymouth, MN 55441
763-412-4000 (o) 763-412-4090 (f)
www.ae-mn.com

STAMP
I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
Signature: *Chris M. Piliod*
Name: Chris M. Piliod, P.E.
Date: 1/24/19
Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE
BUILDING 03 - PAGING SPEAKER FLOOR PLAN - BASEMENT
APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
DATE:
APPROVED: CHIEF OF STAFF
DATE:
APPROVED: HEALTH CARE SYSTEM DIRECTOR
DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PROJECT NO.:	
BUILDING No.:	CHECKED BY:	DRAWN:	ISSUE DATE:
	CP	CG	1/24/19
LOCATION:	DATE:	DRAWING NO.:	
VA MEDICAL CENTER ST. CLOUD, MN 56303		ET03-00	


VA U.S. Department of Veterans Affairs
Veterans Health Administration
St. Cloud VA Health Care System

GENERAL NOTES:

- A. PRIOR TO BID, CONTRACTOR SHALL VISIT SITE AND REVIEW SCOPE OF WORK.
- B. DEMOLITION, INSTALLATION AND TESTING SHALL BE DONE IN ACCORDANCE WITH SPECIFICATIONS.
- C. PROVIDE PUBLIC ADDRESS SYSTEM MUTING RELAYS AT EACH LOCAL SOUND SYSTEM.
- D. SPEAKERS TAGGED WITH "S" INDICATE SURFACE MOUNTED SPEAKERS. CONTRACTOR SHALL CONFIRM WALL/CEILING TYPES AND REQUIREMENTS FOR SURFACE MOUNT SPEAKERS PRIOR TO INSTALLATION.
- E. PROVIDE SURFACE MOUNT SPEAKERS AS SHOWN ON PLAN. WIRING ABOVE GYP-BOARD FINISHED CEILING SHALL FOLLOW EXISTING PATHWAYS. UTILIZE EXISTING ACCESS PANELS. DO NOT CUT IN NEW ACCESS PANELS.
- F. PROVIDE FINISHED COVERPLATE OVER EXISTING SPEAKER HOLES. PAINT COVERPLATE TO MATCH EXISTING ADJACENT FINISHED SPACE.
- G. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.

KEY NOTES:

- ◇ PROVIDE PA CIRCUIT FROM BUILDING 3.

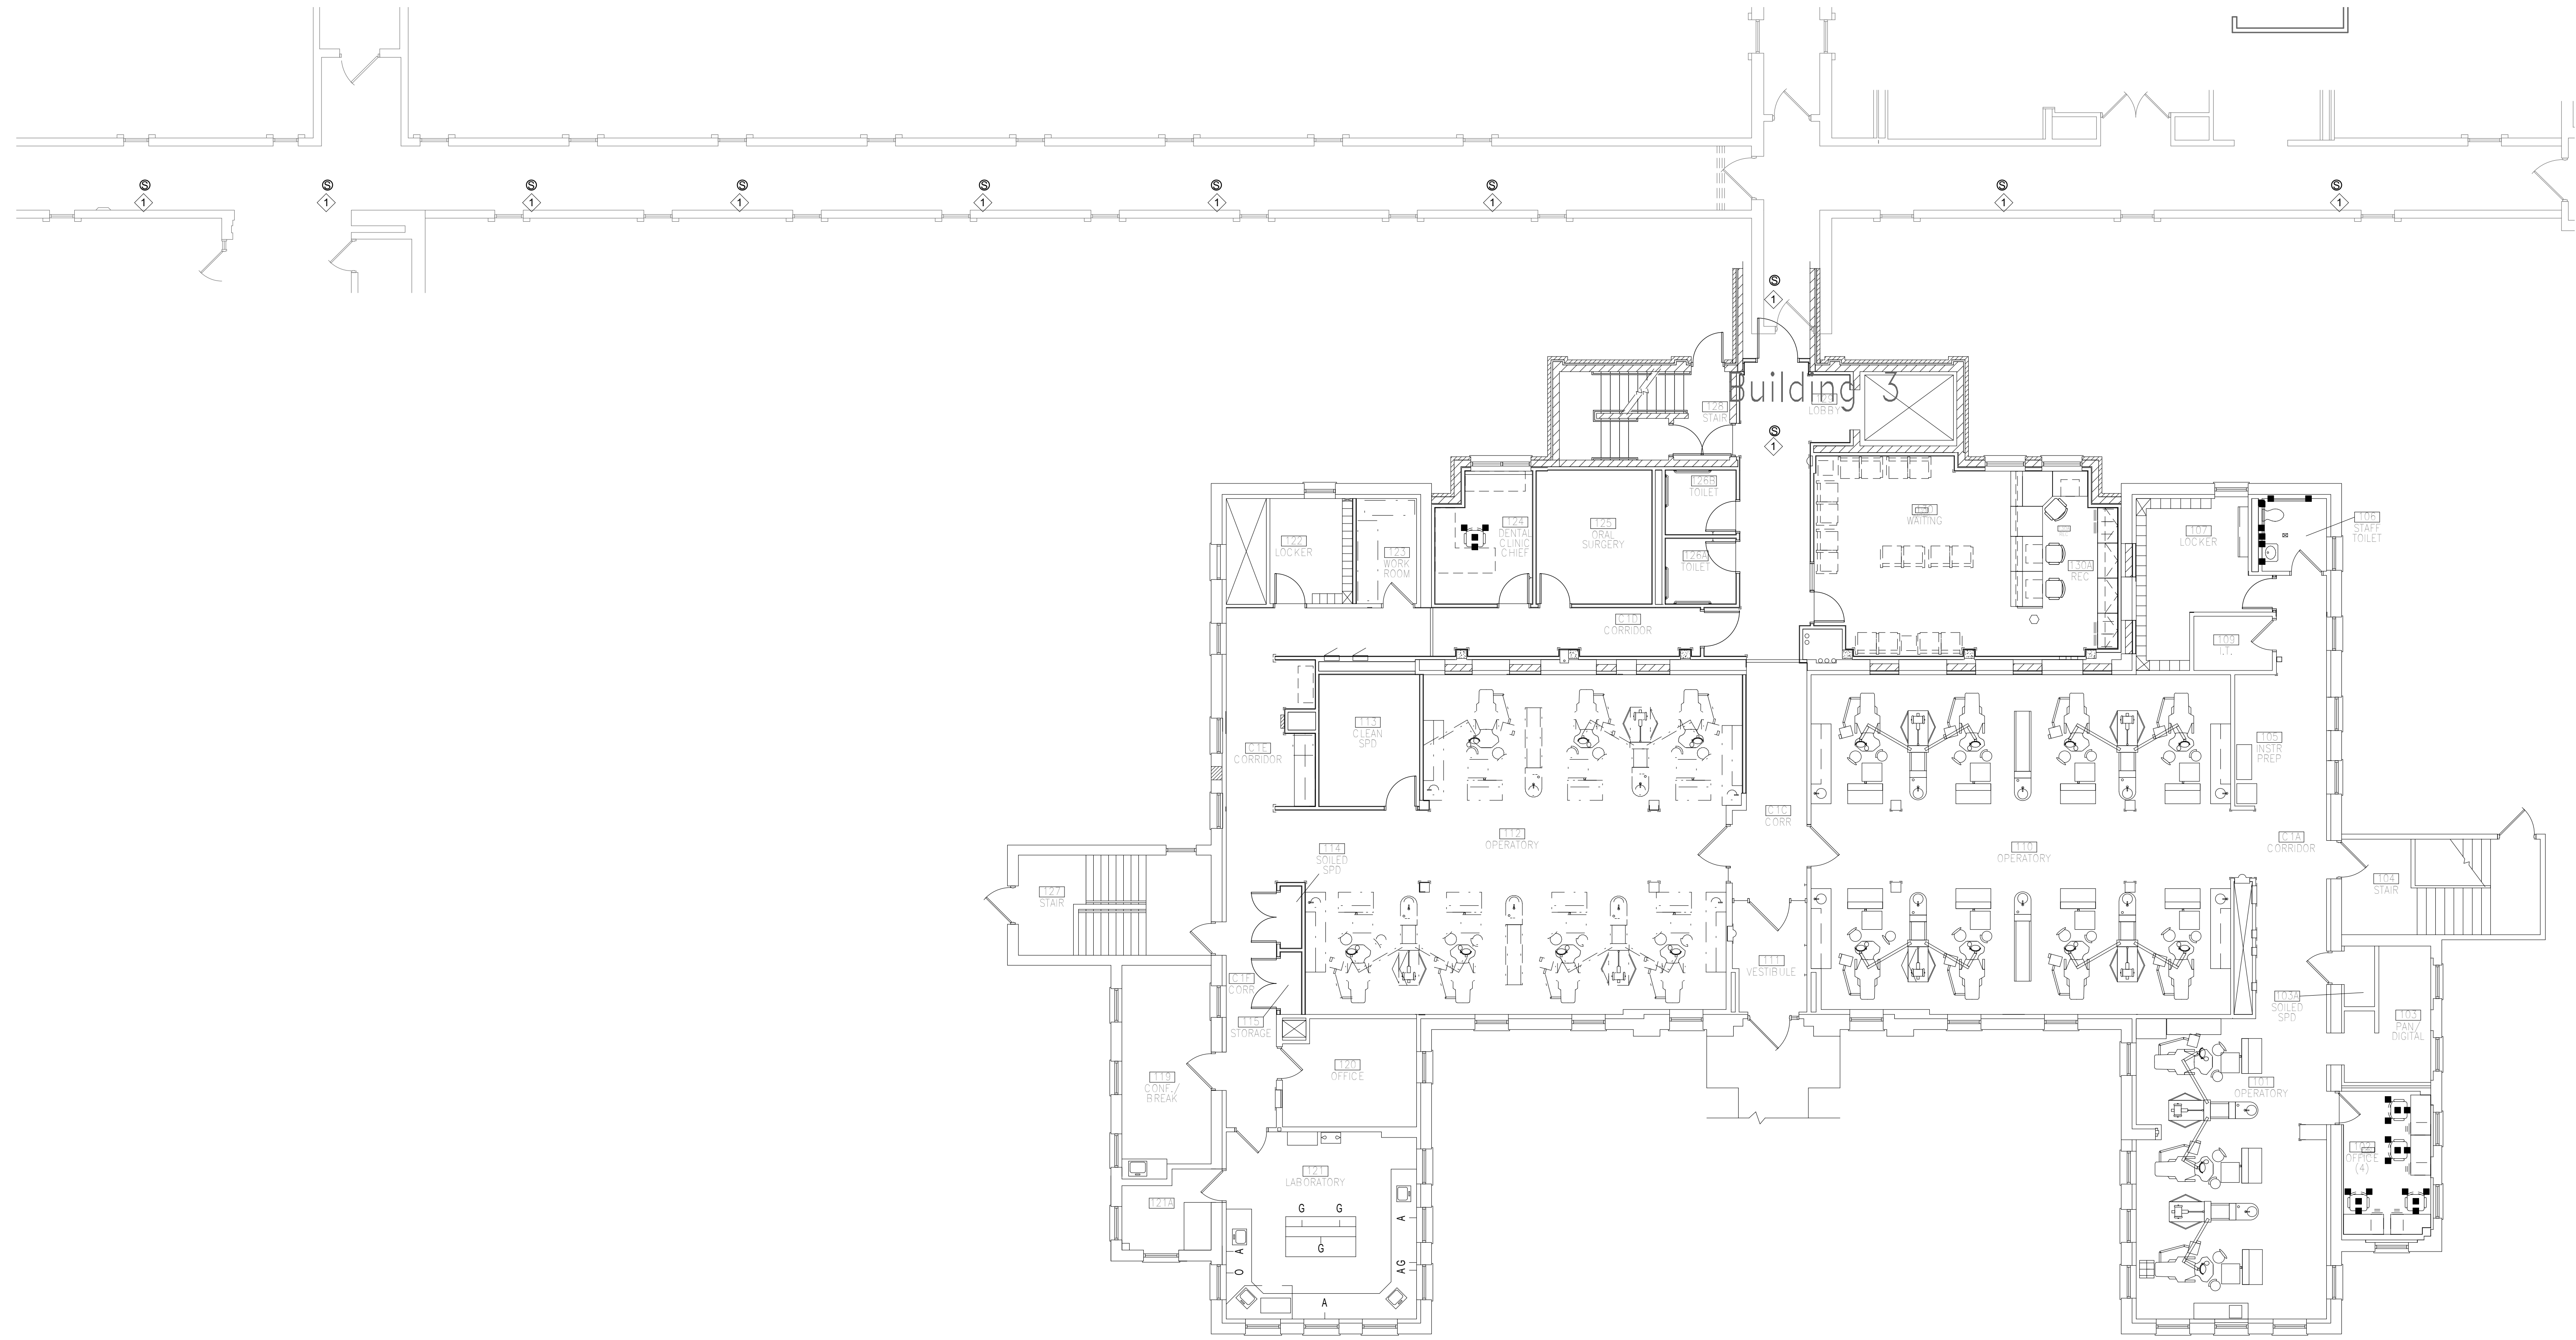

1 BUILDING 03 - PAGING SPEAKER FLOOR PLAN - FIRST FLOOR
NO SCALE

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

 DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.


 Name: Chris M. Piliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE	APPROVED: INFECTION CONTROL NURSE	DATE
APPROVED: GEMS COORDINATOR	DATE	APPROVED: PATIENT SAFETY	DATE
APPROVED: PROJECTS SECTION MANAGER	DATE	APPROVED: CHIEF OF POLICE	DATE
APPROVED: DIRECTOR FMS	DATE	APPROVED: SAFETY MANAGER	DATE

DRAWING TITLE
BUILDING 03 - PAGING SPEAKER FLOOR PLAN - FIRST FLOOR
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE
 APPROVED: CHIEF OF STAFF
 DATE
 APPROVED: HEALTH CARE SYSTEM DIRECTOR
 DATE

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PLOT SCALE	
PROJECT NO.		ISSUE DATE	
BUILDING No.	CHECKED BY	DRAWN	DATE
	Author		
LOCATION	DATE	DRAWING NO.	
VA MEDICAL CENTER ST. CLOUD, MN 56303		ET03-01	

VA
U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

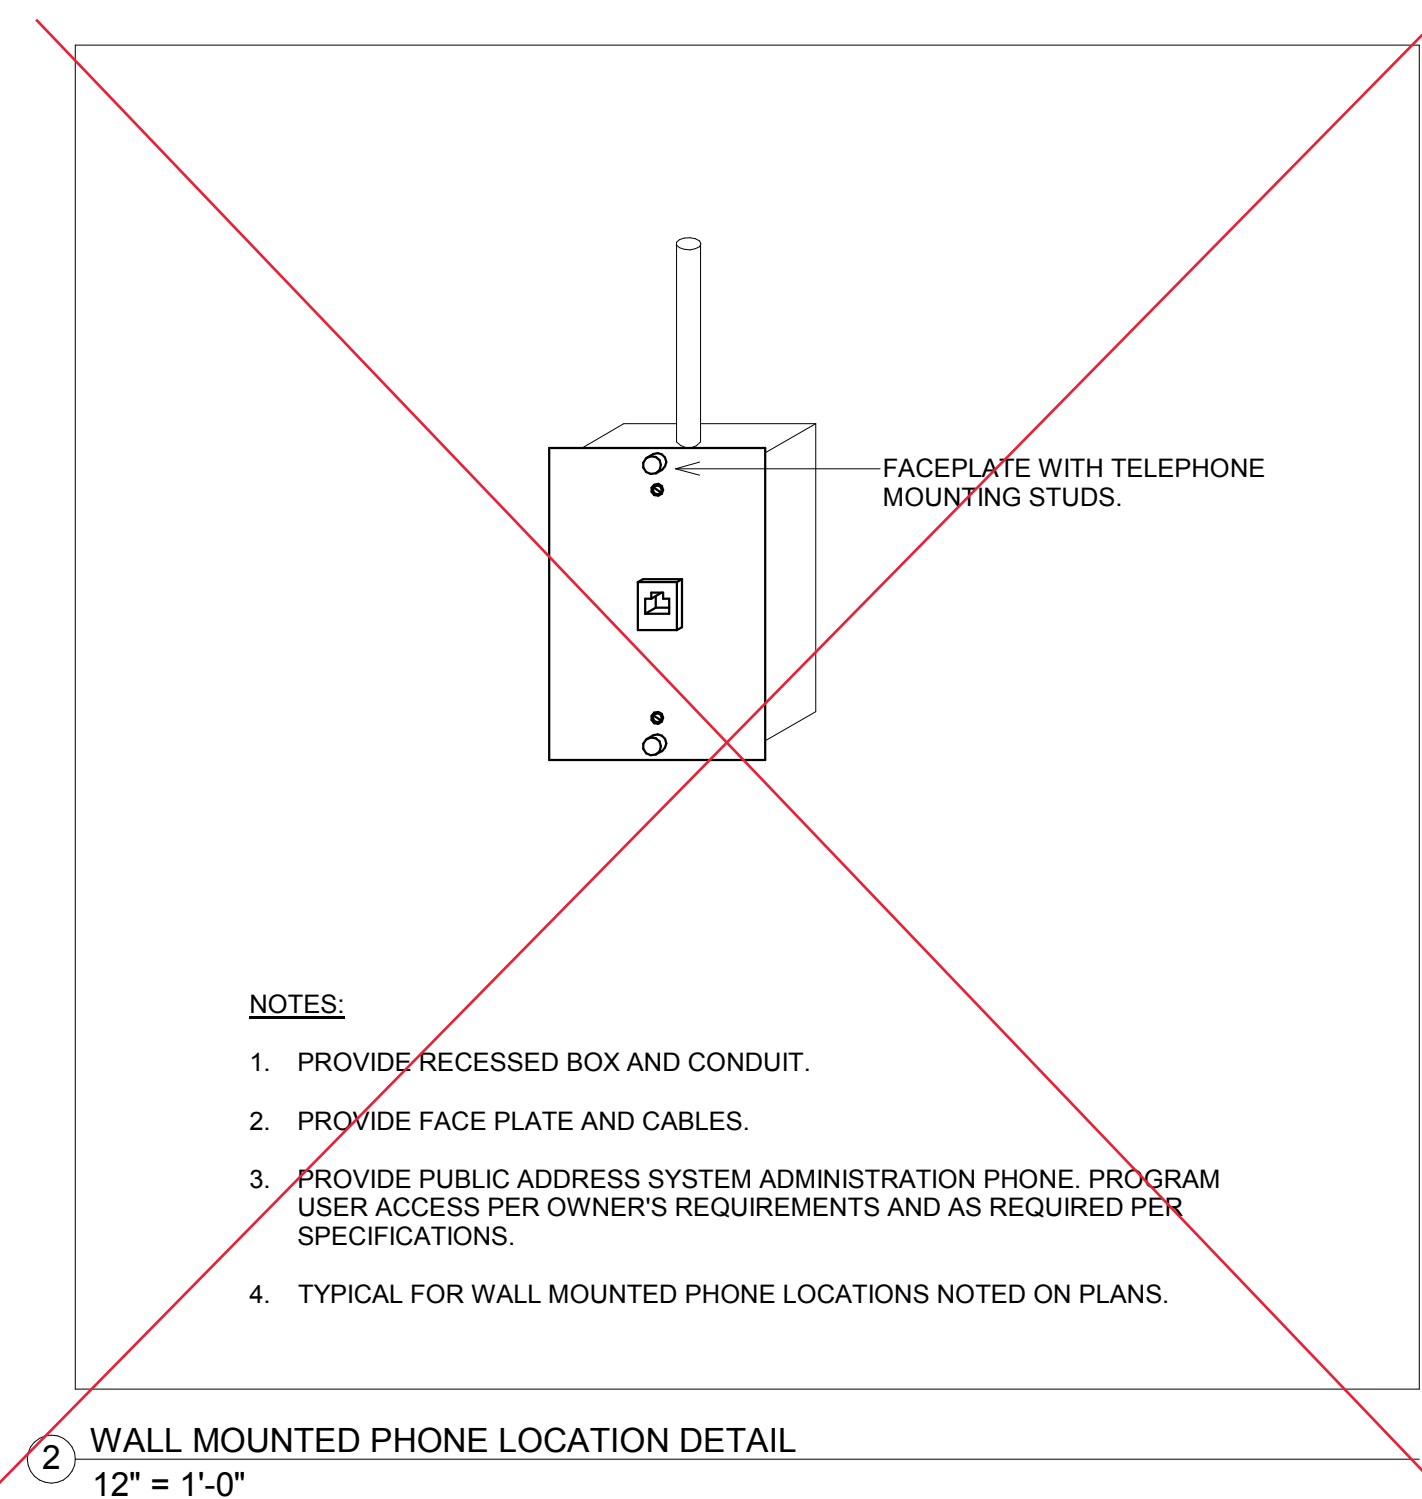


GENERAL NOTES:

- A. PRIOR TO BID, CONTRACTOR SHALL VISIT SITE AND REVIEW SCOPE OF WORK.
- B. DEMOLITION, INSTALLATION AND TESTING SHALL BE DONE IN ACCORDANCE WITH SPECIFICATIONS.
- C. PROVIDE PUBLIC ADDRESS SYSTEM MUTING RELAYS AT EACH LOCAL SOUND SYSTEM.
- D. SPEAKERS TAGGED WITH "S" INDICATE SURFACE MOUNTED SPEAKERS. CONTRACTOR SHALL CONFIRM WALL/CEILING TYPES AND REQUIREMENTS FOR SURFACE MOUNT SPEAKERS PRIOR TO INSTALLATION.
- E. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.
- F. PROVIDE MINIMUM 3/4" BLUE EMT FOR PUBLIC ADDRESS SYSTEM SPEAKERS.

KEY NOTES:

◇ PROVIDE PUBLIC ADDRESS SYSTEM ADMINISTRATION PHONE. PROVIDE INTERFACE TO HEADEND EQUIPMENT. VERIFY LOCATION WITH OWNER PRIOR TO INSTALLATION. MOUNT 45" AFF. INSTALL OUTLET RECESSED WITHIN MASONRY WALL.

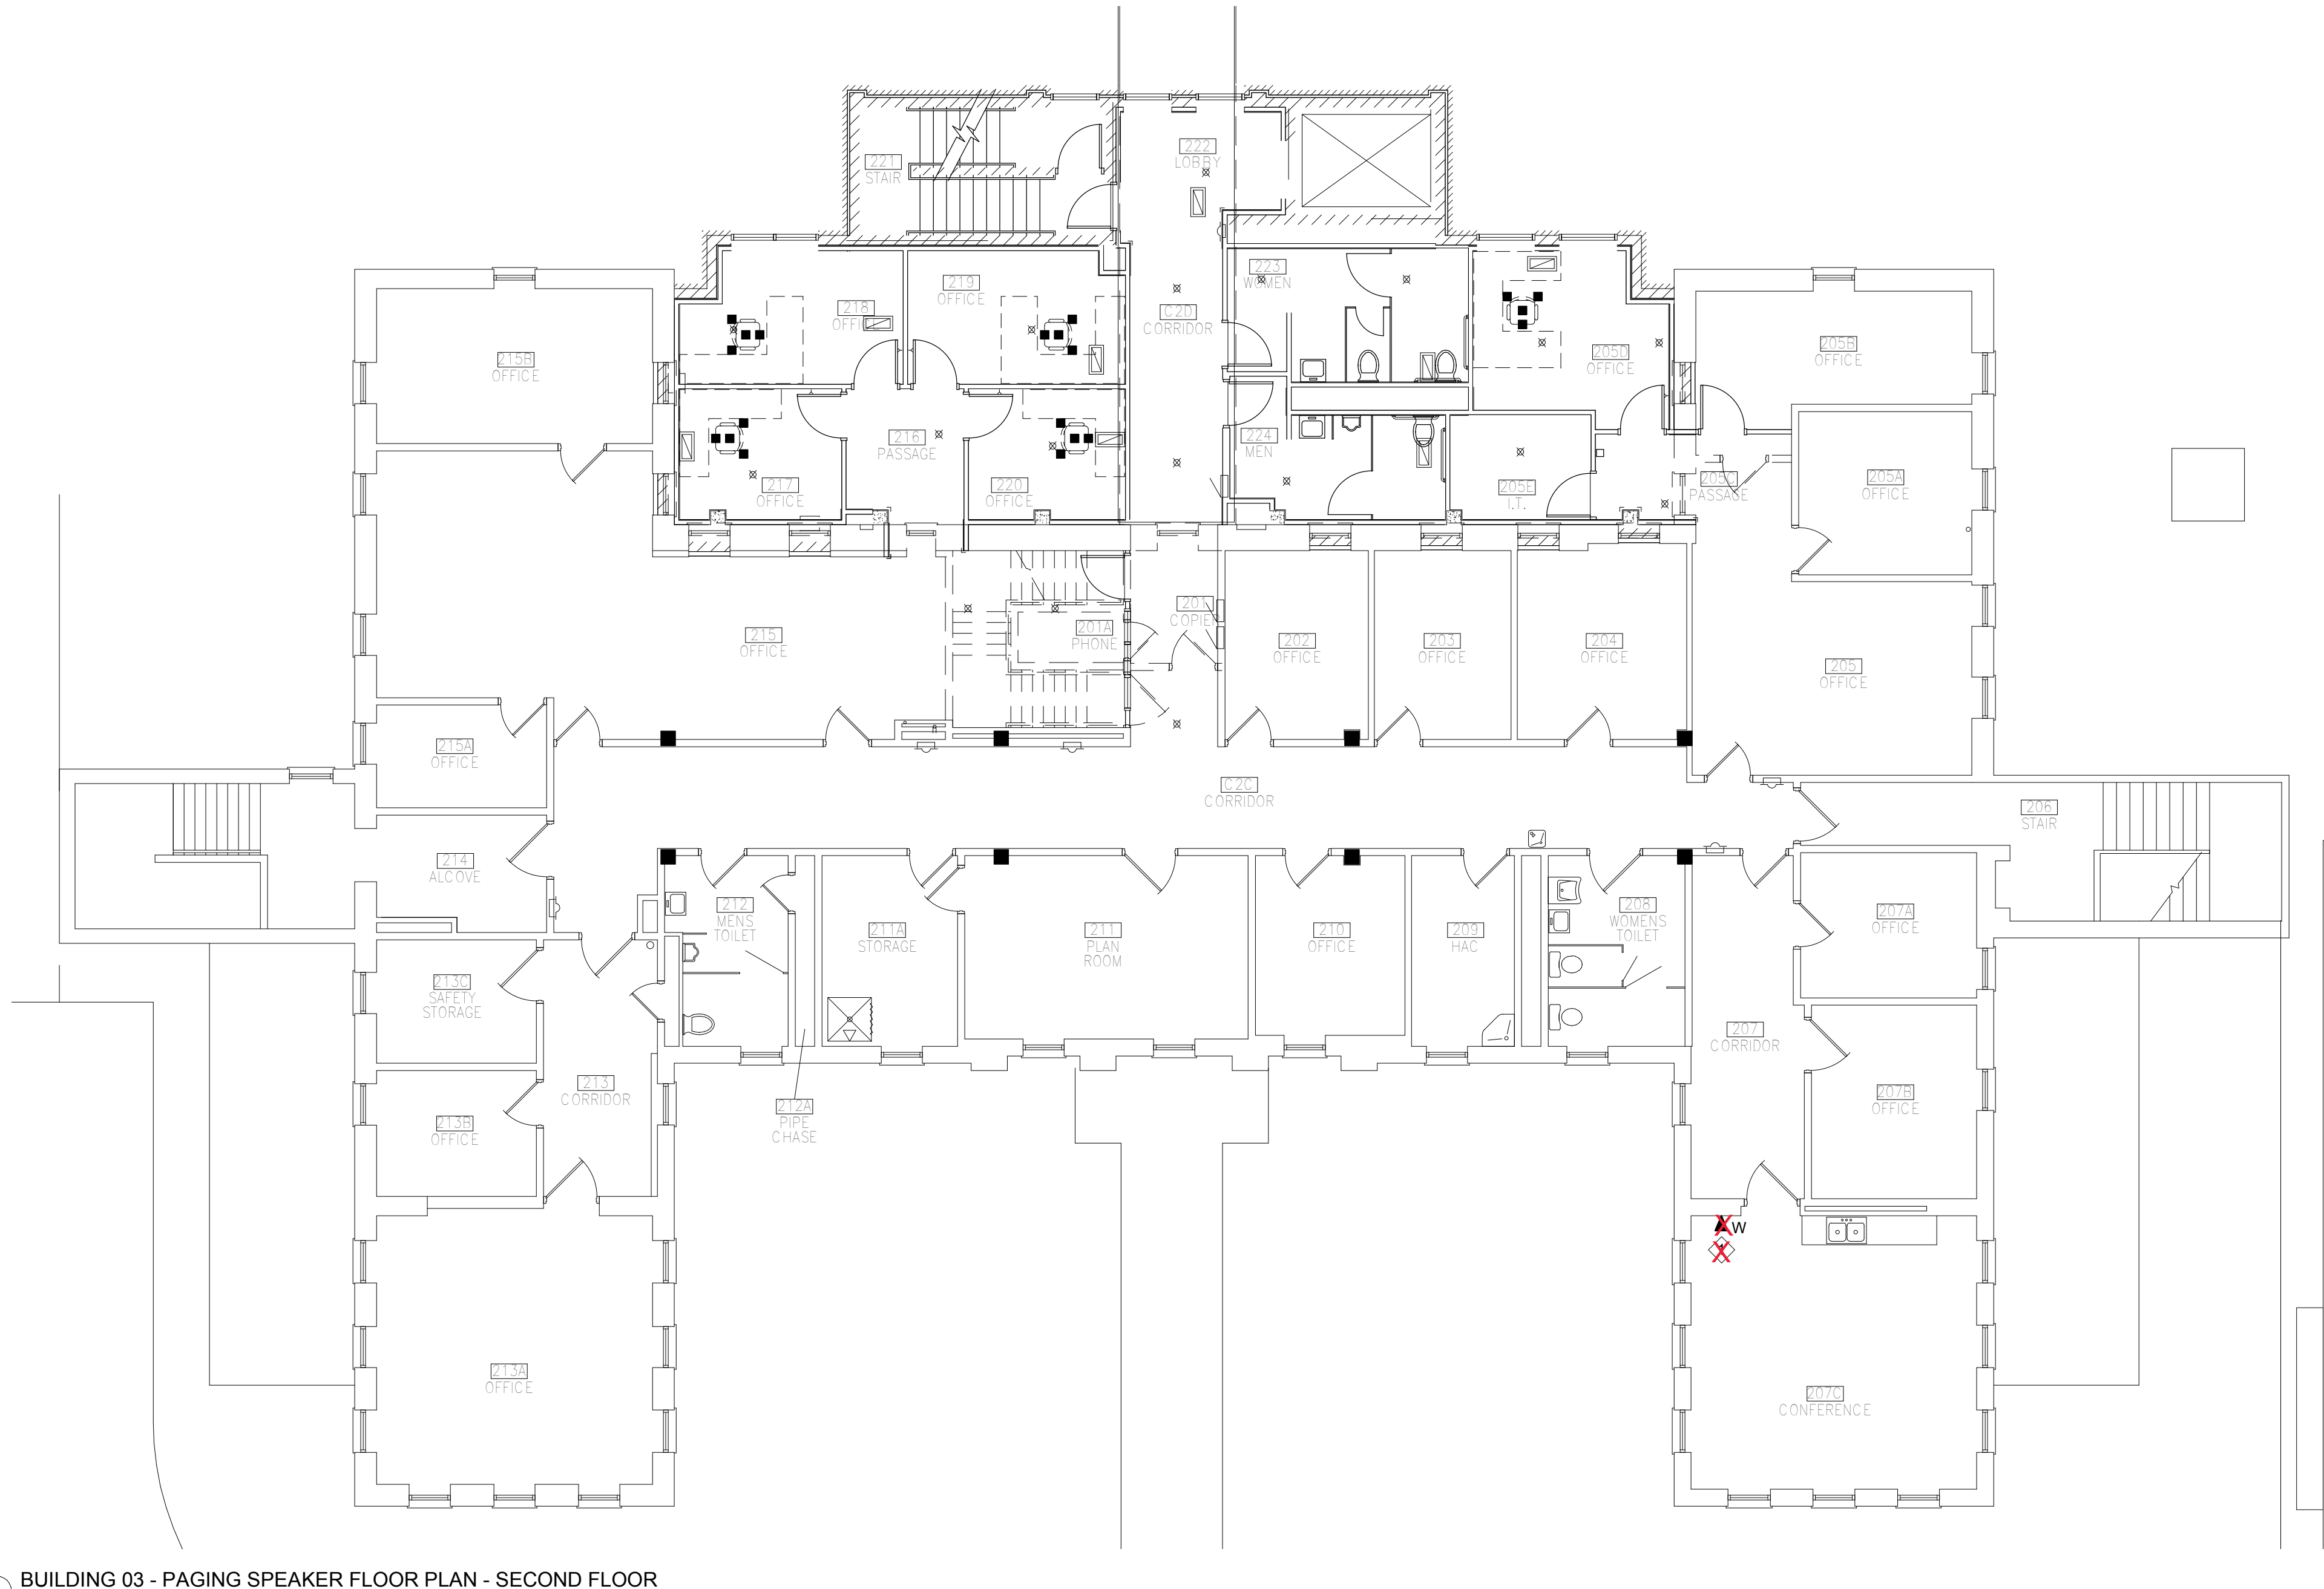

1/24/2019 11:29:58 PM
C:\Revit\Projects\VA ST CLOUD PAGING_Elec_R112.dwg.rvt

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)
DUNHAM
50 South Sixth Street / Suite 1100
Minneapolis, Minnesota 55402-1540
Phone: 612-465-7550 Fax: 612-465-7551
www.dunhaminc.com
mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD
ANDERSON ENGINEERING
ENGINEERING • ARCHITECTURE • LAND SURVEYING
ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
Anderson Engineering of Minnesota, LLC
13605 1st Avenue North
Suite 100
Plymouth, MN 55441
763-412-4000 (o) 763-412-4090 (f)
www.ae-mn.com

STAMP
I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
Signature: *Chris M. Piliod*
Name: Chris M. Piliod, P.E.
Date: 1/24/19
Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE
BUILDING 03 - PAGING SPEAKER FLOOR PLAN - SECOND FLOOR
APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
DATE:
APPROVED: CHIEF OF STAFF
DATE:
APPROVED: HEALTH CARE SYSTEM DIRECTOR
DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PLOT SCALE	
PROJECT NO.		ISSUE DATE	
BUILDING No.	CHECKED BY	DRAWN	DATE
	Checker	Author	1/24/19
LOCATION	DATE	DRAWING NO.	
VA MEDICAL CENTER ST. CLOUD, MN 56303		ET03-02	


VA U.S. Department of Veterans Affairs
Veterans Health Administration
St. Cloud VA Health Care System

GENERAL NOTES:

- A. PRIOR TO BID, CONTRACTOR SHALL VISIT SITE AND REVIEW SCOPE OF WORK.
- B. DEMOLITION, INSTALLATION AND TESTING SHALL BE DONE IN ACCORDANCE WITH SPECIFICATIONS.
- C. PROVIDE PUBLIC ADDRESS SYSTEM MUTING RELAYS AT EACH LOCAL SOUND SYSTEM.
- D. SPEAKERS TAGGED WITH "S" INDICATE SURFACE MOUNTED SPEAKERS. CONTRACTOR SHALL CONFIRM WALL/CEILING TYPES AND REQUIREMENTS FOR SURFACE MOUNT SPEAKERS PRIOR TO INSTALLATION.
- E. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.
- F. PROVIDE MINIMUM 3/4" BLUE EMT FOR PUBLIC ADDRESS SYSTEM SPEAKERS.

KEY NOTES:

- 1. PROVIDE PUBLIC ADDRESS SYSTEM MICROPHONE. PROVIDE INTERFACE TO HEADEND EQUIPMENT LOCATED WITHIN ROOM. VERIFY LOCATION WITH OWNER PRIOR TO INSTALLATION. PA SYSTEM HEAD END IN BUILDING 4 DATA CENTER
- 2. EXTEND 12-STRAND OM1 FIBER AND PUBLIC ADDRESS (PA) SYSTEM CIRCUITS FROM PHONE ROOM 1 TO DEMARK ROOM 044. SPLICE PA CIRCUITS WITHIN PA BOX AND ROUTE IN EXISTING CABLE TRAY TO DEMARK ROOM 044. PROVIDE ORANGE 3/4" C TO EXTEND FIBER TO DEMARK ROOM 044. CABLING SHALL ROUTE IN TUNNEL. PA SYSTEM HEAD END IN BUILDING 4 DATA CENTER

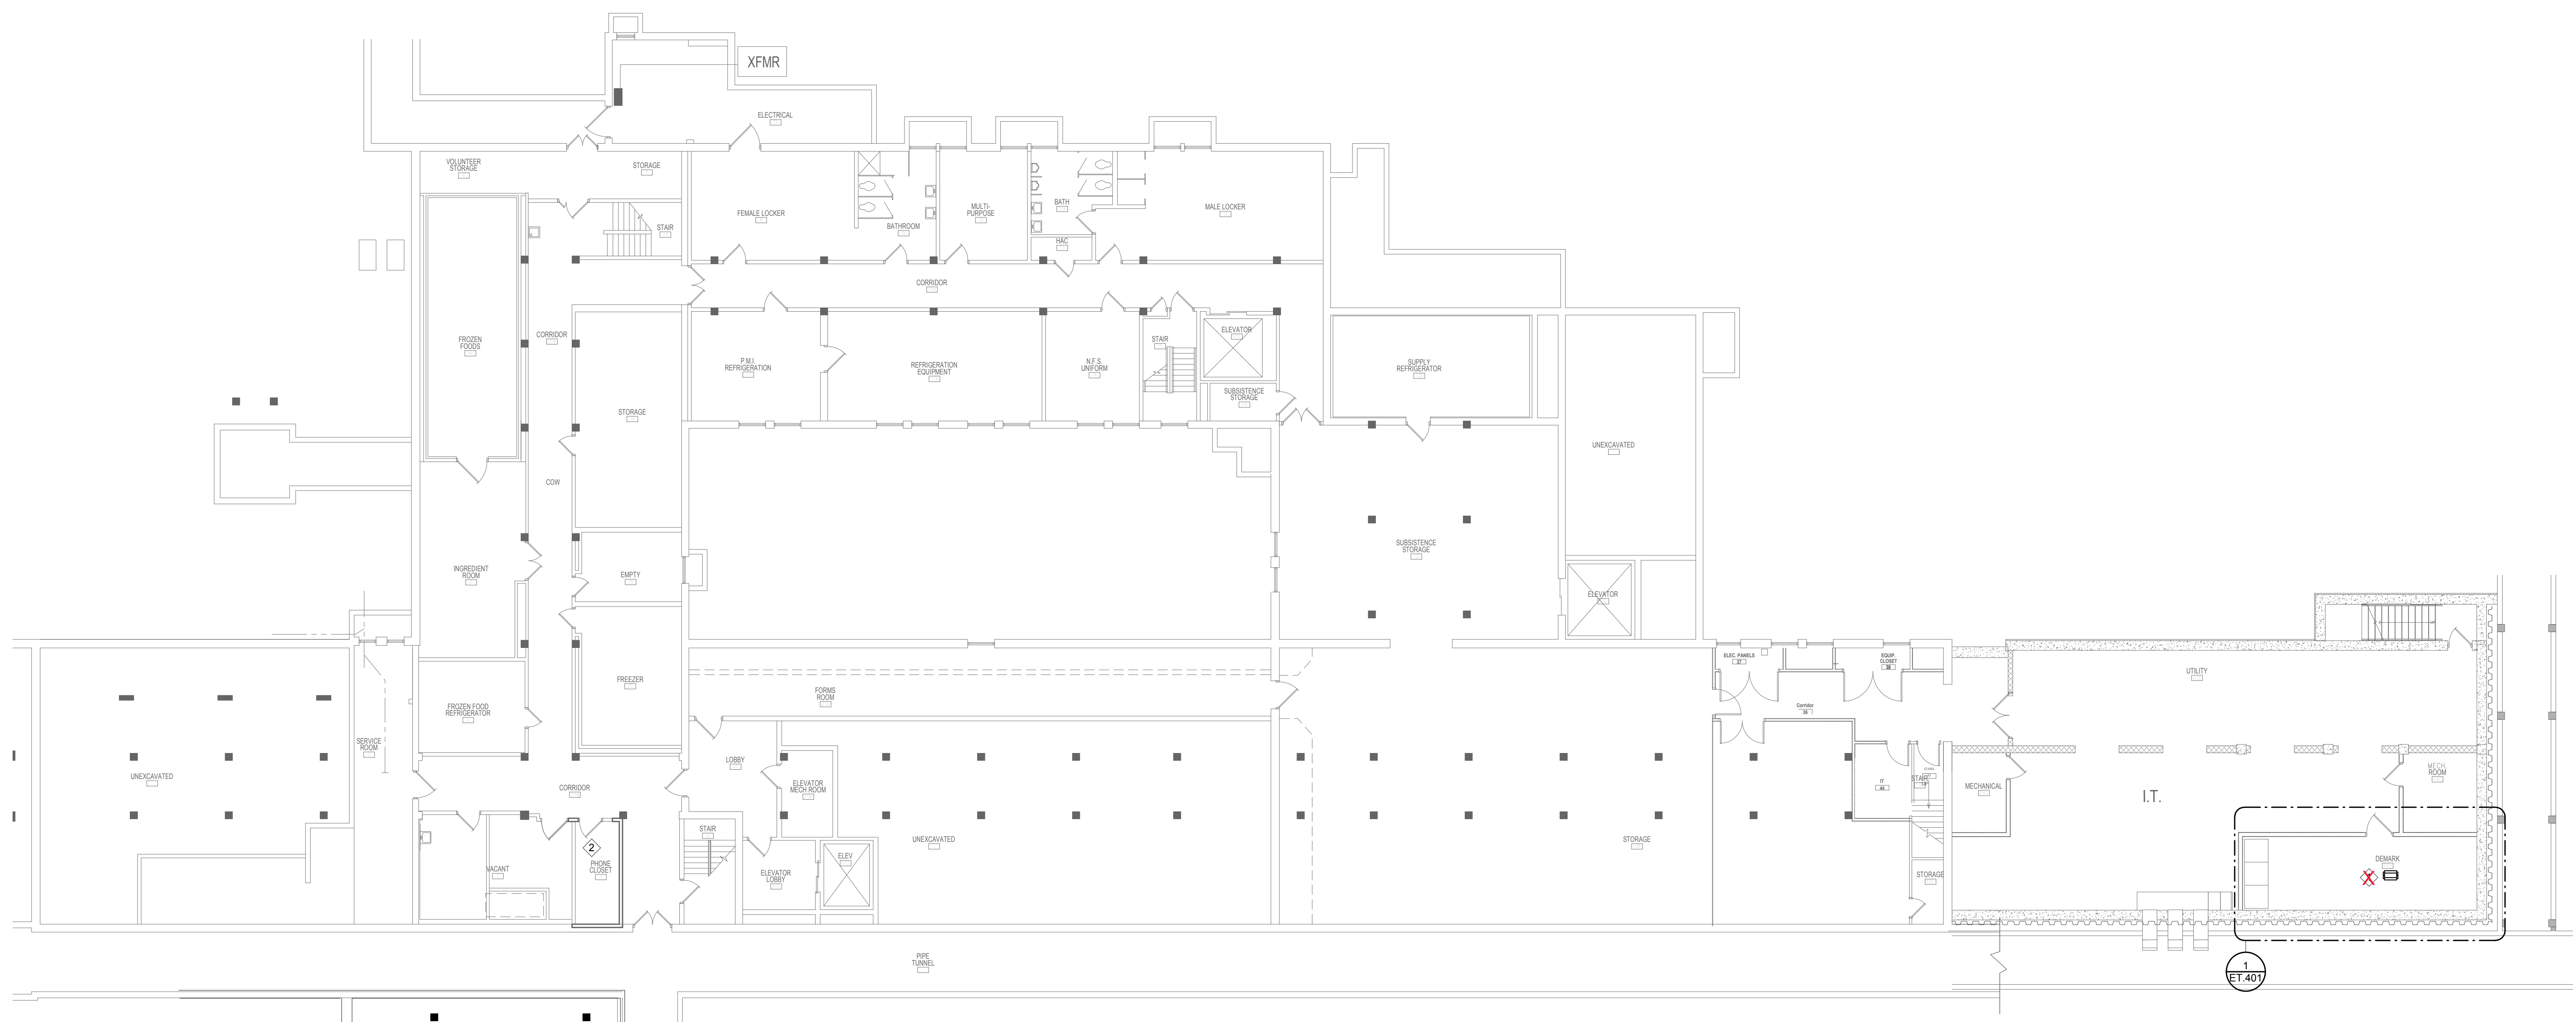

1 BUILDING 04 - PAGING SPEAKER FLOOR PLAN - BASEMENT
3/32" = 1'-0"

C:\Revit\Projects\VA ST CLOUD PAGING_Bldg_R12.dwg.rvt

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)
DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD
ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE
BUILDING 04 - PAGING SPEAKER FLOOR PLAN - BASEMENT
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:
 APPROVED: CHIEF OF STAFF
 DATE:
 APPROVED: HEALTH CARE SYSTEM DIRECTOR
 DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PLOT SCALE	
PROJECT NO.		ISSUE DATE	
BUILDING No.	CHECKED BY	CP	CG
DATE	DATE	DATE	DATE
LOCATION VA MEDICAL CENTER ST. CLOUD, MN 56303		DRAWING NO. ET04-00	

VA U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

GENERAL NOTES:

- A. PRIOR TO BID, CONTRACTOR SHALL VISIT SITE AND REVIEW SCOPE OF WORK.
- B. DEMOLITION, INSTALLATION AND TESTING SHALL BE DONE IN ACCORDANCE WITH SPECIFICATIONS.
- C. PROVIDE PUBLIC ADDRESS SYSTEM MUTING RELAYS AT EACH LOCAL SOUND SYSTEM.
- D. SPEAKERS TAGGED WITH "S" INDICATE SURFACE MOUNTED SPEAKERS. CONTRACTOR SHALL CONFIRM WALL/CEILING TYPES AND REQUIREMENTS FOR SURFACE MOUNT SPEAKERS PRIOR TO INSTALLATION.
- E. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.
- F. PROVIDE MINIMUM 3/4" BLUE EMT FOR PUBLIC ADDRESS SYSTEM SPEAKERS.

KEY NOTES:

- ◆ PROVIDE PUBLIC ADDRESS SYSTEM ADMINISTRATION TELEPHONE. PROVIDE INTERFACE TO HEARING EQUIPMENT LOCATED ON FIRST FLOOR. VERIFY LOCATION WITH OWNER PRIOR TO INSTALLATION.



1 BUILDING 04 - PAGING SPEAKER FLOOR PLAN - SECOND FLOOR
3/32" = 1'-0"

1/24/2019 11:21:00 PM
C:\Revit\Projects\VA ST CLOUD PAGING_Elec_R12.dwg.rvt

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:


DRAWING TITLE
BUILDING 04 - PAGING SPEAKER FLOOR PLAN - SECOND FLOOR
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:
 APPROVED: CHIEF OF STAFF
 DATE:
 APPROVED: HEALTH CARE SYSTEM DIRECTOR
 DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PROJECT NO.:	
BUILDING No.:	CHECKED BY:	DRAWN:	ISSUE DATE:
	CP	CG	1/24/19
LOCATION	DATE:	DRAWING NO.:	
VA MEDICAL CENTER ST. CLOUD, MN 56303		ET04-02	

VA
U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

GENERAL NOTES:

- A. PRIOR TO BID, CONTRACTOR SHALL VISIT SITE AND REVIEW SCOPE OF WORK.
- B. DEMOLITION, INSTALLATION AND TESTING SHALL BE DONE IN ACCORDANCE WITH SPECIFICATIONS.
- C. PROVIDE PUBLIC ADDRESS SYSTEM MUTING RELAYS AT EACH LOCAL SOUND SYSTEM.
- D. SPEAKERS TAGGED WITH "S" INDICATE SURFACE MOUNTED SPEAKERS. CONTRACTOR SHALL CONFIRM WALL/CEILING TYPES AND REQUIREMENTS FOR SURFACE MOUNT SPEAKERS PRIOR TO INSTALLATION.
- E. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.
- F. PROVIDE MINIMUM 3/4" BLUE EMT FOR PUBLIC ADDRESS SYSTEM SPEAKERS.

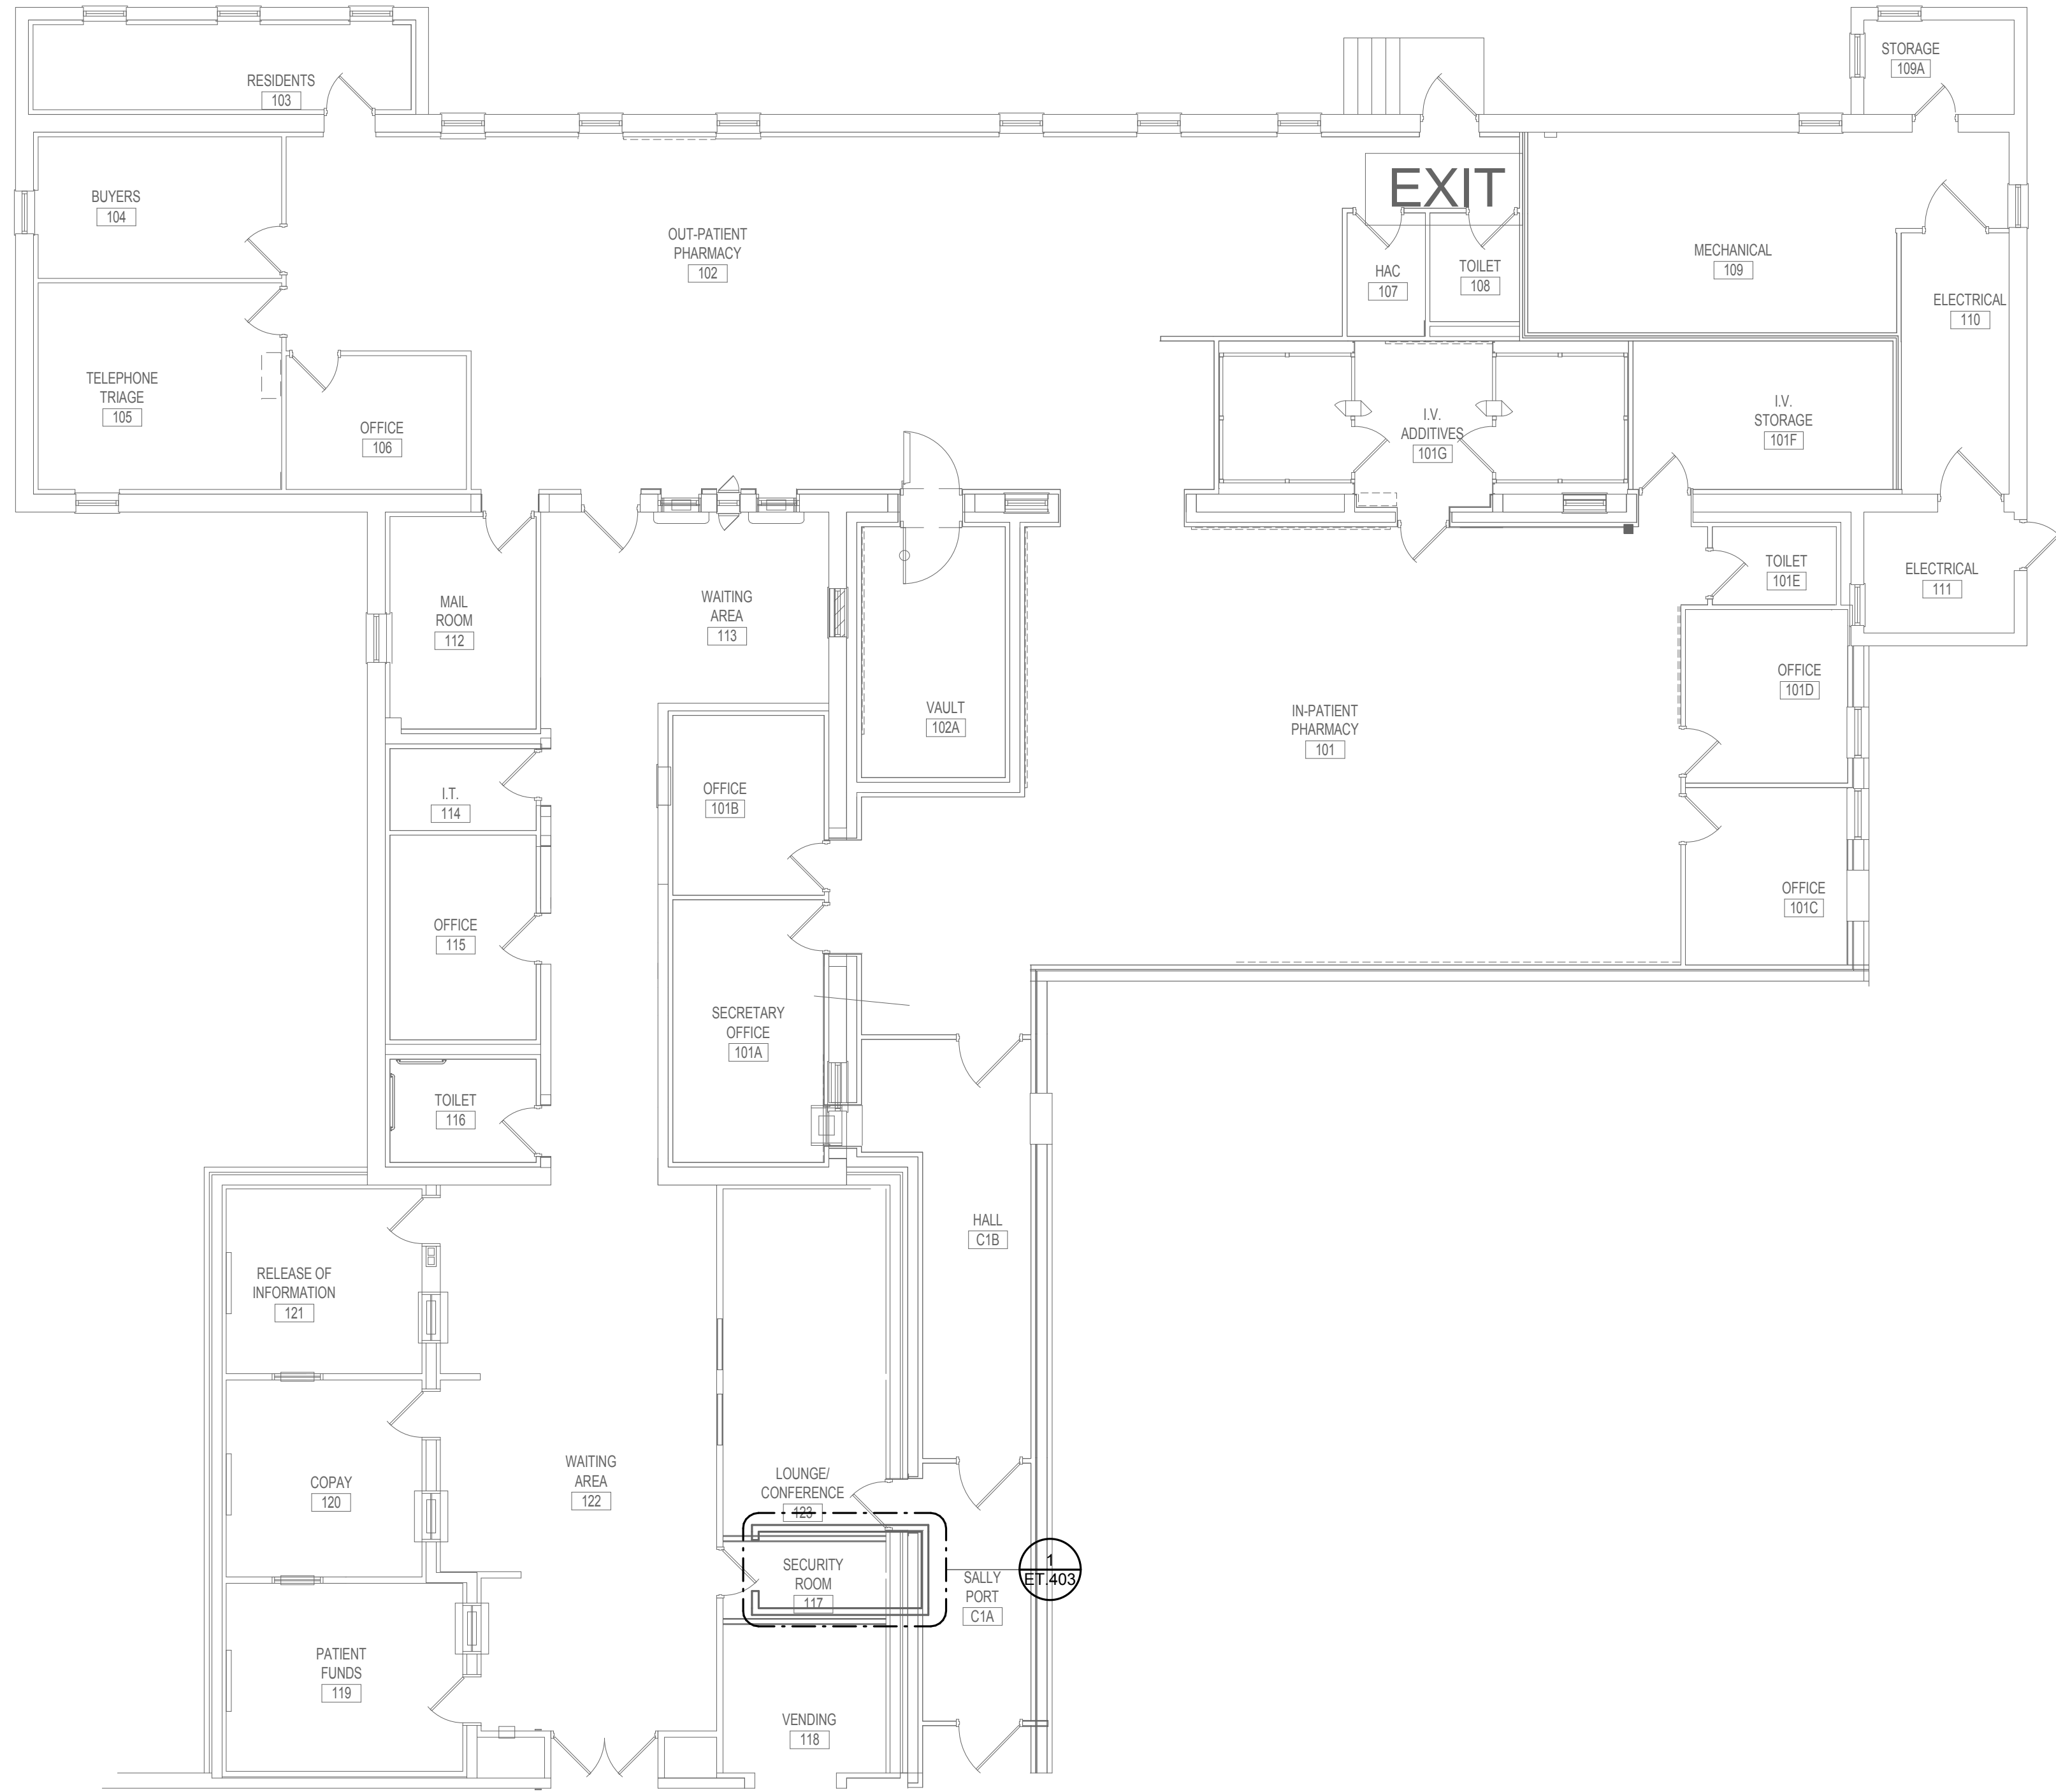

1 BUILDING 05 - PAGING SPEAKER FLOOR PLAN - FIRST FLOOR
1/8" = 1'-0"

C:\Revit\Projects\VA ST CLOUD PAGING_Bldg_R12.dwg

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE BUILDING 05 - PAGING SPEAKER FLOOR PLAN - FIRST FLOOR
APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
DATE:
APPROVED: CHIEF OF STAFF
DATE:
APPROVED: HEALTH CARE SYSTEM DIRECTOR
DATE:


PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM	PROJECT NO.:
BUILDING No.:	CHECKED BY: CP
DATE:	DRAWN: CG
ISSUE DATE: 1/24/19	DRAWING NO.: ET05-01
LOCATION: VA MEDICAL CENTER ST. CLOUD, MN 56303	DATE:

VA

U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

GENERAL NOTES:

- A. PRIOR TO BID, CONTRACTOR SHALL VISIT SITE AND REVIEW SCOPE OF WORK.
- B. DEMOLITION, INSTALLATION AND TESTING SHALL BE DONE IN ACCORDANCE WITH SPECIFICATIONS.
- C. PROVIDE PUBLIC ADDRESS SYSTEM MUTING RELAYS AT EACH LOCAL SOUND SYSTEM.
- D. SPEAKERS TAGGED WITH "S" INDICATE SURFACE MOUNTED SPEAKERS. CONTRACTOR SHALL CONFIRM WALL/CEILING TYPES AND REQUIREMENTS FOR SURFACE MOUNT SPEAKERS PRIOR TO INSTALLATION.
- E. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.
- F. PROVIDE MINIMUM 3/4" BLUE EMT FOR PUBLIC ADDRESS SYSTEM SPEAKERS.

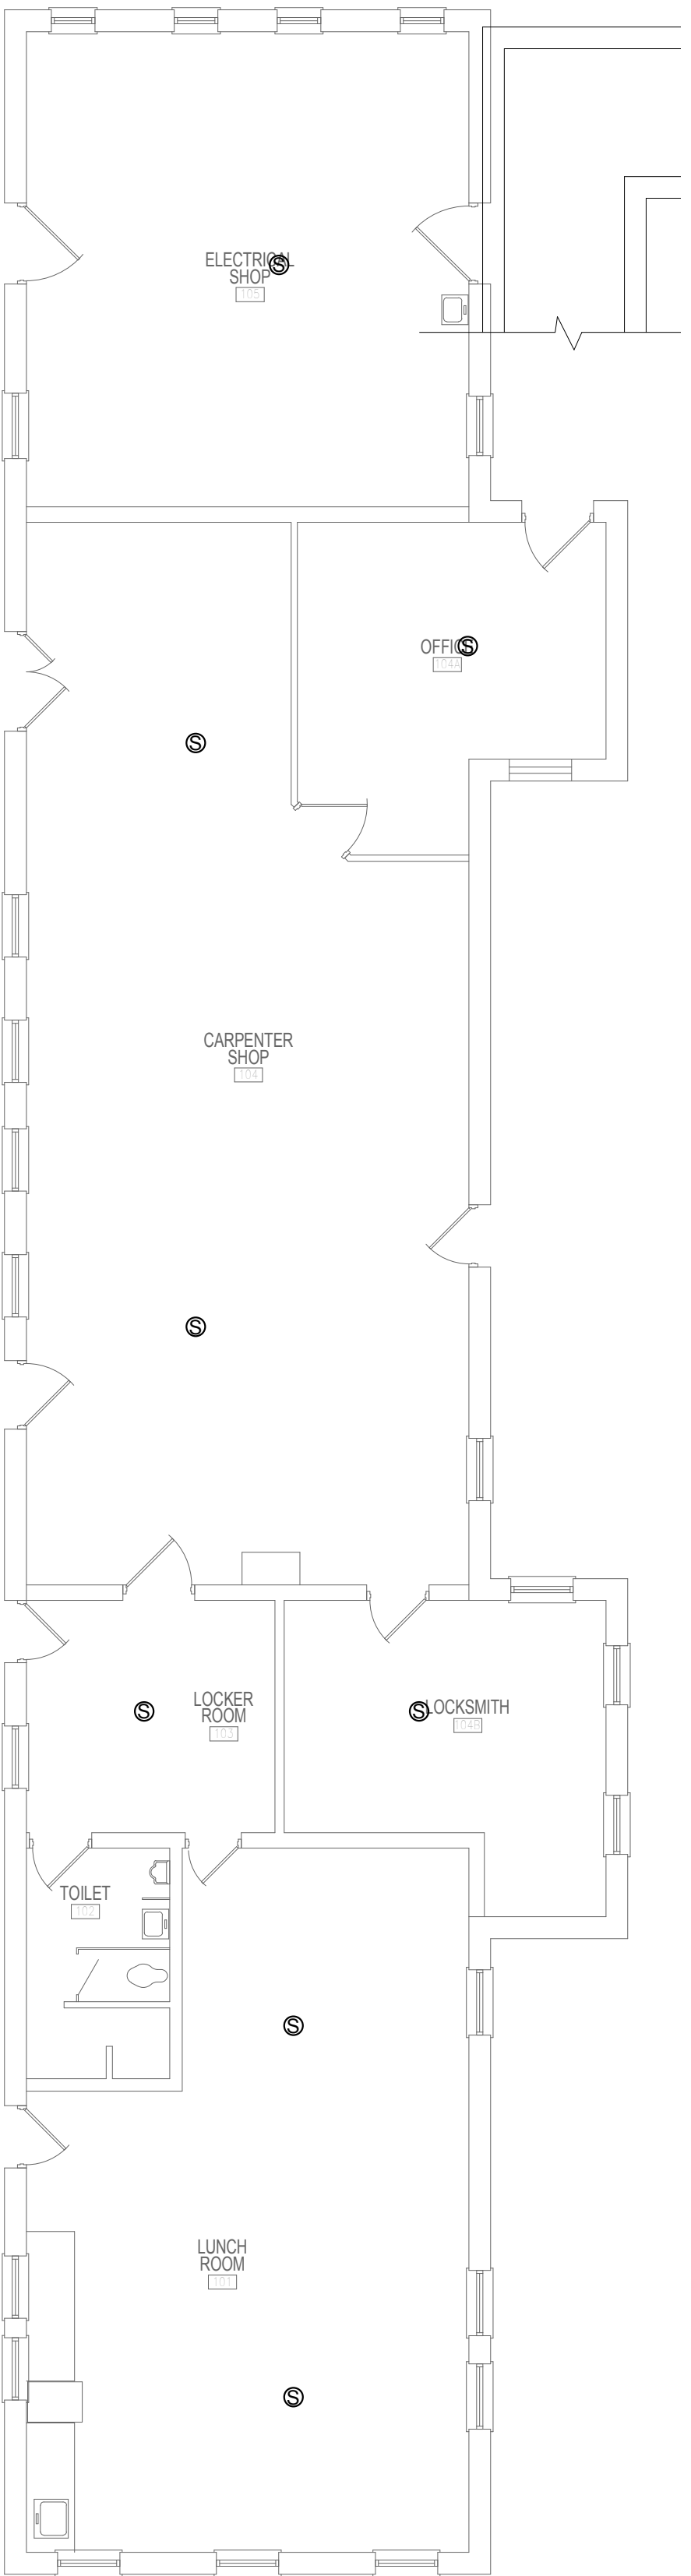

① BUILDING 06 - PAGING SPEAKER FLOOR PLAN - FIRST FLOOR
1/8" = 1'-0"

1/24/2019 12:10:11 PM

C:\Revit\Projects\VA ST CLOUD PAGING_Elec_R12.dwg

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE	APPROVED: INFECTION CONTROL NURSE	DATE
APPROVED: GEMS COORDINATOR	DATE	APPROVED: PATIENT SAFETY	DATE
APPROVED: PROJECTS SECTION MANAGER	DATE	APPROVED: CHIEF OF POLICE	DATE
APPROVED: DIRECTOR FMS	DATE	APPROVED: SAFETY MANAGER	DATE


DRAWING TITLE
BUILDING 06 - PAGING SPEAKER FLOOR PLAN - FIRST FLOOR
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE
 APPROVED: CHIEF OF STAFF
 DATE
 APPROVED: HEALTH CARE SYSTEM DIRECTOR
 DATE

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PROJECT NO.	
BUILDING No.	CHECKED BY	DRAWN	ISSUE DATE
	CP	CG	1/24/19
LOCATION	DATE	DRAWING NO.	
VA MEDICAL CENTER ST. CLOUD, MN 56303		ET06-01	

VA **U.S. Department of Veterans Affairs**
 Veterans Health Administration
 St. Cloud VA Health Care System

GENERAL NOTES:

- A. PRIOR TO BID, CONTRACTOR SHALL VISIT SITE AND REVIEW SCOPE OF WORK.
- B. DEMOLITION, INSTALLATION AND TESTING SHALL BE DONE IN ACCORDANCE WITH SPECIFICATIONS.
- C. PROVIDE PUBLIC ADDRESS SYSTEM MUTING RELAYS AT EACH LOCAL SOUND SYSTEM.
- D. SPEAKERS TAGGED WITH "S" INDICATE SURFACE MOUNTED SPEAKERS. CONTRACTOR SHALL CONFIRM WALL/CEILING TYPES AND REQUIREMENTS FOR SURFACE MOUNT SPEAKERS PRIOR TO INSTALLATION.
- E. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.
- F. PROVIDE MINIMUM 3/4" BLUE EMT FOR PUBLIC ADDRESS SYSTEM SPEAKERS.

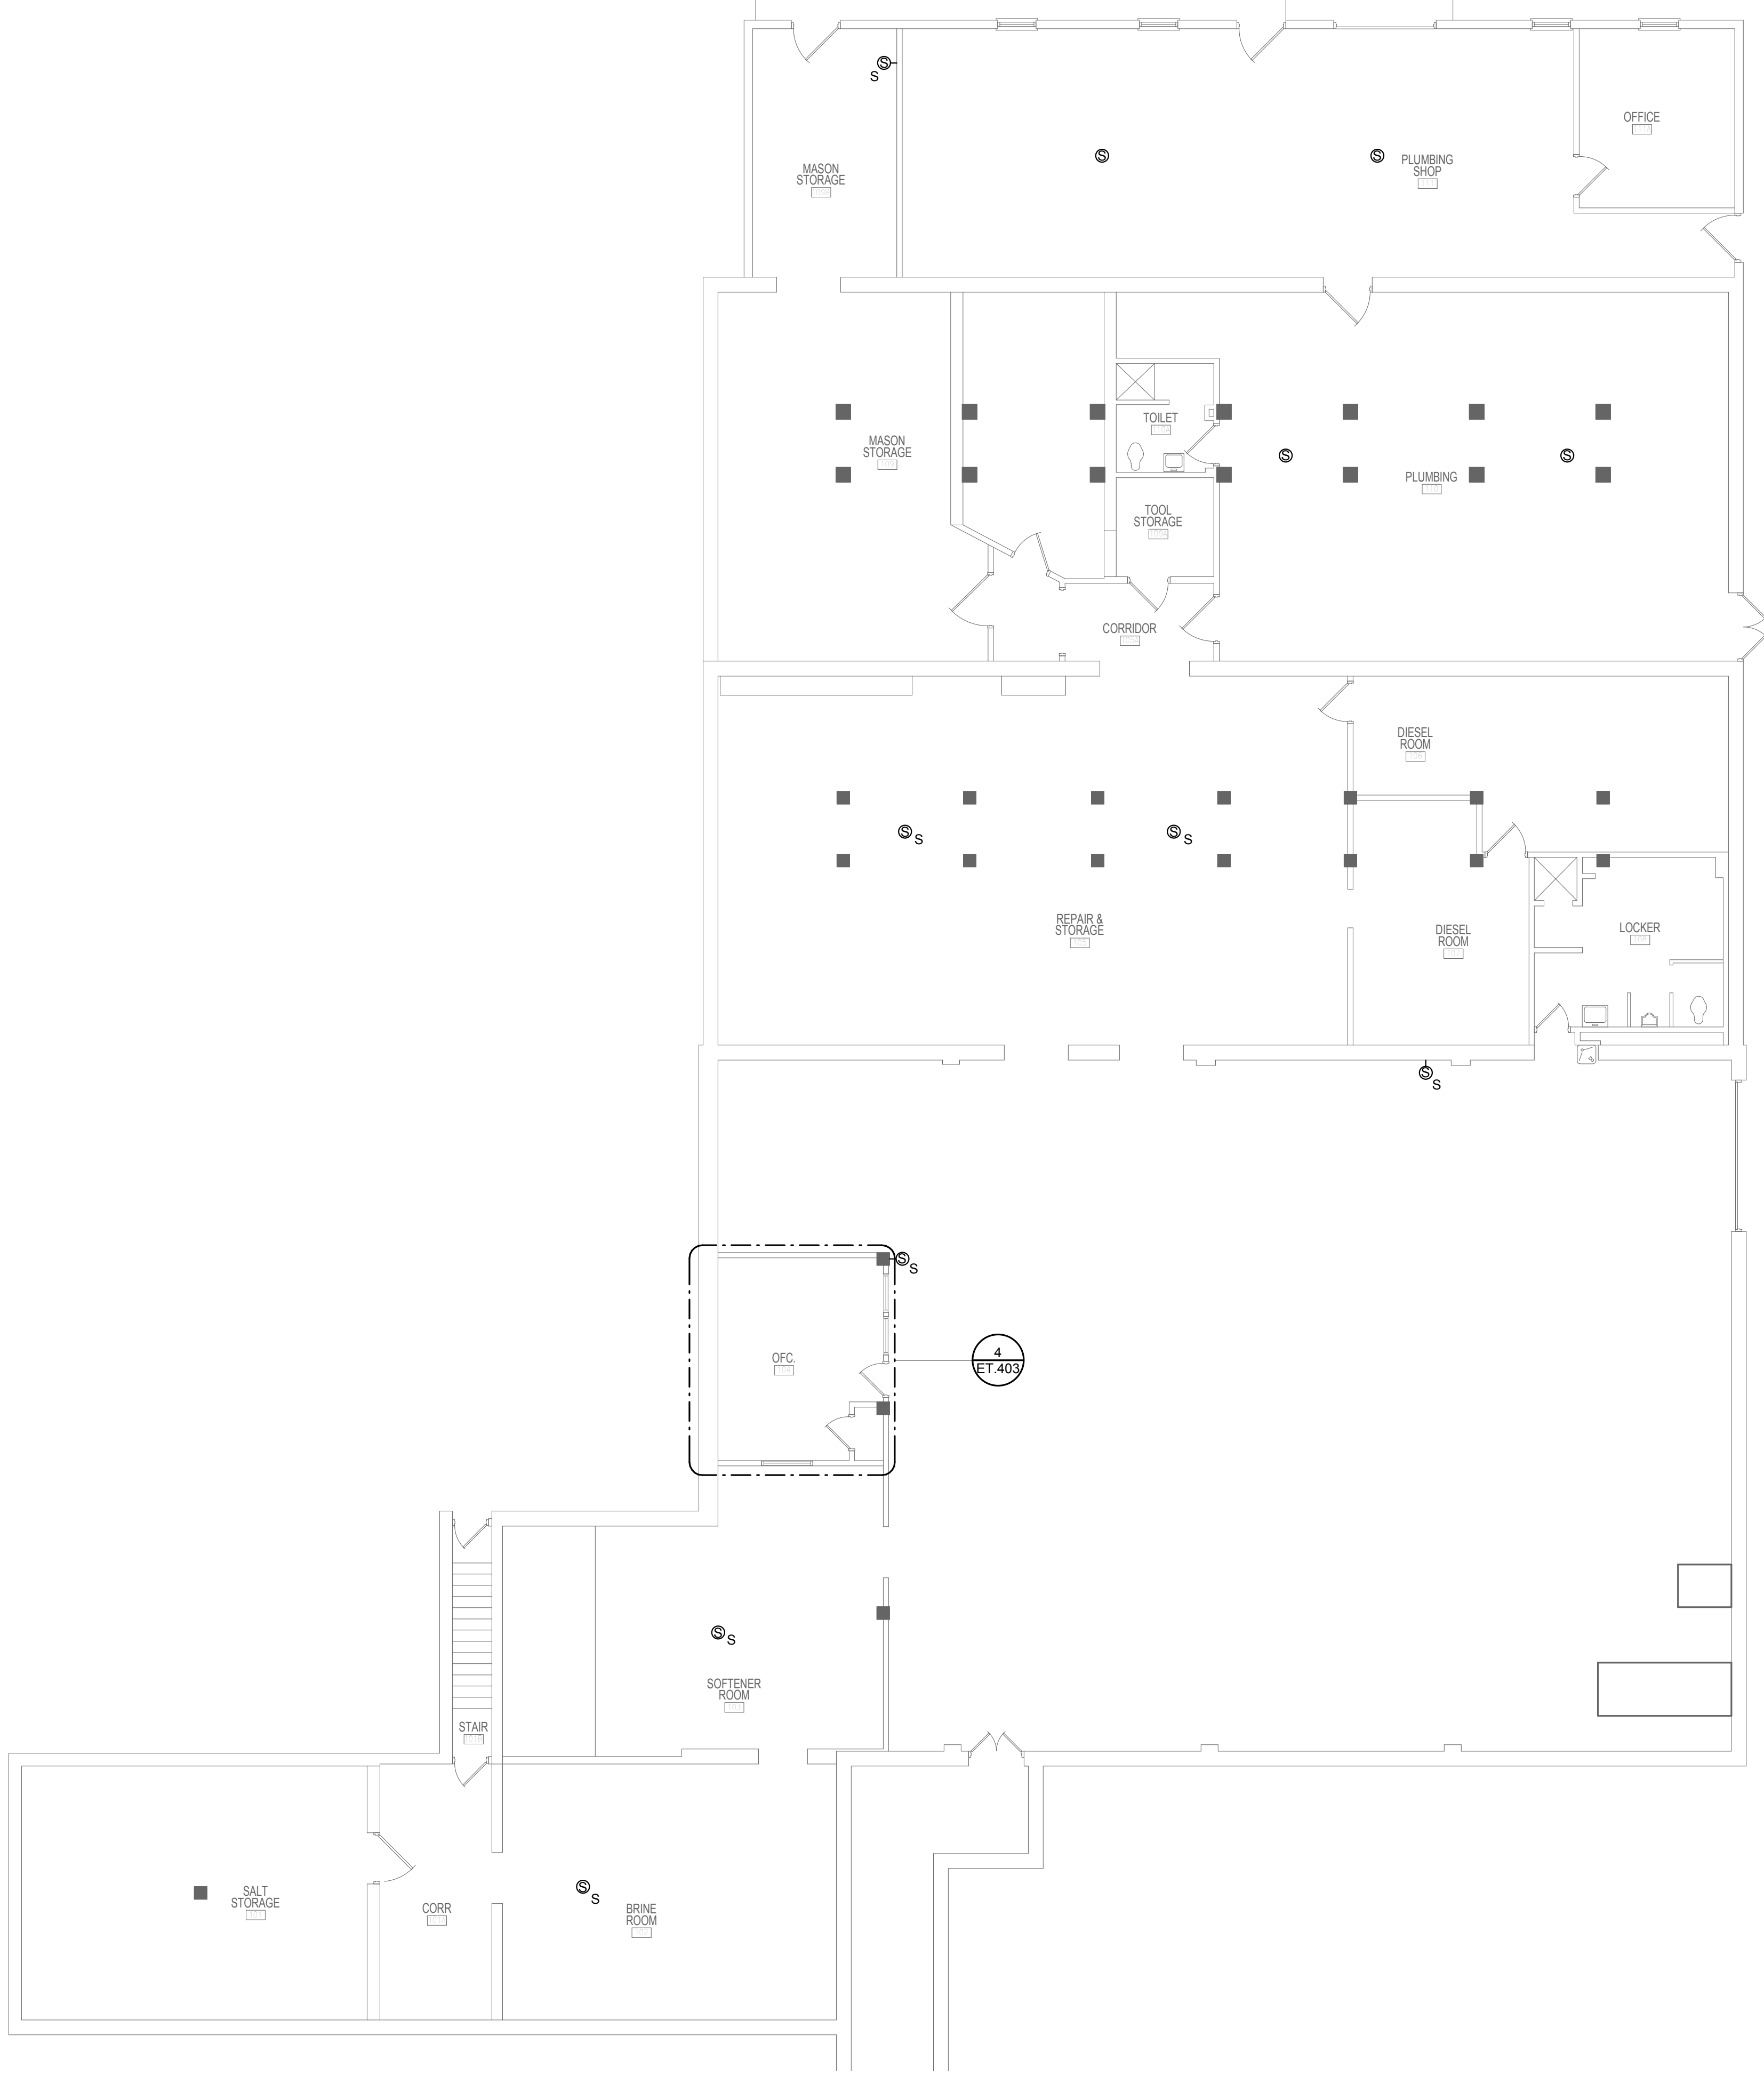

1 BUILDING 07 - PAGING SPEAKER FLOOR PLAN - FIRST FLOOR
1/8" = 1'-0"

1/24/2019 12:10:52 PM
C:\Revit\Projects\VA ST CLOUD\PAGING_Elec_R1E.dwg

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:


DRAWING TITLE
BUILDING 07 - PAGING SPEAKER FLOOR PLAN - FIRST FLOOR
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:
 APPROVED: CHIEF OF STAFF
 DATE:
 APPROVED: HEALTH CARE SYSTEM DIRECTOR
 DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PROJECT NO.:	
BUILDING No.:	CHECKED BY:	DRAWN:	ISSUE DATE:
	CP	CG	1/24/19
LOCATION	DATE:	DRAWING NO.:	
VA MEDICAL CENTER ST. CLOUD, MN 56303		ET07-01	

VA
U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

GENERAL NOTES:

- A. PRIOR TO BID, CONTRACTOR SHALL VISIT SITE AND REVIEW SCOPE OF WORK.
- B. DEMOLITION, INSTALLATION AND TESTING SHALL BE DONE IN ACCORDANCE WITH SPECIFICATIONS.
- C. PROVIDE PUBLIC ADDRESS SYSTEM MUTING RELAYS AT EACH LOCAL SOUND SYSTEM.
- D. SPEAKERS TAGGED WITH "S" INDICATE SURFACE MOUNTED SPEAKERS. CONTRACTOR SHALL CONFIRM WALL/CEILING TYPES AND REQUIREMENTS FOR SURFACE MOUNT SPEAKERS PRIOR TO INSTALLATION.
- E. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.
- F. PROVIDE MINIMUM 3/4" BLUE EMT FOR PUBLIC ADDRESS SYSTEM SPEAKERS.

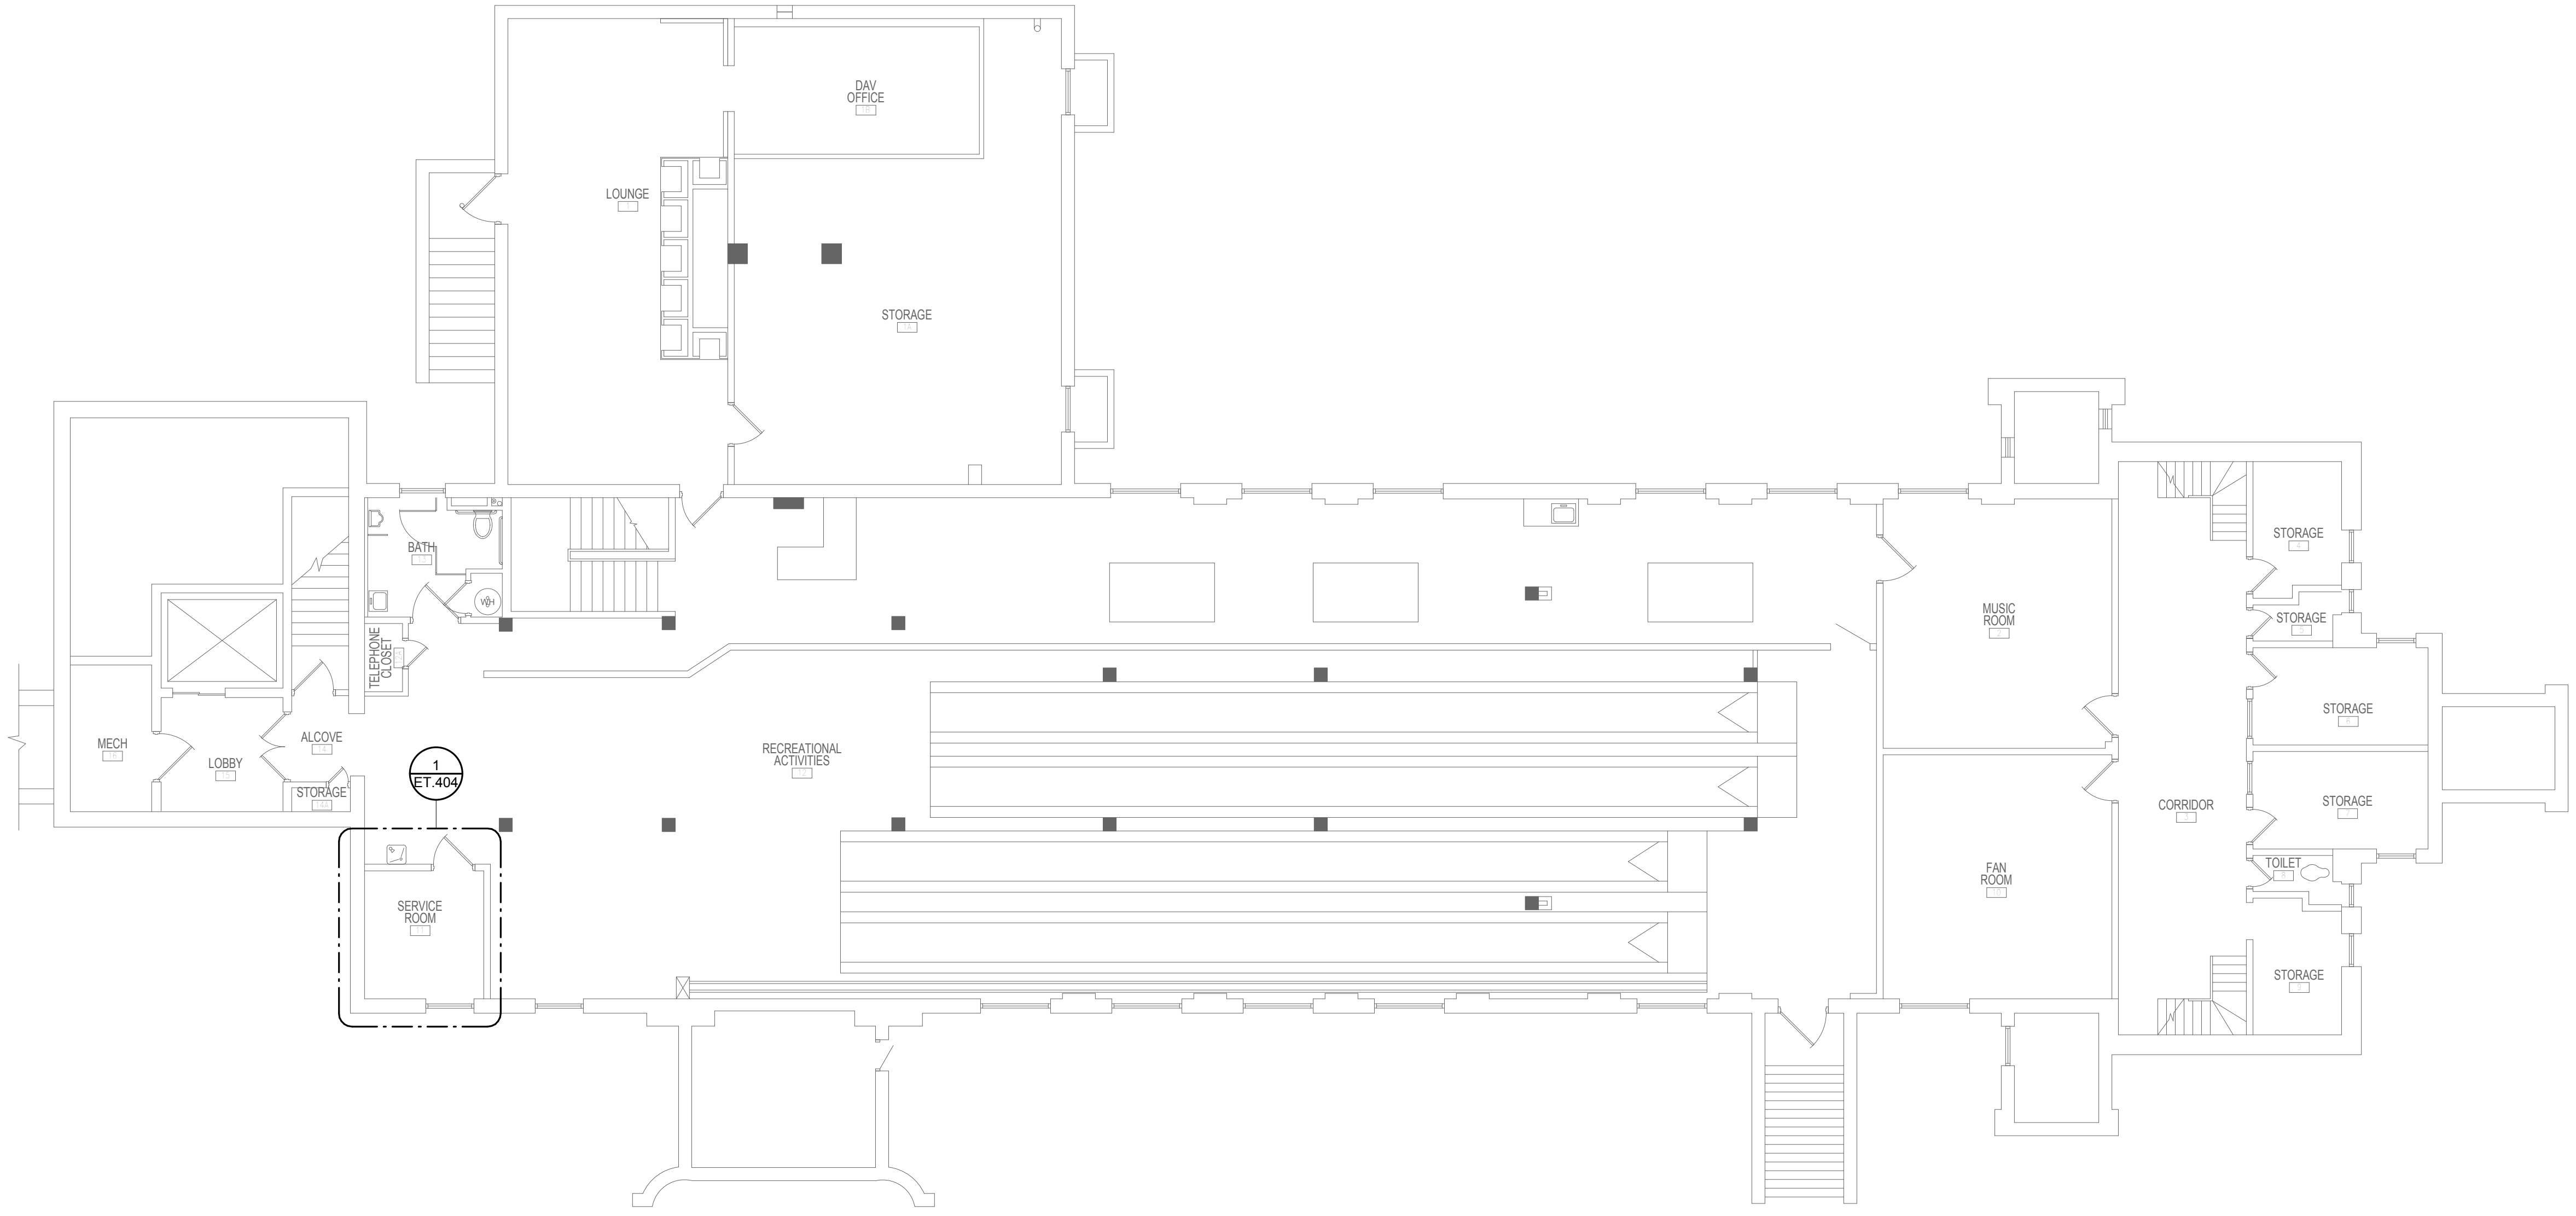

1 BUILDING 08 - PAGING SPEAKER FLOOR PLAN - BASEMENT
1/8" = 1'-0"

1/24/2019 12:10:52 PM

C:\Revit\Projects\VA ST CLOUD PAGING_Elec_R12.dwg

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Piliod*
 Name: Chris M. Piliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE
BUILDING 08 - PAGING SPEAKER FLOOR PLAN - BASEMENT
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:
 APPROVED: CHIEF OF STAFF
 DATE:
 APPROVED: HEALTH CARE SYSTEM DIRECTOR
 DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PLOT SCALE	
PROJECT NO.		PROJECT NO.	
BUILDING No.	CHECKED BY	DRAWN	ISSUE DATE
	CP	CG	1/24/19
LOCATION	DATE	DRAWING NO.	
VA MEDICAL CENTER ST. CLOUD, MN 56303		ET08-00	


VA **U.S. Department of Veterans Affairs**
 Veterans Health Administration
 St. Cloud VA Health Care System

GENERAL NOTES:

- A. PRIOR TO BID, CONTRACTOR SHALL VISIT SITE AND REVIEW SCOPE OF WORK.
- B. DEMOLITION, INSTALLATION AND TESTING SHALL BE DONE IN ACCORDANCE WITH SPECIFICATIONS.
- C. PROVIDE PUBLIC ADDRESS SYSTEM MUTING RELAYS AT EACH LOCAL SOUND SYSTEM.
- D. SPEAKERS TAGGED WITH "S" INDICATE SURFACE MOUNTED SPEAKERS. CONTRACTOR SHALL CONFIRM WALL/CEILING TYPES AND REQUIREMENTS FOR SURFACE MOUNT SPEAKERS PRIOR TO INSTALLATION.
- E. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.
- F. PROVIDE MINIMUM 3/4" BLUE EMT FOR PUBLIC ADDRESS SYSTEM SPEAKERS.

KEY NOTES:

- ① PROVIDE PUBLIC ADDRESS SYSTEM MUTING RELAY FOR EXISTING AV EQUIPMENT. MATCH EXISTING CONDITIONS. RE-CONNECT AV SYSTEM IN AUDITORIUM. AUDITORIUM AV SPEAKERS TO TIE INTO NEW PUBLIC ADDRESS SYSTEM AT HEADEND LOCATION.

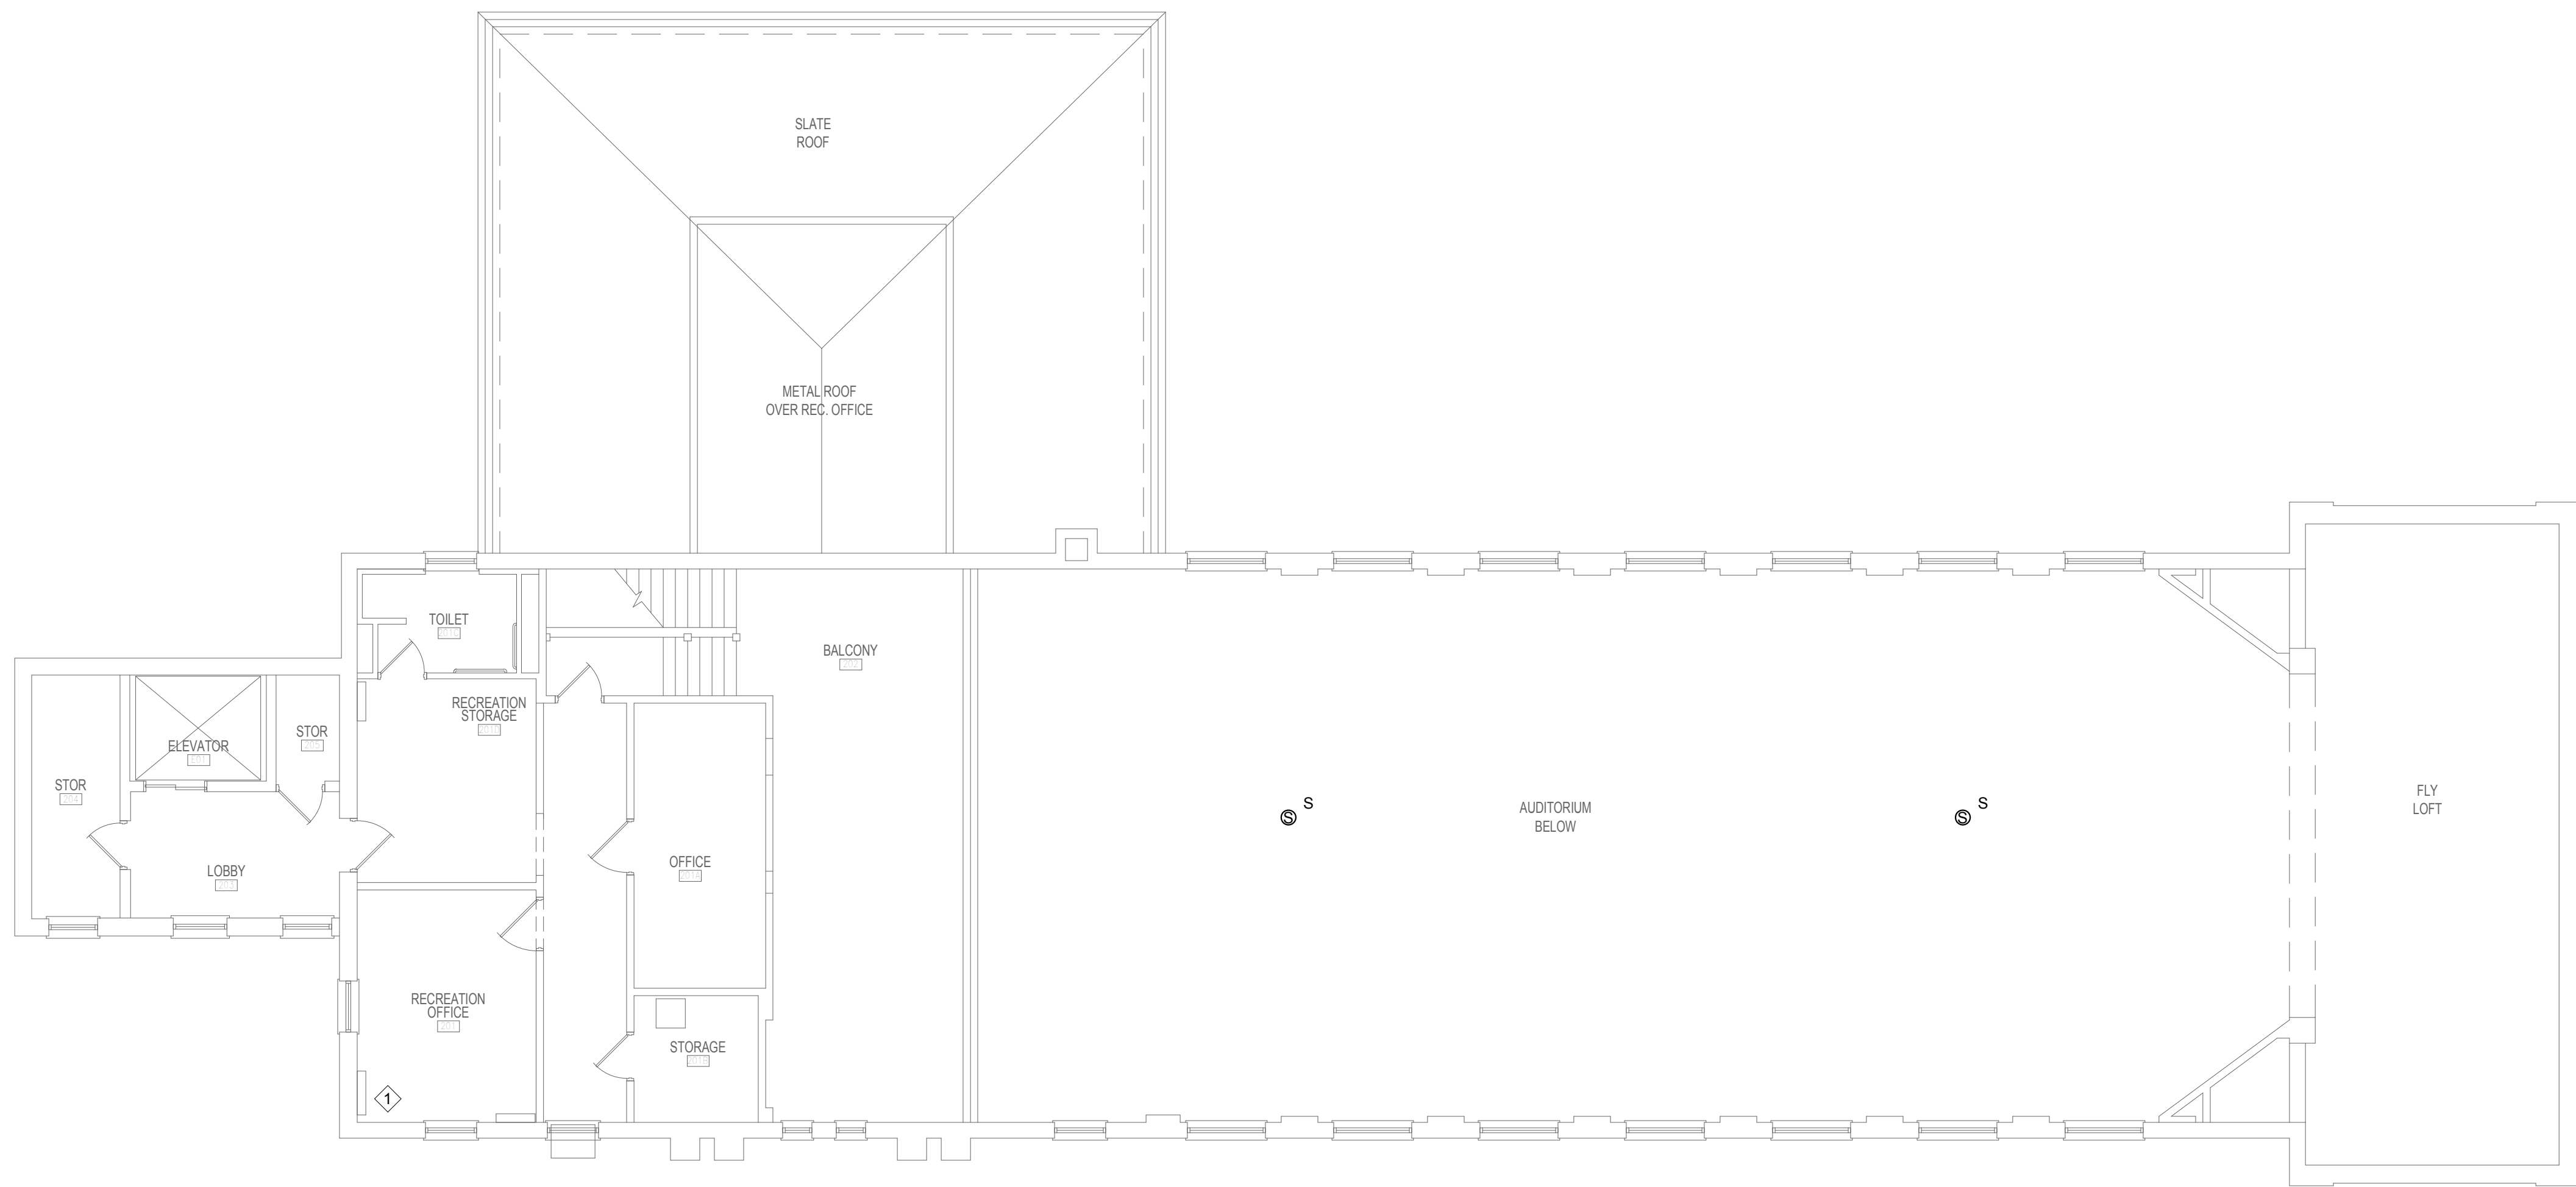

① BUILDING 08 - PAGING SPEAKER FLOOR PLAN - SECOND FLOOR
1/8" = 1'-0"

1/24/2019 12:10:58 PM

C:\Revit\Projects\VA ST CLOUD PAGING_Elec_R12.dwg

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE
BUILDING 08 - PAGING SPEAKER FLOOR PLAN - SECOND FLOOR
 DATE:
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:
 APPROVED: CHIEF OF STAFF
 DATE:
 APPROVED: HEALTH CARE SYSTEM DIRECTOR
 DATE:


PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PROJECT NO.:	
BUILDING No.:	CHECKED BY:	DRAWN:	ISSUE DATE:
	CP	CG	1/24/19
LOCATION:	DATE:	DRAWING NO.:	
VA MEDICAL CENTER ST. CLOUD, MN 56303		ET08-02	



U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

GENERAL NOTES:

- A. PRIOR TO BID, CONTRACTOR SHALL VISIT SITE AND REVIEW SCOPE OF WORK.
- B. DEMOLITION, INSTALLATION AND TESTING SHALL BE DONE IN ACCORDANCE WITH SPECIFICATIONS.
- C. PROVIDE PUBLIC ADDRESS SYSTEM MUTING RELAYS AT EACH LOCAL SOUND SYSTEM.
- D. SPEAKERS TAGGED WITH "S" INDICATE SURFACE MOUNTED SPEAKERS. CONTRACTOR SHALL CONFIRM WALL/CEILING TYPES AND REQUIREMENTS FOR SURFACE MOUNT SPEAKERS PRIOR TO INSTALLATION.
- E. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.
- F. PROVIDE MINIMUM 3/4" BLUE EMT FOR PUBLIC ADDRESS SYSTEM SPEAKERS.

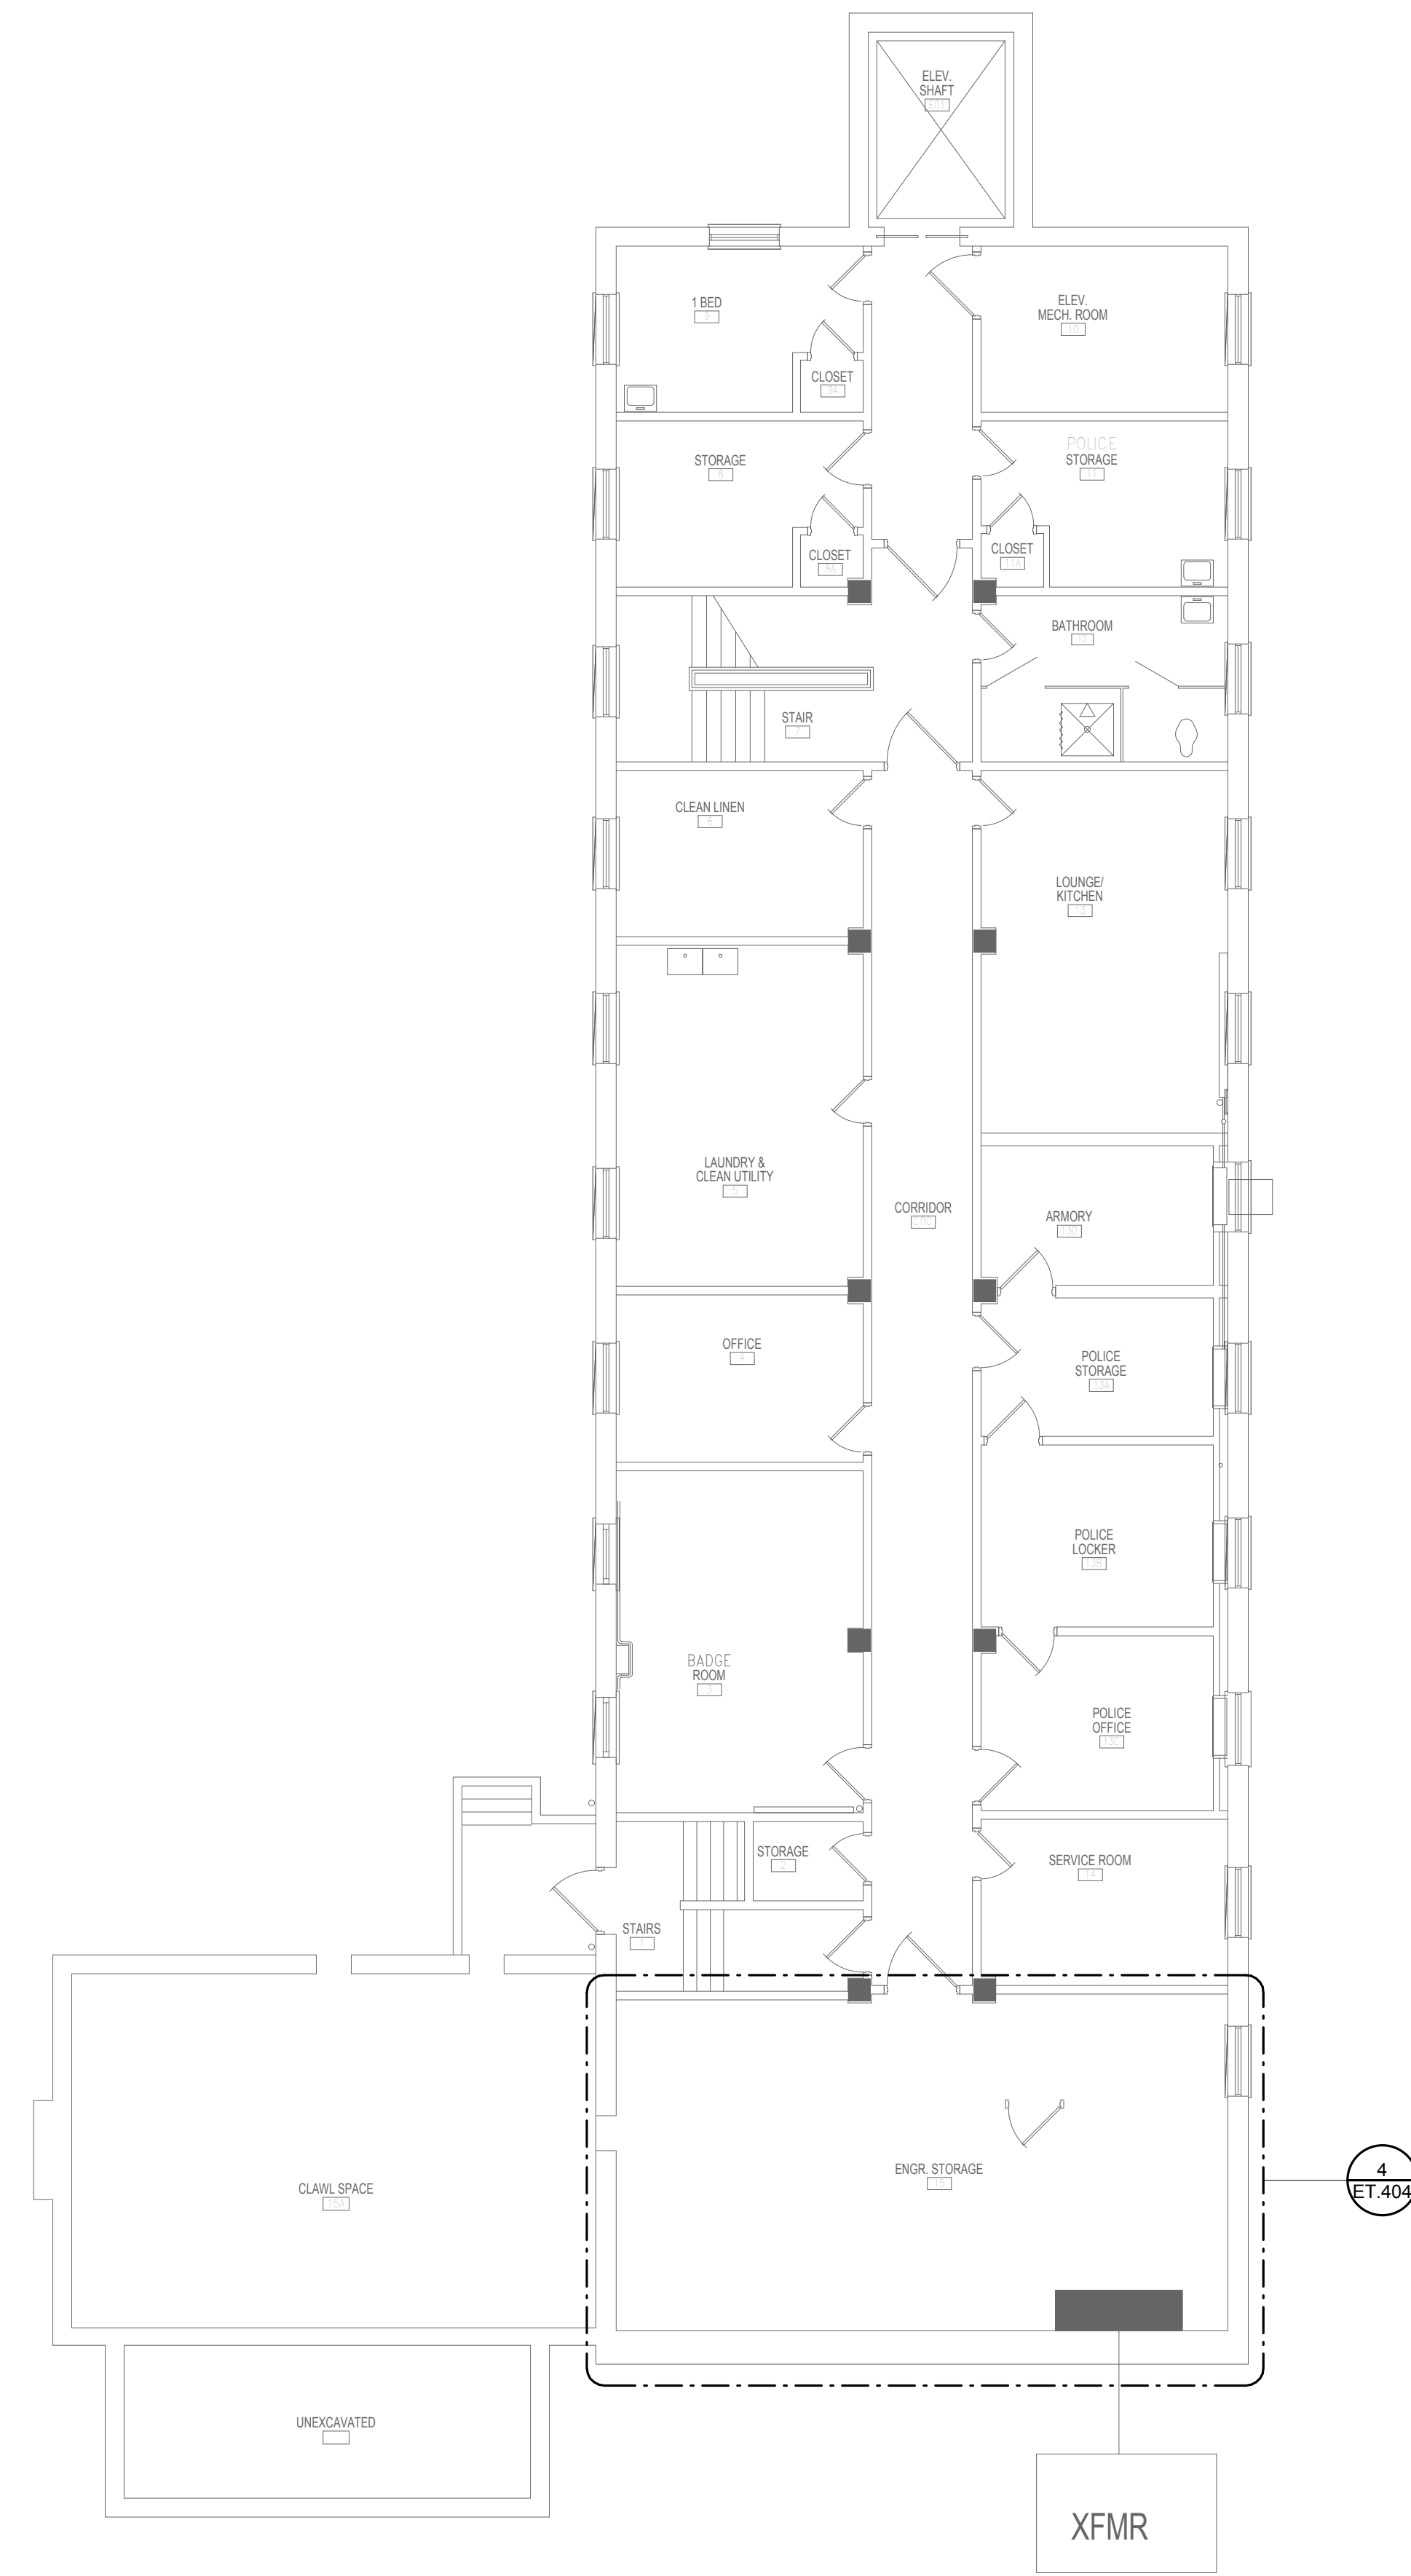

1 BUILDING 09 - PAGING SPEAKER FLOOR PLAN - BASEMENT
1/8" = 1'-0"

C:\Revit\Projects\VA ST CLOUD PAGING_Elec_Bldg_R12.dwg 1/24/2019 12:10:41 PM

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE	APPROVED: INFECTION CONTROL NURSE	DATE
APPROVED: GEMS COORDINATOR	DATE	APPROVED: PATIENT SAFETY	DATE
APPROVED: PROJECTS SECTION MANAGER	DATE	APPROVED: CHIEF OF POLICE	DATE
APPROVED: DIRECTOR FMS	DATE	APPROVED: SAFETY MANAGER	DATE


DRAWING TITLE BUILDING 09 - PAGING SPEAKER FLOOR PLAN - BASEMENT
APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
DATE
APPROVED: CHIEF OF STAFF
DATE
APPROVED: HEALTH CARE SYSTEM DIRECTOR
DATE

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM	PROJECT NO.		
BUILDING No.	CHECKED BY	DRAWN	ISSUE DATE
CP	CG	CG	1/24/19
LOCATION VA MEDICAL CENTER ST. CLOUD, MN 56303	DATE	DRAWING NO.	ET09-00

VA **U.S. Department of Veterans Affairs**
 Veterans Health Administration
 St. Cloud VA Health Care System

GENERAL NOTES:

- A. PRIOR TO BID, CONTRACTOR SHALL VISIT SITE AND REVIEW SCOPE OF WORK.
- B. DEMOLITION, INSTALLATION AND TESTING SHALL BE DONE IN ACCORDANCE WITH SPECIFICATIONS.
- C. PROVIDE PUBLIC ADDRESS SYSTEM MUTING RELAYS AT EACH LOCAL SOUND SYSTEM.
- D. SPEAKERS TAGGED WITH "S" INDICATE SURFACE MOUNTED SPEAKERS. CONTRACTOR SHALL CONFIRM WALL/CEILING TYPES AND REQUIREMENTS FOR SURFACE MOUNT SPEAKERS PRIOR TO INSTALLATION.
- E. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.
- F. PROVIDE MINIMUM 3/4" BLUE EMT FOR PUBLIC ADDRESS SYSTEM SPEAKERS.

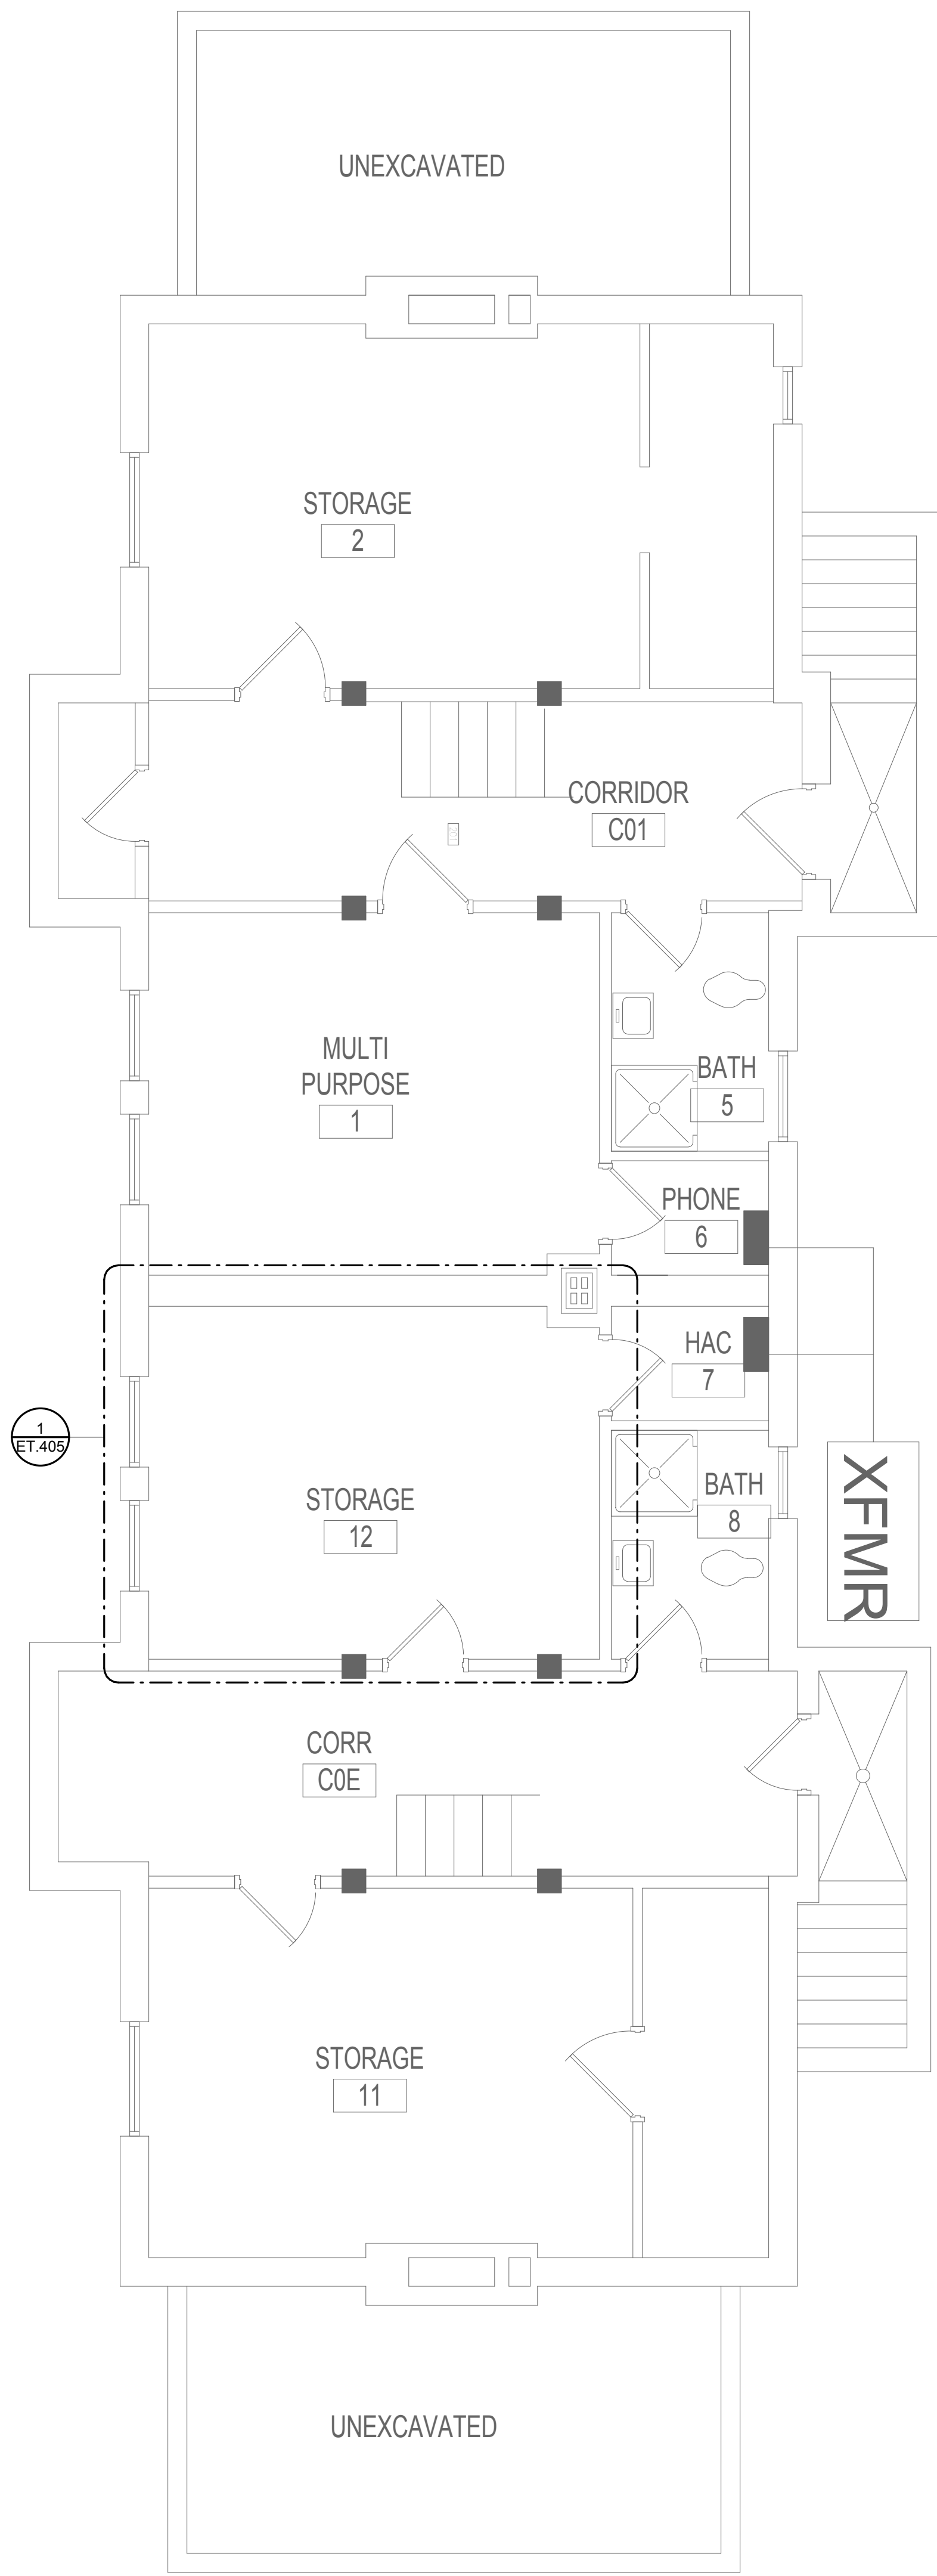

1 BUILDING 10 - PAGING SPEAKER FLOOR PLAN - BASEMENT
1/4" = 1'-0"

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE BUILDING 10 - PAGING SPEAKER FLOOR PLAN - BASEMENT
APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
DATE:
APPROVED: CHIEF OF STAFF
DATE:
APPROVED: HEALTH CARE SYSTEM DIRECTOR
DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM	PROJECT NO.:
BUILDING NO.:	CHECKED BY: CP
DATE:	CG
ISSUE DATE:	DRAWN:
1/24/19	DATE:
LOCATION: VA MEDICAL CENTER ST. CLOUD, MN 56303	DRAWING NO.:
	ET10-00

VA **U.S. Department of Veterans Affairs**
 Veterans Health Administration
 St. Cloud VA Health Care System

GENERAL NOTES:

A. PRIOR TO BID, CONTRACTOR SHALL VISIT SITE AND REVIEW SCOPE OF WORK.


B. DEMOLITION, INSTALLATION AND TESTING SHALL BE DONE IN ACCORDANCE WITH SPECIFICATIONS.

C. PROVIDE PUBLIC ADDRESS SYSTEM MUTING RELAYS AT EACH LOCAL SOUND SYSTEM.

D. SPEAKERS TAGGED WITH "S" INDICATE SURFACE MOUNTED SPEAKERS. CONTRACTOR SHALL CONFIRM WALL/CEILING TYPES AND REQUIREMENTS FOR SURFACE MOUNT SPEAKERS PRIOR TO INSTALLATION.

E. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.

F. PROVIDE MINIMUM 3/4" BLUE EMT FOR PUBLIC ADDRESS SYSTEM SPEAKERS.

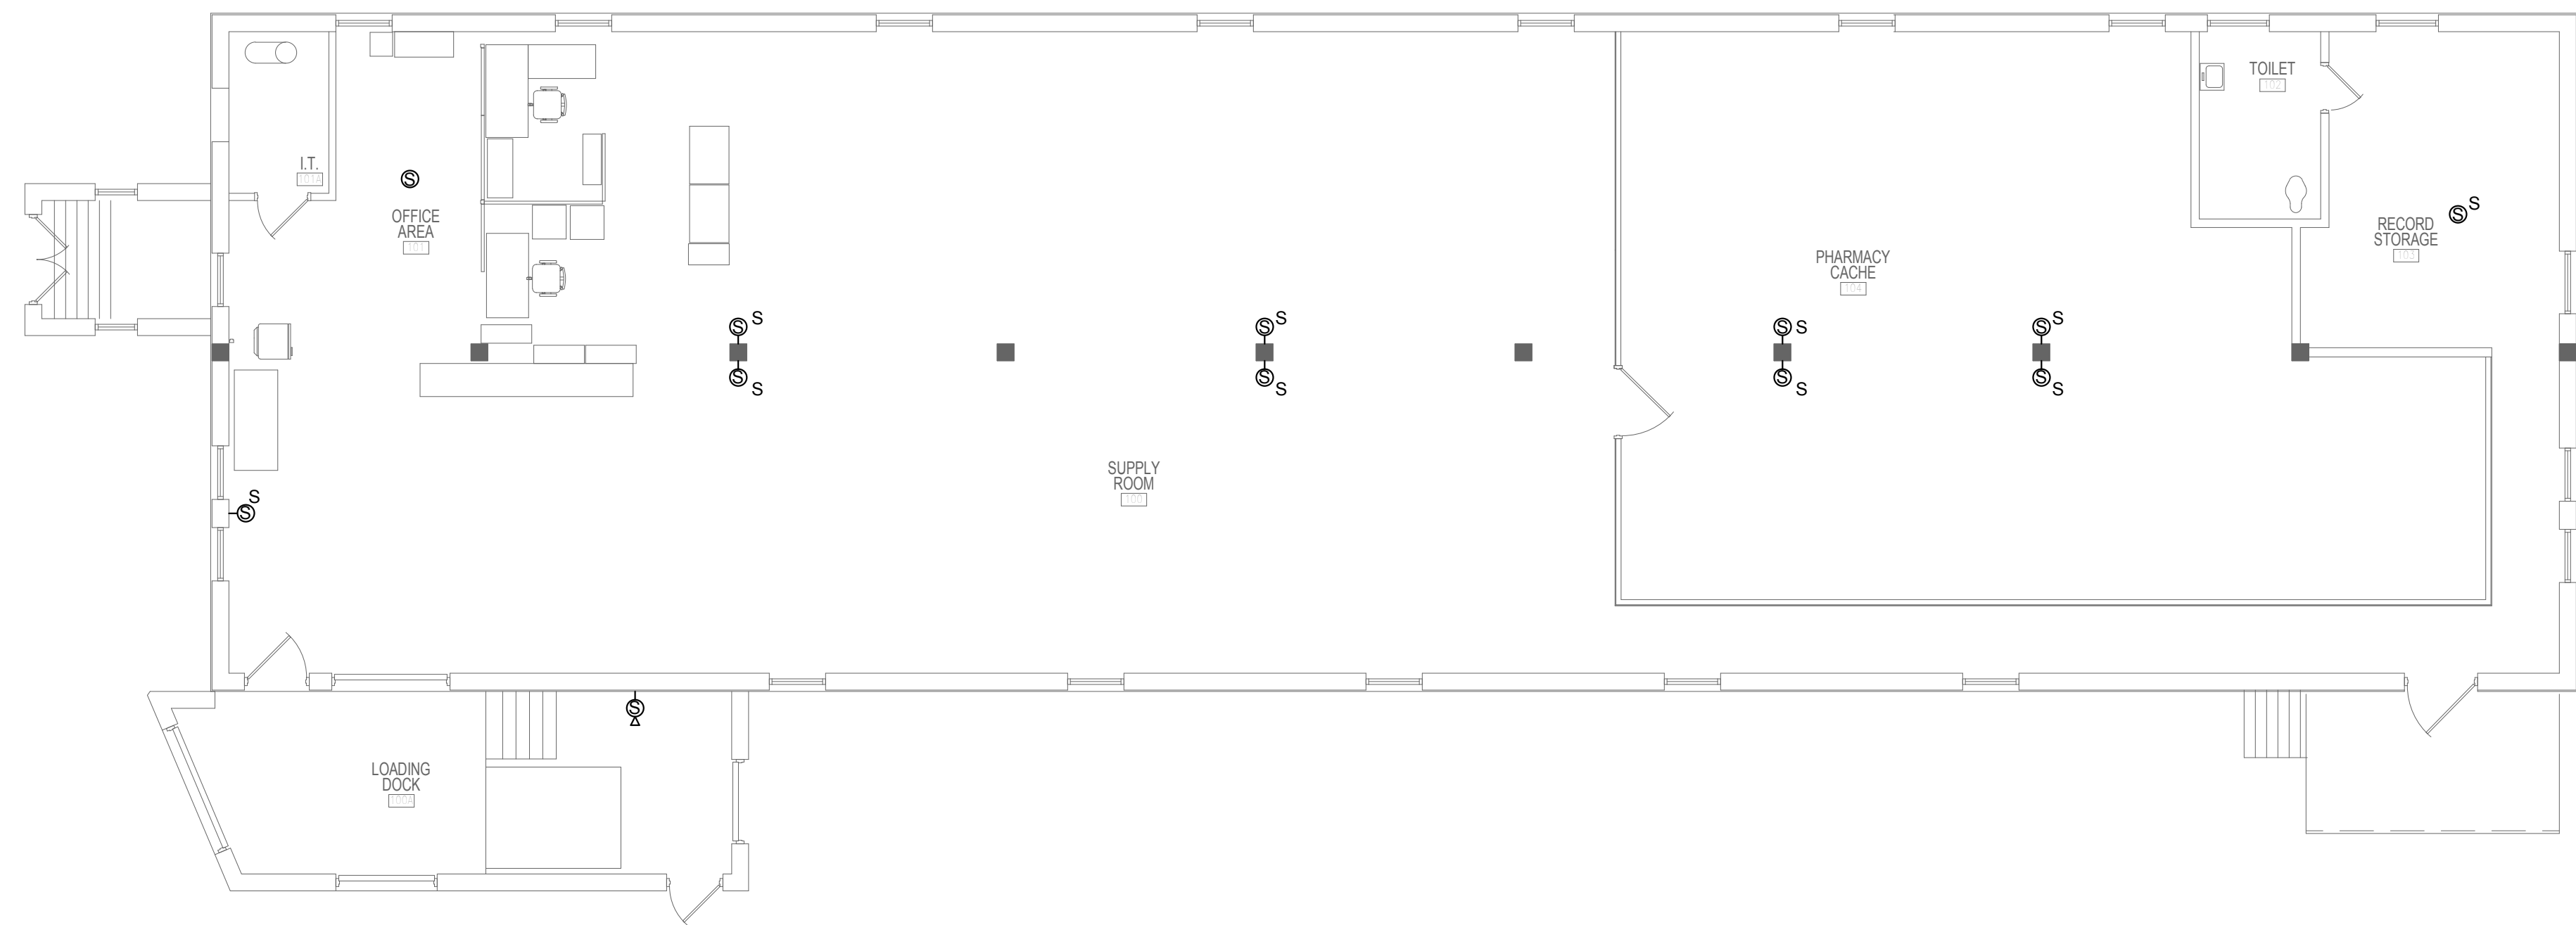

1 BUILDING 14 - PAGING SPEAKER FLOOR PLAN - FIRST FLOOR
1/8" = 1'-0"

1/24/2019 11:21:05 PM
C:\Revit\Projects\VA ST CLOUD PAGING_Elec_R12.dwg.plt

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)
DUNHAM
50 South Sixth Street / Suite 1100
Minneapolis, Minnesota 55402-1540
Phone: 612-465-7550 Fax: 612-465-7551
Web: dunhaminc.com
mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD
ANDERSON ENGINEERING
ENGINEERING • ARCHITECTURE • LAND SURVEYING
ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
Anderson Engineering of Minnesota, LLC
13605 1st Avenue North
Suite 100
Plymouth, MN 55441
763-412-4000 (o) 763-412-4090 (f)
www.ae-mn.com

STAMP
I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
Signature: *Chris M. Pilliod*
Name: Chris M. Pilliod, P.E.
Date: 1/24/19
Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE
BUILDING 14 - PAGING SPEAKER FLOOR PLAN - FIRST FLOOR
APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
DATE:
APPROVED: CHIEF OF STAFF
DATE:
APPROVED: HEALTH CARE SYSTEM DIRECTOR
DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PLOT SCALE	
PROJECT NO.		ISSUE DATE	
BUILDING No.	CHECKED BY	DRAWN	DATE
	CP	CG	1/24/19
LOCATION VA MEDICAL CENTER ST. CLOUD, MN 56303		DRAWING NO. ET14-01	

VA


U.S. Department of Veterans Affairs
Veterans Health Administration
St. Cloud VA Health Care System

GENERAL NOTES:

- A. PRIOR TO BID, CONTRACTOR SHALL VISIT SITE AND REVIEW SCOPE OF WORK.
- B. DEMOLITION, INSTALLATION AND TESTING SHALL BE DONE IN ACCORDANCE WITH SPECIFICATIONS.
- C. PROVIDE PUBLIC ADDRESS SYSTEM MUTING RELAYS AT EACH LOCAL SOUND SYSTEM.
- D. SPEAKERS TAGGED WITH "S" INDICATE SURFACE MOUNTED SPEAKERS. CONTRACTOR SHALL CONFIRM WALL/CEILING TYPES AND REQUIREMENTS FOR SURFACE MOUNT SPEAKERS PRIOR TO INSTALLATION.
- E. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.
- F. PROVIDE MINIMUM 3/4" BLUE EMT FOR PUBLIC ADDRESS SYSTEM SPEAKERS.

KEY NOTES:

① PROVIDE PUBLIC ADDRESS SYSTEM ADMINISTRATION PHONE. PROVIDE INTERFACE TO HEADEND EQUIPMENT. VERIFY LOCATION WITH OWNER PRIOR TO INSTALLATION. MOUNT 48" AFF.

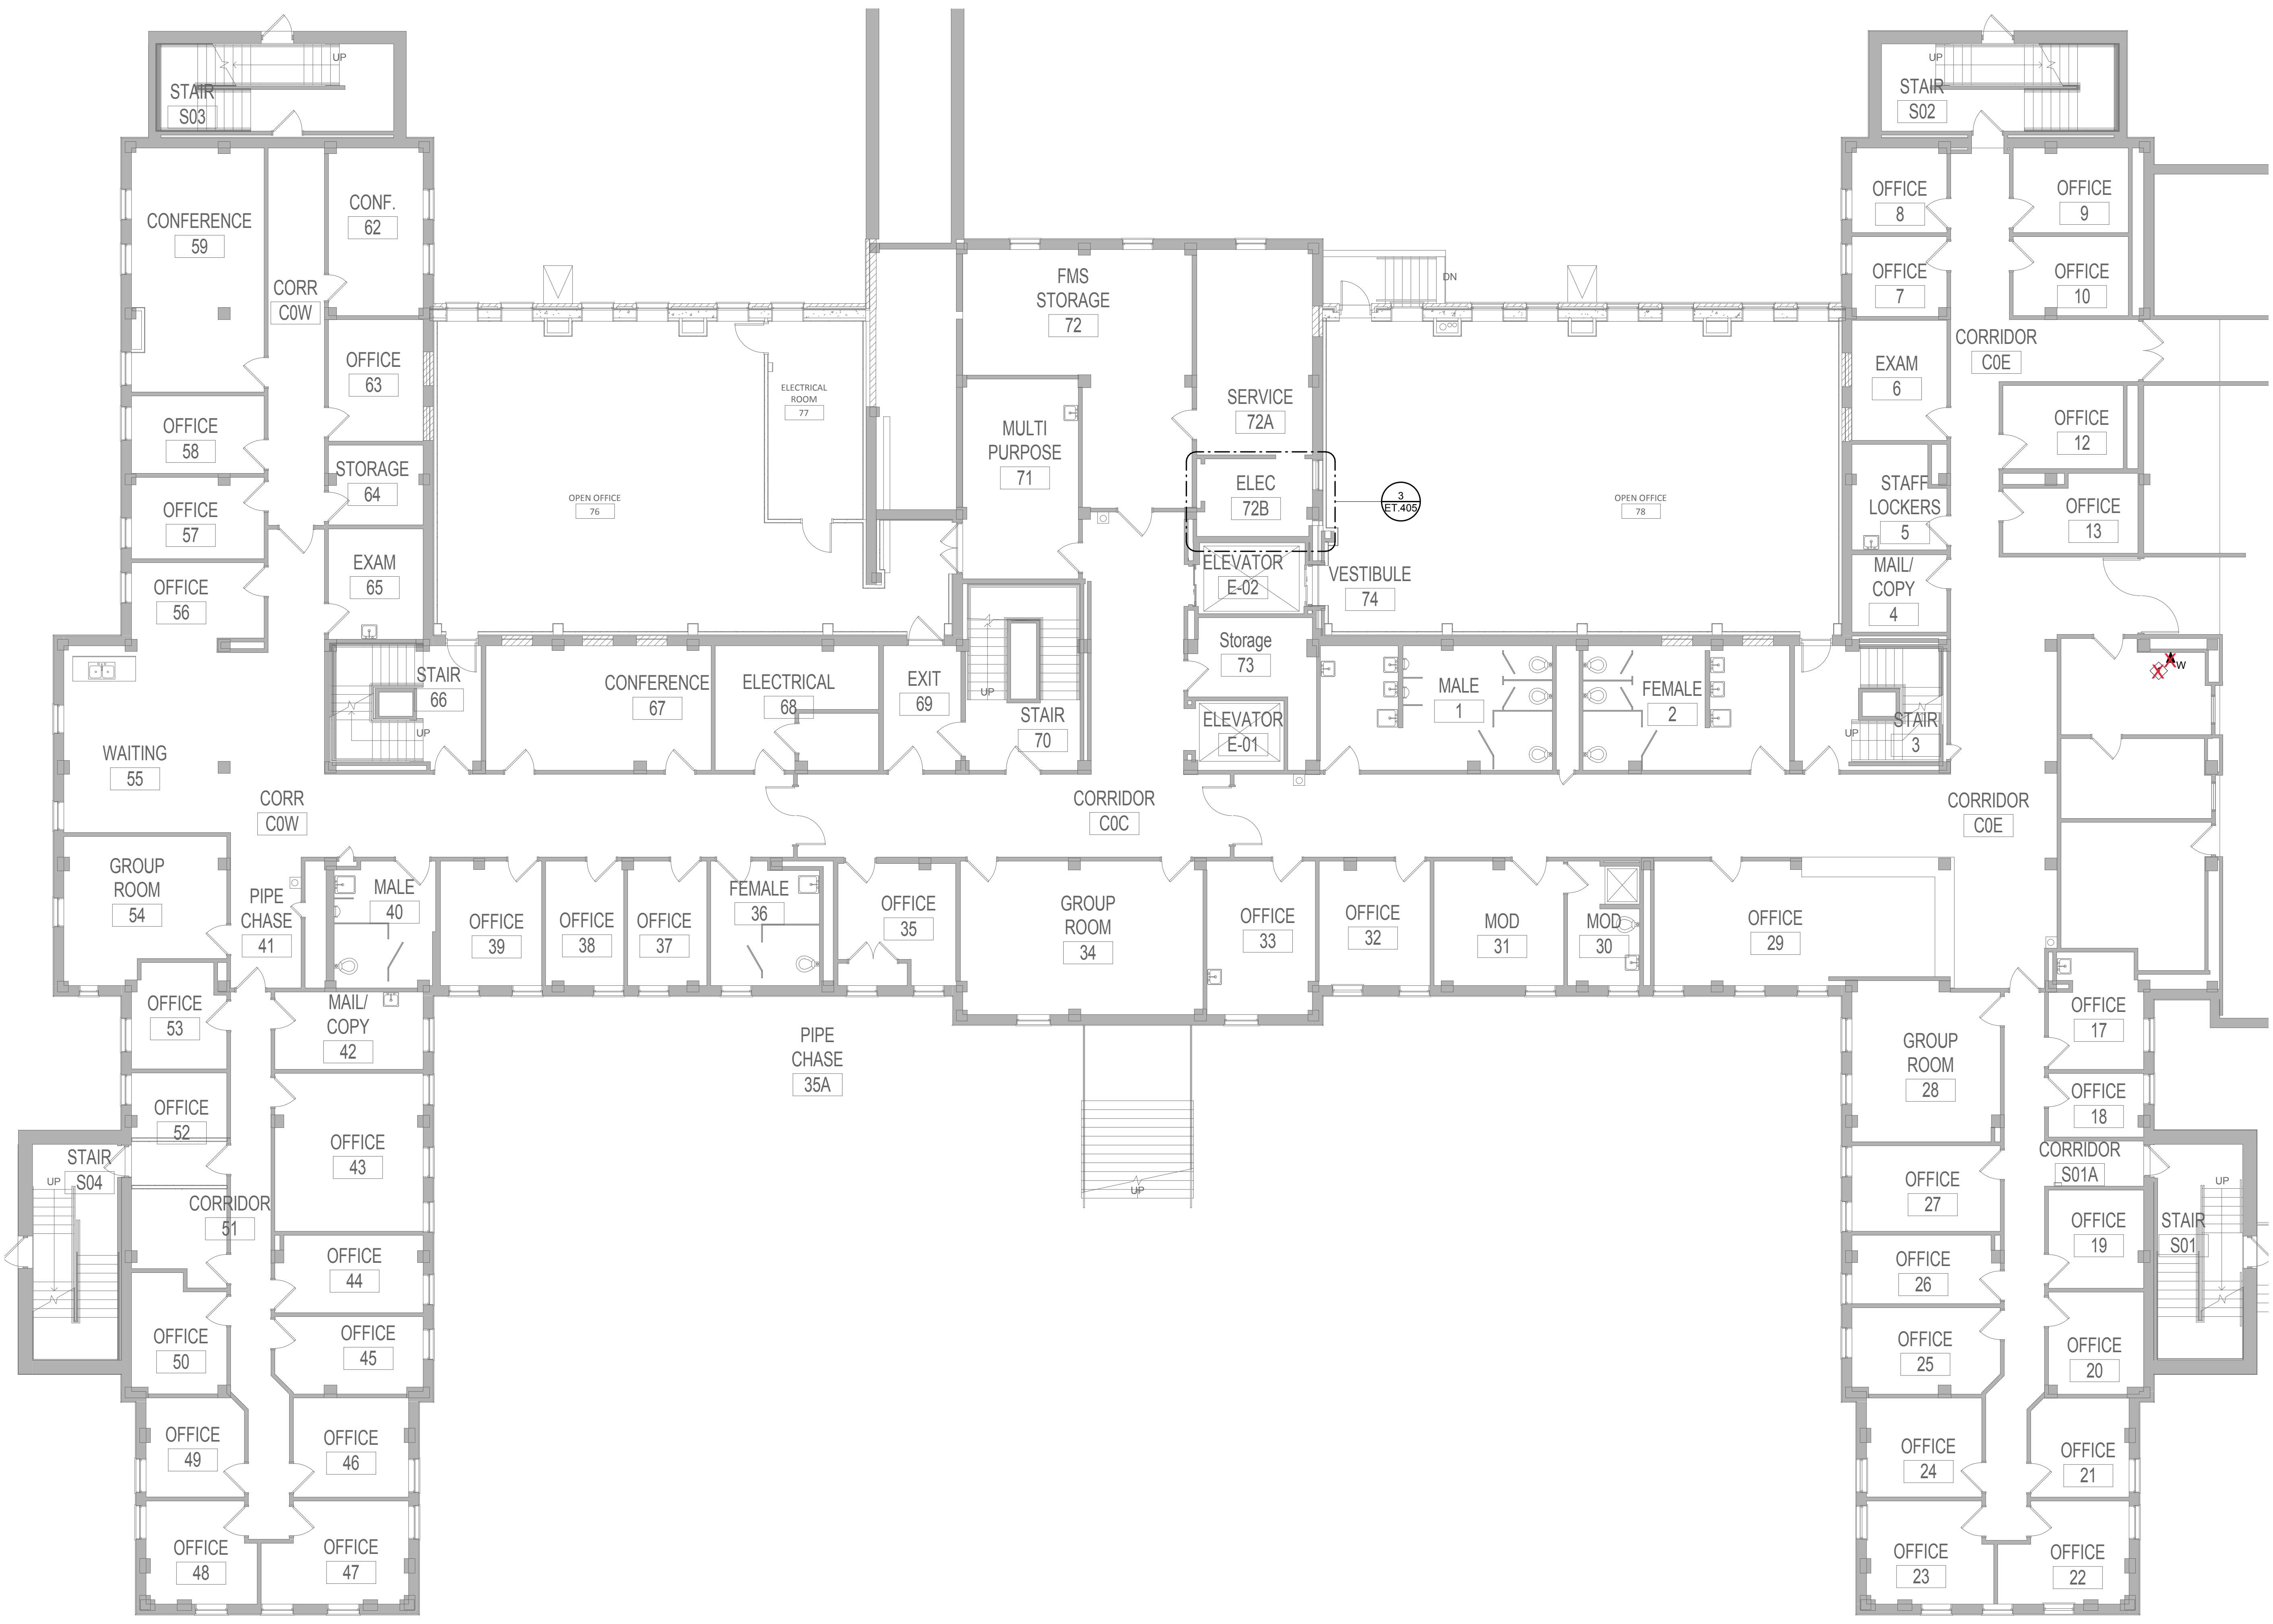

① BUILDING 28 - PAGING SPEAKER FLOOR PLAN - BASEMENT
1/8" = 1'-0"

1/24/2019 12:10:58 PM
C:\Revit\Projects\VA ST CLOUD PAGING_Elec_R12.dwg

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

 DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826


APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE BUILDING 28 - PAGING SPEAKER FLOOR PLAN - BASEMENT	DATE:
APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR	DATE:
APPROVED: CHIEF OF STAFF	DATE:
APPROVED: HEALTH CARE SYSTEM DIRECTOR	DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM	PROJECT NO.:
BUILDING No.:	CHECKED BY: CP
DATE:	DRAWN: CG
LOCATION VA MEDICAL CENTER ST. CLOUD, MN 56303	ISSUE DATE 1/24/19
DRAWING NO. ET28-00	

VA

U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

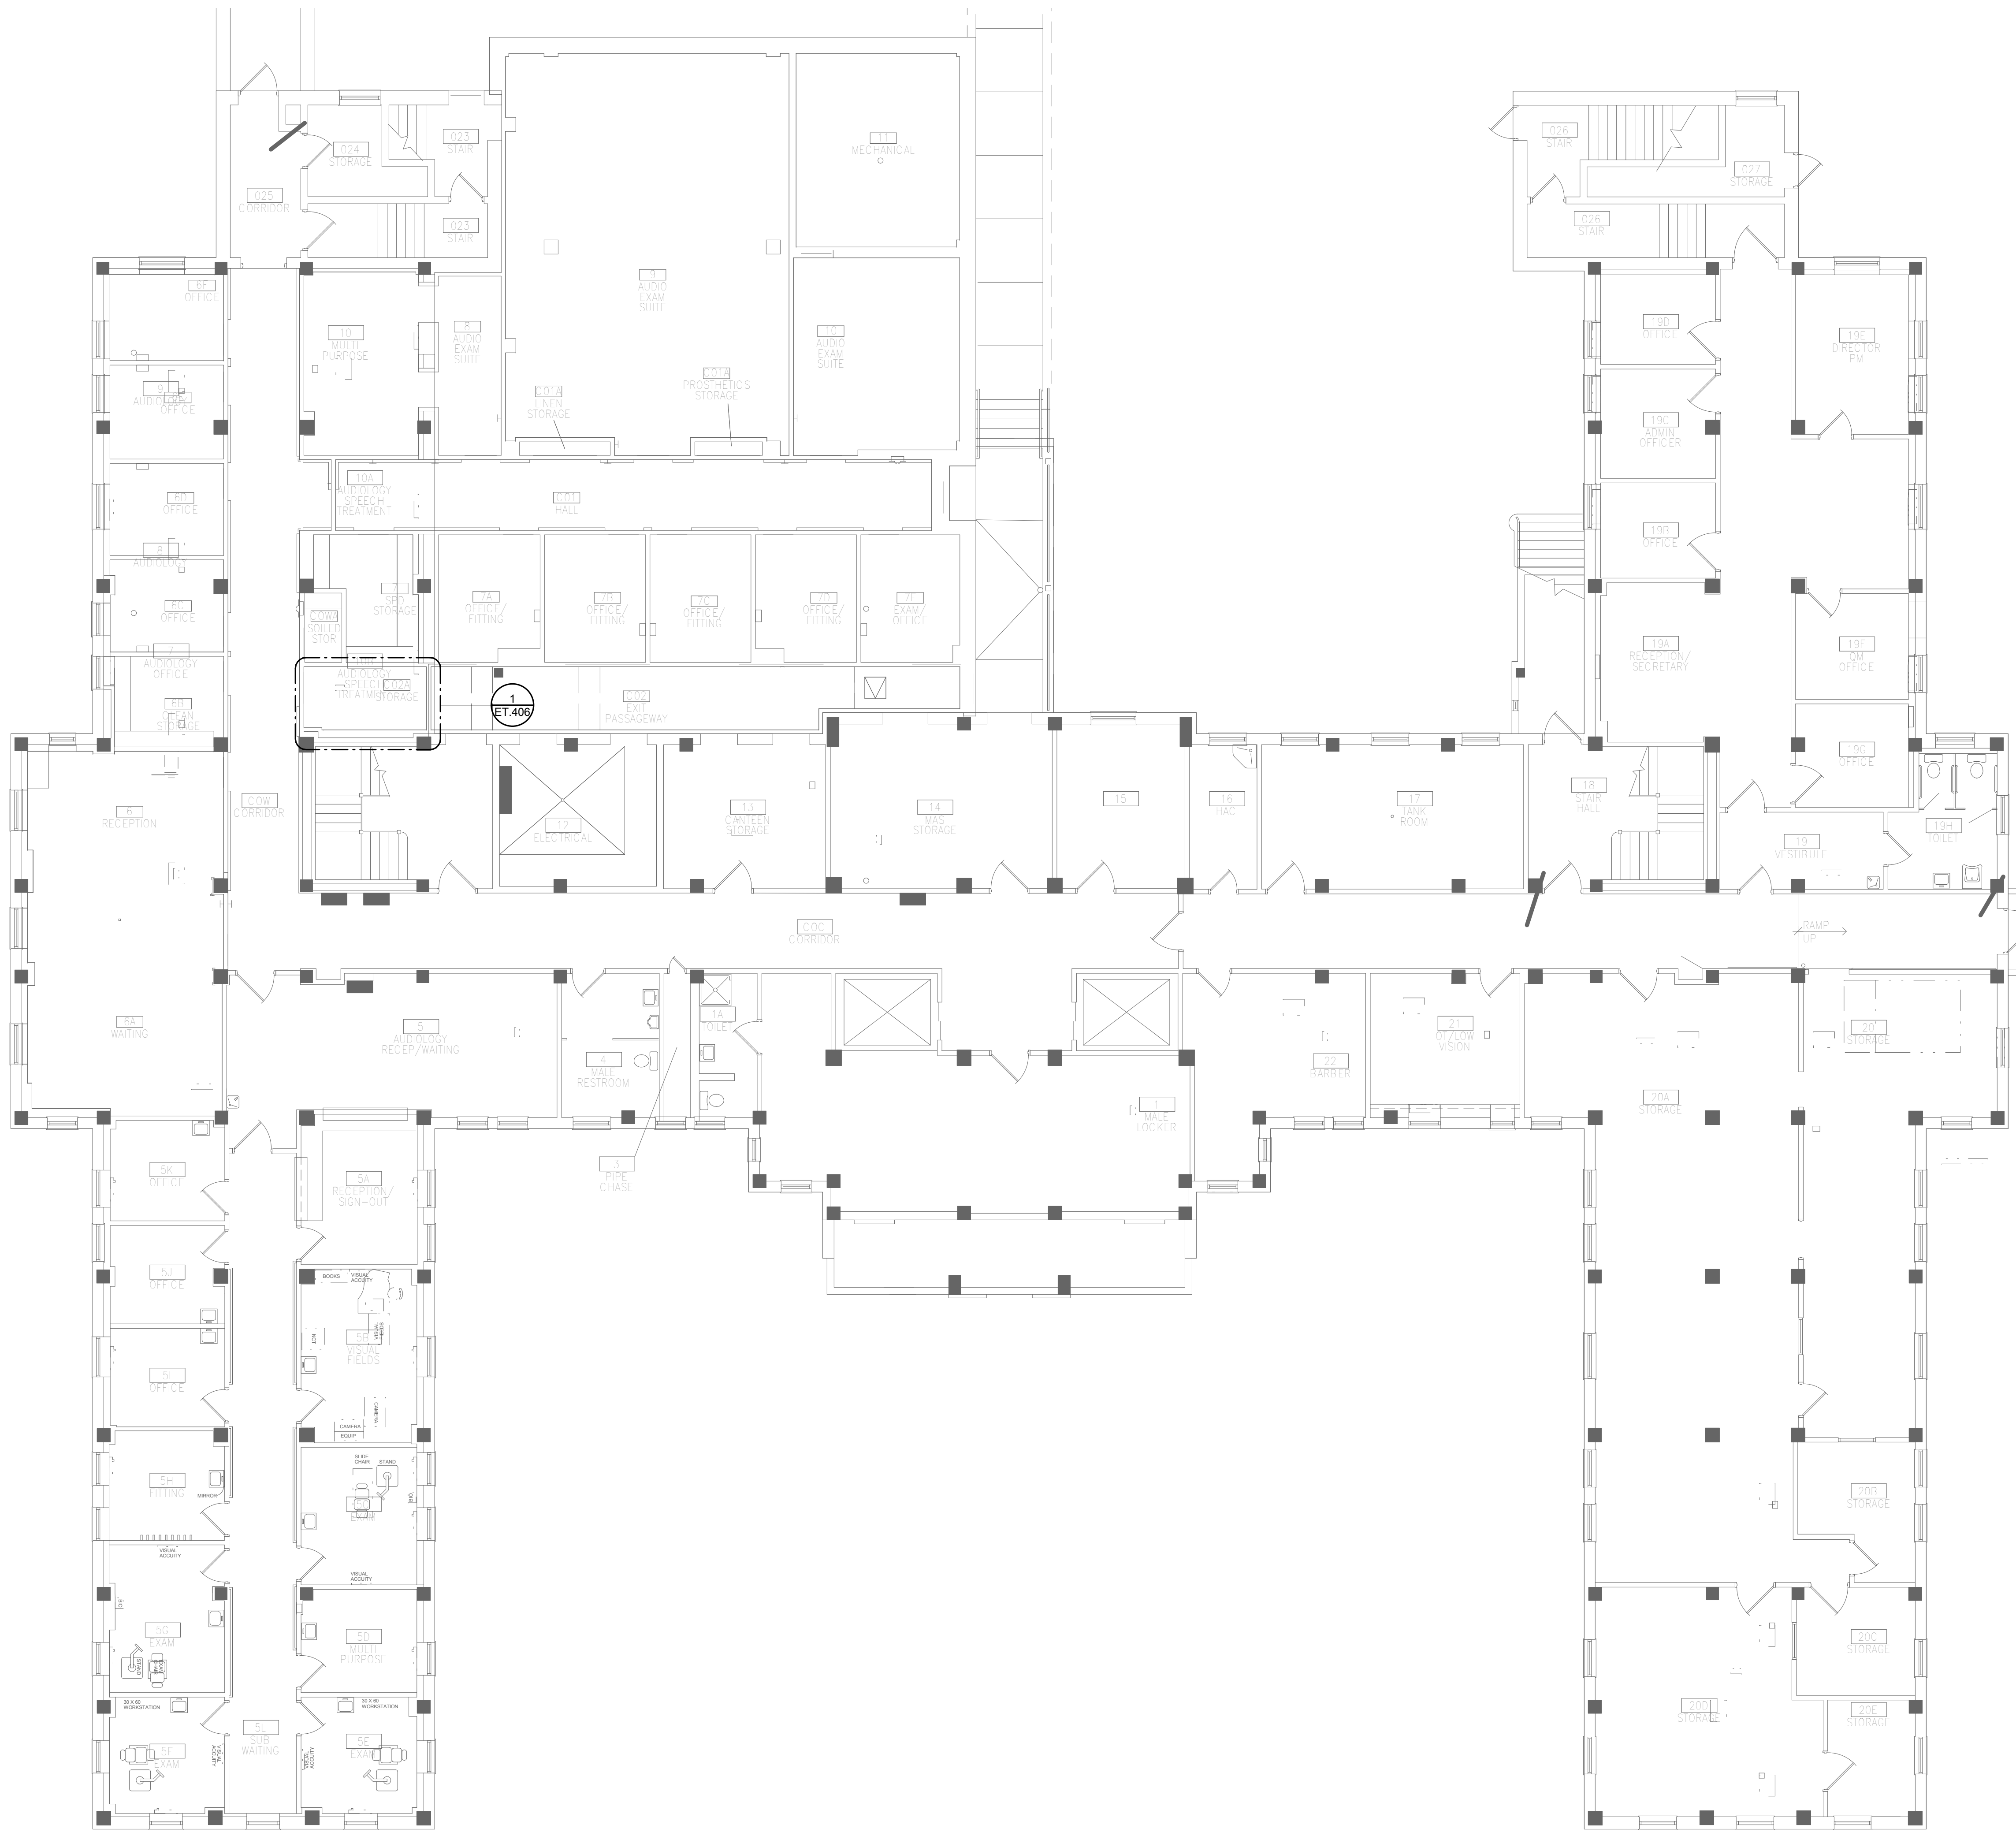

- GENERAL NOTES:**
- A. PRIOR TO BID, CONTRACTOR SHALL VISIT SITE AND REVIEW SCOPE OF WORK.
 - B. DEMOLITION, INSTALLATION AND TESTING SHALL BE DONE IN ACCORDANCE WITH SPECIFICATIONS.
 - C. PROVIDE PUBLIC ADDRESS SYSTEM MUTING RELAYS AT EACH LOCAL SOUND SYSTEM.
 - D. SPEAKERS TAGGED WITH "S" INDICATE SURFACE MOUNTED SPEAKERS. CONTRACTOR SHALL CONFIRM WALL/CEILING TYPES AND REQUIREMENTS FOR SURFACE MOUNT SPEAKERS PRIOR TO INSTALLATION.
 - E. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.
 - F. PROVIDE MINIMUM 3/4" BLUE EMT FOR PUBLIC ADDRESS SYSTEM SPEAKERS.

1 BUILDING 29 - PAGING SPEAKER FLOOR PLAN - BASEMENT FLOOR
1/8" = 1'-0"

1/24/2019 12:10:08 PM
C:\Revit\Projects\VA ST CLOUD PAGING_Elec_R12.dwg.plt

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)
DUNHAM
50 South Sixth Street / Suite 1100
Minneapolis, Minnesota 55402-1540
Phone: 612-465-7550 Fax: 612-465-7551
Web: dunhaminc.com
mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD
ANDERSON ENGINEERING
ENGINEERING • ARCHITECTURE • LAND SURVEYING
ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
Anderson Engineering of Minnesota, LLC
13605 1st Avenue North
Suite 100
Plymouth, MN 55441
763-412-4000 (o) 763-412-4090 (f)
www.ae-mn.com

STAMP
I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
Chris M. Pilliod
Signature
Name: Chris M. Pilliod, P.E.
Date: 1/24/19
Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE BUILDING 29 - PAGING SPEAKER FLOOR PLAN - BASEMENT
APPROVED ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
DATE:
APPROVED CHIEF OF STAFF
DATE:
APPROVED HEALTH CARE SYSTEM DIRECTOR
DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM	PROJECT NO.:
BUILDING No.:	CHECKED BY:
CP	CG
DRAWN:	ISSUE DATE:
CG	1/24/19
DATE:	DRAWING NO.:
LOCATION	ST. CLOUD, MN 56303
DATE:	ET29-00




U.S. Department of Veterans Affairs
Veterans Health Administration
St. Cloud VA Health Care System

GENERAL NOTES:

- A. PRIOR TO BID, CONTRACTOR SHALL VISIT SITE AND REVIEW SCOPE OF WORK.
- B. DEMOLITION, INSTALLATION AND TESTING SHALL BE DONE IN ACCORDANCE WITH SPECIFICATIONS.
- C. PROVIDE PUBLIC ADDRESS SYSTEM MUTING RELAYS AT EACH LOCAL SOUND SYSTEM.
- D. SPEAKERS TAGGED WITH "S" INDICATE SURFACE MOUNTED SPEAKERS. CONTRACTOR SHALL CONFIRM WALL/CEILING TYPES AND REQUIREMENTS FOR SURFACE MOUNT SPEAKERS PRIOR TO INSTALLATION.
- E. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.
- F. PROVIDE MINIMUM 3/4" BLUE EMT FOR PUBLIC ADDRESS SYSTEM SPEAKERS.

KEY NOTES:

- Ⓢ EXTEND EXISTING PUBLIC ADDRESS DUAL COIL CIRCUITS FEEDING THE TEMP T101 TRAILERS TO THE NEW PUBLIC ADDRESS SYSTEM AMPLIFIER LOCATION IN FA ROOM 10.

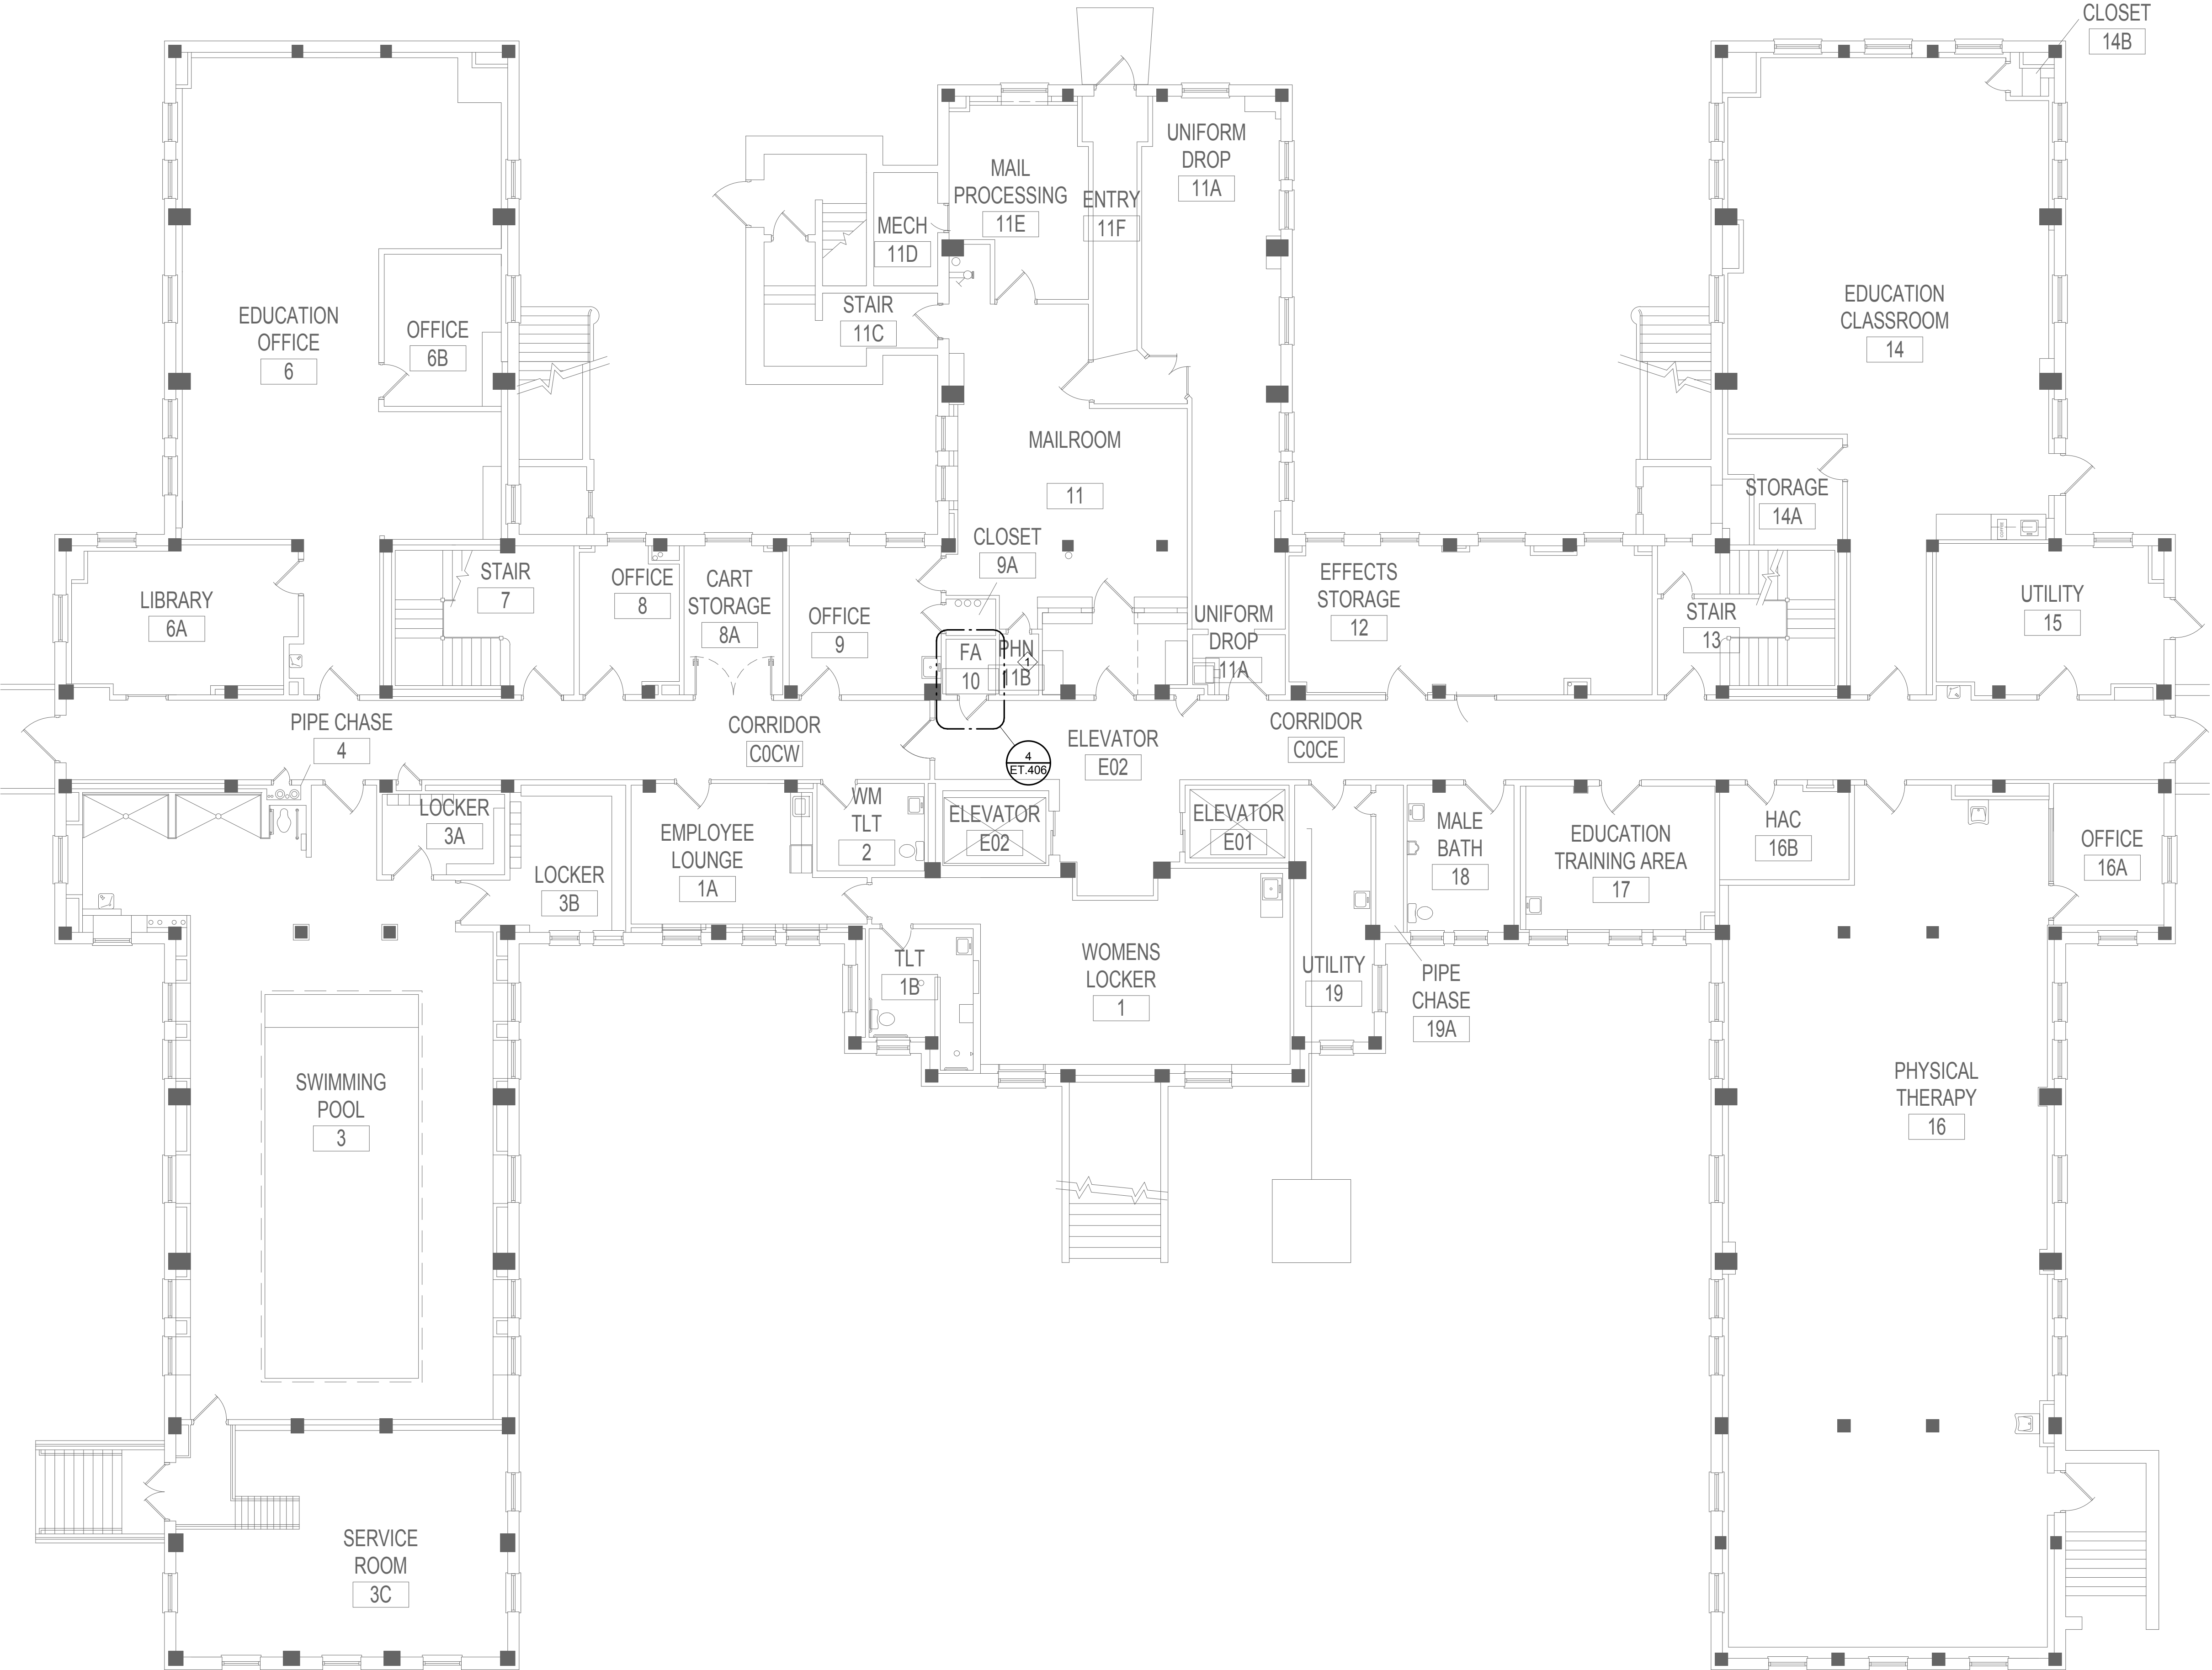

1 BUILDING 48 - PAGING SPEAKER FLOOR PLAN - BASEMENT
1/8" = 1'-0"

1/24/2019 12:10:07 PM
C:\Revit\Projects\VA ST CLOUD PAGING_Bldg_R12.dwg

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

 DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:


DRAWING TITLE
BUILDING 48 - PAGING SPEAKER FLOOR PLAN - BASEMENT
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:
 APPROVED: CHIEF OF STAFF
 DATE:
 APPROVED: HEALTH CARE SYSTEM DIRECTOR
 DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PLOT SCALE	
PROJECT NO.		ISSUE DATE	
BUILDING No.	CHECKED BY	DRAWN	DATE
	CP	CG	1/24/19
LOCATION VA MEDICAL CENTER ST. CLOUD, MN 56303		DRAWING NO. ET48-00	

VA
U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

GENERAL NOTES:

- A. PRIOR TO BID, CONTRACTOR SHALL VISIT SITE AND REVIEW SCOPE OF WORK.
- B. DEMOLITION, INSTALLATION AND TESTING SHALL BE DONE IN ACCORDANCE WITH SPECIFICATIONS.
- C. PROVIDE PUBLIC ADDRESS SYSTEM MUTING RELAYS AT EACH LOCAL SOUND SYSTEM.
- D. SPEAKERS TAGGED WITH "S" INDICATE SURFACE MOUNTED SPEAKERS. CONTRACTOR SHALL CONFIRM WALL/CEILING TYPES AND REQUIREMENTS FOR SURFACE MOUNT SPEAKERS PRIOR TO INSTALLATION.
- E. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.
- F. PROVIDE MINIMUM 3/4" BLUE EMT FOR PUBLIC ADDRESS SYSTEM SPEAKERS.

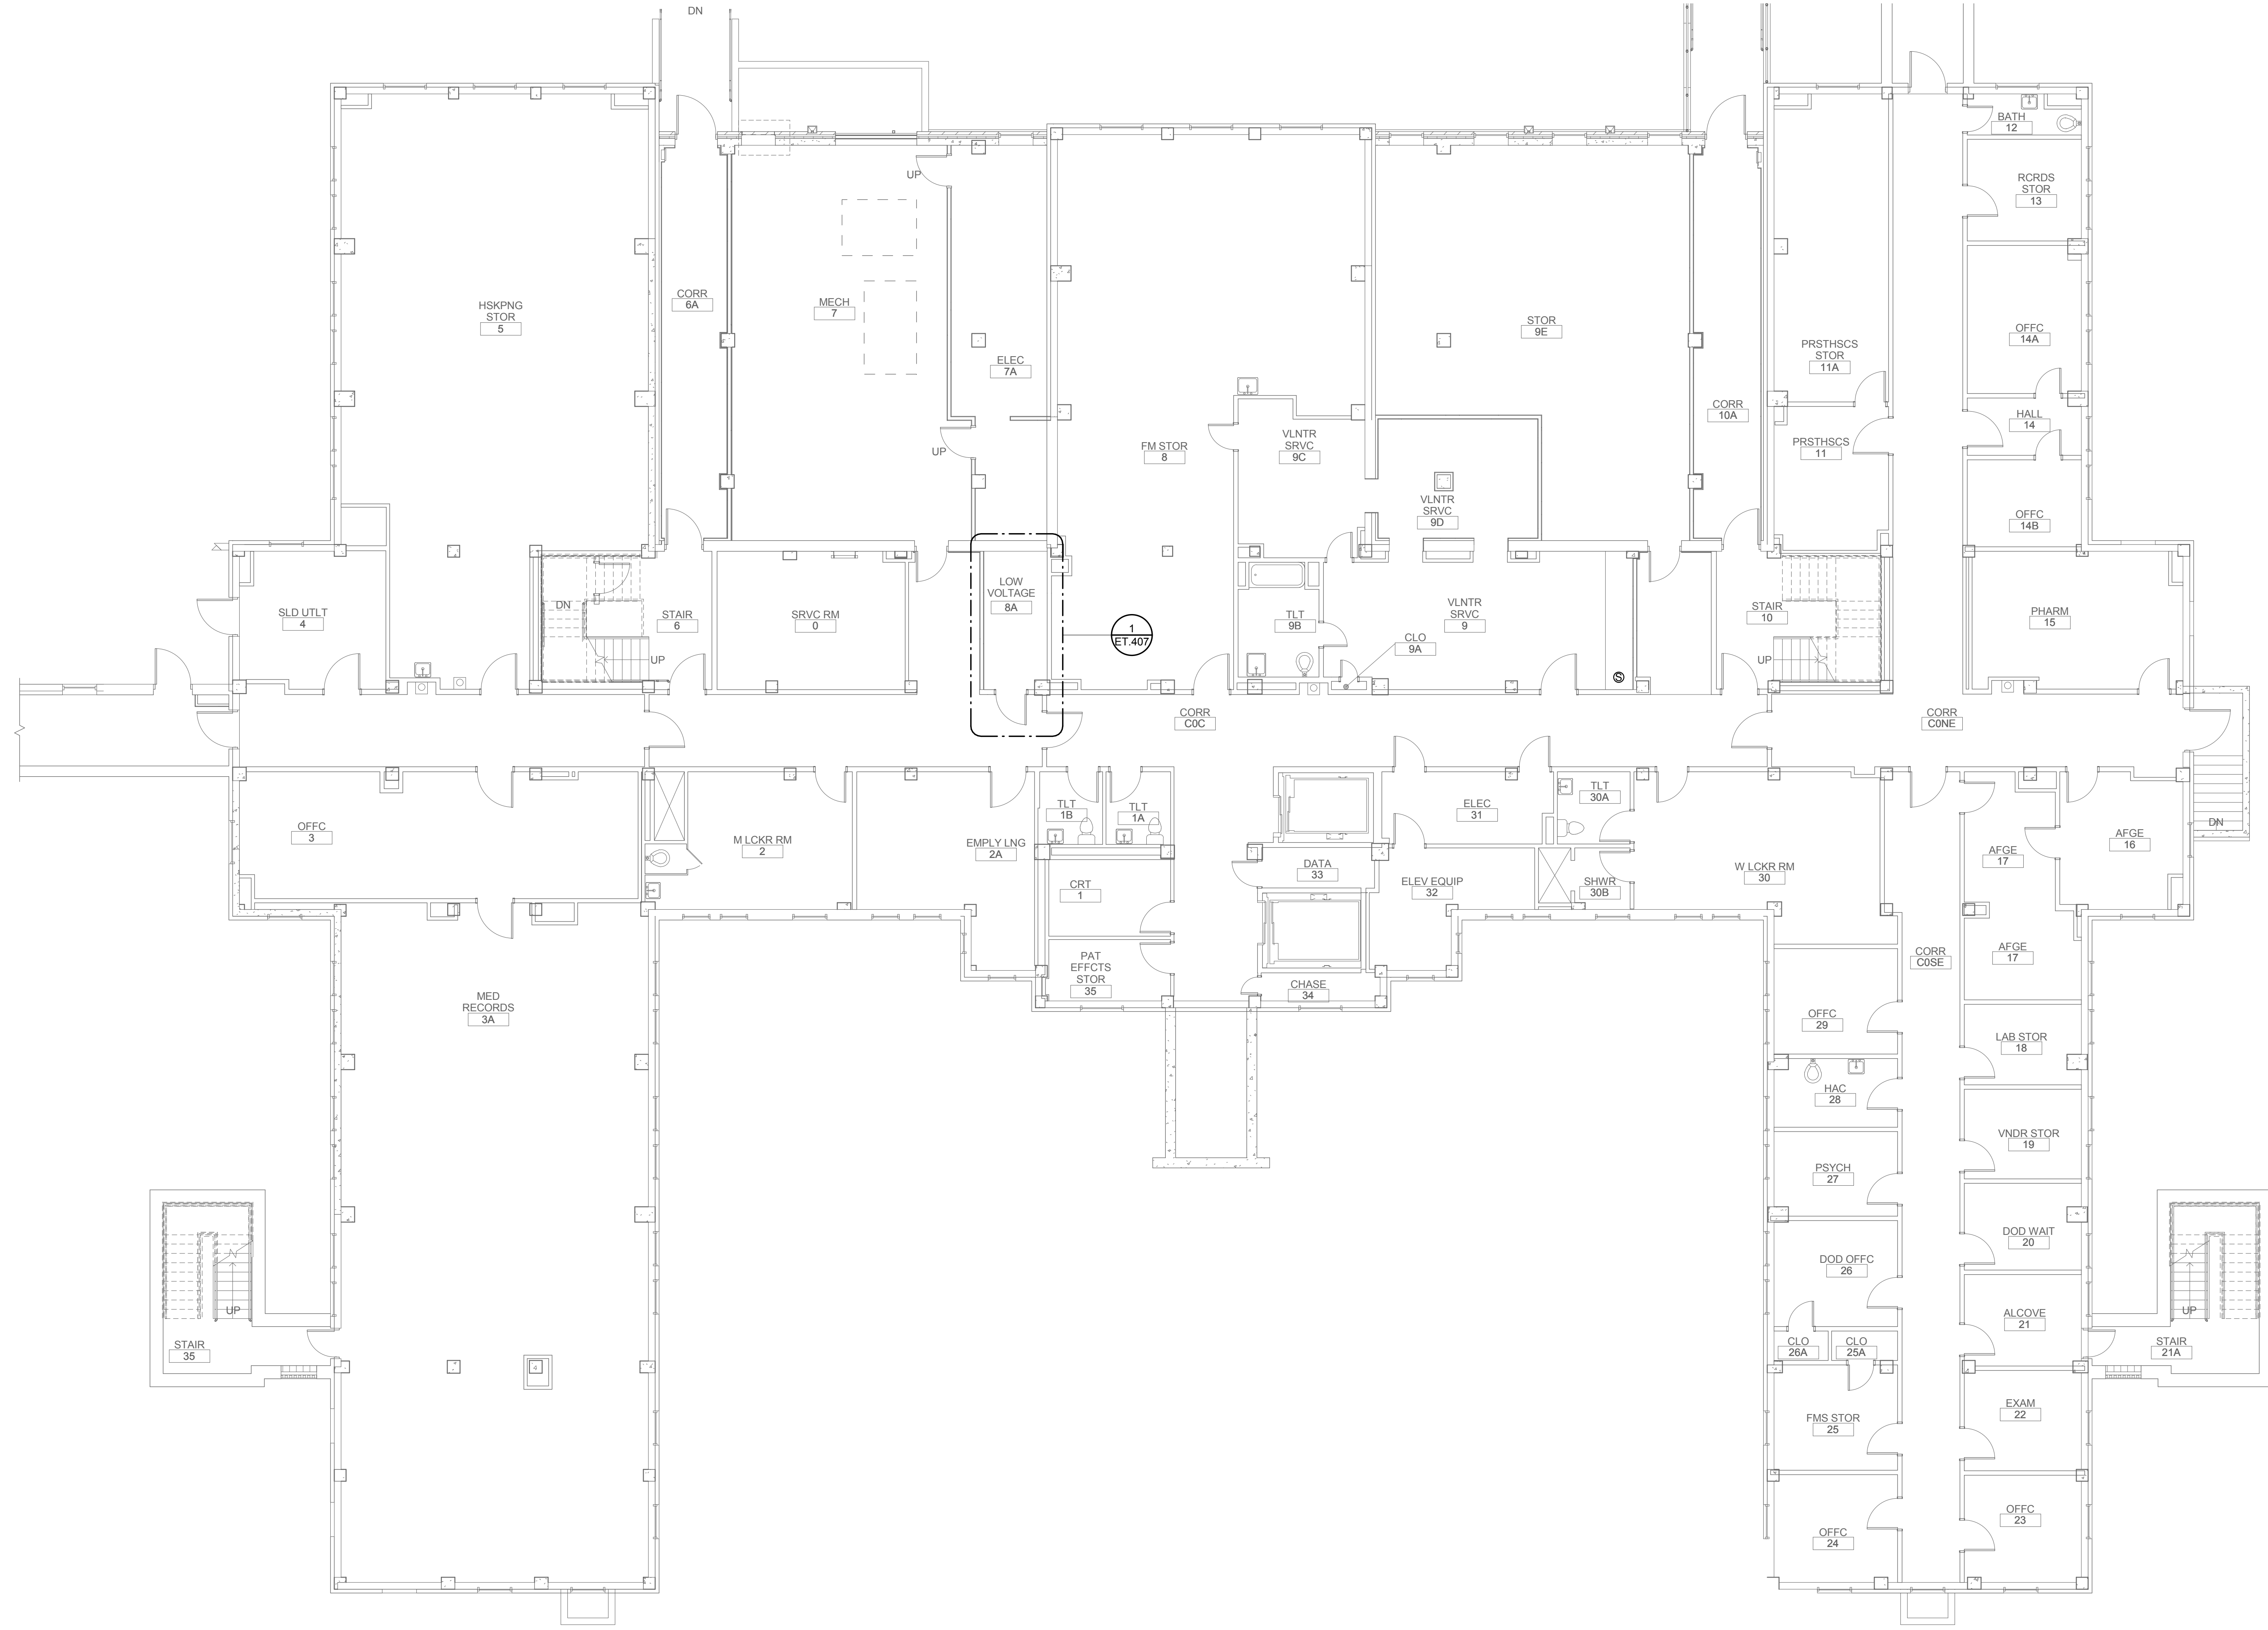

1 BUILDING 49 - PAGING SPEAKER FLOOR PLAN - BASEMENT
1/8" = 1'-0"

C:\Revit\Projects\VA ST CLOUD PAGING_Elec_R1E.dwg 1/24/2019 12:10:07 PM

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

 DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Piliod*
 Name: Chris M. Piliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE BUILDING 49 - PAGING SPEAKER FLOOR PLAN - BASEMENT
APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
DATE:
APPROVED: CHIEF OF STAFF
DATE:
APPROVED: HEALTH CARE SYSTEM DIRECTOR
DATE:


PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM	PROJECT NO.:
DATE:	
BUILDING No.:	CHECKED BY: CP
DATE:	DRAWN: CG
LOCATION VA MEDICAL CENTER ST. CLOUD, MN 56303	ISSUE DATE 1/24/19
DATE:	DRAWING NO. ET49-00



U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

GENERAL NOTES:

- A. PRIOR TO BID, CONTRACTOR SHALL VISIT SITE AND REVIEW SCOPE OF WORK.
- B. DEMOLITION, INSTALLATION AND TESTING SHALL BE DONE IN ACCORDANCE WITH SPECIFICATIONS.
- C. PROVIDE PUBLIC ADDRESS SYSTEM MUTING RELAYS AT EACH LOCAL SOUND SYSTEM.
- D. SPEAKERS TAGGED WITH "S" INDICATE SURFACE MOUNTED SPEAKERS. CONTRACTOR SHALL CONFIRM WALL/CEILING TYPES AND REQUIREMENTS FOR SURFACE MOUNT SPEAKERS PRIOR TO INSTALLATION.
- E. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.
- F. PROVIDE MINIMUM 3/4" BLUE EMT FOR PUBLIC ADDRESS SYSTEM SPEAKERS.

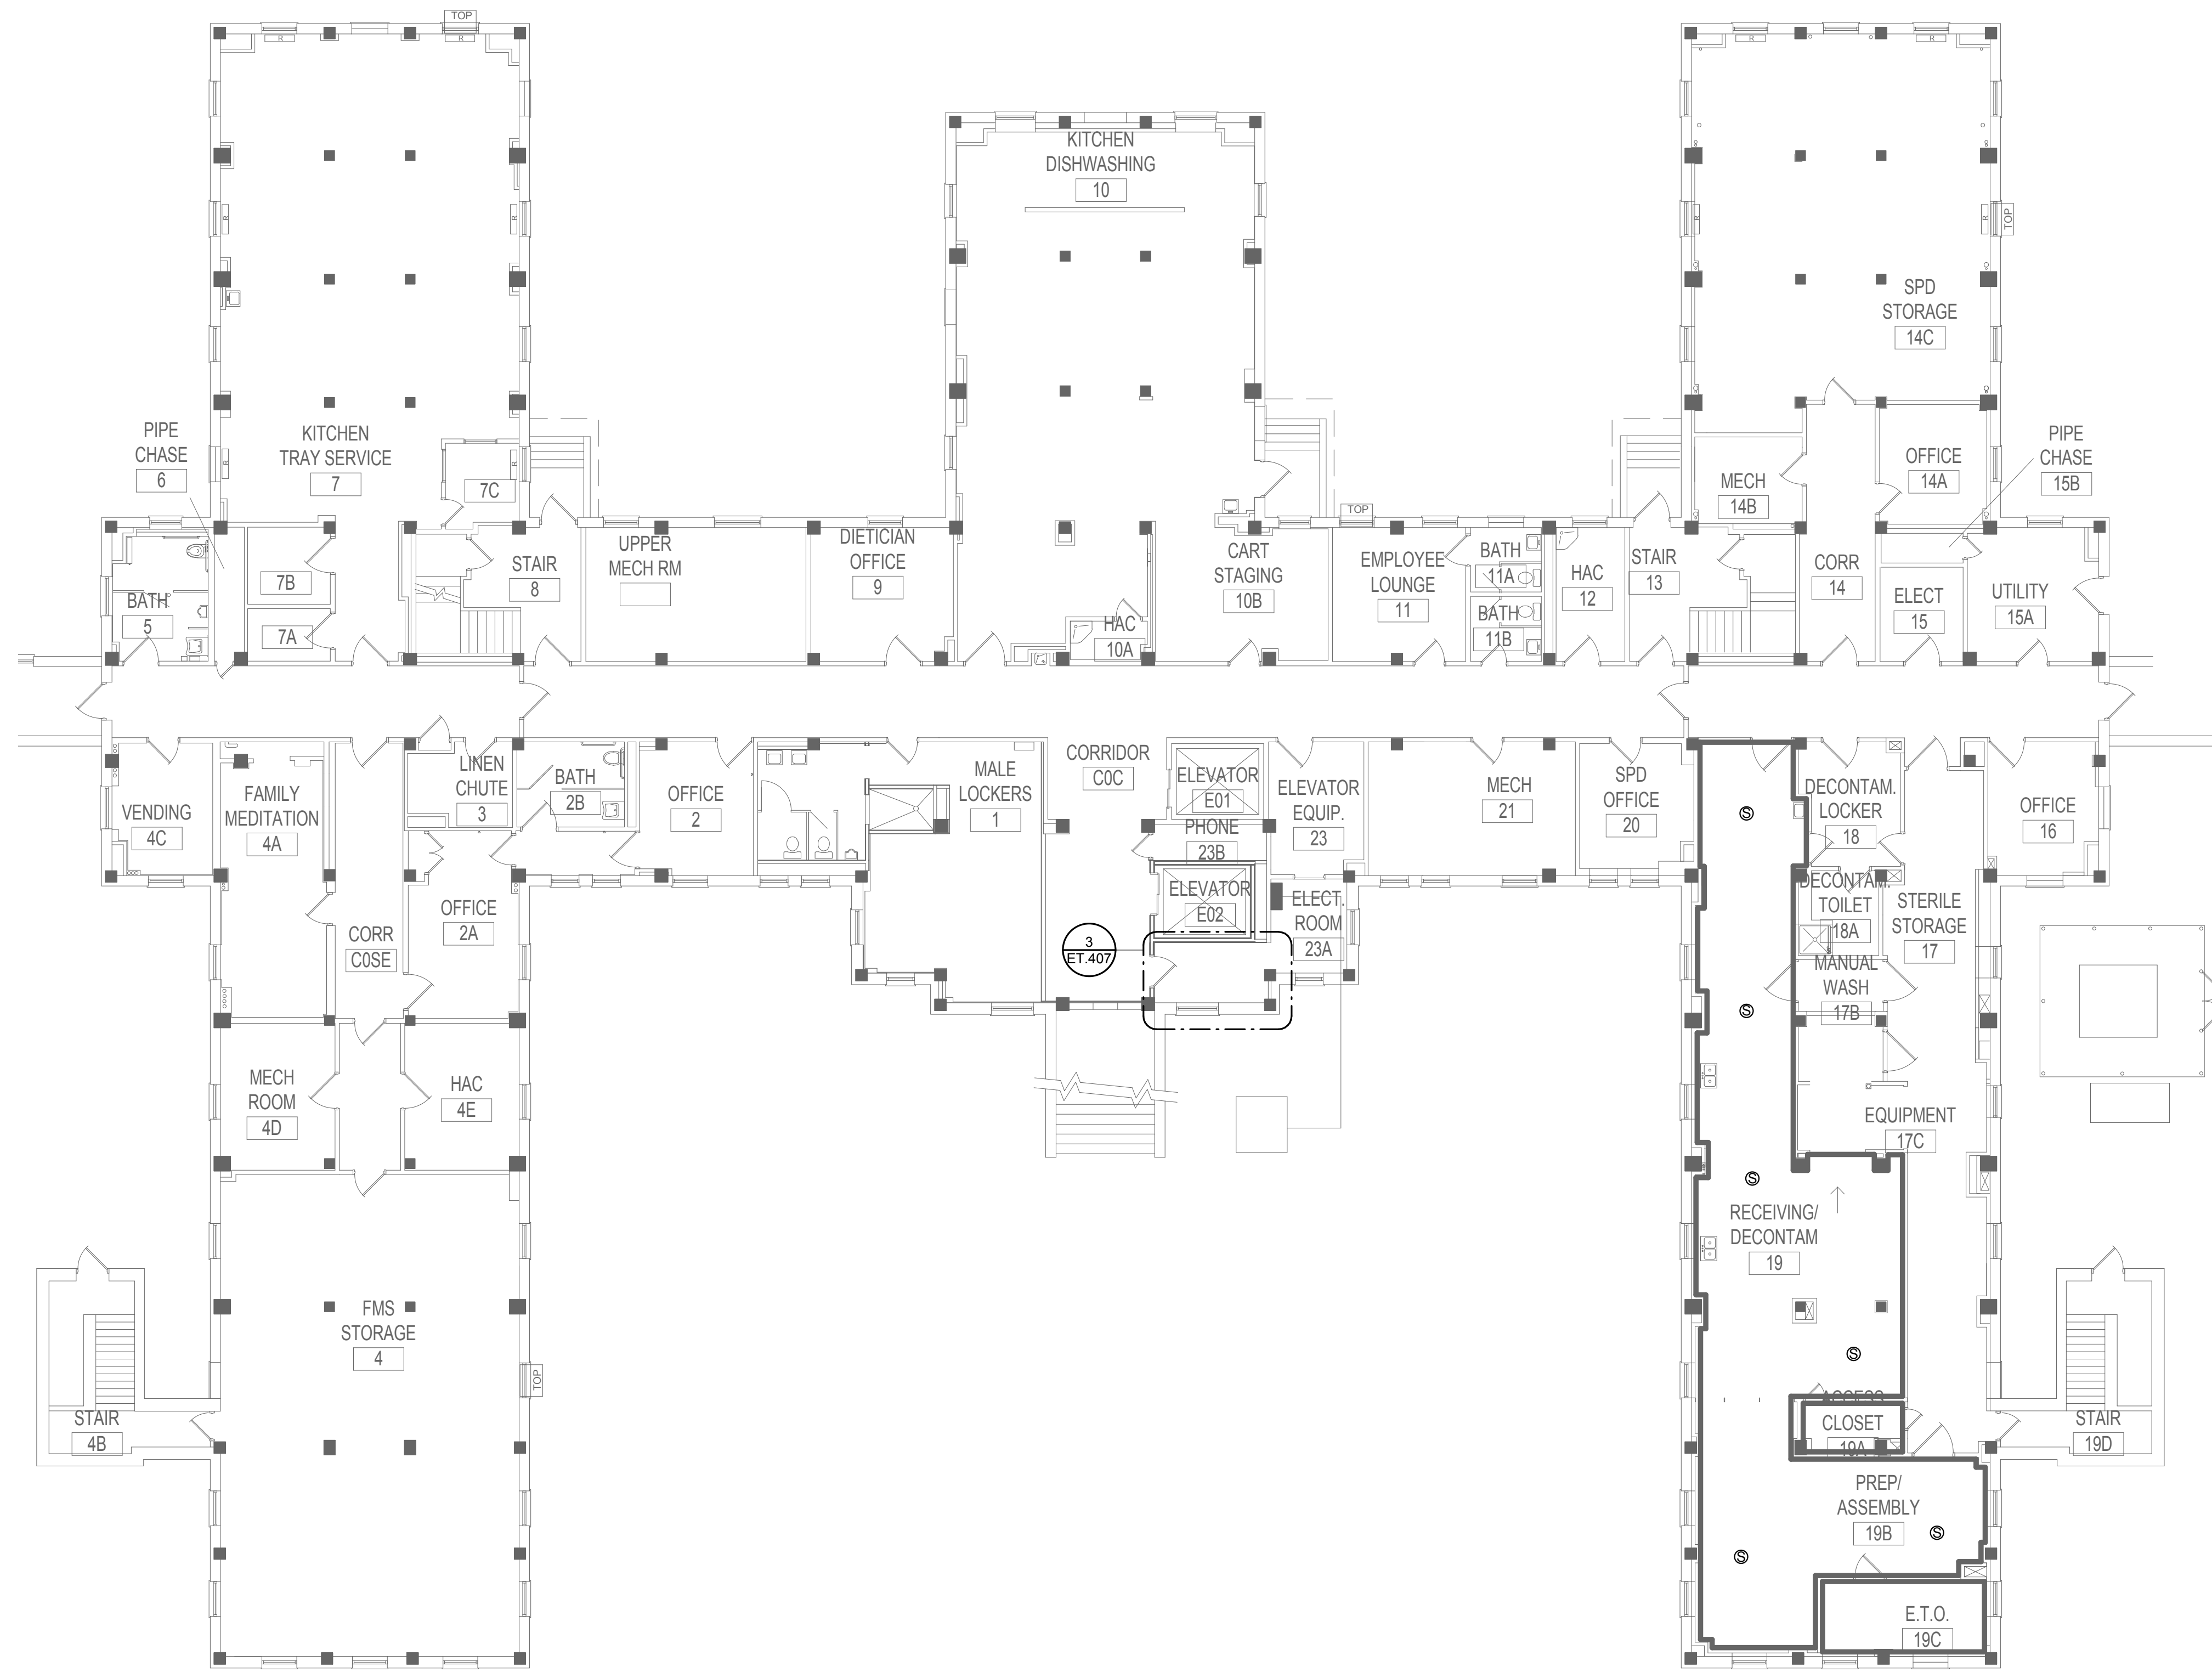

1 BUILDING 50 - PAGING SPEAKER FLOOR PLAN - BASEMENT
3/32" = 1'-0"

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)
DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD
ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE
BUILDING 50 - PAGING SPEAKER FLOOR PLAN - BASEMENT
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:
 APPROVED: CHIEF OF STAFF
 DATE:
 APPROVED: HEALTH CARE SYSTEM DIRECTOR
 DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PLOT SCALE	
PROJECT NO.		ISSUE DATE	
BUILDING No.	CHECKED BY	DRAWN	DATE
	CP	CG	1/24/19
LOCATION VA MEDICAL CENTER ST. CLOUD, MN 56303		DRAWING NO. ET50-00	

VA

U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System


C:\Revit\Projects\VA ST CLOUD PAGING_Elec_R12_cmg.rvt 1/24/2019 12:10:58 PM

GENERAL NOTES:

- A. PRIOR TO BID, CONTRACTOR SHALL VISIT SITE AND REVIEW SCOPE OF WORK.
- B. DEMOLITION, INSTALLATION AND TESTING SHALL BE DONE IN ACCORDANCE WITH SPECIFICATIONS.
- C. PROVIDE PUBLIC ADDRESS SYSTEM MUTING RELAYS AT EACH LOCAL SOUND SYSTEM.
- D. SPEAKERS TAGGED WITH "S" INDICATE SURFACE MOUNTED SPEAKERS. CONTRACTOR SHALL CONFIRM WALL/CEILING TYPES AND REQUIREMENTS FOR SURFACE MOUNT SPEAKERS PRIOR TO INSTALLATION.
- E. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.
- F. PROVIDE MINIMUM 3/4" BLUE EMT FOR PUBLIC ADDRESS SYSTEM SPEAKERS.

KEY NOTES:

① ~~PROVIDE PUBLIC ADDRESS SYSTEM ADMINISTRATION PHONE. PROVIDE INTERFACE TO HEADEND EQUIPMENT LOCATED IN BASEMENT. INSTALL AS A WALL-MOUNT DEVICE ON COLUMN, 48" AFF.~~

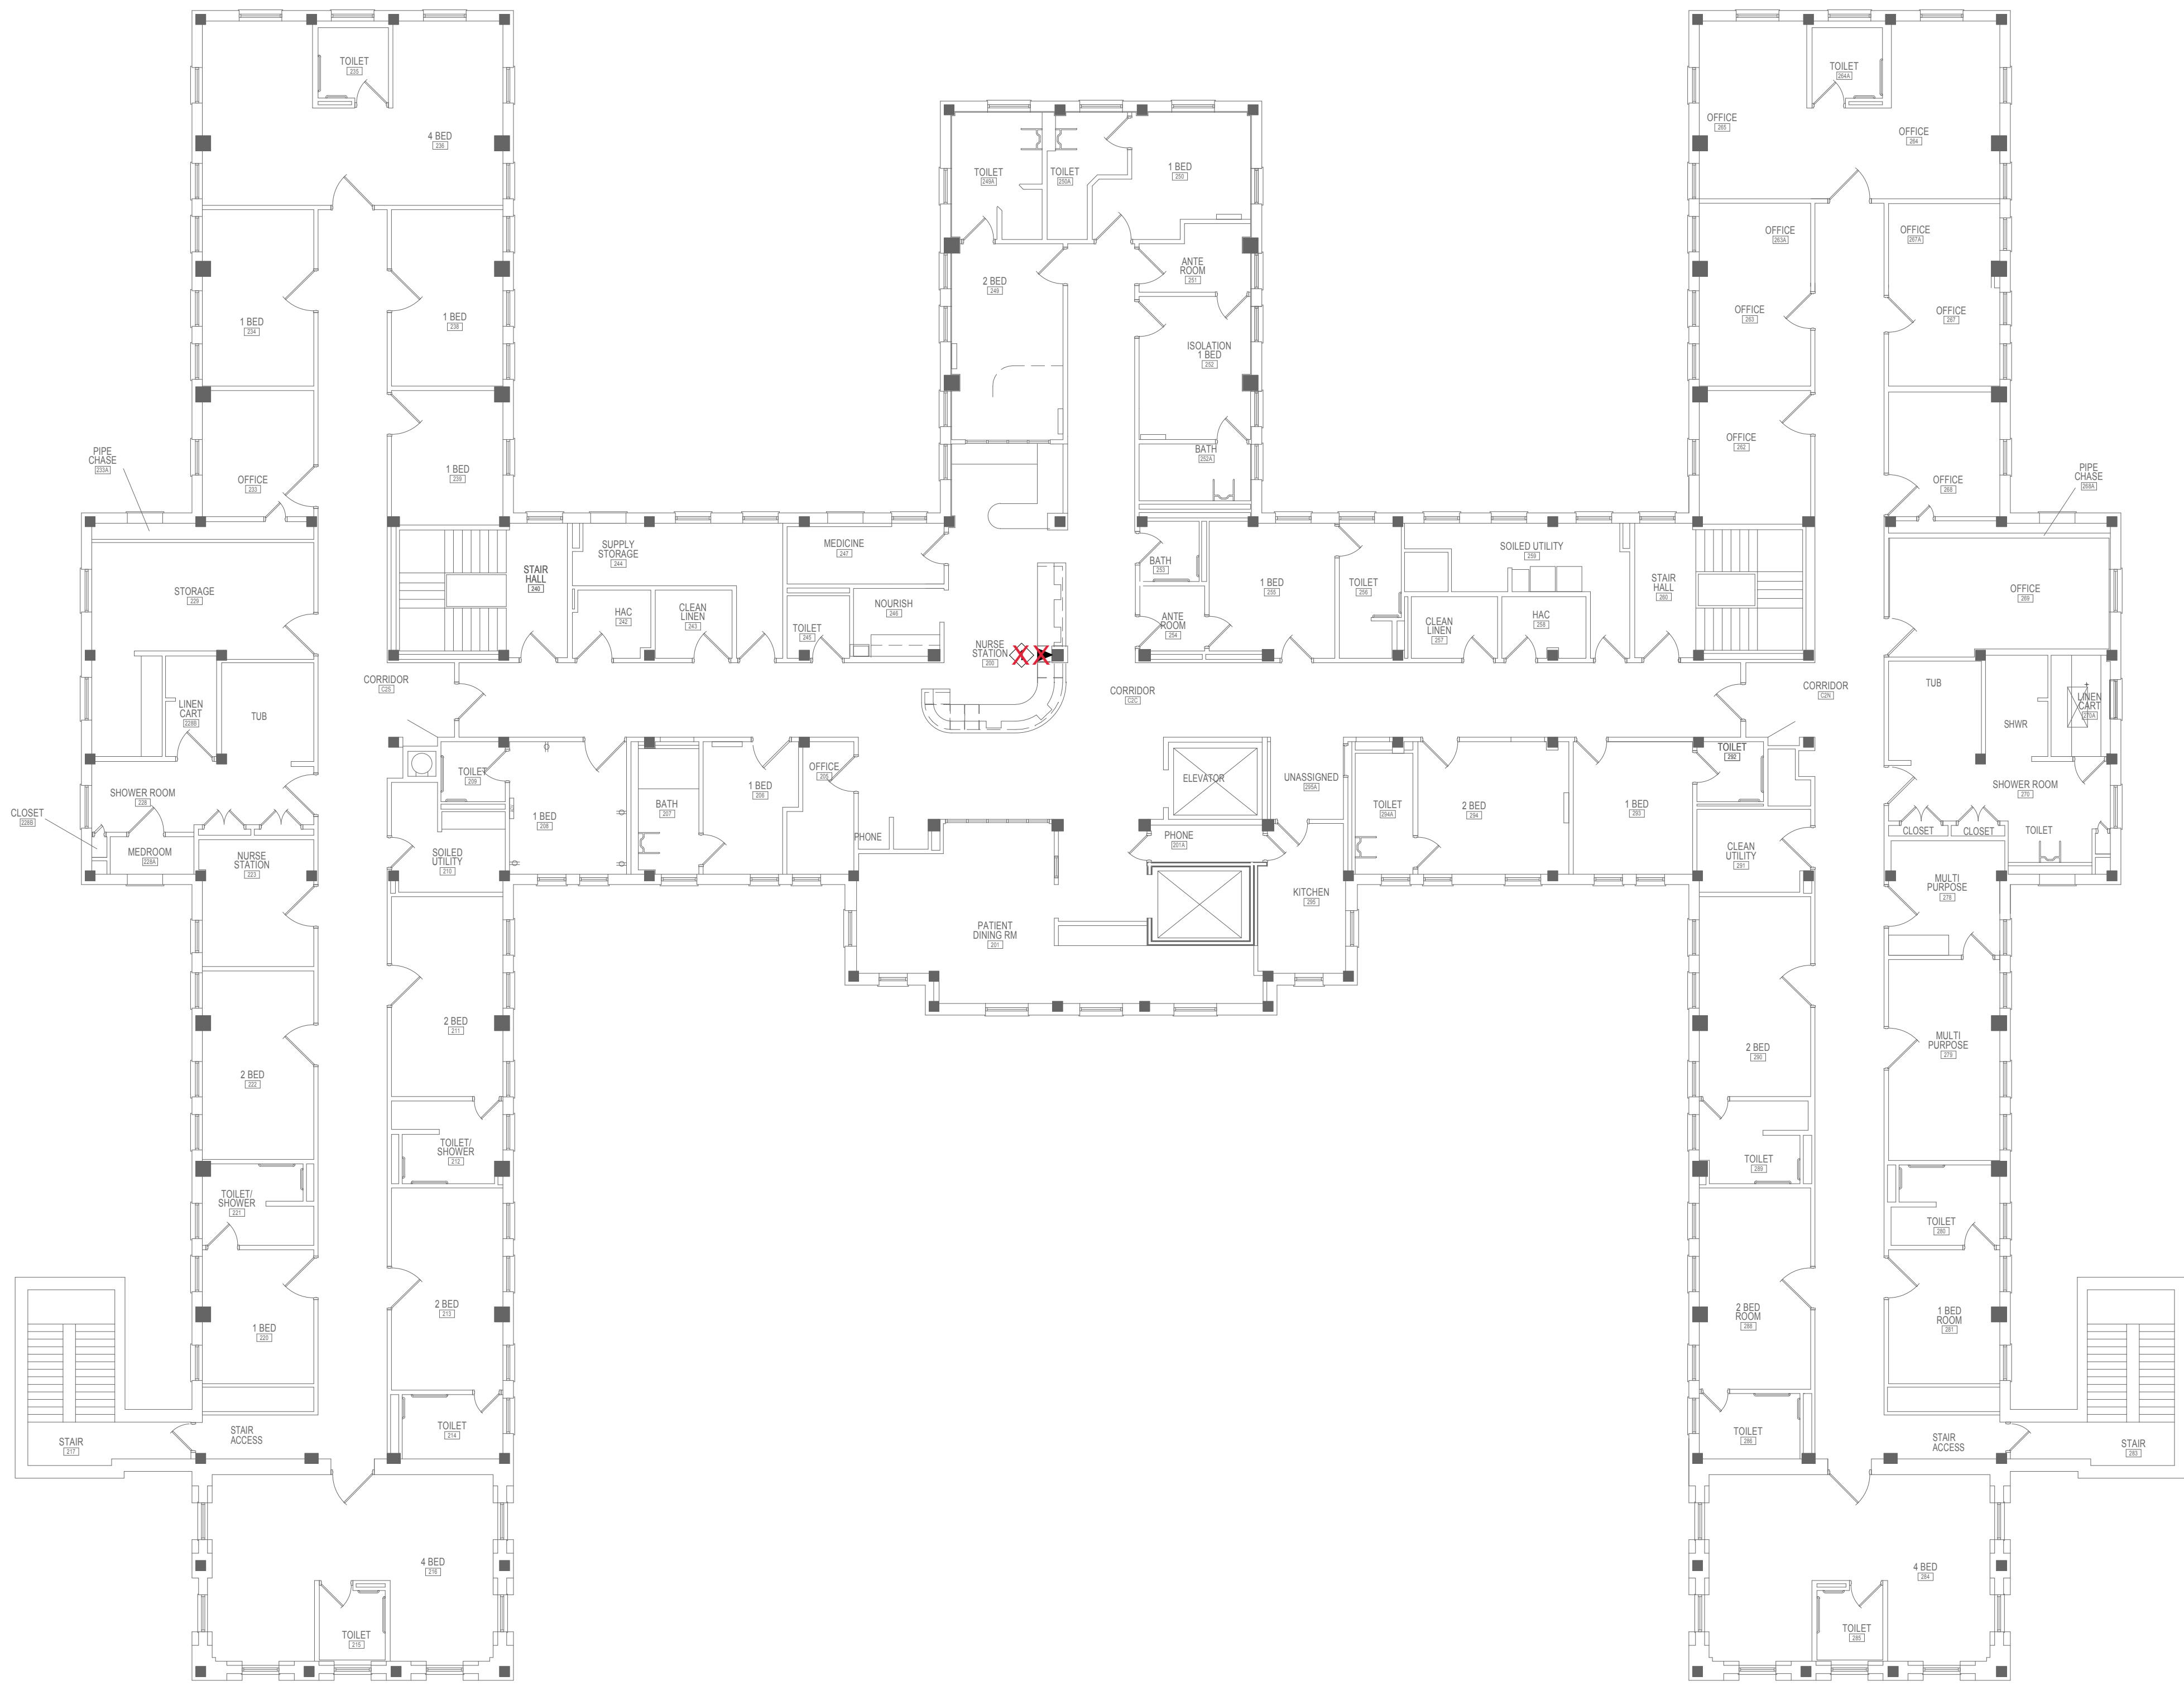

① BUILDING 50 - PAGING SPEAKER FLOOR PLAN - SECOND FLOOR
3/32" = 1'-0"

C:\Revit\Projects\VA ST CLOUD PAGING_Elec_R12.dwg 1/24/2019 12:09 PM

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com
AE PROJECT NUMBER: Project Number

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Piliod*
 Name: Chris M. Piliod, P.E.
 Date: 1/24/19
 Registration Number: 50826


APPROVED: SERVICE LINE DIRECTOR	DATE	APPROVED: INFECTION CONTROL NURSE	DATE
APPROVED: GEMS COORDINATOR	DATE	APPROVED: PATIENT SAFETY	DATE
APPROVED: PROJECTS SECTION MANAGER	DATE	APPROVED: CHIEF OF POLICE	DATE
APPROVED: DIRECTOR FMS	DATE	APPROVED: SAFETY MANAGER	DATE

DRAWING TITLE
BUILDING 50 - PAGING SPEAKER FLOOR PLAN - SECOND FLOOR
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE
 APPROVED: CHIEF OF STAFF
 DATE
 APPROVED: HEALTH CARE SYSTEM DIRECTOR
 DATE

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PLOT SCALE	
PROJECT NO.		ISSUE DATE	
BUILDING No.	CHECKED BY	DRAWN	DATE
	CP	CG	1/24/19
LOCATION VA MEDICAL CENTER ST. CLOUD, MN 56303		DRAWING NO. ET50-02	

VA

U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

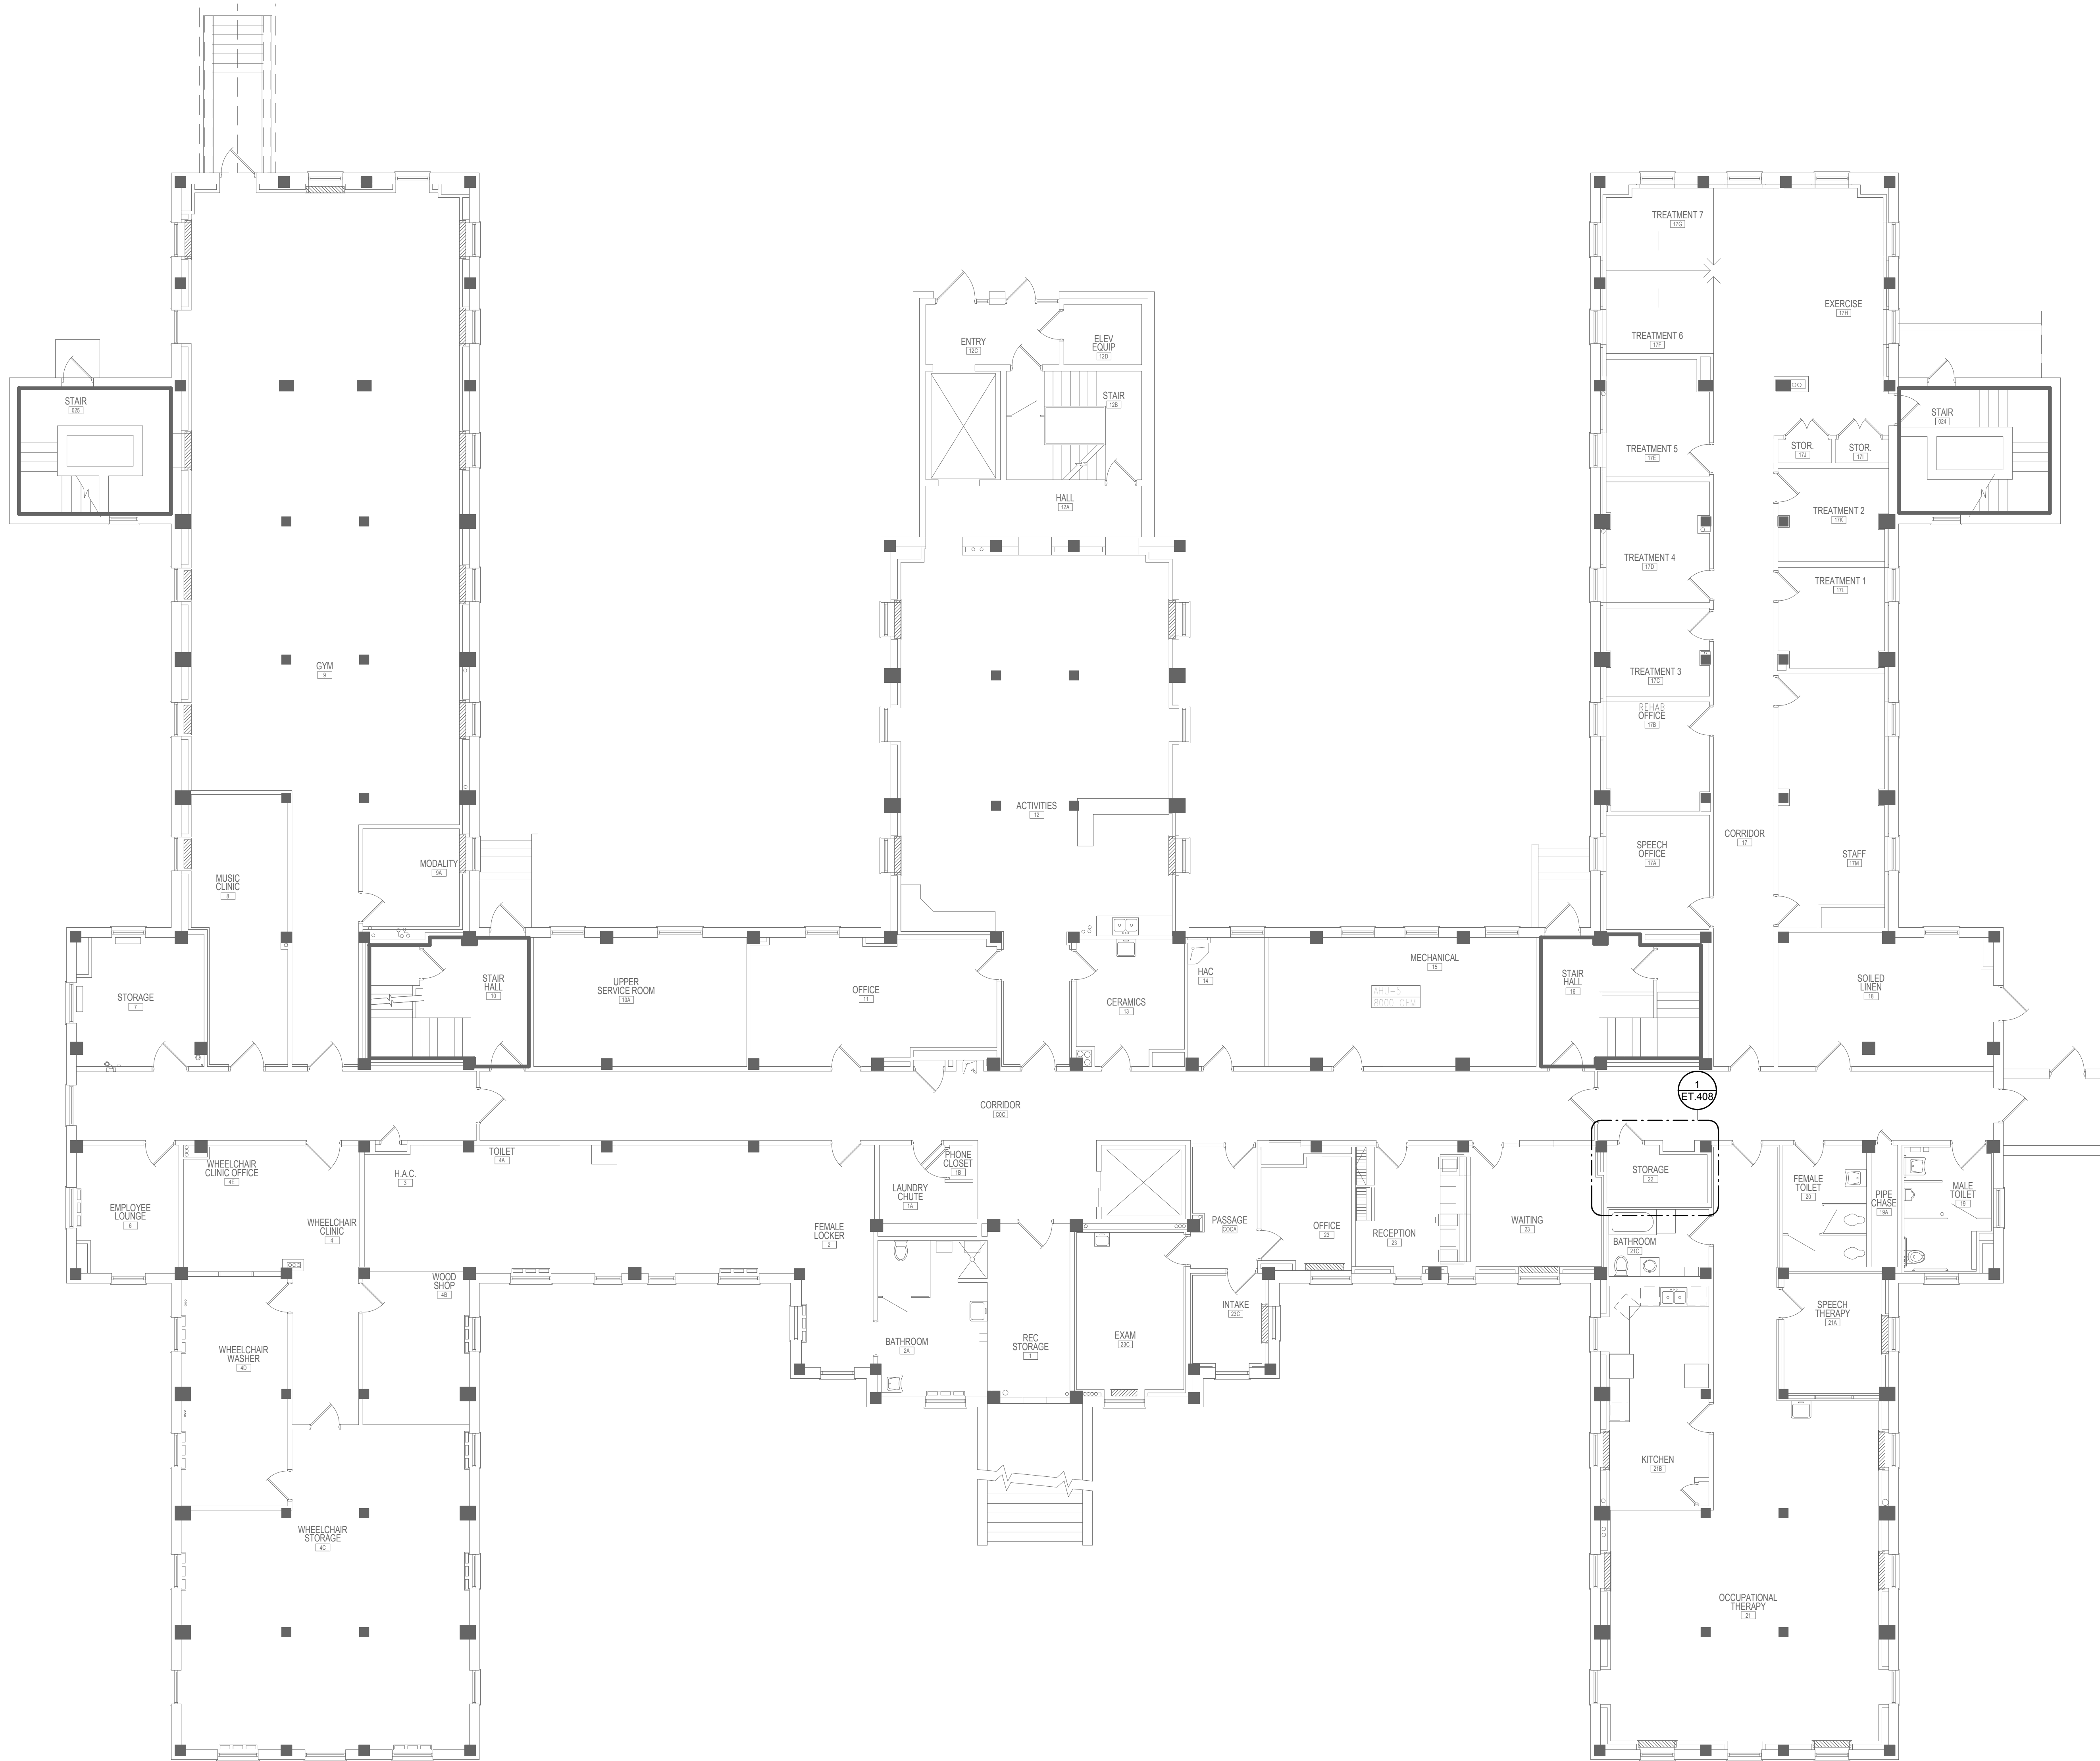

- GENERAL NOTES:**
- A. PRIOR TO BID, CONTRACTOR SHALL VISIT SITE AND REVIEW SCOPE OF WORK.
 - B. DEMOLITION, INSTALLATION AND TESTING SHALL BE DONE IN ACCORDANCE WITH SPECIFICATIONS.
 - C. PROVIDE PUBLIC ADDRESS SYSTEM MUTING RELAYS AT EACH LOCAL SOUND SYSTEM.
 - D. SPEAKERS TAGGED WITH "S" INDICATE SURFACE MOUNTED SPEAKERS. CONTRACTOR SHALL CONFIRM WALL/CEILING TYPES AND REQUIREMENTS FOR SURFACE MOUNT SPEAKERS PRIOR TO INSTALLATION.
 - E. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.
 - F. PROVIDE MINIMUM 3/4" BLUE EMT FOR PUBLIC ADDRESS SYSTEM SPEAKERS.

1 BUILDING 51 - PAGING SPEAKER FLOOR PLAN - FIRST FLOOR
1/8" = 1'-0"

1/24/2019 11:21:09 PM

C:\Revit\Projects\VA ST CLOUD PAGING_Bldg_R12.dwg

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Piliod*
 Name: Chris M. Piliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE
BUILDING 51 - PAGING SPEAKER FLOOR PLAN - FIRST FLOOR
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:
 APPROVED: CHIEF OF STAFF
 DATE:
 APPROVED: HEALTH CARE SYSTEM DIRECTOR
 DATE:


PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PLOT SCALE	
PROJECT NO.		DATE	
BUILDING No.	CHECKED BY	DRAWN	ISSUE DATE
	CP	CG	1/24/19
LOCATION	DATE	DRAWING NO.	
VA MEDICAL CENTER ST. CLOUD, MN 56303		ET51-01	



U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

GENERAL NOTES:

- A. PRIOR TO BID, CONTRACTOR SHALL VISIT SITE AND REVIEW SCOPE OF WORK.
- B. DEMOLITION, INSTALLATION AND TESTING SHALL BE DONE IN ACCORDANCE WITH SPECIFICATIONS.
- C. PROVIDE PUBLIC ADDRESS SYSTEM MUTING RELAYS AT EACH LOCAL SOUND SYSTEM.
- D. SPEAKERS TAGGED WITH "S" INDICATE SURFACE MOUNTED SPEAKERS. CONTRACTOR SHALL CONFIRM WALL/CEILING TYPES AND REQUIREMENTS FOR SURFACE MOUNT SPEAKERS PRIOR TO INSTALLATION.
- E. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.
- F. PROVIDE MINIMUM 3/4" BLUE EMT FOR PUBLIC ADDRESS SYSTEM SPEAKERS.

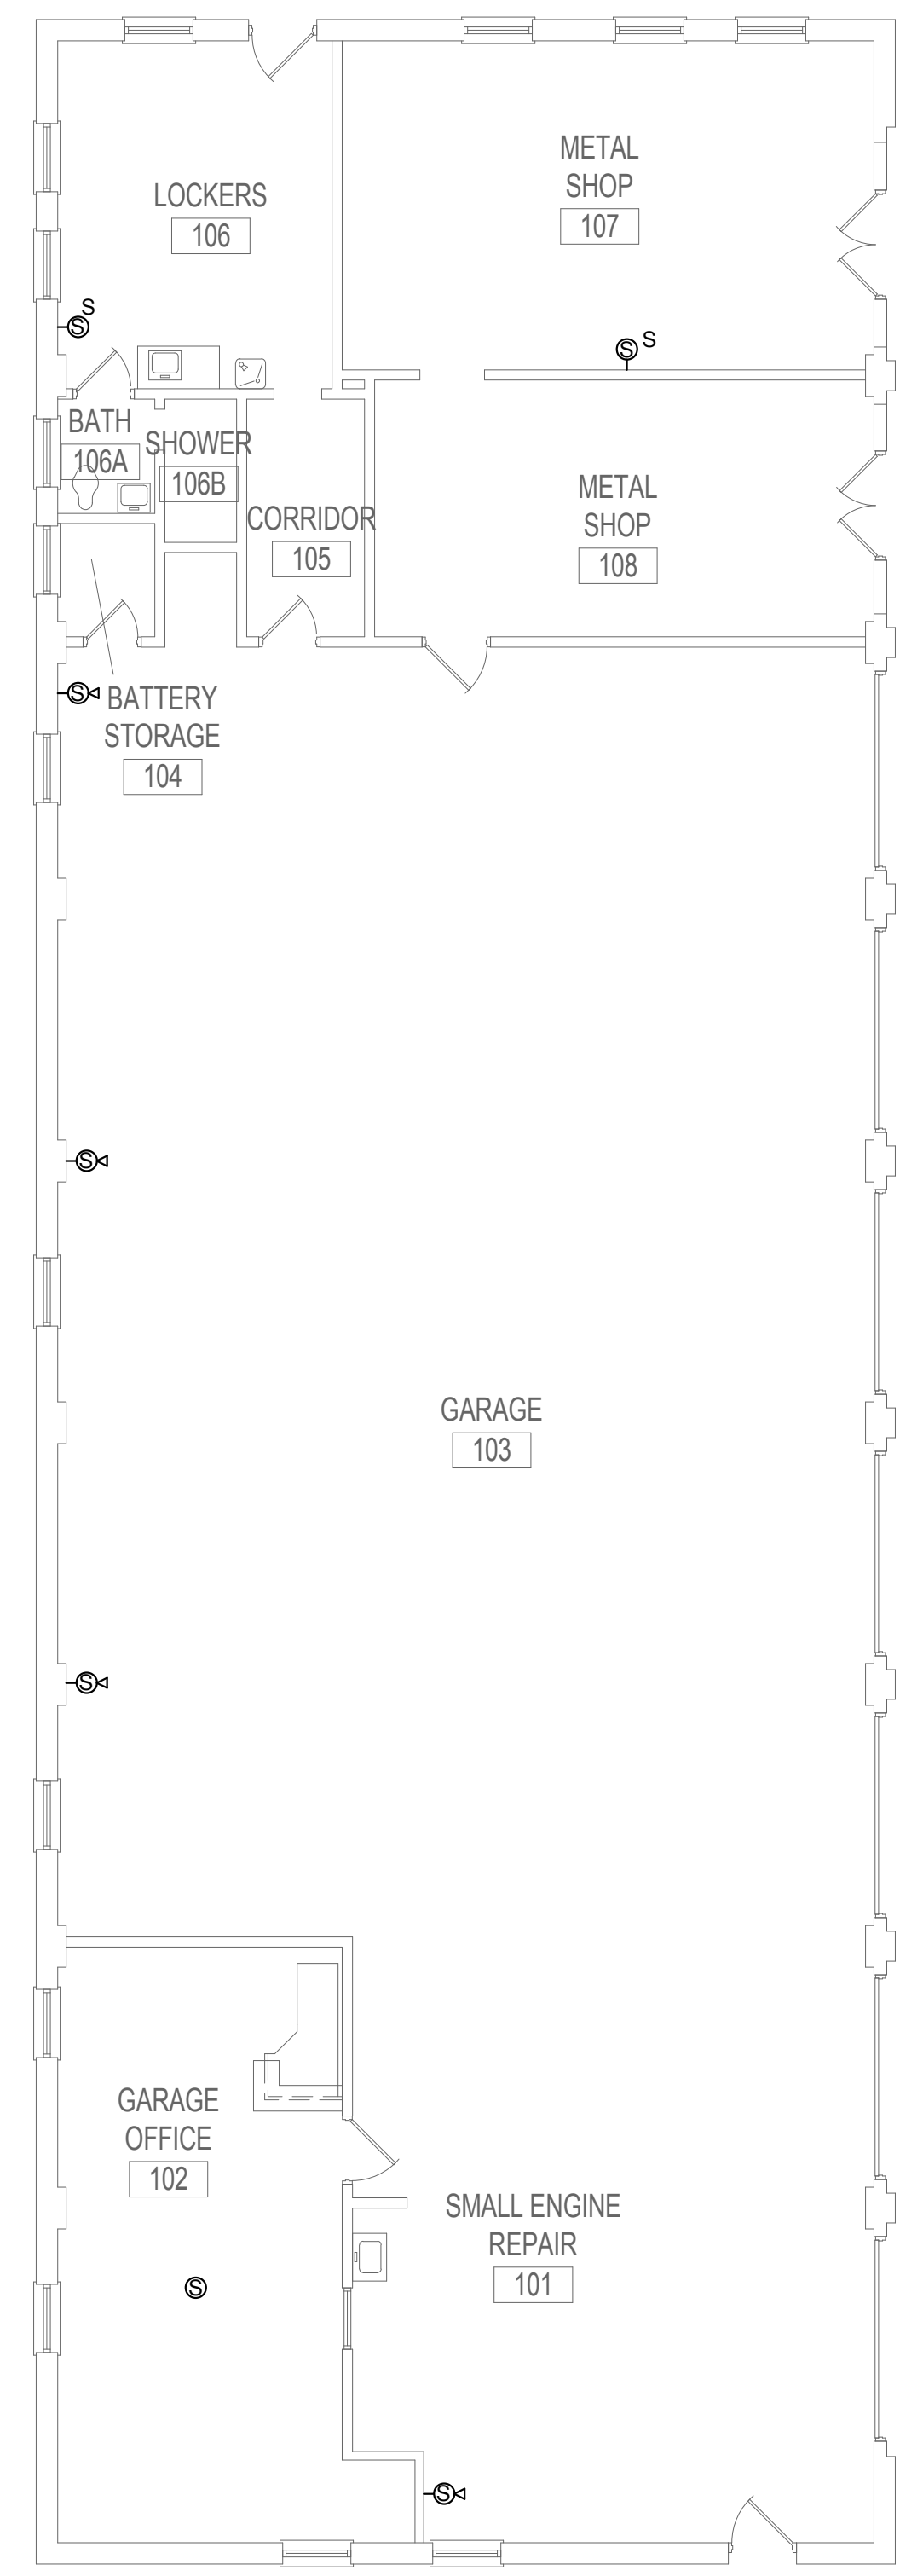

1 BUILDING 54 - PAGING SPEAKER FLOOR PLAN - FIRST FLOOR
1/8" = 1'-0"

C:\Revit\Projects\VA ST CLOUD PAGING_Elec_R1E.dwg 1/24/2019 12:11:10 PM

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:


DRAWING TITLE BUILDING 54 - PAGING SPEAKER FLOOR PLAN - FIRST FLOOR
APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
DATE:
APPROVED: CHIEF OF STAFF
DATE:
APPROVED: HEALTH CARE SYSTEM DIRECTOR
DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM	PROJECT NO.:
BUILDING No.:	CHECKED BY: CP
DATE:	DRAWN: CG
LOCATION VA MEDICAL CENTER ST. CLOUD, MN 56303	ISSUE DATE 1/24/19
DATE:	DRAWING NO. ET54-01

VA **U.S. Department of Veterans Affairs**
 Veterans Health Administration
 St. Cloud VA Health Care System

GENERAL NOTES:

- A. PRIOR TO BID, CONTRACTOR SHALL VISIT SITE AND REVIEW SCOPE OF WORK.
- B. DEMOLITION, INSTALLATION AND TESTING SHALL BE DONE IN ACCORDANCE WITH SPECIFICATIONS.
- C. PROVIDE PUBLIC ADDRESS SYSTEM MUTING RELAYS AT EACH LOCAL SOUND SYSTEM.
- D. SPEAKERS TAGGED WITH "S" INDICATE SURFACE MOUNTED SPEAKERS. CONTRACTOR SHALL CONFIRM WALL/CEILING TYPES AND REQUIREMENTS FOR SURFACE MOUNT SPEAKERS PRIOR TO INSTALLATION.
- E. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.
- F. PROVIDE MINIMUM 3/4" BLUE EMT FOR PUBLIC ADDRESS SYSTEM SPEAKERS.

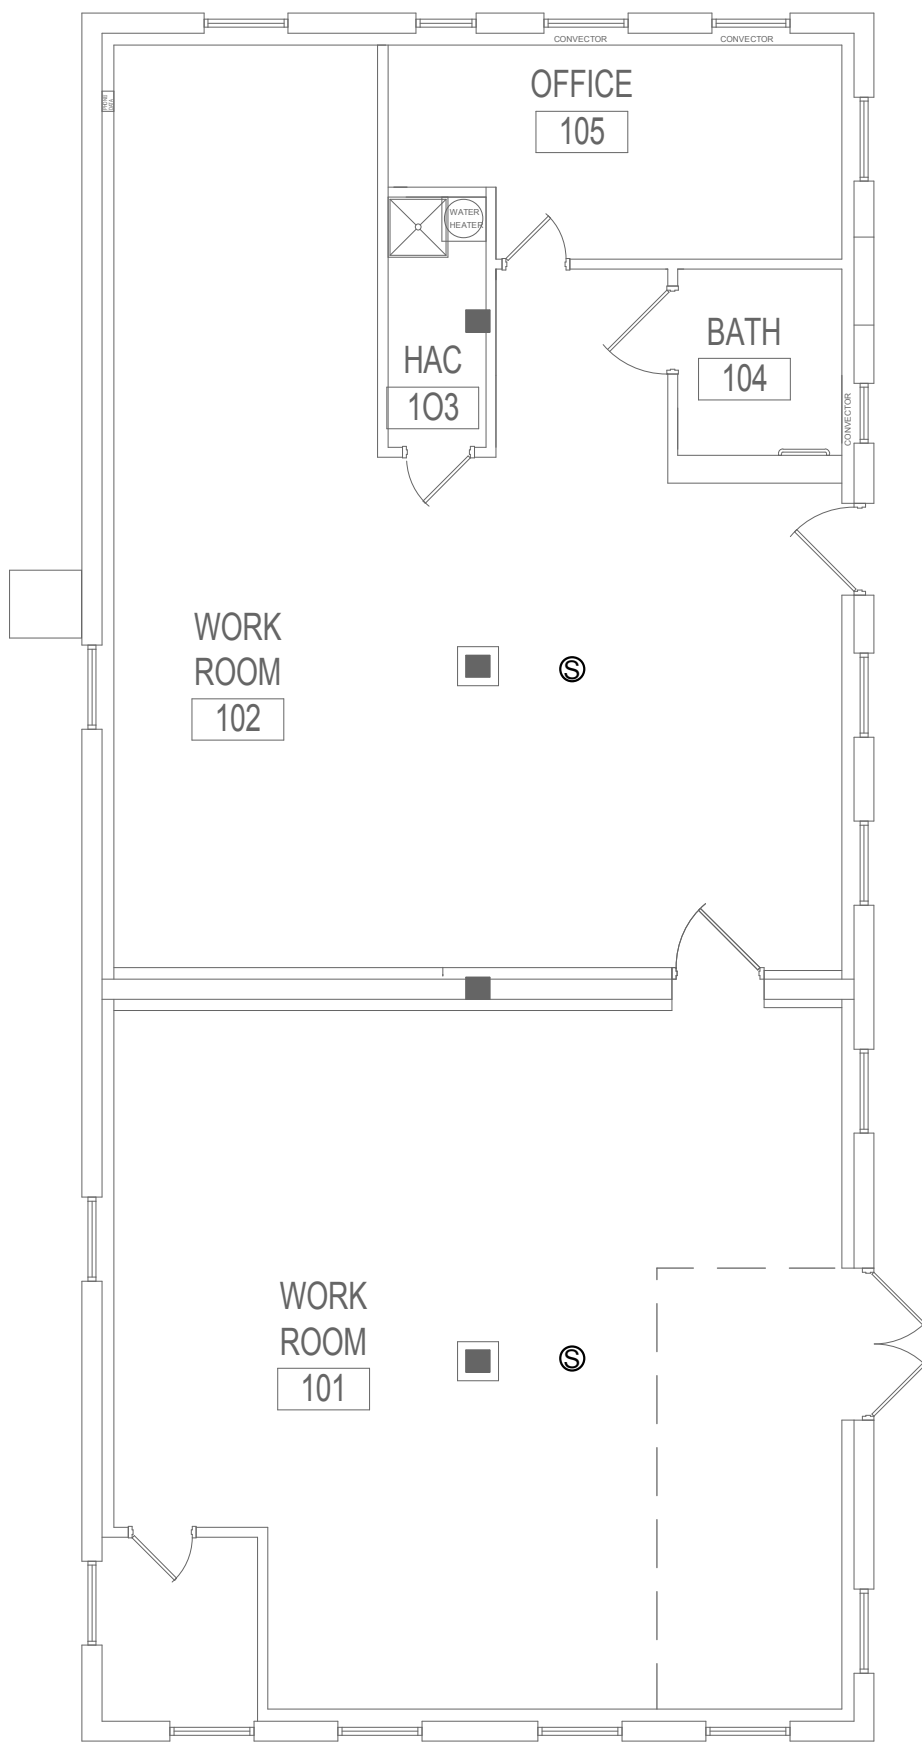

1 BUILDING 57 - PAGING SPEAKER FLOOR PLAN - FIRST FLOOR
1/8" = 1'-0"

1/24/2019 12:11:10 PM

C:\Revit\Projects\VA ST CLOUD PAGING_Elec_R1E.dwg

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE
BUILDING 57 - PAGING SPEAKER FLOOR PLAN - FIRST FLOOR
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:
 APPROVED: CHIEF OF STAFF
 DATE:
 APPROVED: HEALTH CARE SYSTEM DIRECTOR
 DATE:


PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PROJECT NO.:	
BUILDING No.:	CHECKED BY:	DRAWN:	ISSUE DATE:
	CP	CG	1/24/19
LOCATION:	DATE:	DRAWING NO.:	
VA MEDICAL CENTER ST. CLOUD, MN 56303		ET57-01	




U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

GENERAL NOTES:

- A. PRIOR TO BID, CONTRACTOR SHALL VISIT SITE AND REVIEW SCOPE OF WORK.
- B. DEMOLITION, INSTALLATION AND TESTING SHALL BE DONE IN ACCORDANCE WITH SPECIFICATIONS.
- C. PROVIDE PUBLIC ADDRESS SYSTEM MUTING RELAYS AT EACH LOCAL SOUND SYSTEM.
- D. SPEAKERS TAGGED WITH "S" INDICATE SURFACE MOUNTED SPEAKERS. CONTRACTOR SHALL CONFIRM WALL/CEILING TYPES AND REQUIREMENTS FOR SURFACE MOUNT SPEAKERS PRIOR TO INSTALLATION.
- E. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.
- F. PROVIDE MINIMUM 3/4" BLUE EMT FOR PUBLIC ADDRESS SYSTEM SPEAKERS.

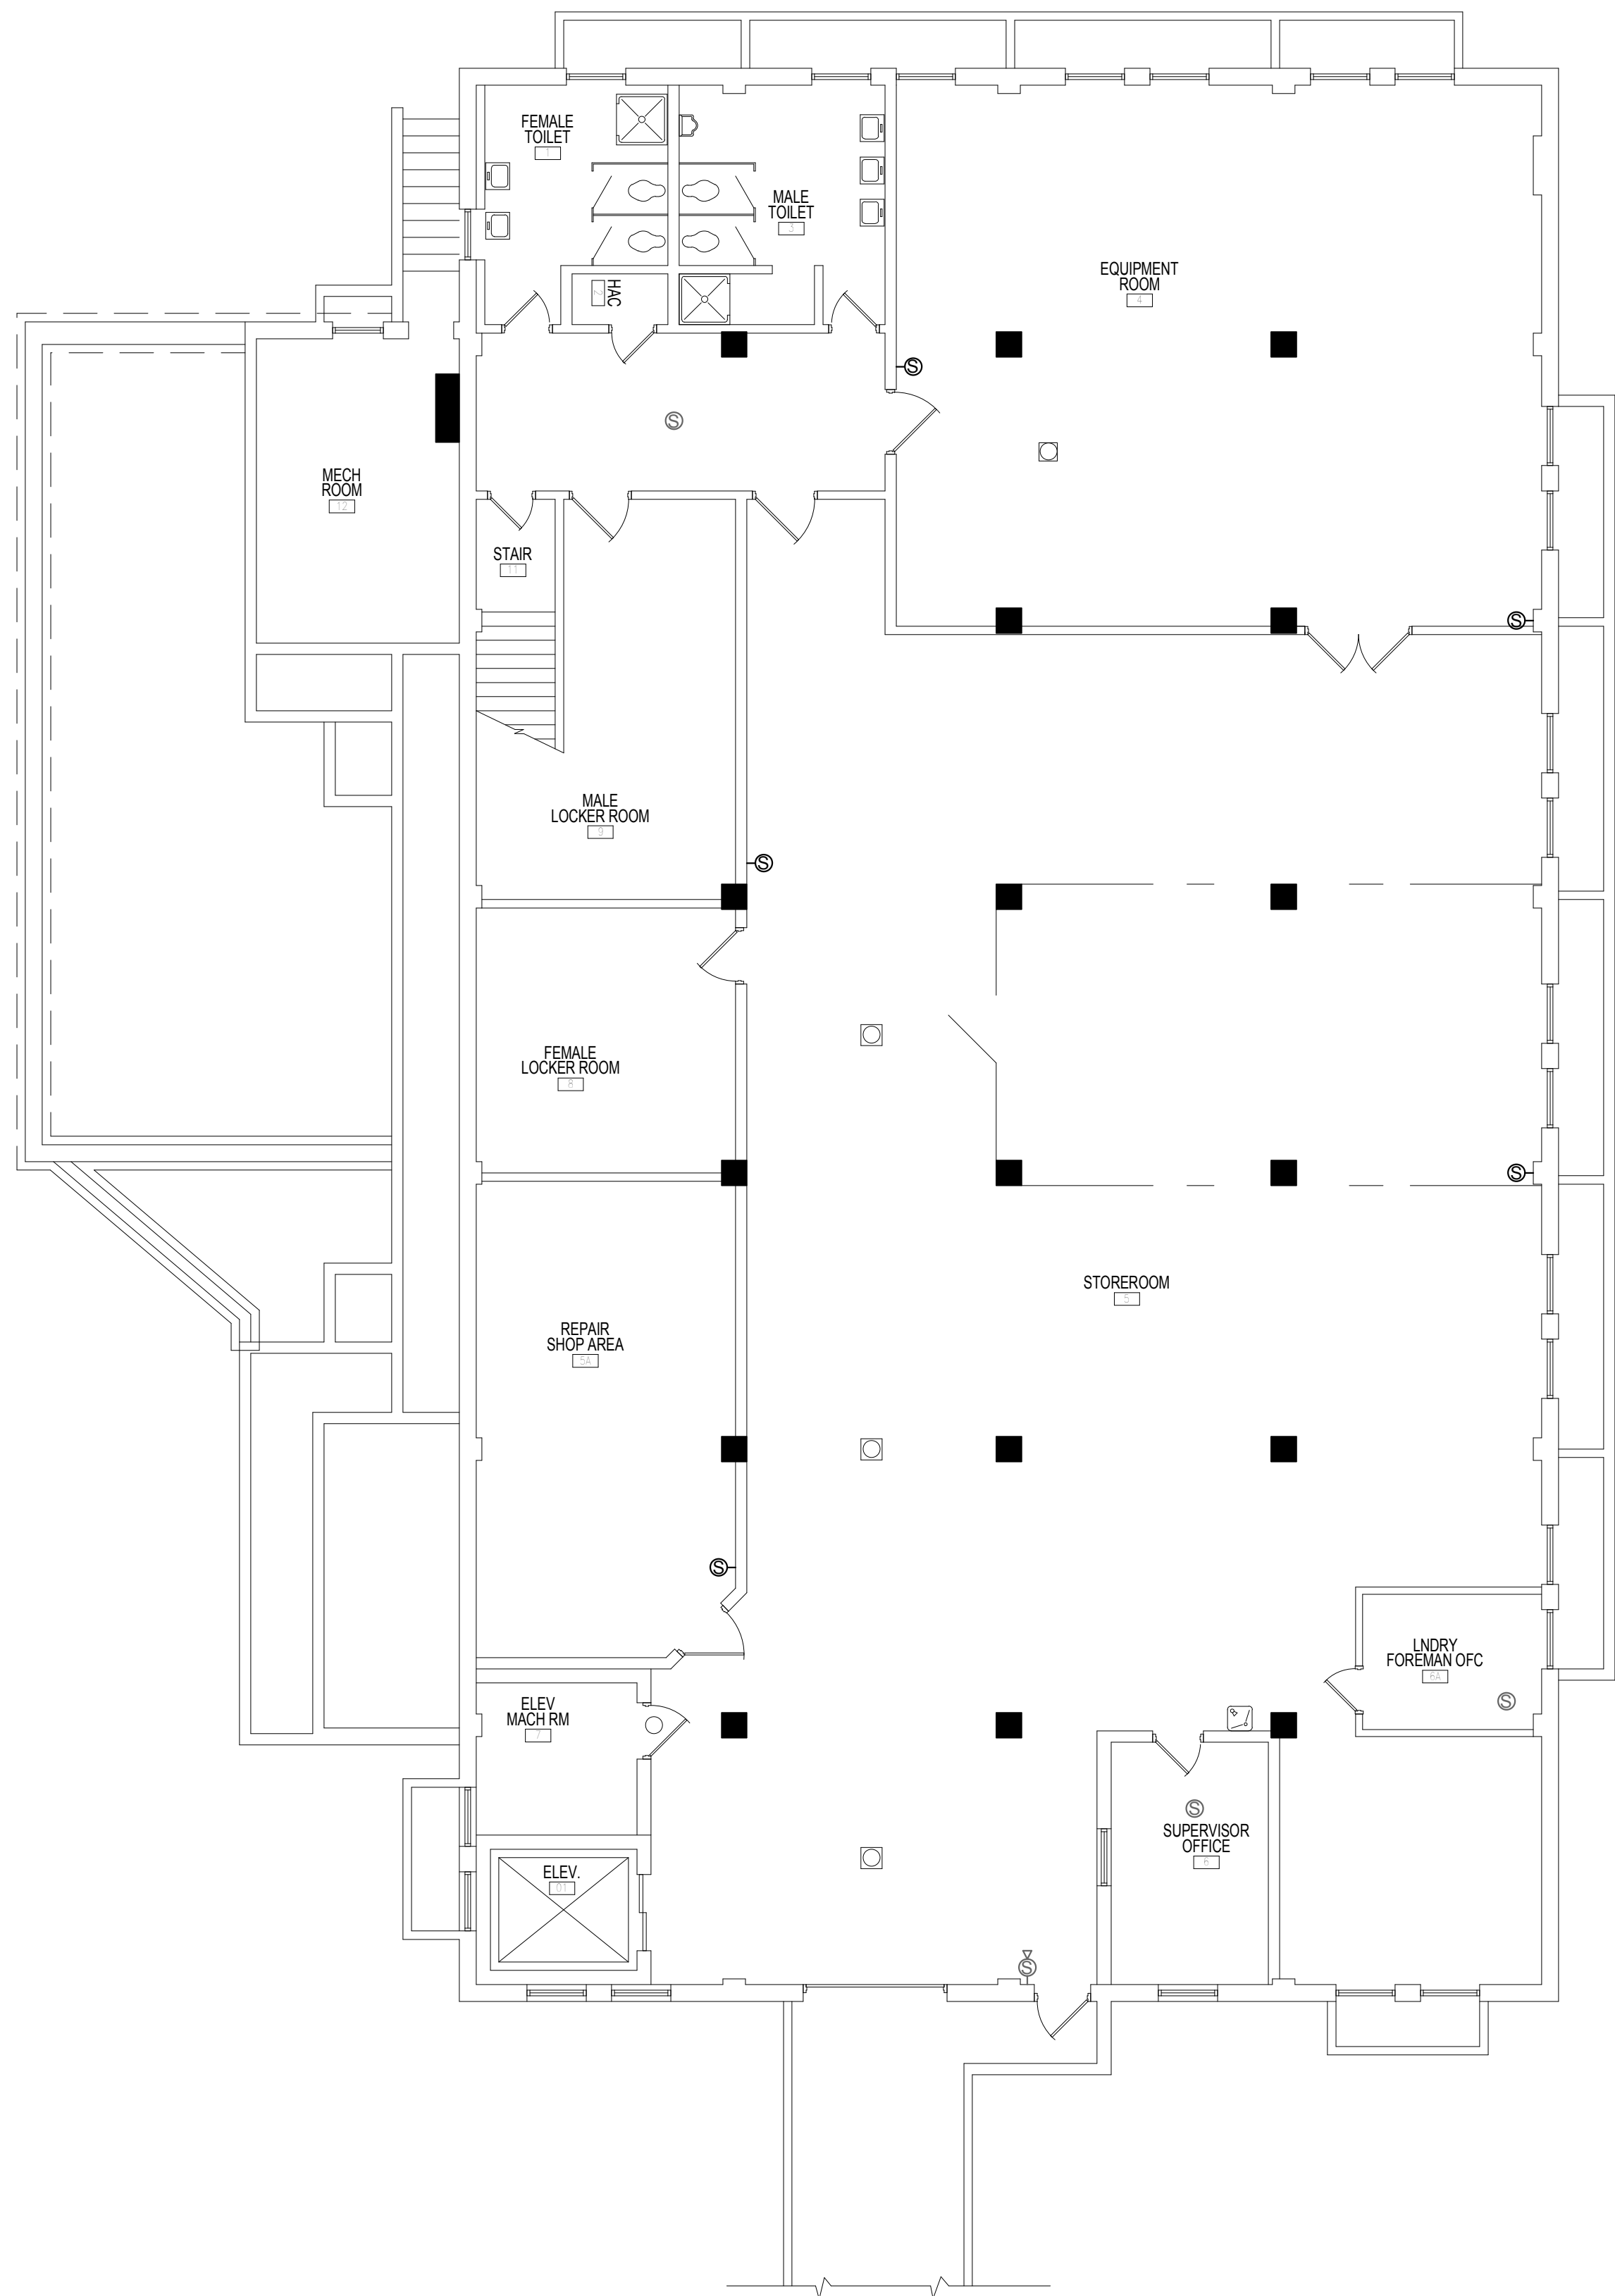

① BUILDING 59 - PAGING SPEAKER FLOOR PLAN - BASEMENT
1/8" = 1'-0"

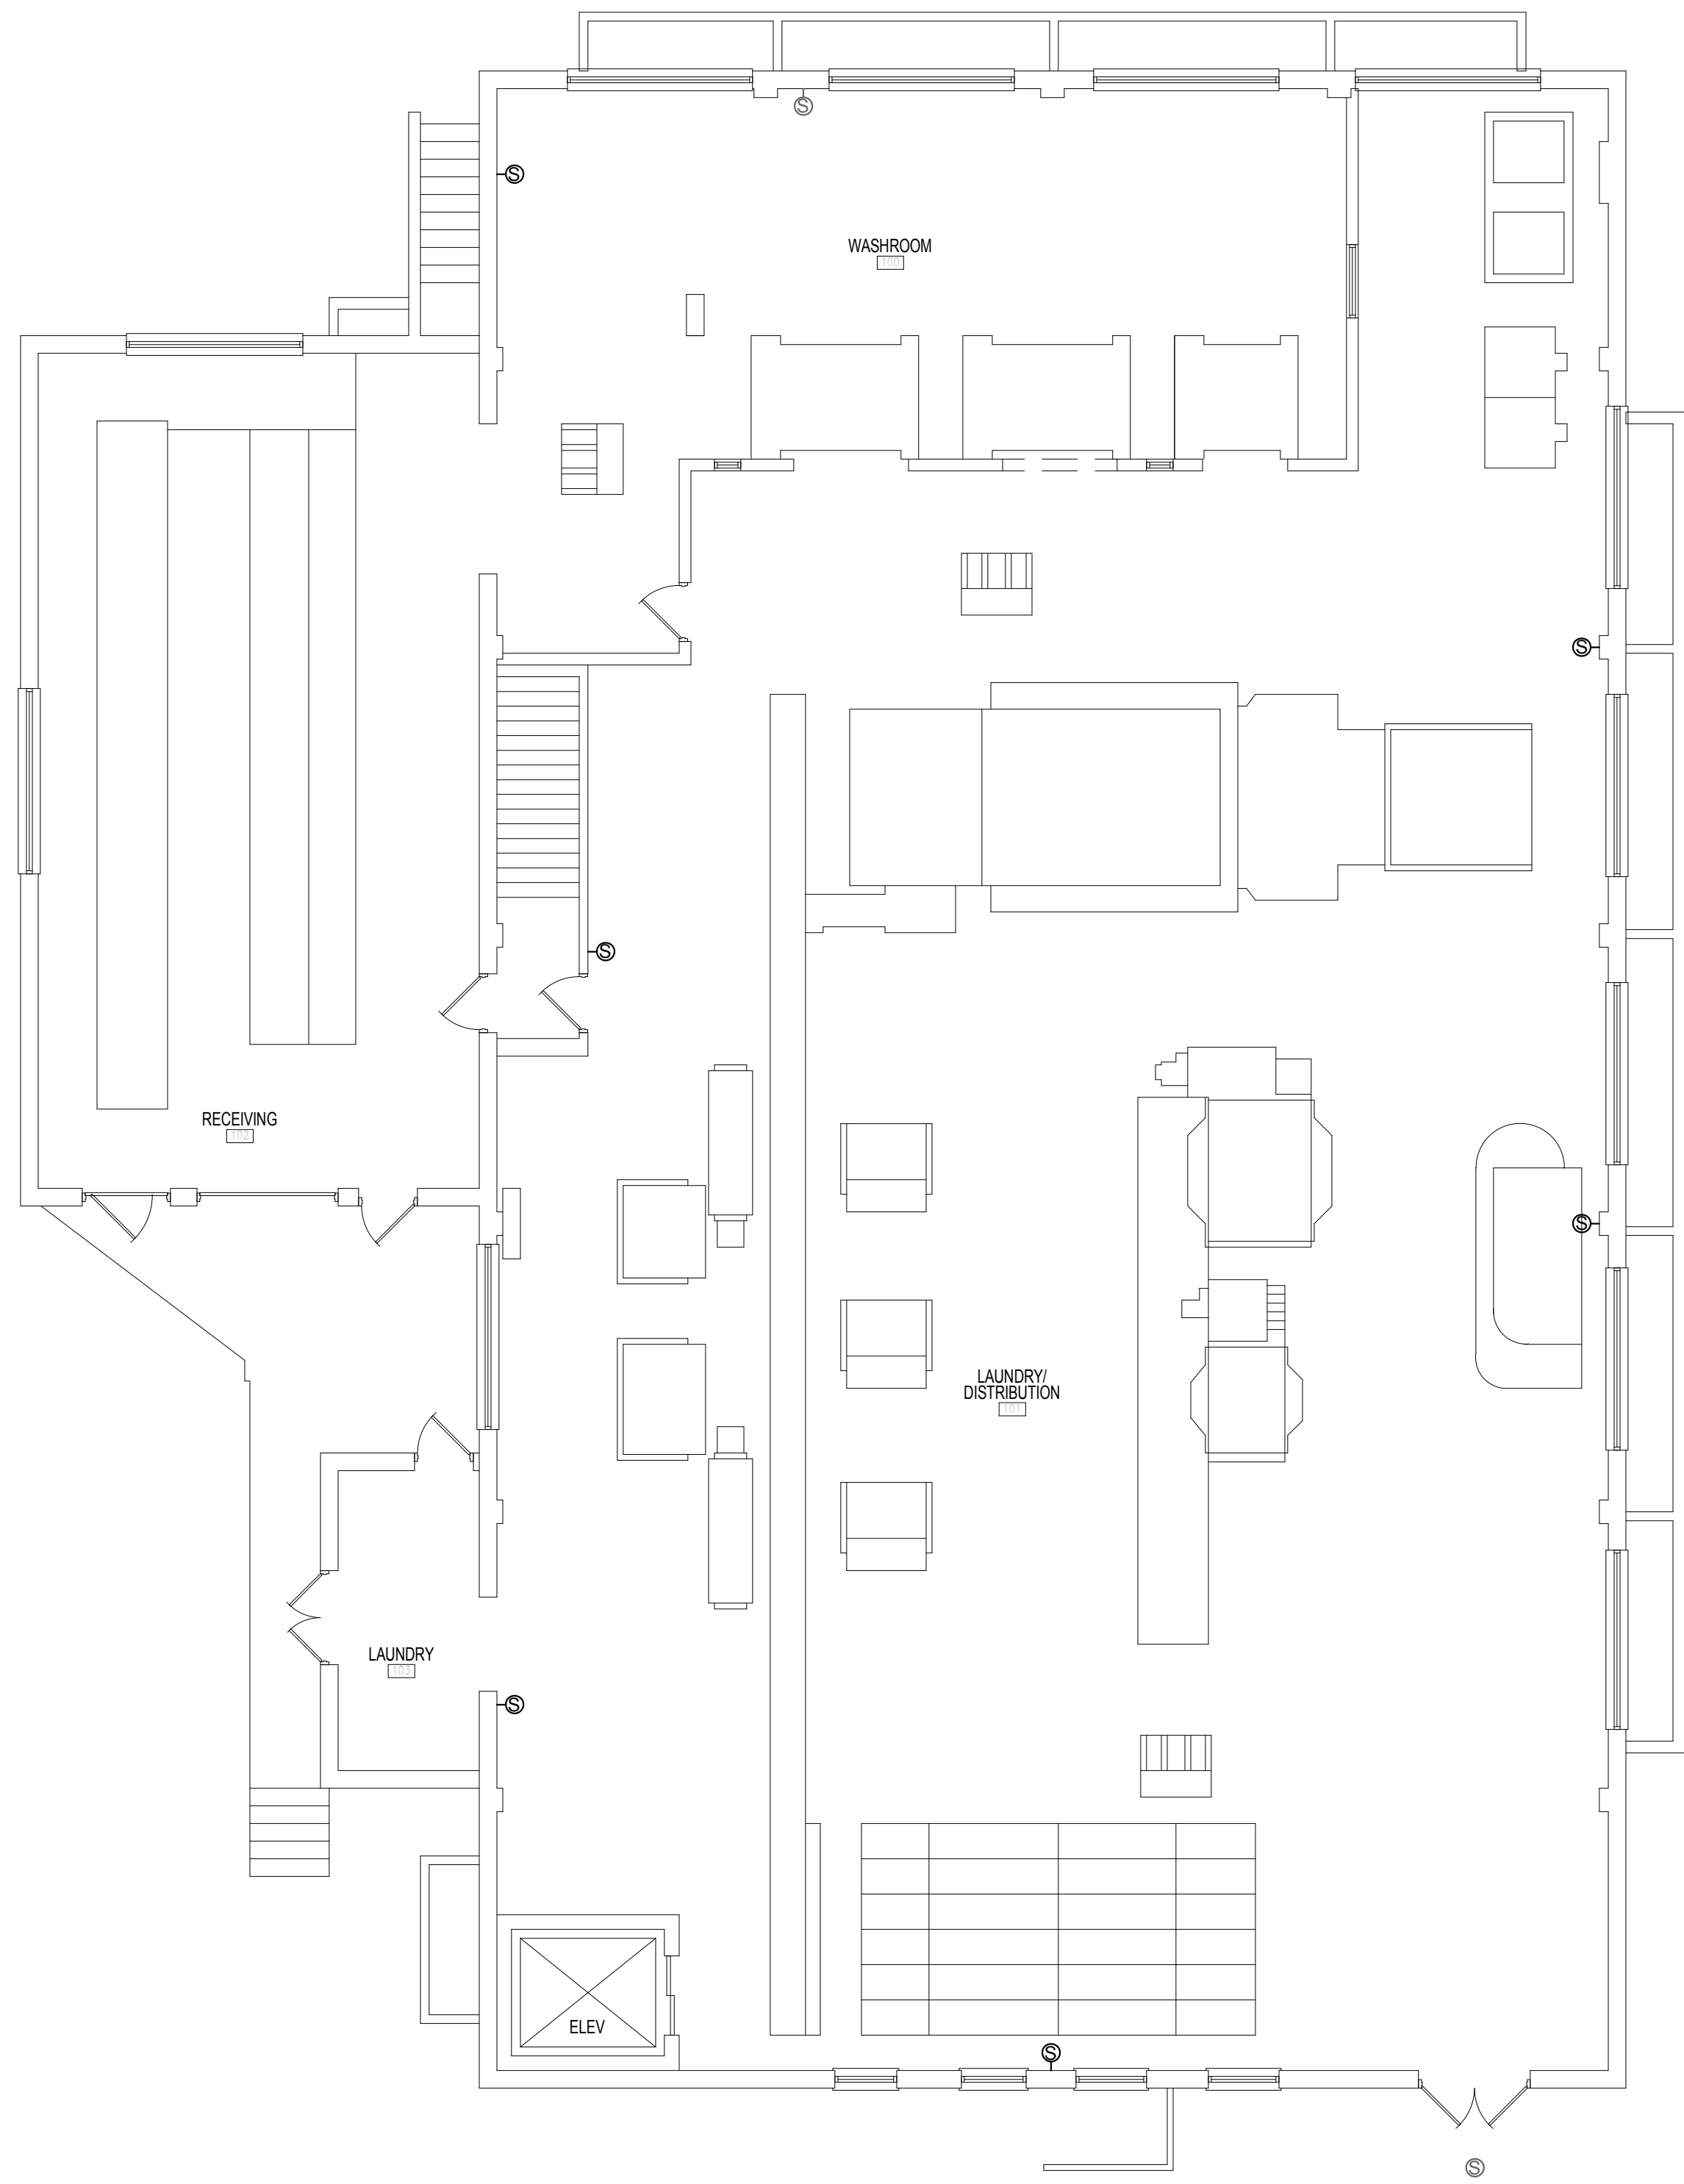

② BUILDING 59 - PAGING SPEAKER FLOOR PLAN - FIRST FLOOR
1/8" = 1'-0"

C:\Revit\Projects\VA ST CLCLOUD\PAGING\Bldg_012_cmg.dwg

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE
BUILDING 59 - PAGING SPEAKER FLOOR PLAN - BASEMENT & FIRST FLOOR
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:
 APPROVED: CHIEF OF STAFF
 DATE:
 APPROVED: HEALTH CARE SYSTEM DIRECTOR
 DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PLOT SCALE	
PROJECT NO.		DATE	
BUILDING No.	CHECKED BY	DRAWN	ISSUE DATE
	CP	CG	1/24/19
LOCATION	DATE	DRAWING NO.	
VA MEDICAL CENTER ST. CLOUD, MN 56303		ET59-00	

VA
U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

GENERAL NOTES:

A. PRIOR TO BID, CONTRACTOR SHALL VISIT SITE AND REVIEW SCOPE OF WORK.


B. DEMOLITION, INSTALLATION AND TESTING SHALL BE DONE IN ACCORDANCE WITH SPECIFICATIONS.

C. PROVIDE PUBLIC ADDRESS SYSTEM MUTING RELAYS AT EACH LOCAL SOUND SYSTEM.

D. SPEAKERS TAGGED WITH "S" INDICATE SURFACE MOUNTED SPEAKERS. CONTRACTOR SHALL CONFIRM WALL/CEILING TYPES AND REQUIREMENTS FOR SURFACE MOUNT SPEAKERS PRIOR TO INSTALLATION.

E. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.

F. PROVIDE MINIMUM 3/4" BLUE EMT FOR PUBLIC ADDRESS SYSTEM SPEAKERS.

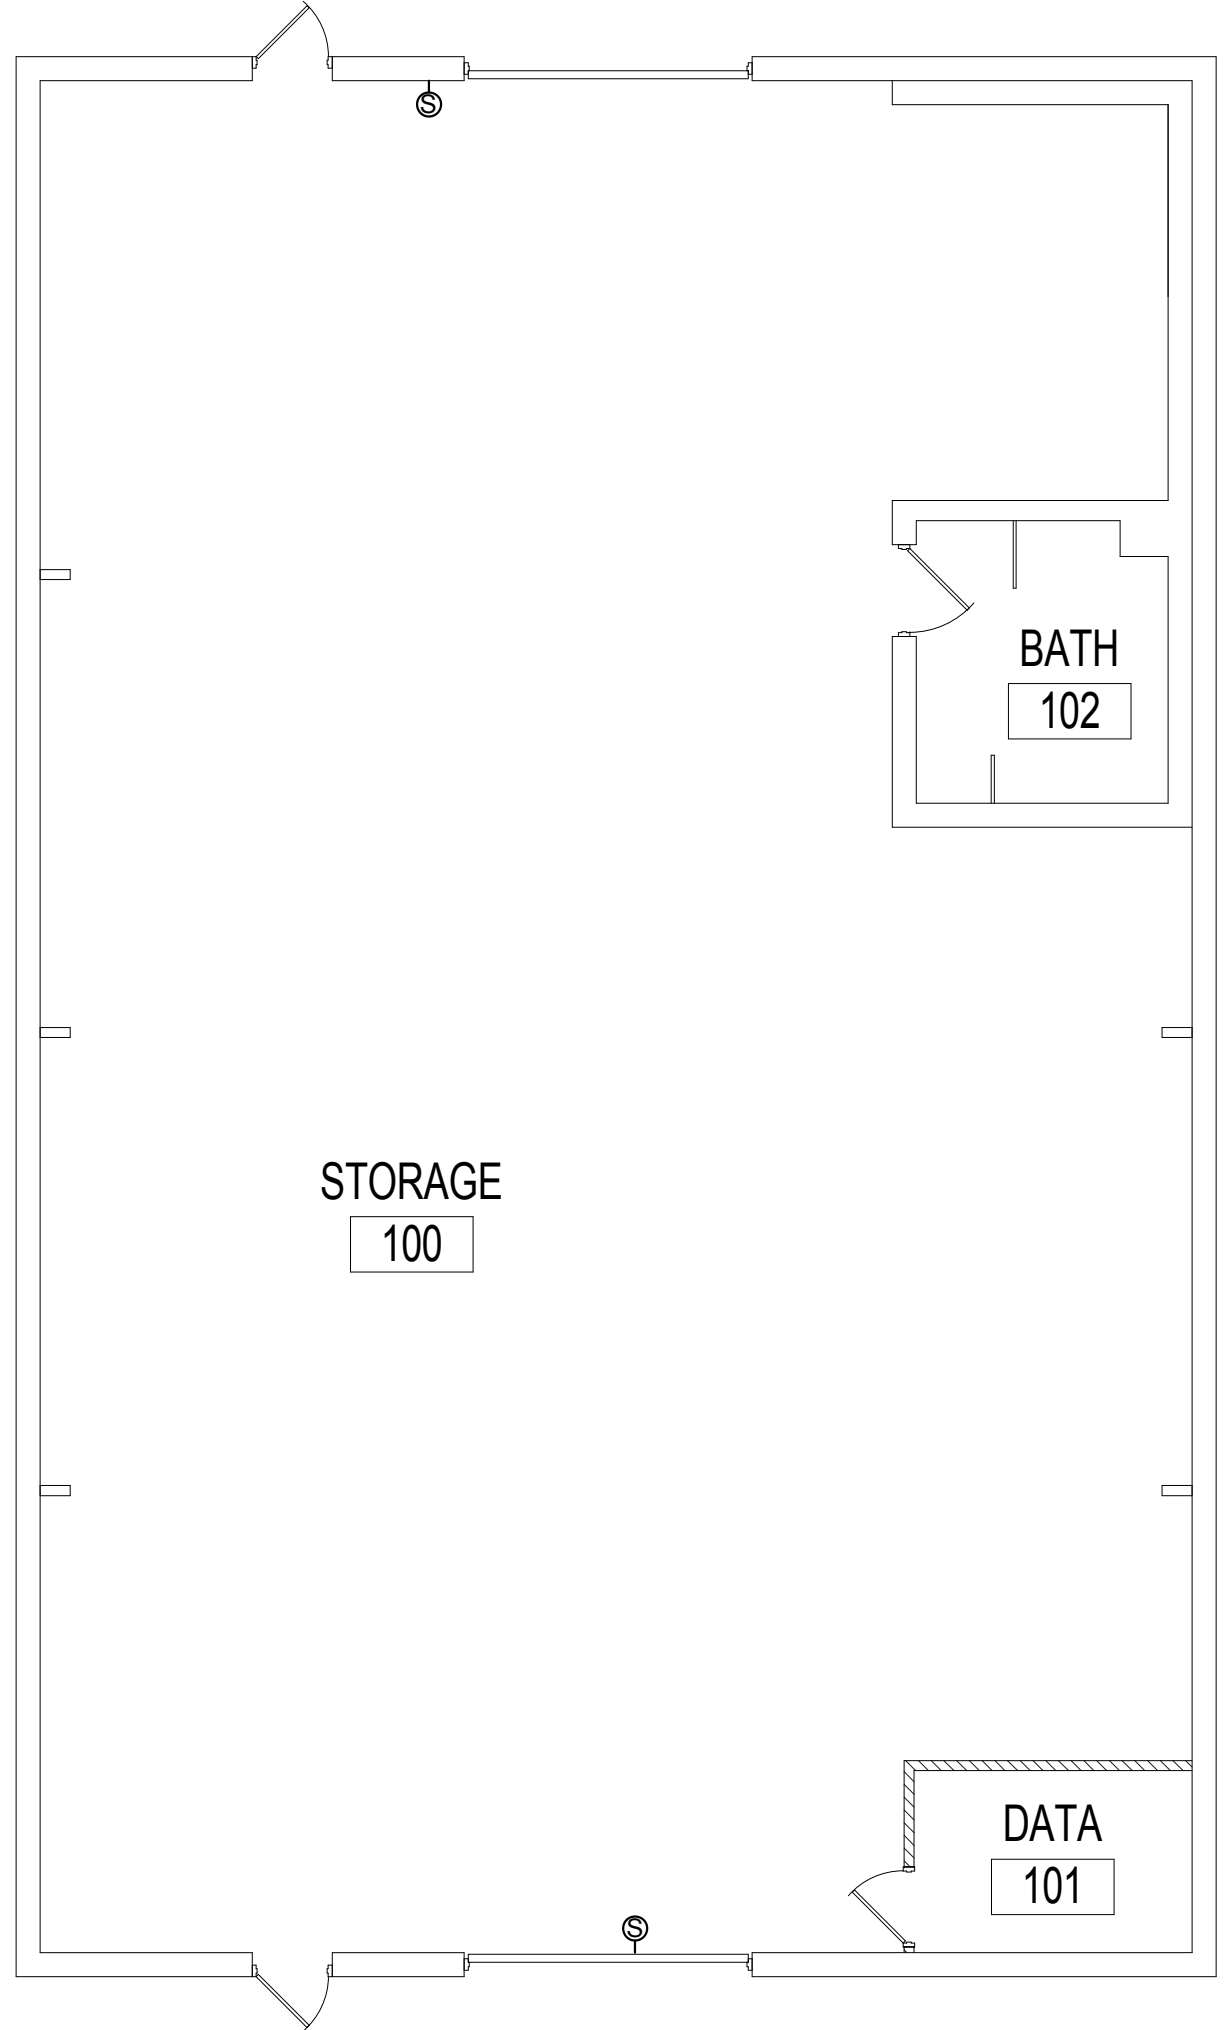

1 BUILDING 109 - PAGING SPEAKER FLOOR PLAN - FIRST FLOOR
1/8" = 1'-0"

1/24/2019 12:11:12 PM
C:\Revit\Projects\VA ST CLOUD\PAGING_Elec_R12.dwg.plt

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)
DUNHAM
50 South Sixth Street / Suite 1100
Minneapolis, Minnesota 55402-1540
Phone: 612-465-7550 Fax: 612-465-7551
Web: dunhaminc.com
mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD
ANDERSON ENGINEERING
ENGINEERING • ARCHITECTURE • LAND SURVEYING
ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
Anderson Engineering of Minnesota, LLC
13605 1st Avenue North
Suite 100
Plymouth, MN 55441
763-412-4000 (o) 763-412-4090 (f)
www.ae-mn.com

STAMP
I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
Signature: *Chris M. Pilliod*
Name: Chris M. Pilliod, P.E.
Date: 1/24/19
Registration Number: 50826


APPROVED: SERVICE LINE DIRECTOR	DATE	APPROVED: INFECTION CONTROL NURSE	DATE
APPROVED: GEMS COORDINATOR	DATE	APPROVED: PATIENT SAFETY	DATE
APPROVED: PROJECTS SECTION MANAGER	DATE	APPROVED: CHIEF OF POLICE	DATE
APPROVED: DIRECTOR FMS	DATE	APPROVED: SAFETY MANAGER	DATE

DRAWING TITLE
BUILDING 109 - PAGING SPEAKER FLOOR PLAN - FIRST FLOOR
DATE: _____
APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
DATE: _____
APPROVED: CHIEF OF STAFF
DATE: _____
APPROVED: HEALTH CARE SYSTEM DIRECTOR
DATE: _____

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PLOT SCALE	
PROJECT NO.		DATE	
BUILDING No.	CHECKED BY	DRAWN	ISSUE DATE
	CP	CG	1/24/19
LOCATION	DATE	DRAWING NO.	
VA MEDICAL CENTER ST. CLOUD, MN 56303		ET109-01	




U.S. Department of Veterans Affairs
Veterans Health Administration
St. Cloud VA Health Care System

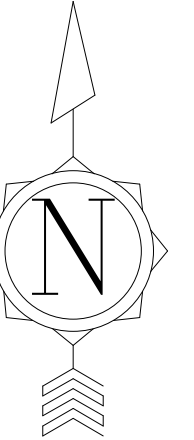

GENERAL NOTES:

- A. PRIOR TO BID, CONTRACTOR SHALL VISIT SITE AND REVIEW SCOPE OF WORK.
- B. DEMOLITION, INSTALLATION AND TESTING SHALL BE DONE IN ACCORDANCE WITH SPECIFICATIONS.
- C. PROVIDE PUBLIC ADDRESS SYSTEM MUTING RELAYS AT EACH LOCAL SOUND SYSTEM.
- D. SPEAKERS TAGGED WITH "S" INDICATE SURFACE MOUNTED SPEAKERS. CONTRACTOR SHALL CONFIRM WALL/CEILING TYPES AND REQUIREMENTS FOR SURFACE MOUNT SPEAKERS PRIOR TO INSTALLATION.
- E. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.
- F. PROVIDE MINIMUM 3/4" BLUE EMT FOR PUBLIC ADDRESS SYSTEM SPEAKERS.

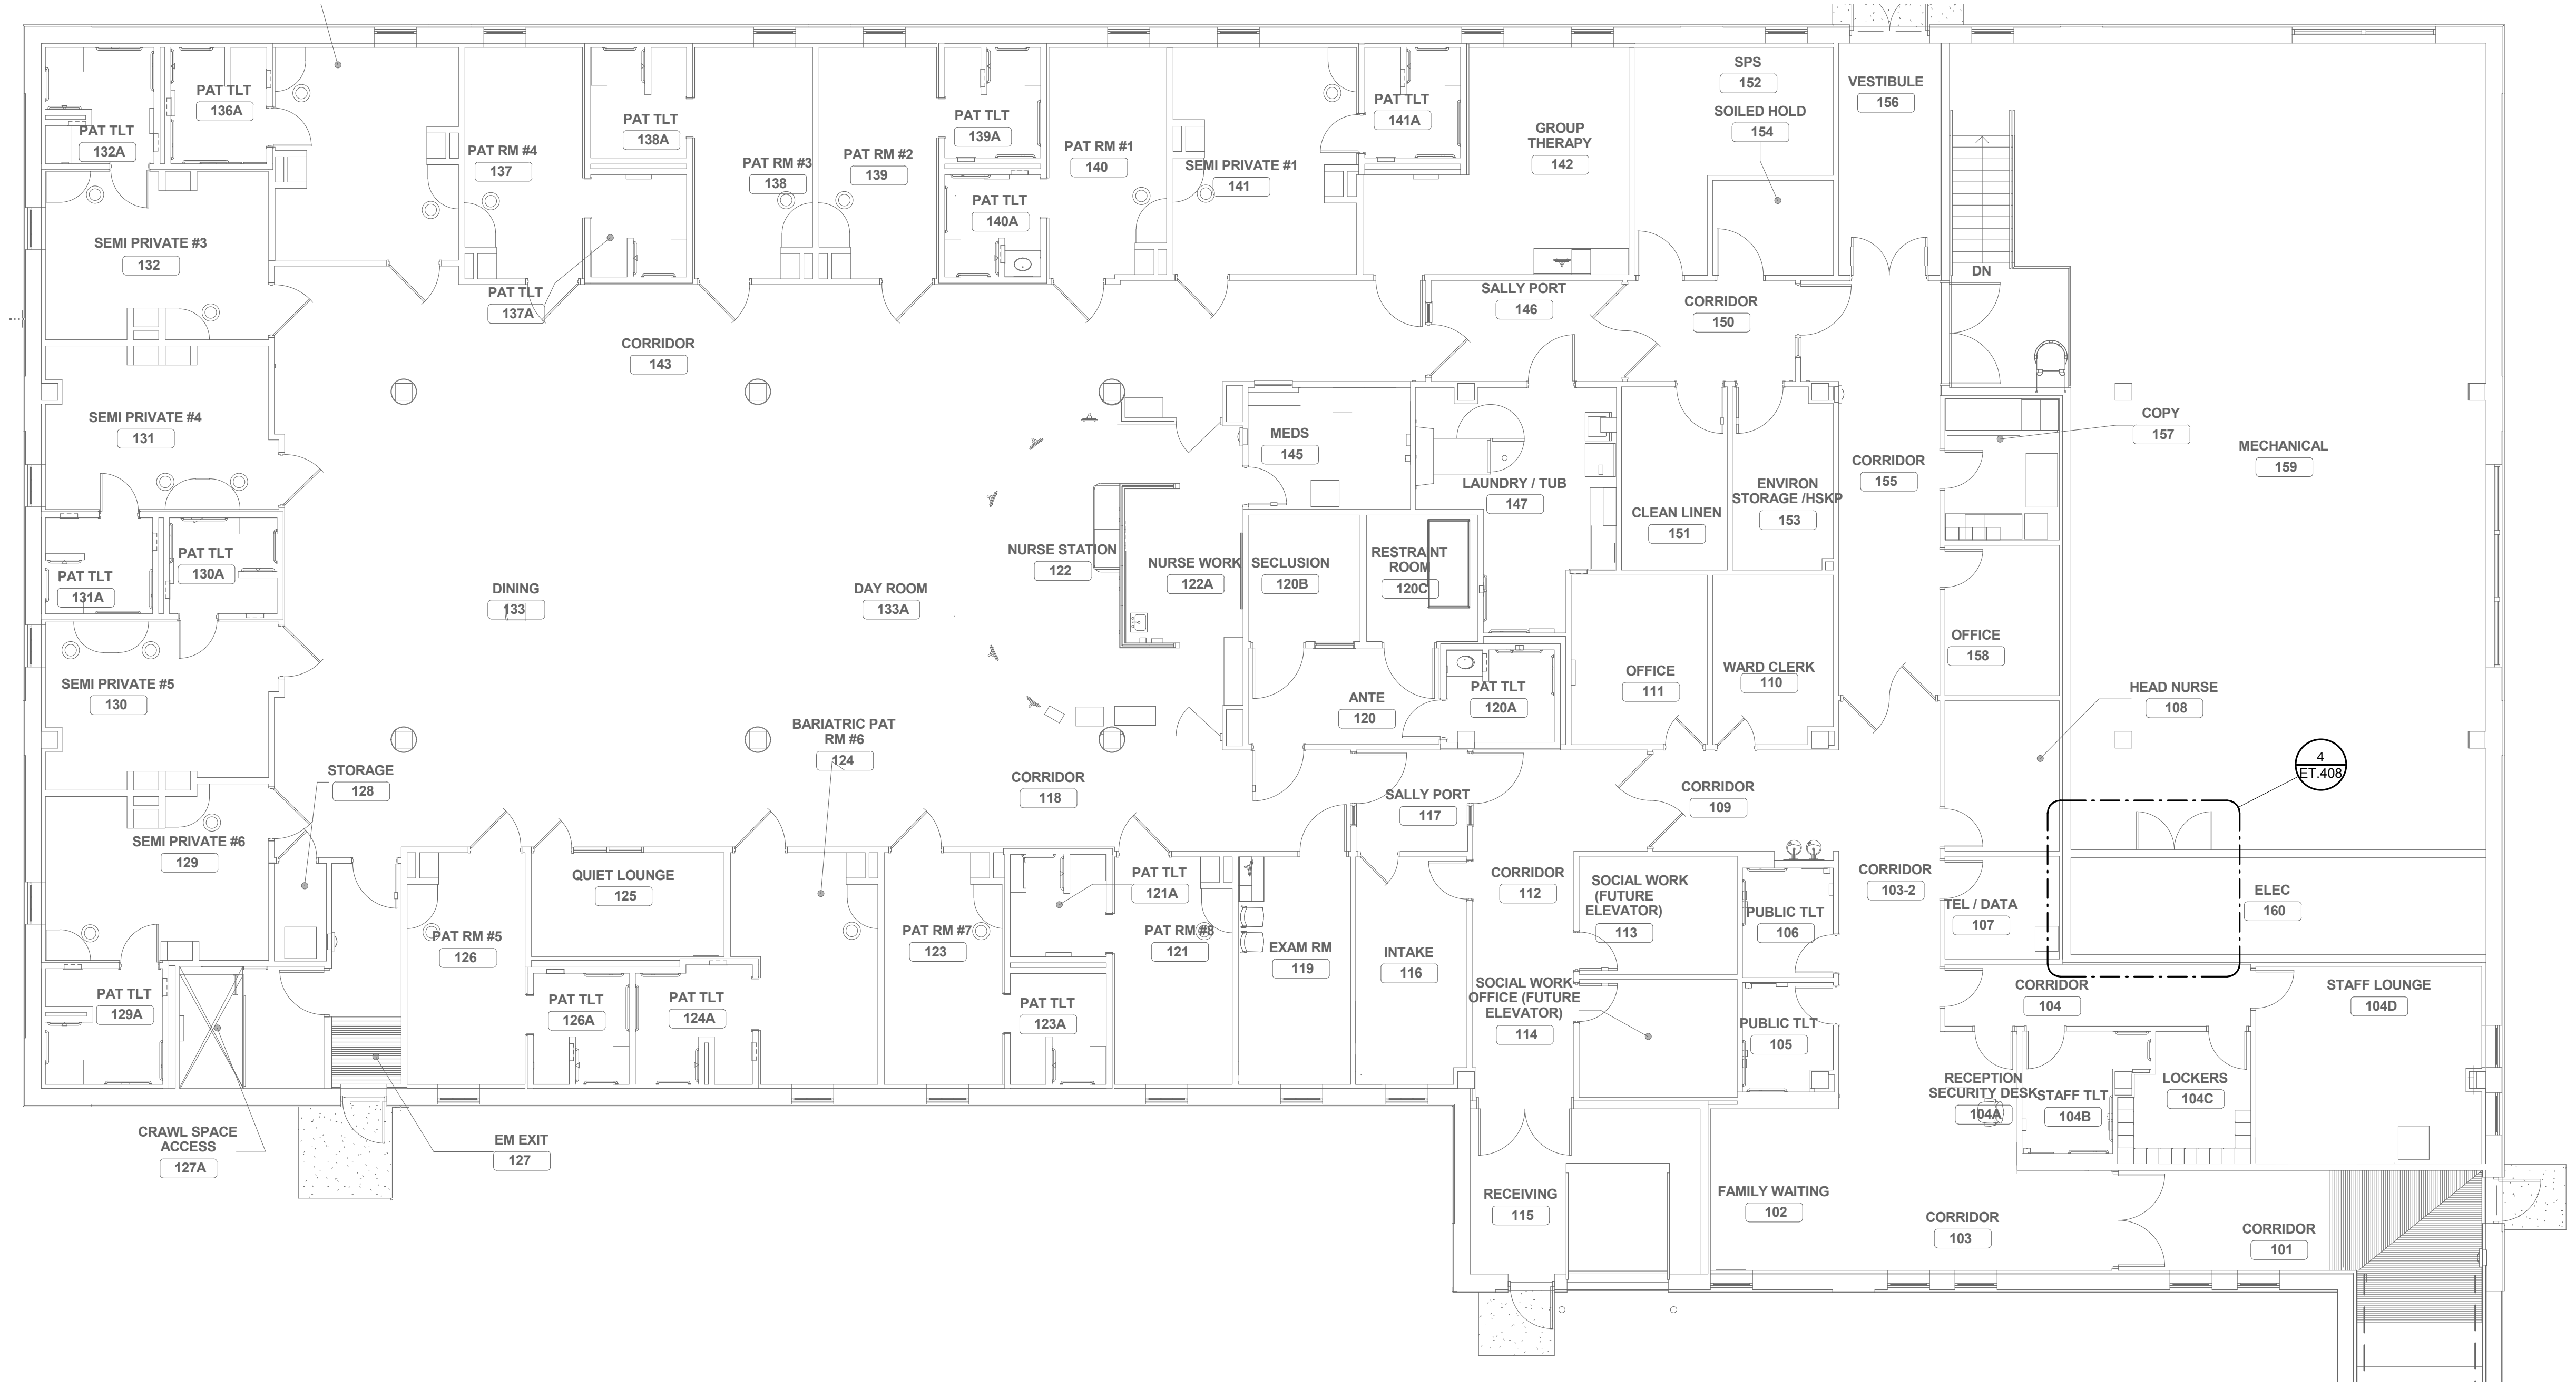

1 BUILDING 115 - PAGING SPEAKER FLOOR PLAN - FIRST FLOOR
1/8" = 1'-0"

1/24/2019 11:21:12 PM
C:\Revit\Projects\VA ST CLOUD PAGING_Elec_R12.dwg

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

 DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE
BUILDING 115 - PAGING SPEAKER FLOOR PLAN - FIRST FLOOR
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:
 APPROVED: CHIEF OF STAFF
 DATE:
 APPROVED: HEALTH CARE SYSTEM DIRECTOR
 DATE:


PROJECT TITLE
UPGRADE PUBLIC ADDRESS SYSTEM
 BUILDING No. _____ CHECKED BY **CP** DRAWN **CG** ISSUE DATE **1/24/19**
 LOCATION
 VA MEDICAL CENTER
 ST. CLOUD, MN 56303
 DRAWING NO.
ET115-01

VA

U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

GENERAL NOTES:

- A. PRIOR TO BID, CONTRACTOR SHALL VISIT SITE AND REVIEW SCOPE OF WORK.
- B. DEMOLITION, INSTALLATION AND TESTING SHALL BE DONE IN ACCORDANCE WITH SPECIFICATIONS.
- C. PROVIDE PUBLIC ADDRESS SYSTEM MUTING RELAYS AT EACH LOCAL SOUND SYSTEM.
- D. SPEAKERS TAGGED WITH "S" INDICATE SURFACE MOUNTED SPEAKERS. CONTRACTOR SHALL CONFIRM WALL/CEILING TYPES AND REQUIREMENTS FOR SURFACE MOUNT SPEAKERS PRIOR TO INSTALLATION.
- E. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.
- F. PROVIDE MINIMUM 3/4" BLUE EMT FOR PUBLIC ADDRESS SYSTEM SPEAKERS.

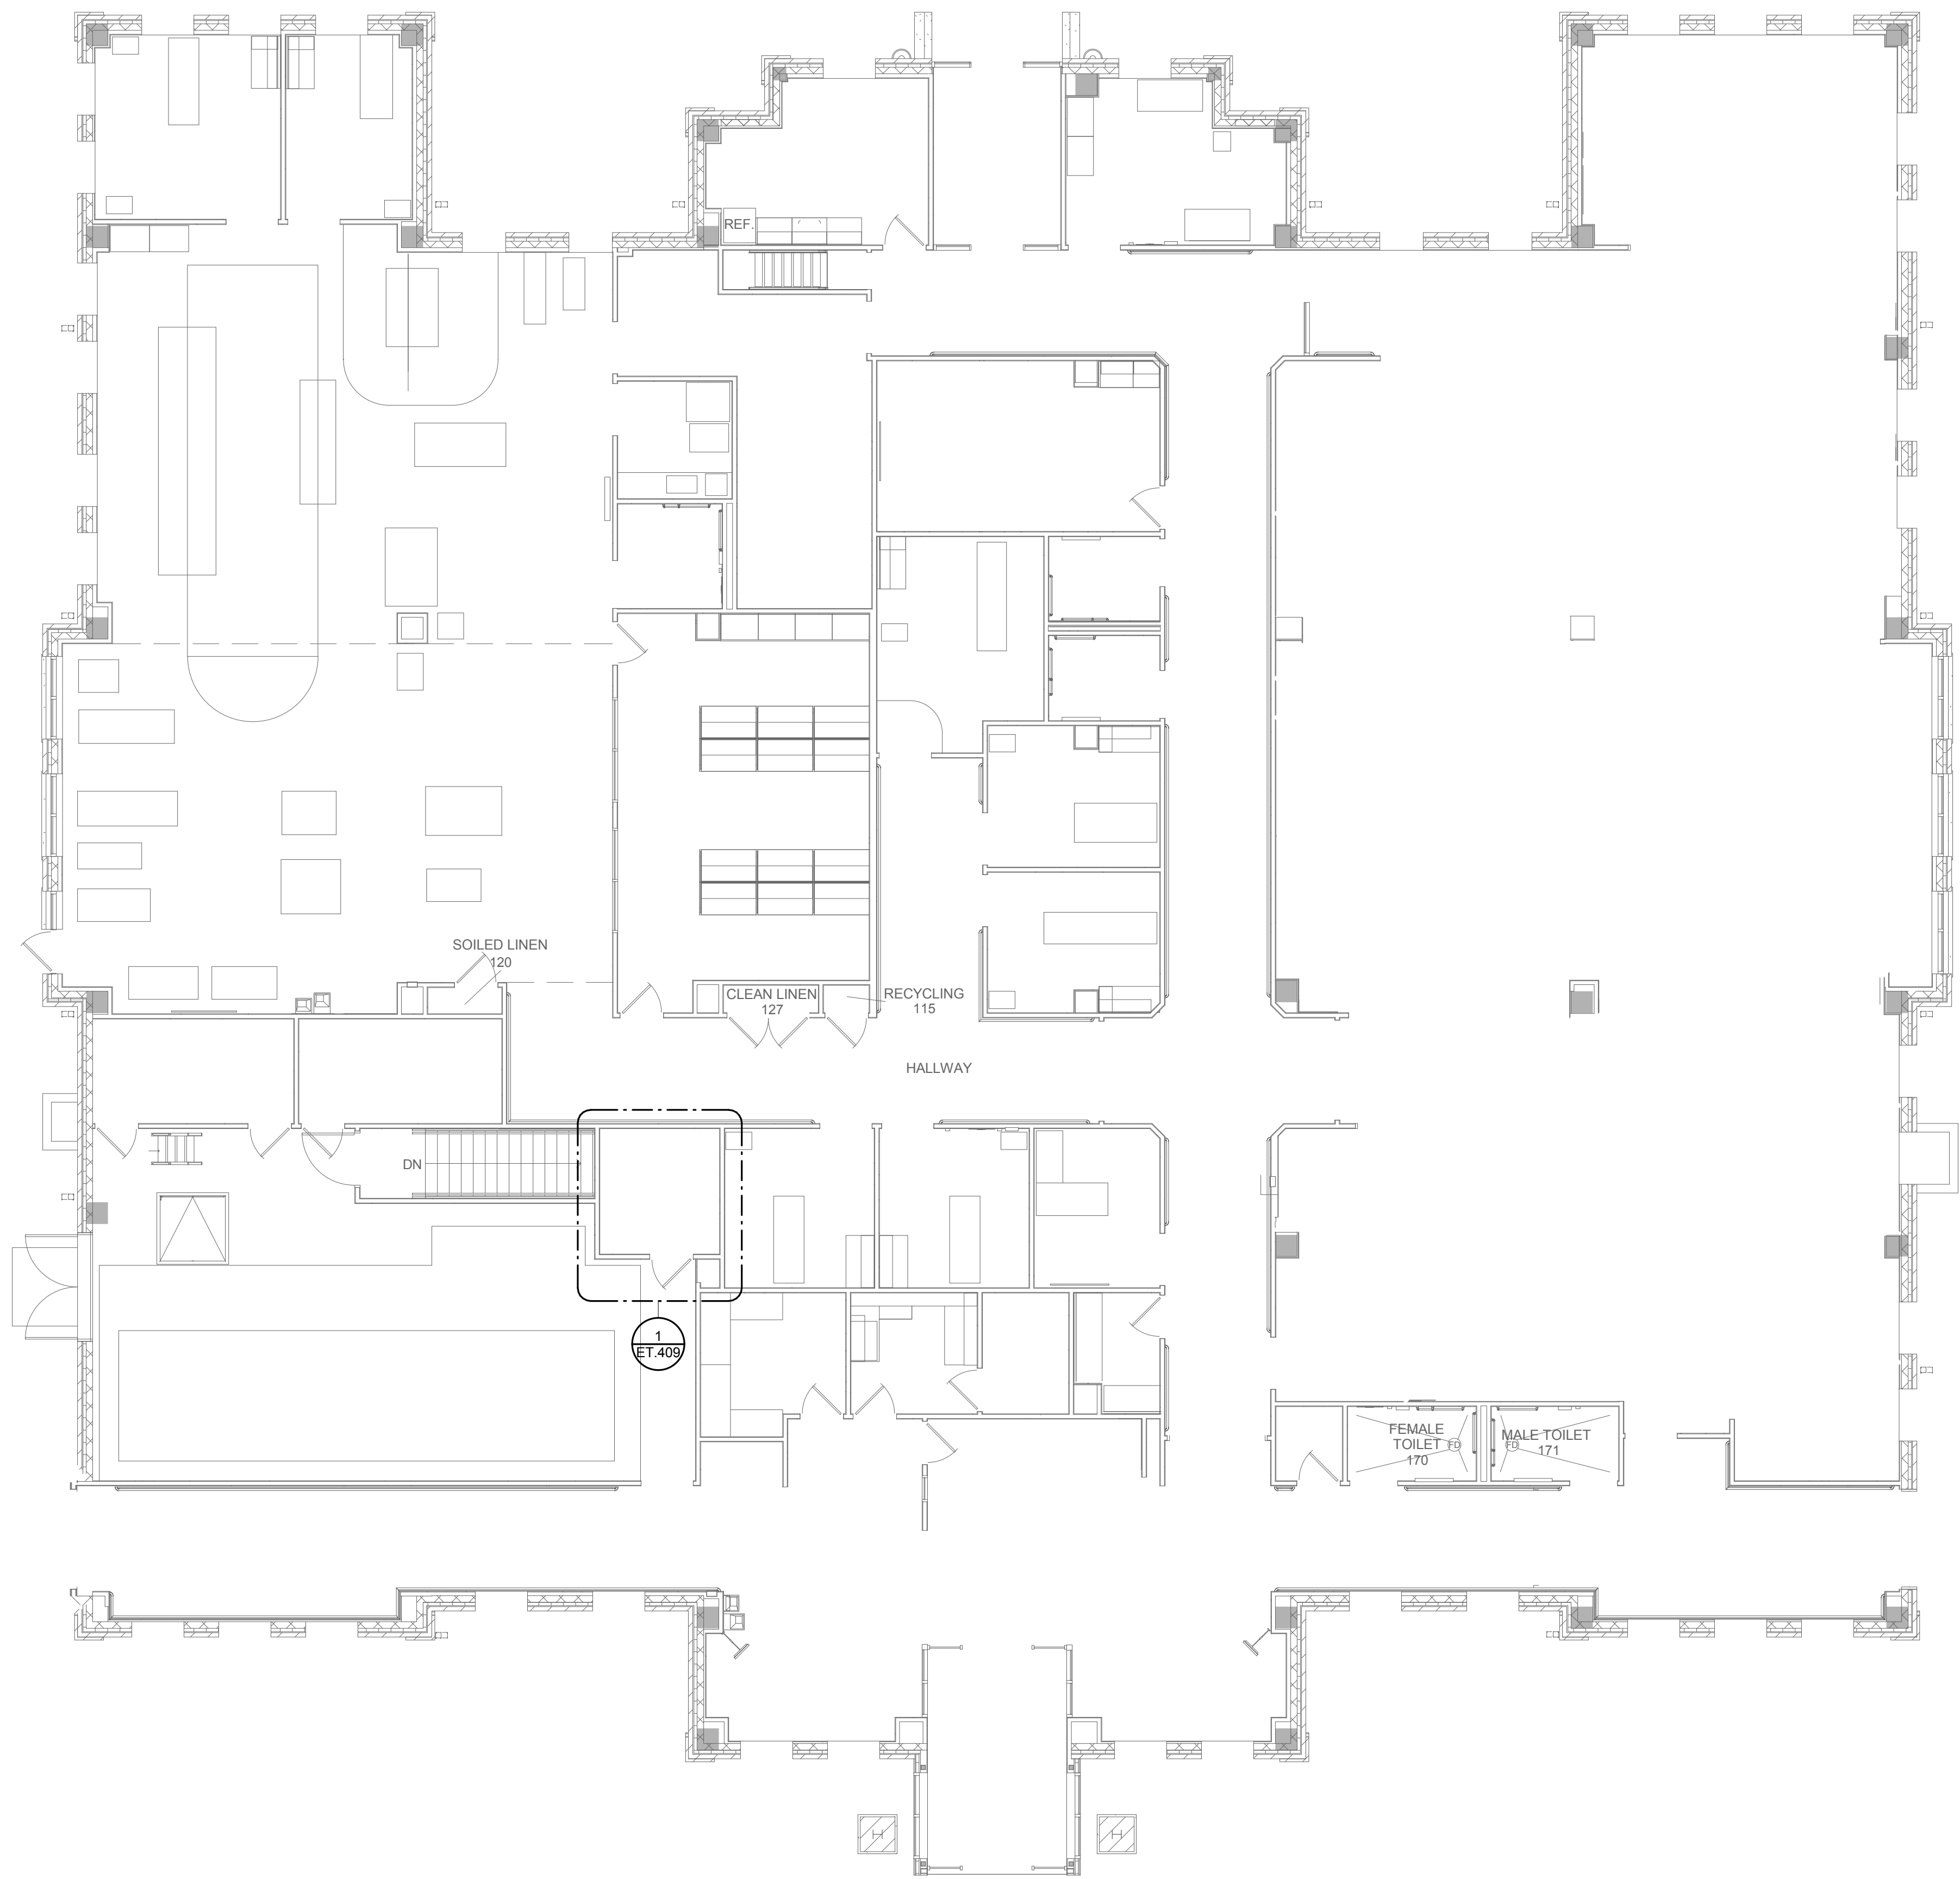

1 BUILDING 116 - PAGING SPEAKER FLOOR PLAN - FIRST FLOOR
1/8" = 1'-0"

1/24/2019 12:11:19 PM
C:\Revit\Projects\VA ST CLOUD PAGING_Bldg_ET116.dwg

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE
BUILDING 116 - PAGING SPEAKER FLOOR PLAN - FIRST FLOOR
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:
 APPROVED: CHIEF OF STAFF
 DATE:
 APPROVED: HEALTH CARE SYSTEM DIRECTOR
 DATE:

PROJECT TITLE
UPGRADE PUBLIC ADDRESS SYSTEM
 PROJECT NO.:
 BUILDING No.:
 CHECKED BY: CP
 DRAWN: CG
 ISSUE DATE: 1/24/19
 LOCATION: VA MEDICAL CENTER ST. CLOUD, MN 56303
 DRAWING NO.: **ET116-01**

VA


U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

GENERAL NOTES:

- A. PRIOR TO BID, CONTRACTOR SHALL VISIT SITE AND REVIEW SCOPE OF WORK.
- B. DEMOLITION, INSTALLATION AND TESTING SHALL BE DONE IN ACCORDANCE WITH SPECIFICATIONS.
- C. PROVIDE PUBLIC ADDRESS SYSTEM MUTING RELAYS AT EACH LOCAL SOUND SYSTEM.
- D. SPEAKERS TAGGED WITH "S" INDICATE SURFACE MOUNTED SPEAKERS. CONTRACTOR SHALL CONFIRM WALL/CILING TYPES AND REQUIREMENTS FOR SURFACE MOUNT SPEAKERS PRIOR TO INSTALLATION.
- E. REFERENCE DIVISION 7 FOR FIRESTOPPING REQUIREMENTS.
- F. PROVIDE MINIMUM 3/4" BLUE EMT FOR PUBLIC ADDRESS SYSTEM SPEAKERS.

KEY NOTES:

- 1. REMOVE EXISTING PUBLIC ADDRESS SYSTEM CABLING, CONNECTIVITY AND ENCLOSURE. REMOVE 120VAC BACK TO SOURCE. REMOVE AND RETURN PUBLIC ADDRESS SYSTEM AMPLIFIER(S) AND NETWORK SWITCH TO OWNER. REMOVAL OF EXISTING SYSTEM SHALL OCCUR AFTER THE NEW PUBLIC ADDRESS SYSTEM IS INSTALLED AND TESTED PER PROJECT REQUIREMENTS.
- 2. LEAVE EXISTING PA SYSTEM COMPONENTS IN PLACE. PROVIDE AND INSTALL NEW AC QUAD RECEPTACLE, AC OUTLET STRIPS, AC POWER LINE SURGE PROTECTOR AND FILTER, AND UPS PER SPECIFICATION 27 11 00

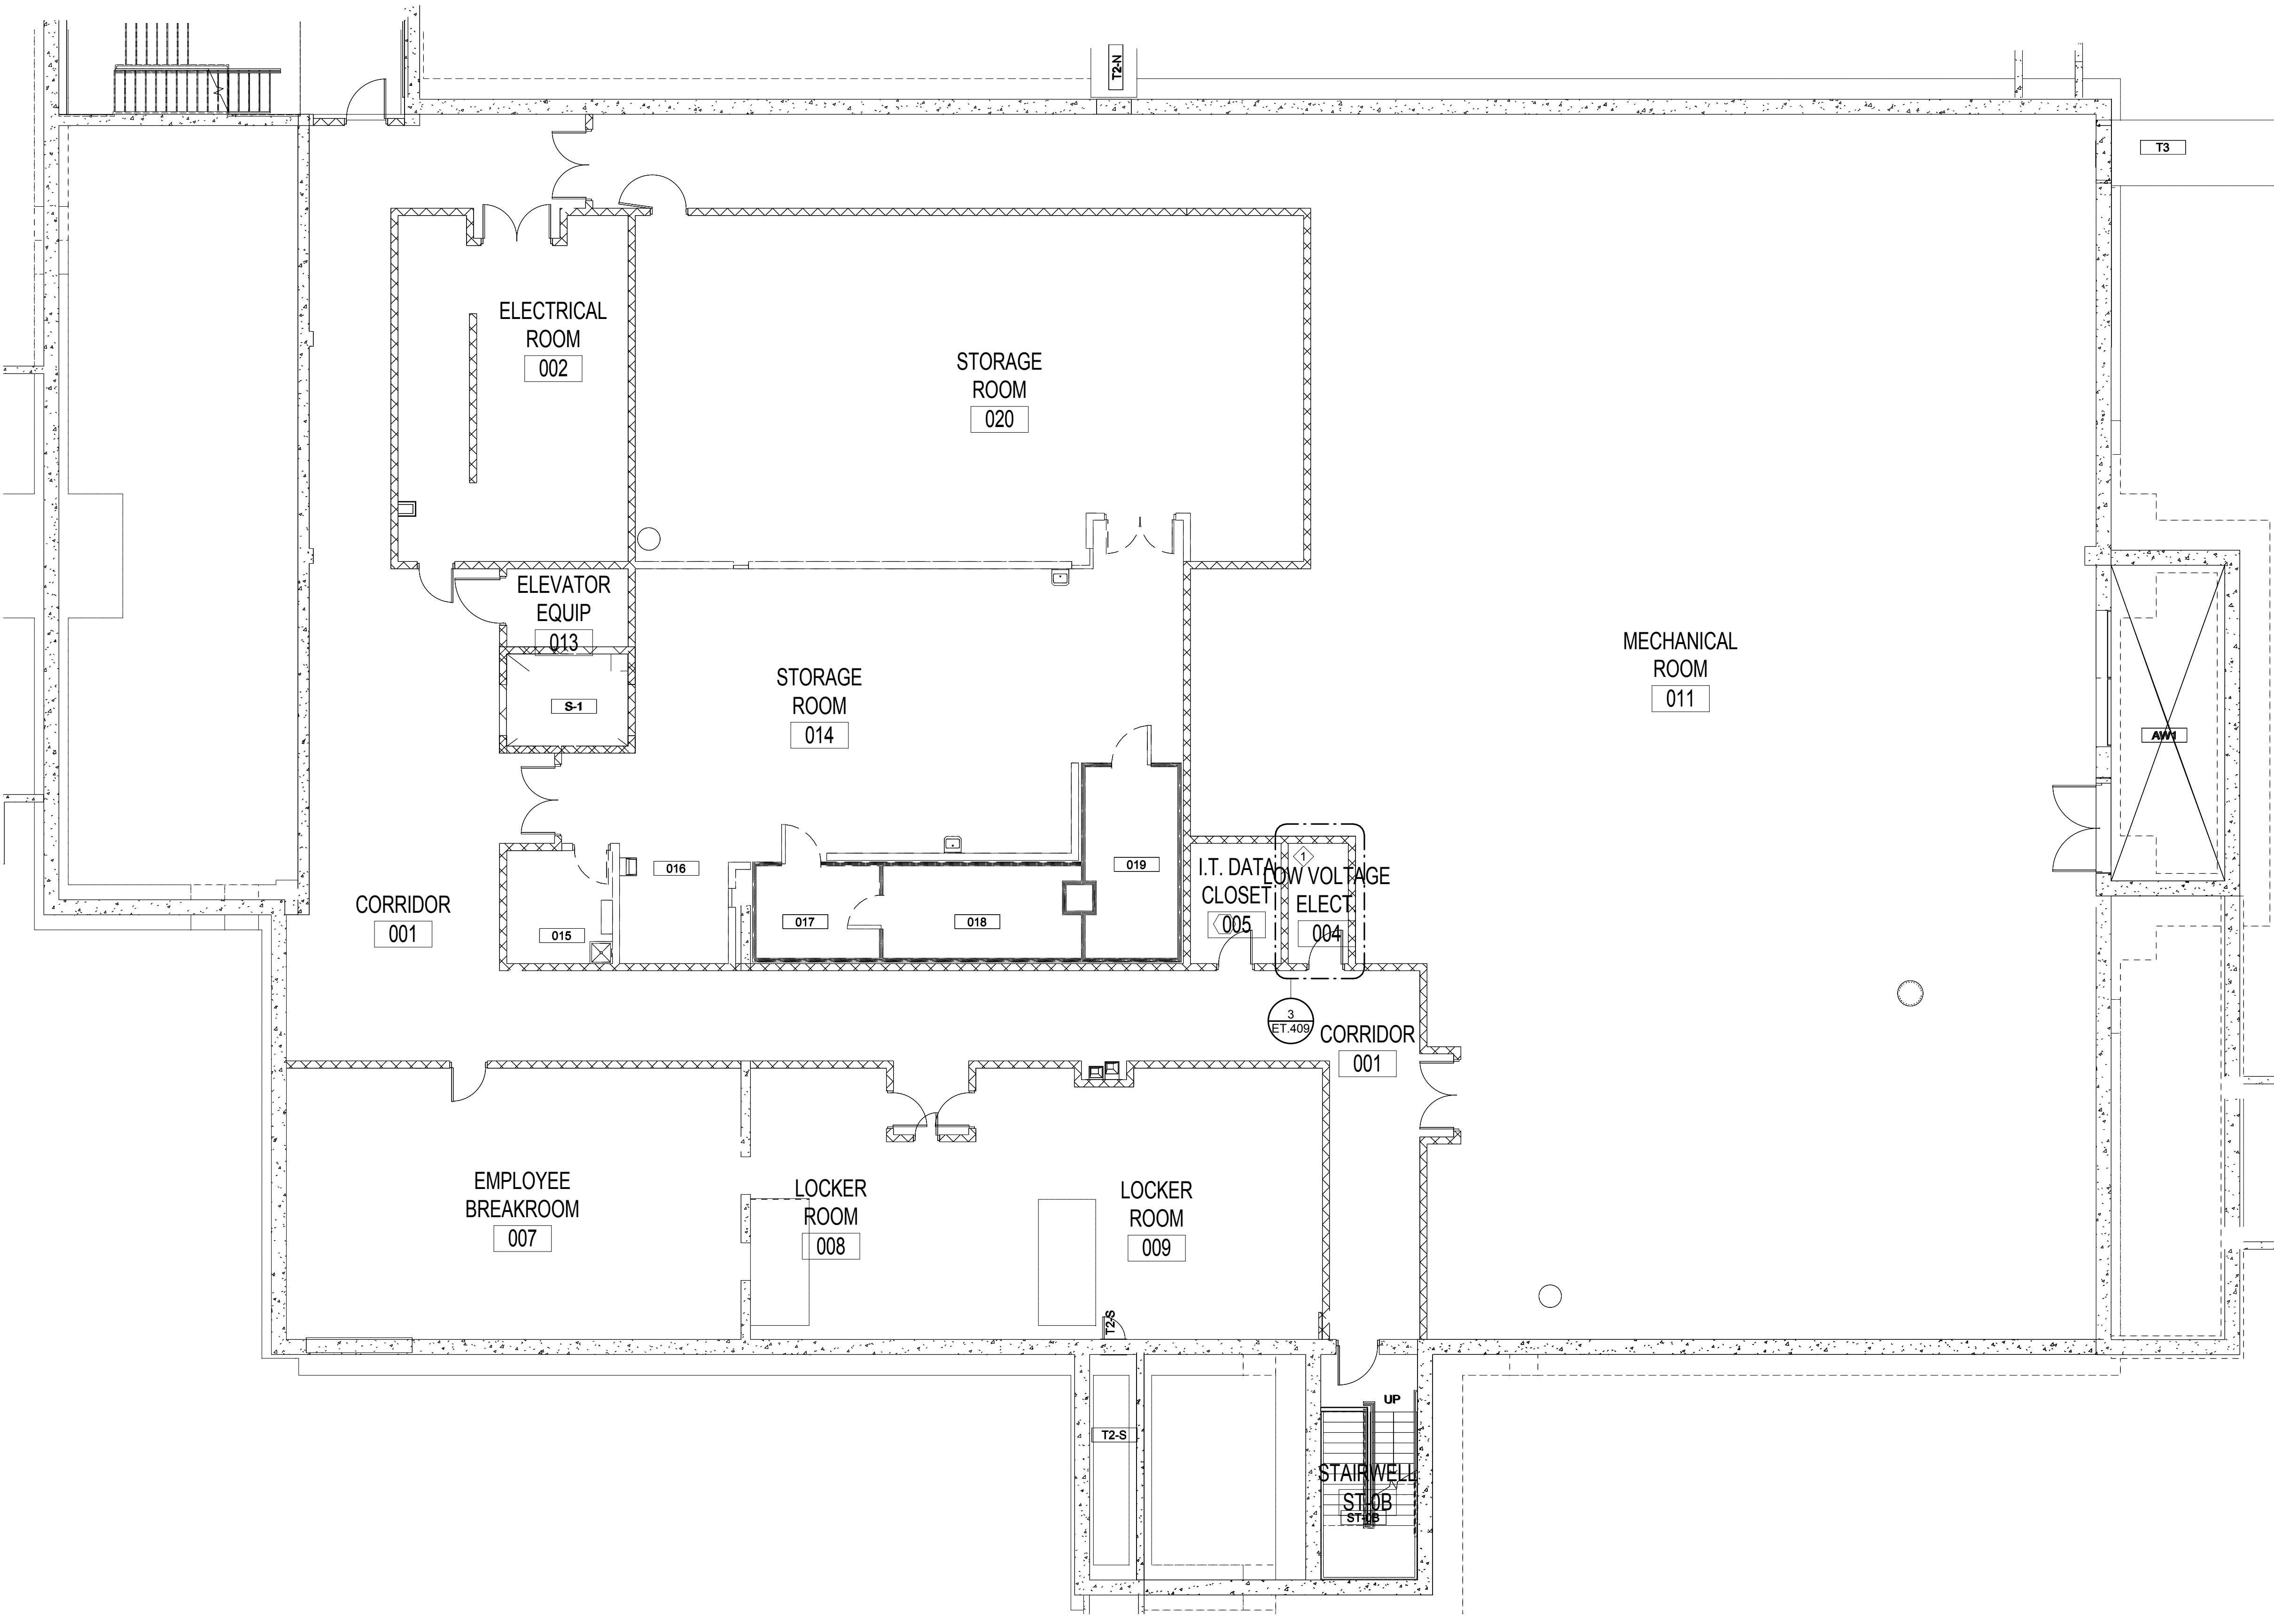

1 BUILDING 118 - PAGING SPEAKER DEMOLITION FLOOR PLAN - BASEMENT
1/8" = 1'-0"

C:\Revit\Projects\VA ST CLOUD\PAGING\Bldg_R118_chgs.rvt

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE
BUILDING 118 - PAGING SPEAKER FLOOR PLAN - BASEMENT
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:
 APPROVED: CHIEF OF STAFF
 DATE:
 APPROVED: HEALTH CARE SYSTEM DIRECTOR
 DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM		PLOT SCALE	
PROJECT NO.		DATE	
BUILDING No.	CHECKED BY	DRAWN	ISSUE DATE
	CP	CG	1/24/19
LOCATION	DATE	DRAWING NO.	
VA MEDICAL CENTER ST. CLOUD, MN 56303		ET118-00	


VA
U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

GENERAL NOTES:


- A. PROVIDE CONNECTION TO CRITICAL POWER WITHIN ROOM.
- B. PROVIDE QUAD PROVIDE QUAD RECEPTACLE WITHIN EQUIPMENT CABINET (ENCLOSURE) AND RACK. SEE 27 11 00 FOR REQUIREMENTS.
- C. PROVIDE FIBER OPTIC CONNECTORS (ST/LC) REQUIRED BETWEEN EXISTING FIBER PATCH BOX AND PUBLIC ADDRESS SYSTEM HEADEND EQUIPMENT.
- D. PROVIDE MINIMUM 3/4" ORANGE EMT BETWEEN EXISTING FIBER BOX AND PUBLIC ADDRESS SYSTEM EQUIPMENT.
- E. PROVIDE BLUE EMT BETWEEN PRE-WIRED (AND WIRED) PA CIRCUITS AND PUBLIC ADDRESS SYSTEM EQUIPMENT.
- F. FIELD VERIFY FINAL LOCATION OF PA SYSTEM HEADEND WITHIN ROOM PRIOR TO INSTALL.

KEY NOTES:


- 1. INTERCEPT AND EXTEND POWER FROM EXISTING IN-ROOM RECEPTACLE TO PDU WITHIN RACK.

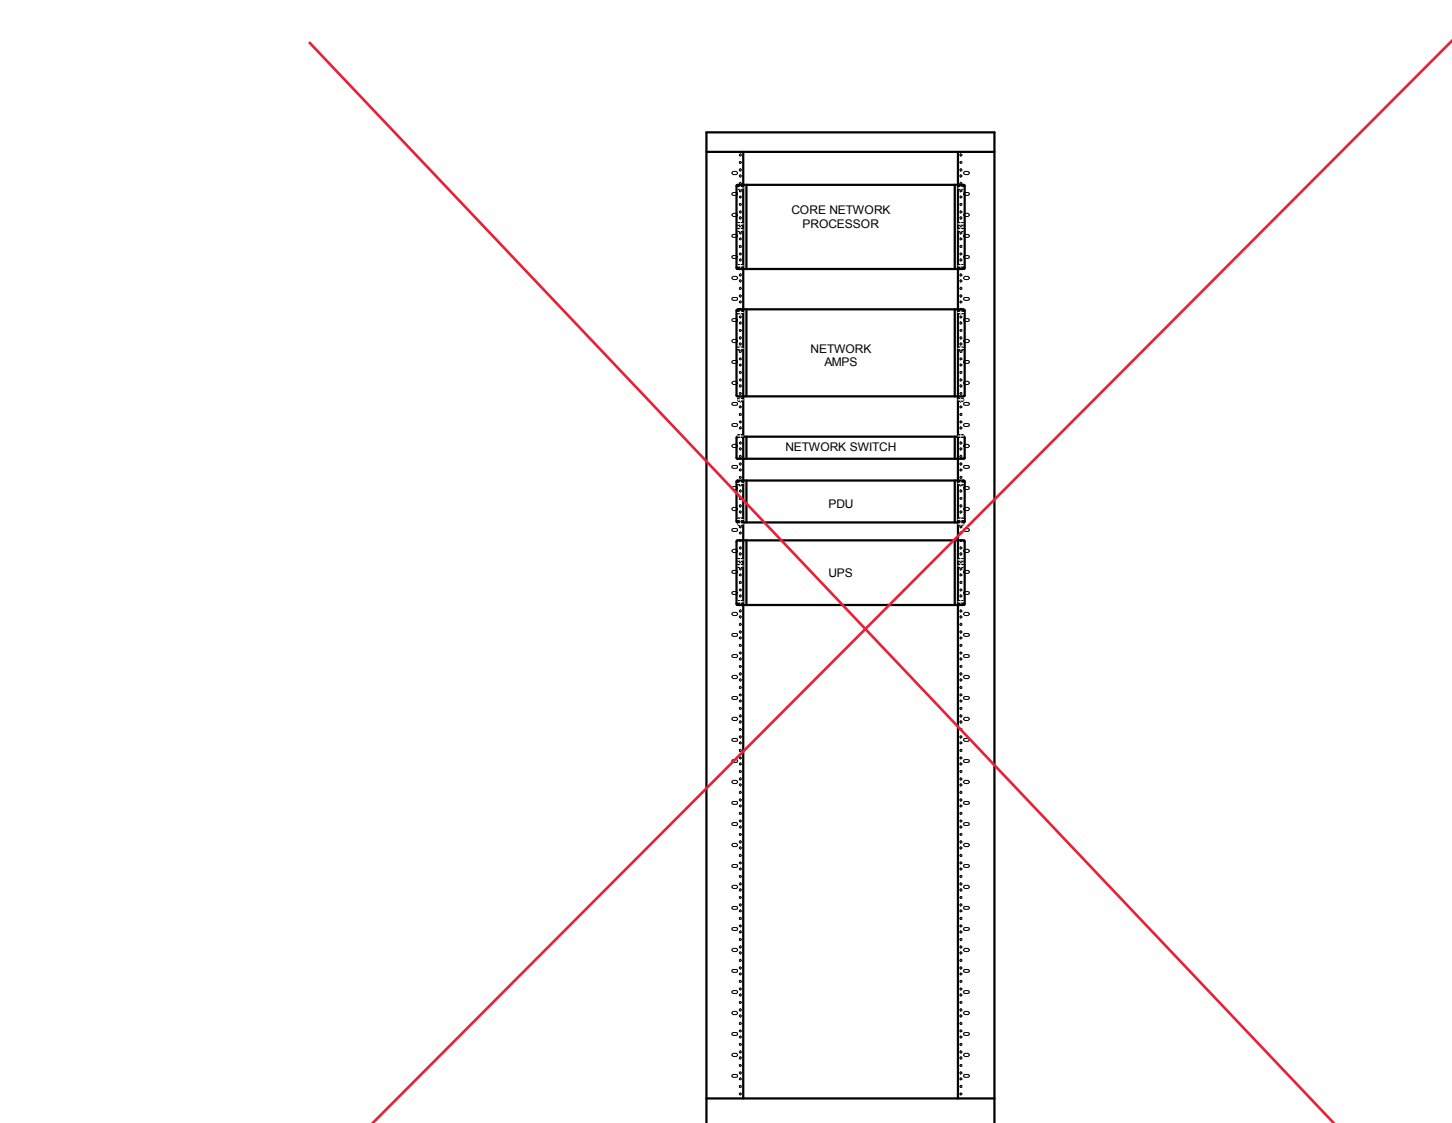


3 BLDG 4 - BASEMENT - DEMARK 041 - SOUTH ELEVATION
3/4" = 1'-0"

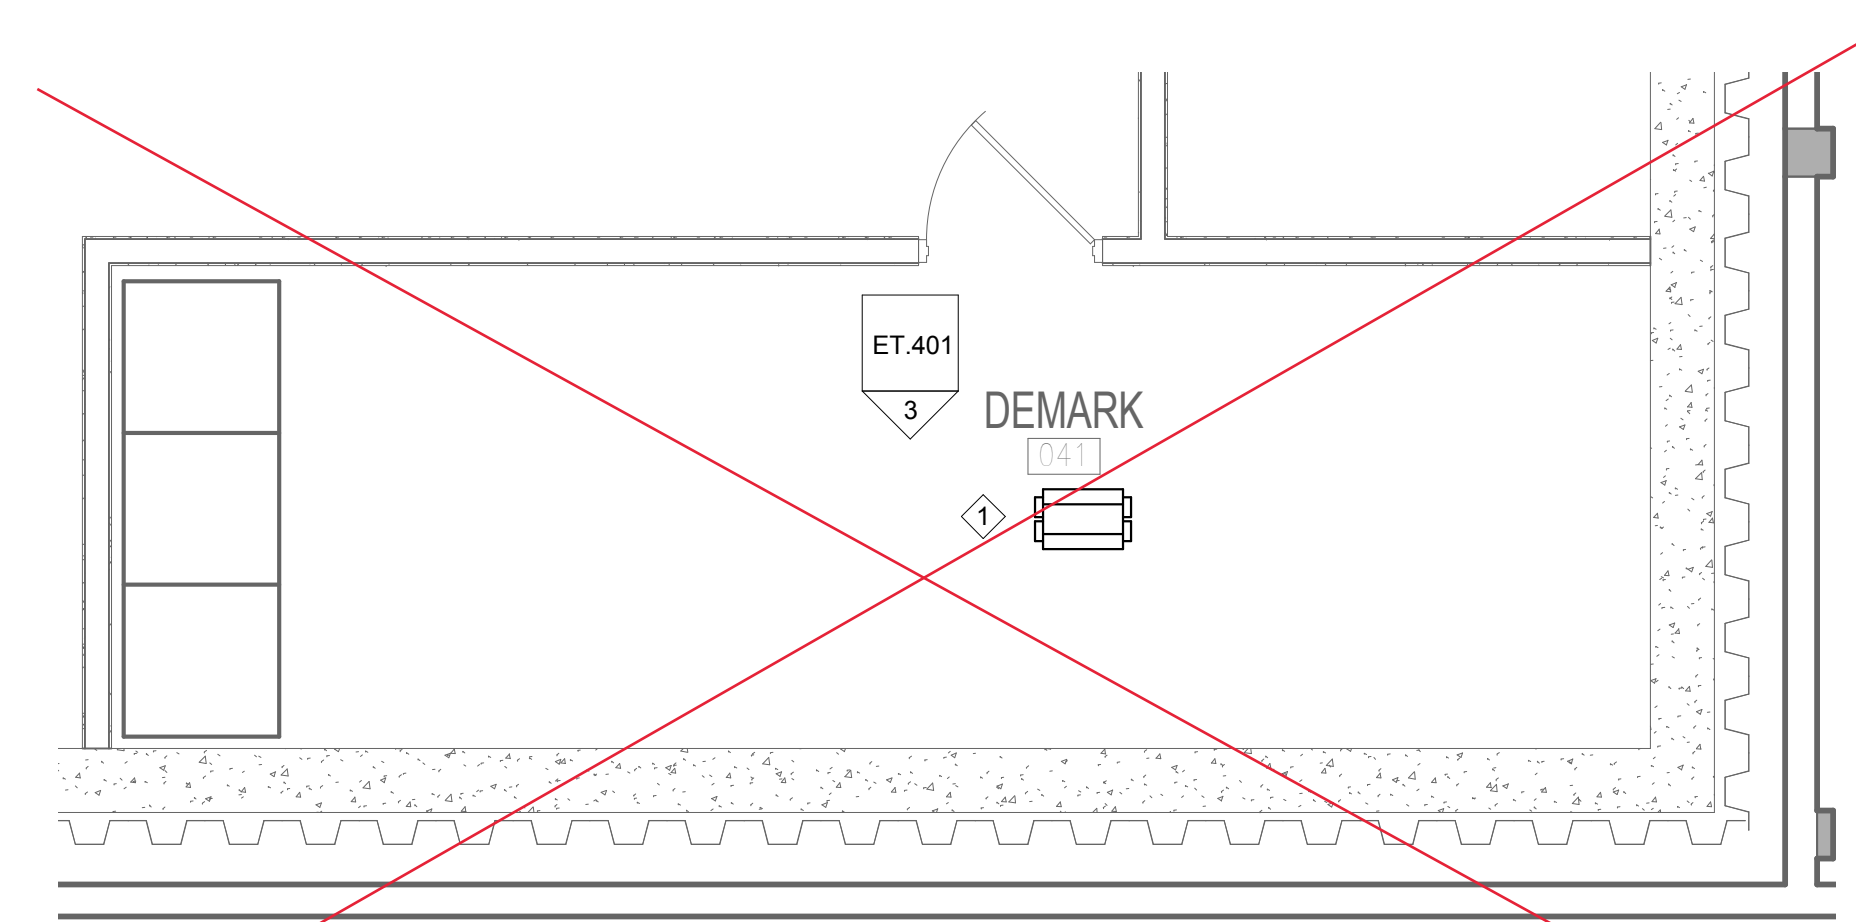


1 ENLARGED ROOM - BUILDING 4 - PA SYSTEM HEADEND UNIT
1/4" = 1'-0"

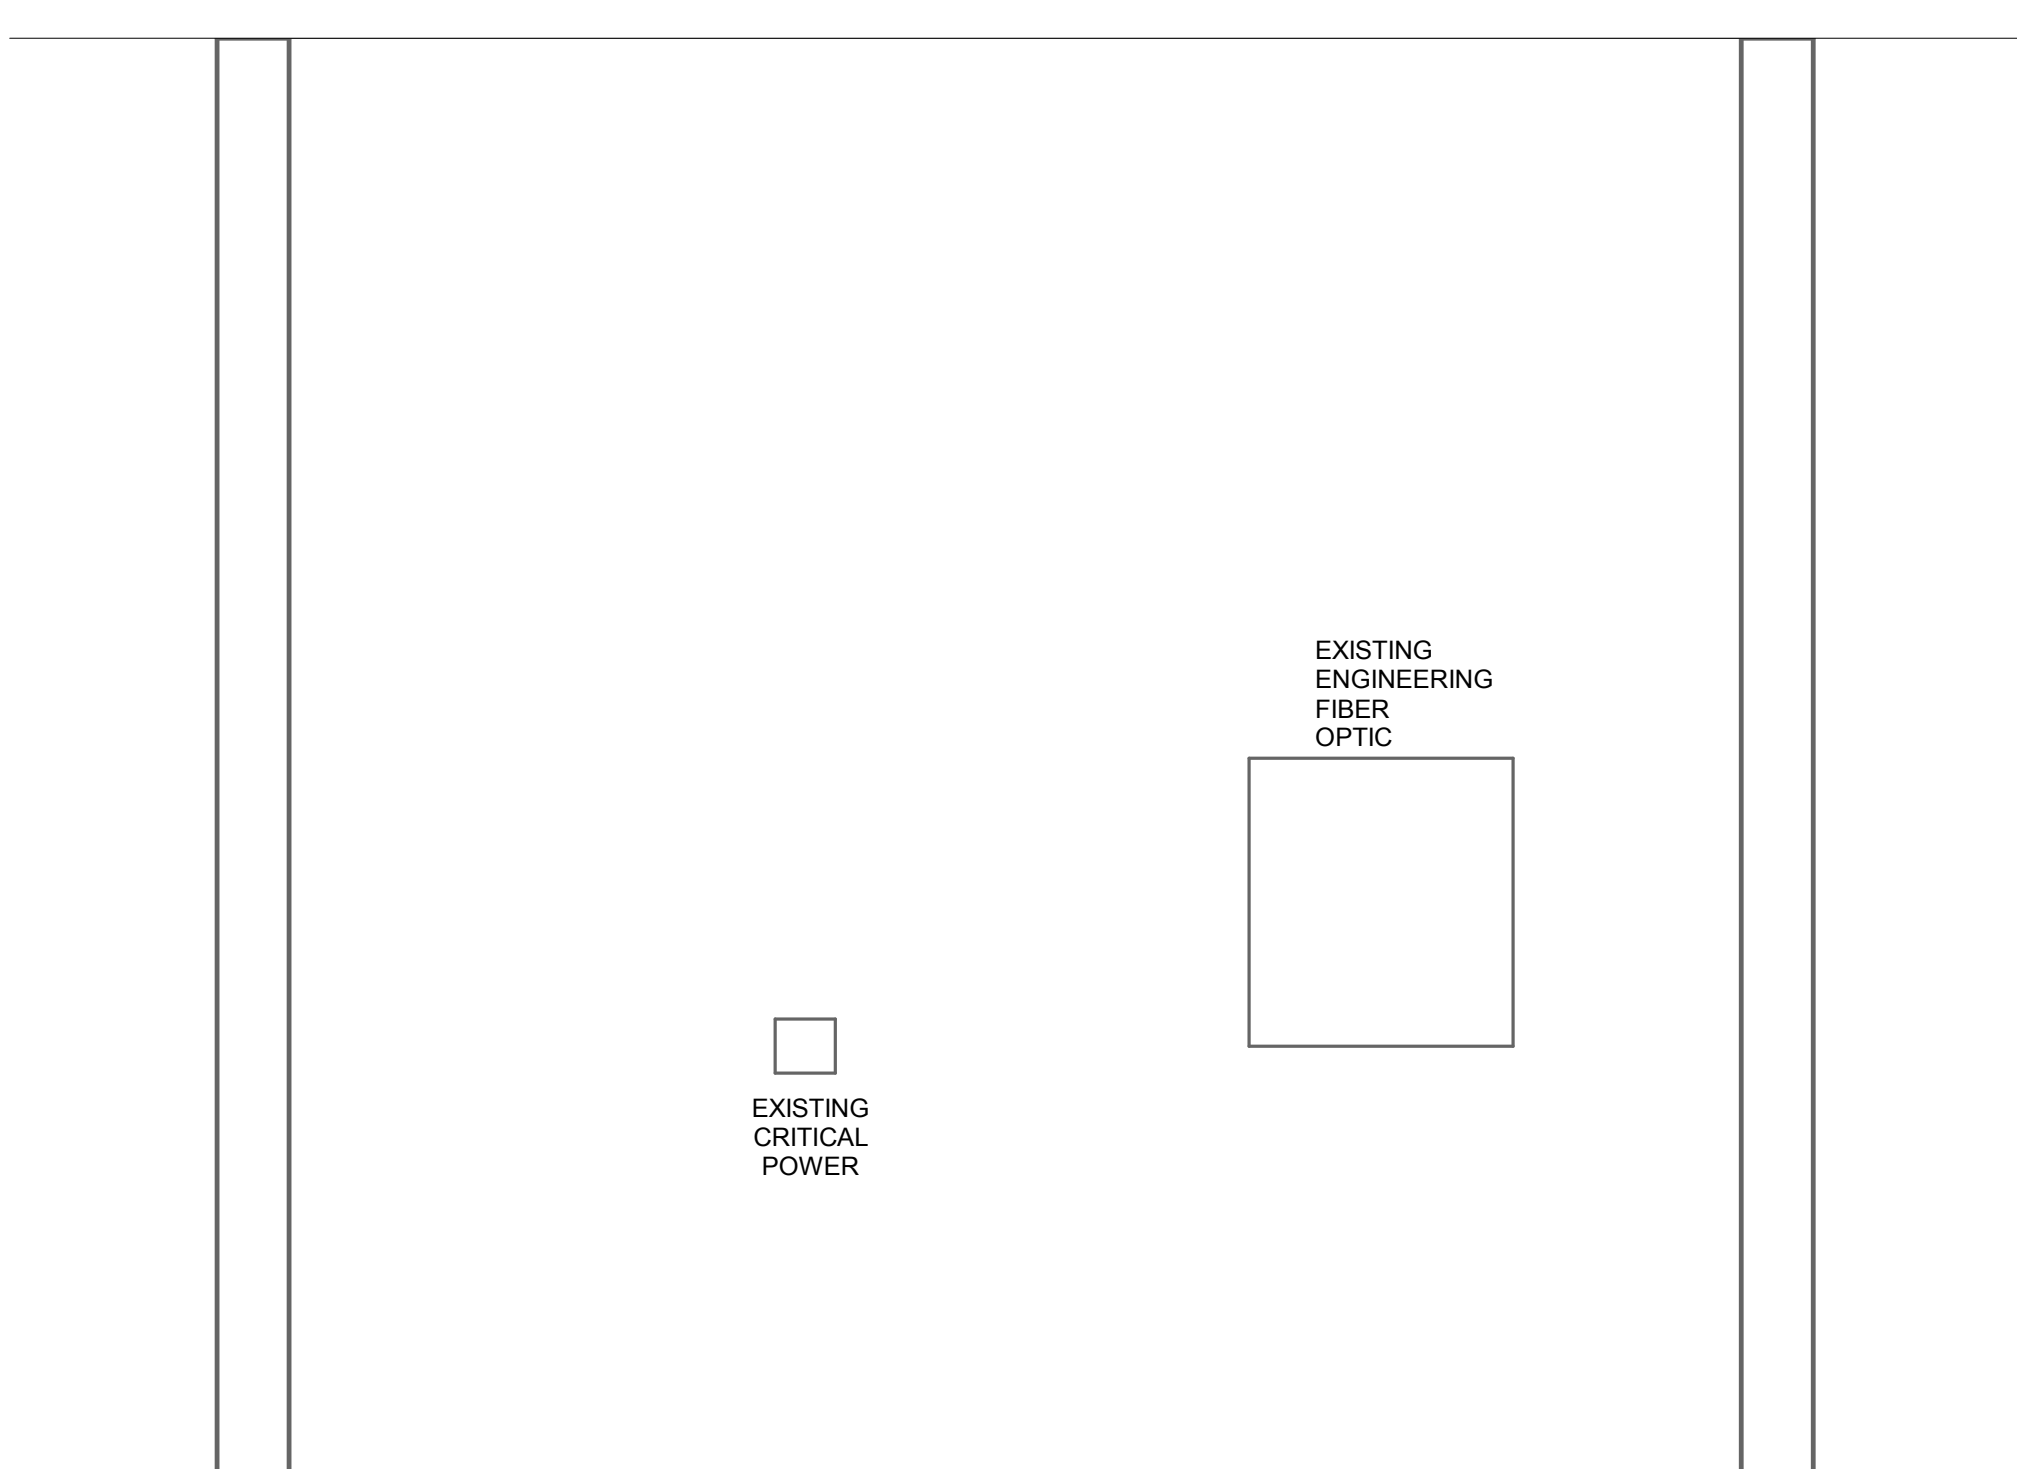

4 BLDG 1 - BASEMENT - PHONE CLOSET 1 - WEST ELEVATION
3/4" = 1'-0"

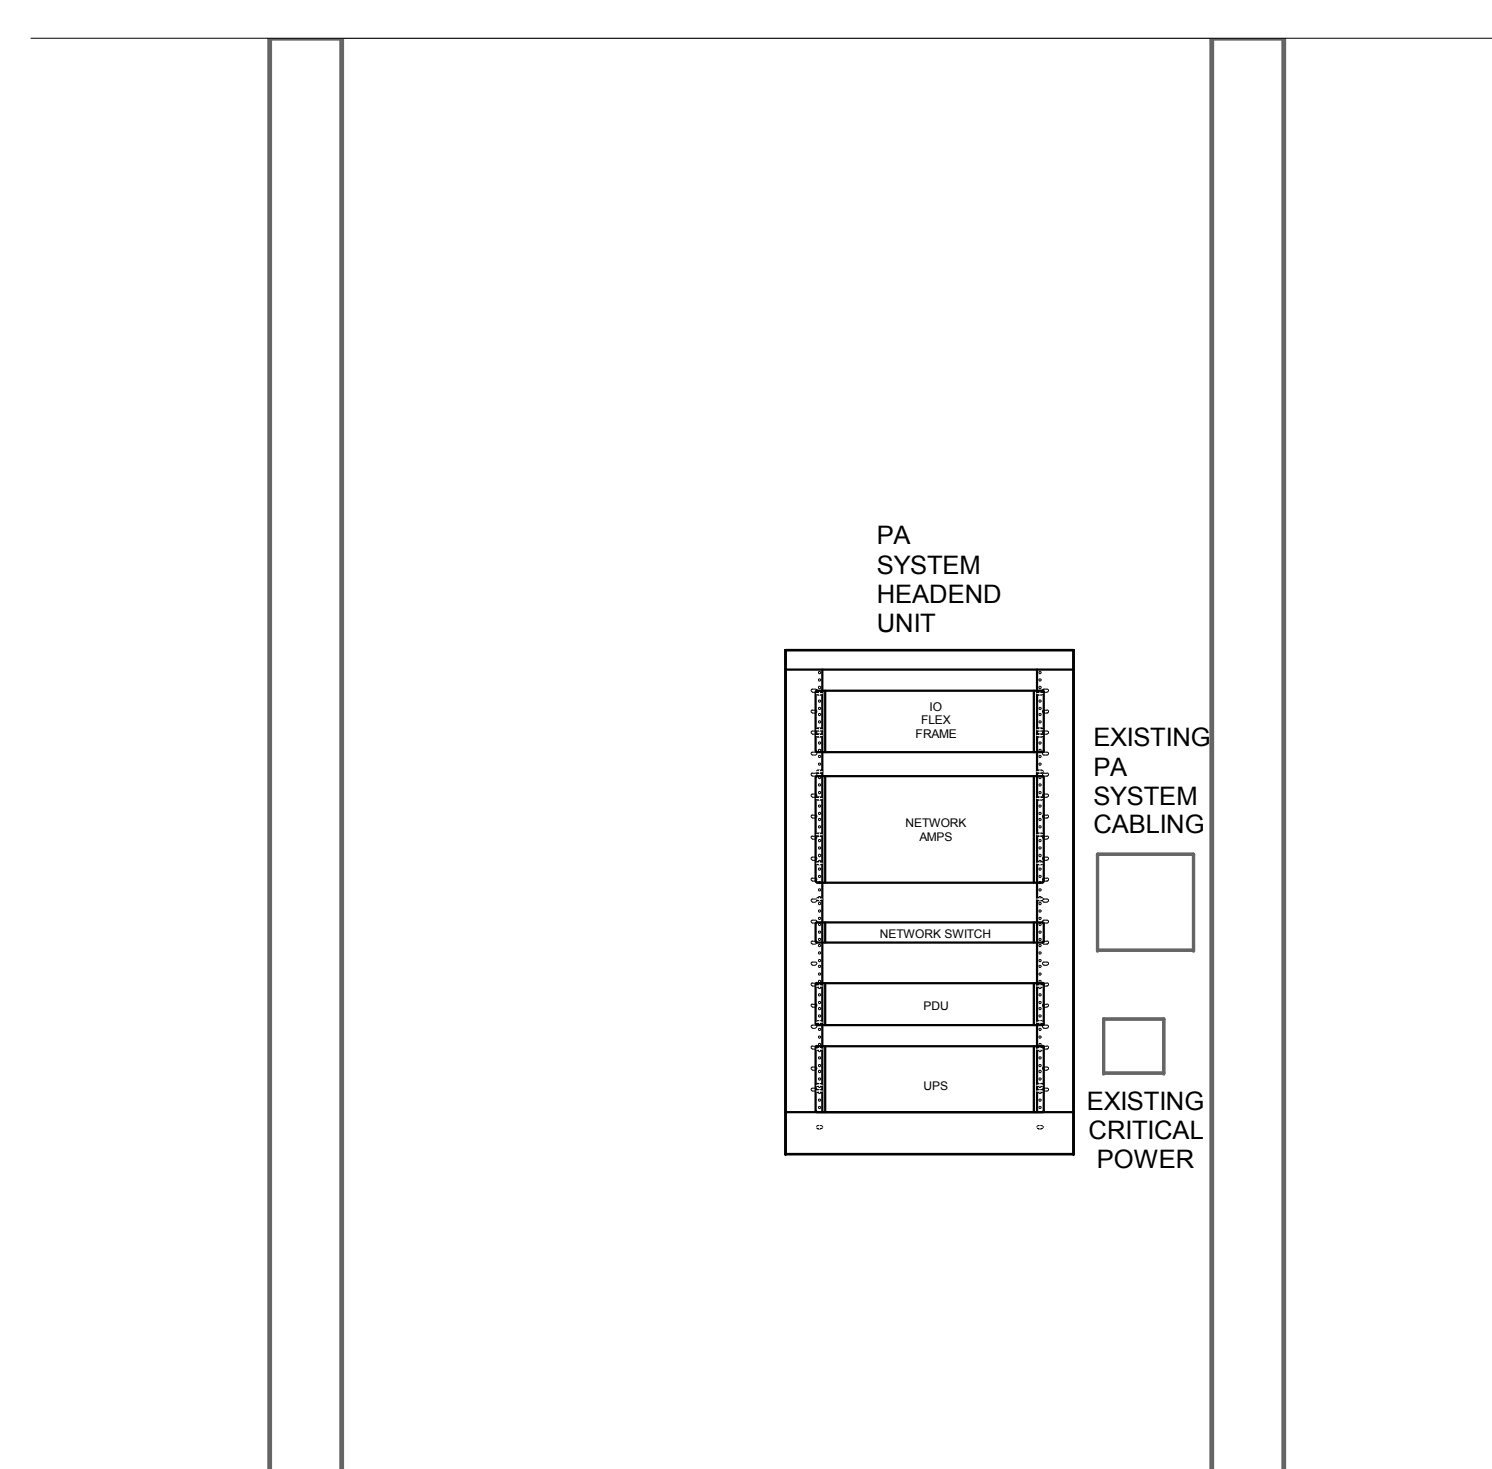

5 BLDG 1 - BASEMENT - PHONE CLOSET 1 - NORTH ELEVATION
3/4" = 1'-0"

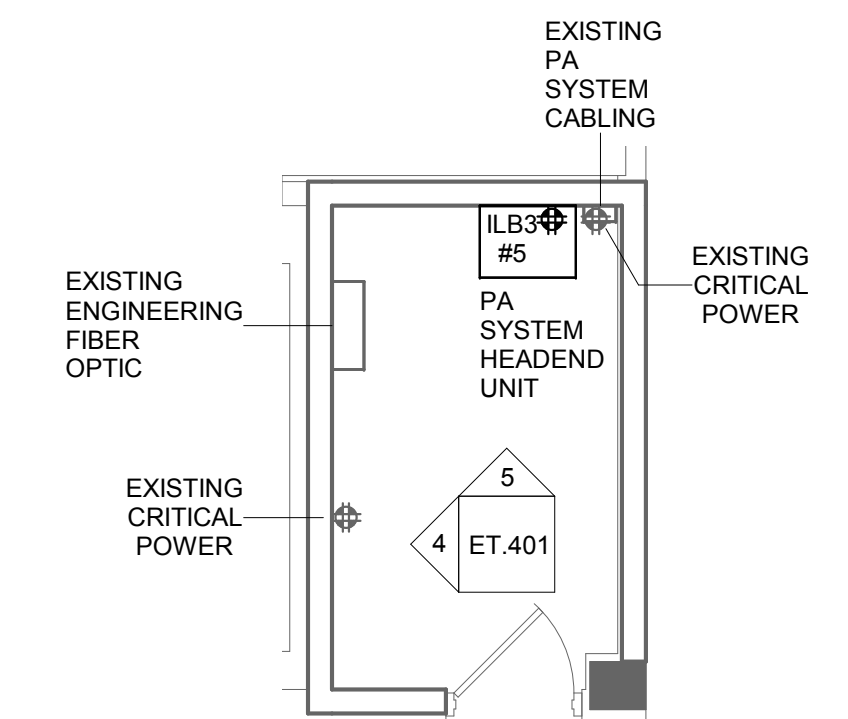

2 ENLARGED ROOM - BUILDING 1 - PA SYSTEM HEADEND UNIT
1/4" = 1'-0"

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)
DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD
ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE ENLARGED COMMUNICATION ROOM PLANS
APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
DATE:
APPROVED: CHIEF OF STAFF
DATE:
APPROVED: HEALTH CARE SYSTEM DIRECTOR
DATE:


PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM	PROJECT NO.:
BUILDING No.:	CHECKED BY: CP
DATE:	DRAWN: CG
ISSUE DATE: 1/24/19	DRAWING NO. ET.401
LOCATION: VA MEDICAL CENTER ST. CLOUD, MN 56303	DATE:

VA U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System


C:\Revit\Projects\VA ST CLOUD\PAINGE_Bldg_R12_cmg.rvt 1/24/2019 11:21:17 PM

- GENERAL NOTES:**
- A. PROVIDE CONNECTION TO CRITICAL POWER WITHIN ROOM, IF AVAILABLE.
 - B. PROVIDE QUAD RECEPTACLE WITHIN EACH EQUIPMENT CABINET (ENCLOSURE). SEE 27 11 00 FOR REQUIREMENTS.
 - C. PROVIDE FIBER OPTIC CONNECTORS (ST/LO) REQUIRED BETWEEN EXISTING FIBER PATCH BOX AND PUBLIC ADDRESS SYSTEM HEADEND EQUIPMENT.
 - D. PROVIDE MINIMUM 3/4" ORANGE EMT BETWEEN EXISTING FIBER BOX AND PUBLIC ADDRESS SYSTEM EQUIPMENT.
 - E. PROVIDE BLUE EMT BETWEEN PRE-WIRED (AND WIRED) PA CIRCUITS AND PUBLIC ADDRESS SYSTEM EQUIPMENT.
 - F. FIELD VERIFY FINAL LOCATION OF PA SYSTEM HEADEND WITHIN ROOM PRIOR TO INSTALL.


- KEY NOTES:**
- ① PROVIDE PUBLIC ADDRESS SYSTEM WALL MOUNTED EQUIPMENT TO MOUNT VERTICALLY WITHIN SHALLOW ROOM. PROVIDE WALL BRACKETS FOR EACH PIECE OF EQUIPMENT REQUIRED. REMOVE AND RETURN EXISTING PA NETWORK SWITCH BACK TO OWNER UPON COMPLETION OF NEW PUBLIC ADDRESS SYSTEM. **SALVAGE AND REINSTALL.**
 - ② PROVIDE INSTALLATION OF PUBLIC ADDRESS SYSTEM RACK ADJACENT TO MECHANICAL DUCTWORK. EXTEND 120V POWER FROM EXISTING RECEPTACLE INTO RACK.

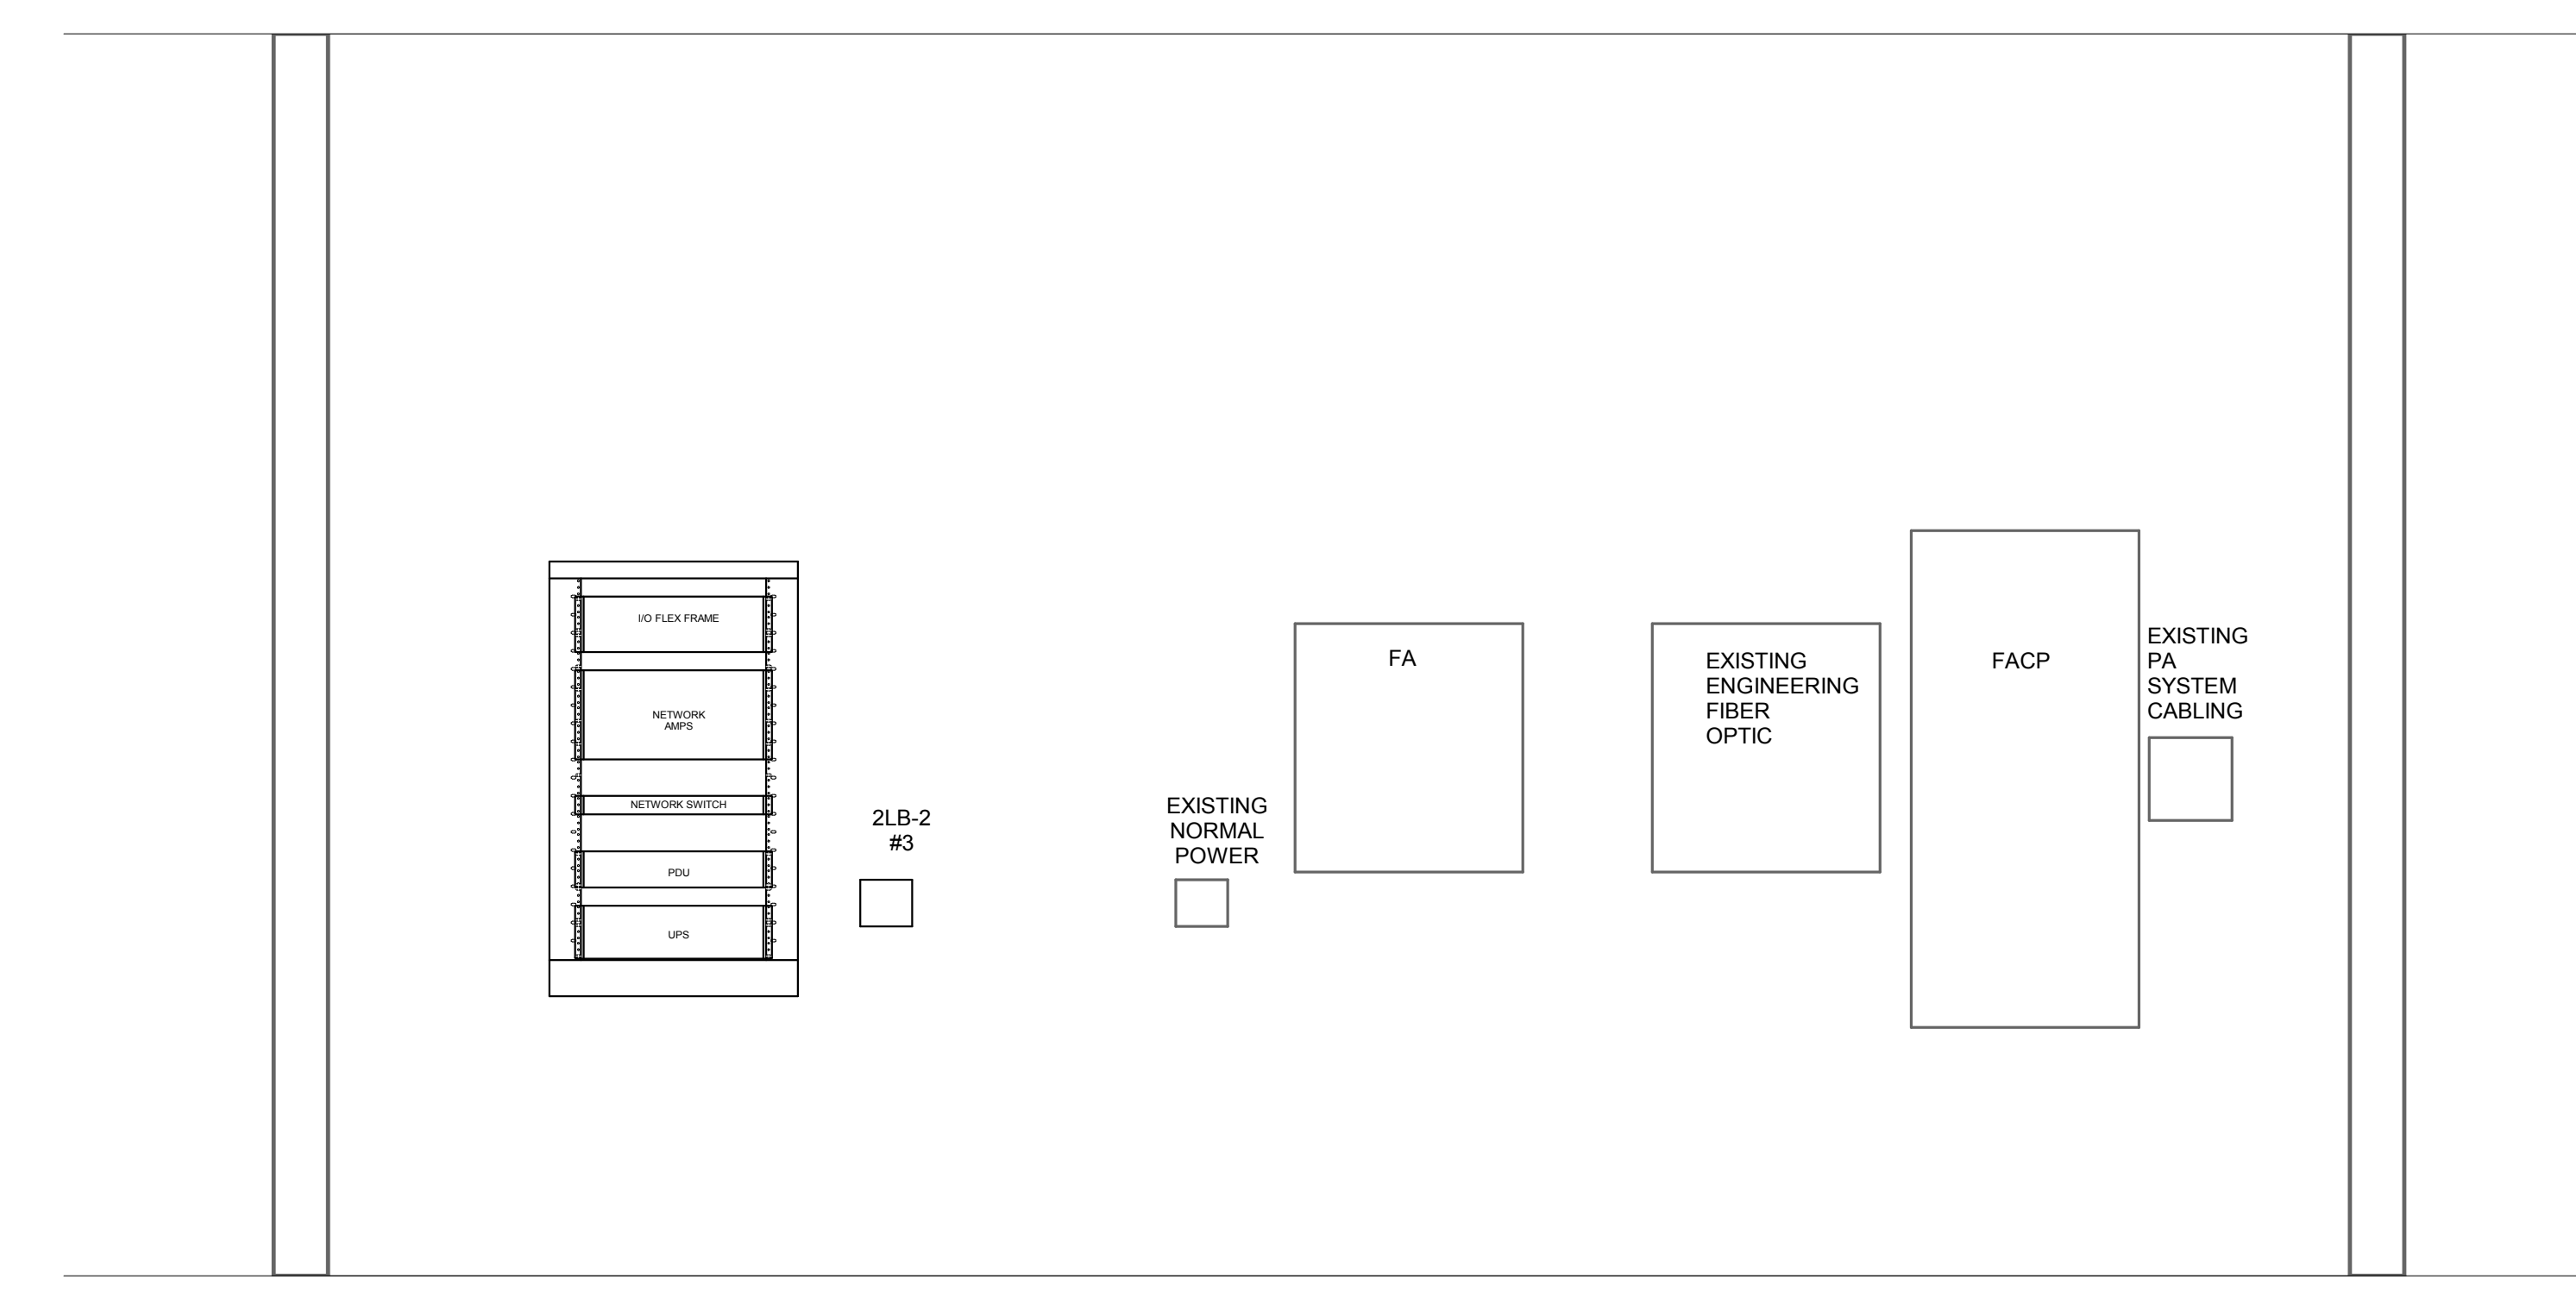


② BLDG 2 - BASEMENT - PHONE CLOSET 1 - NORTH ELEVATION
3/4" = 1'-0"

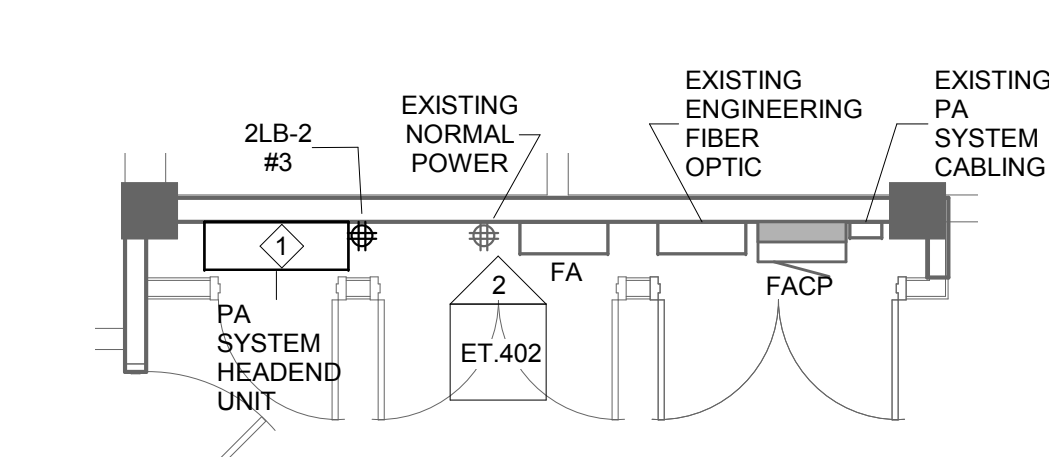


① ENLARGED ROOM - BUILDING 2 - PA SYSTEM HEADEND UNIT
1/4" = 1'-0"

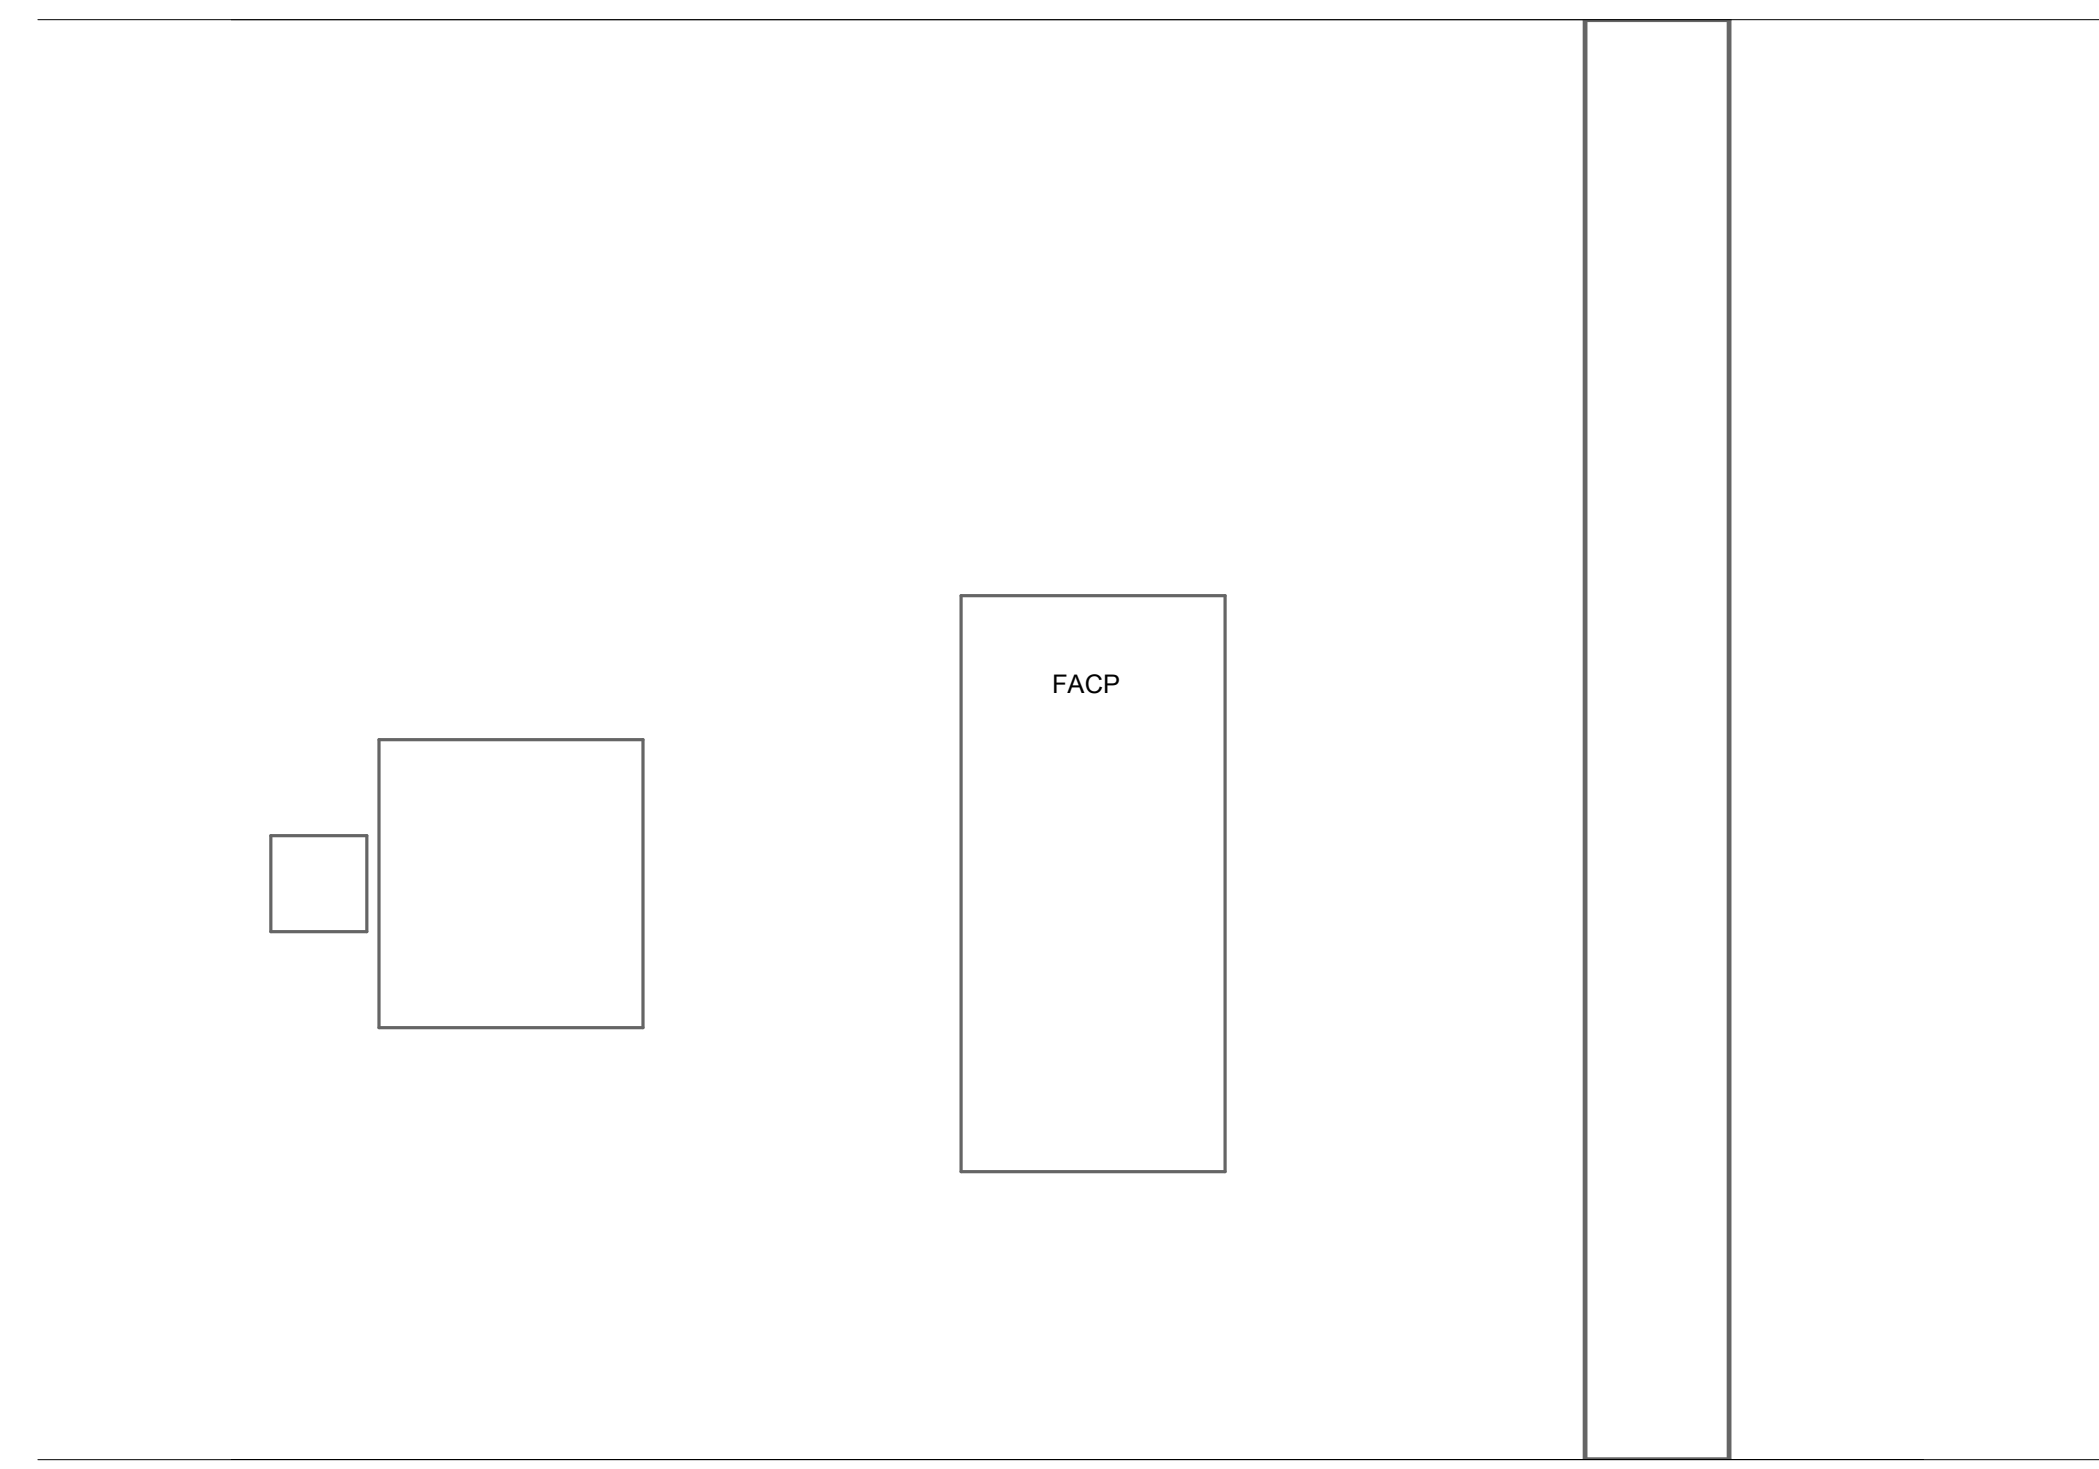

④ BLDG 3 - BASEMENT - BASEMENT 1 - NORTH ELEVATION
3/4" = 1'-0"

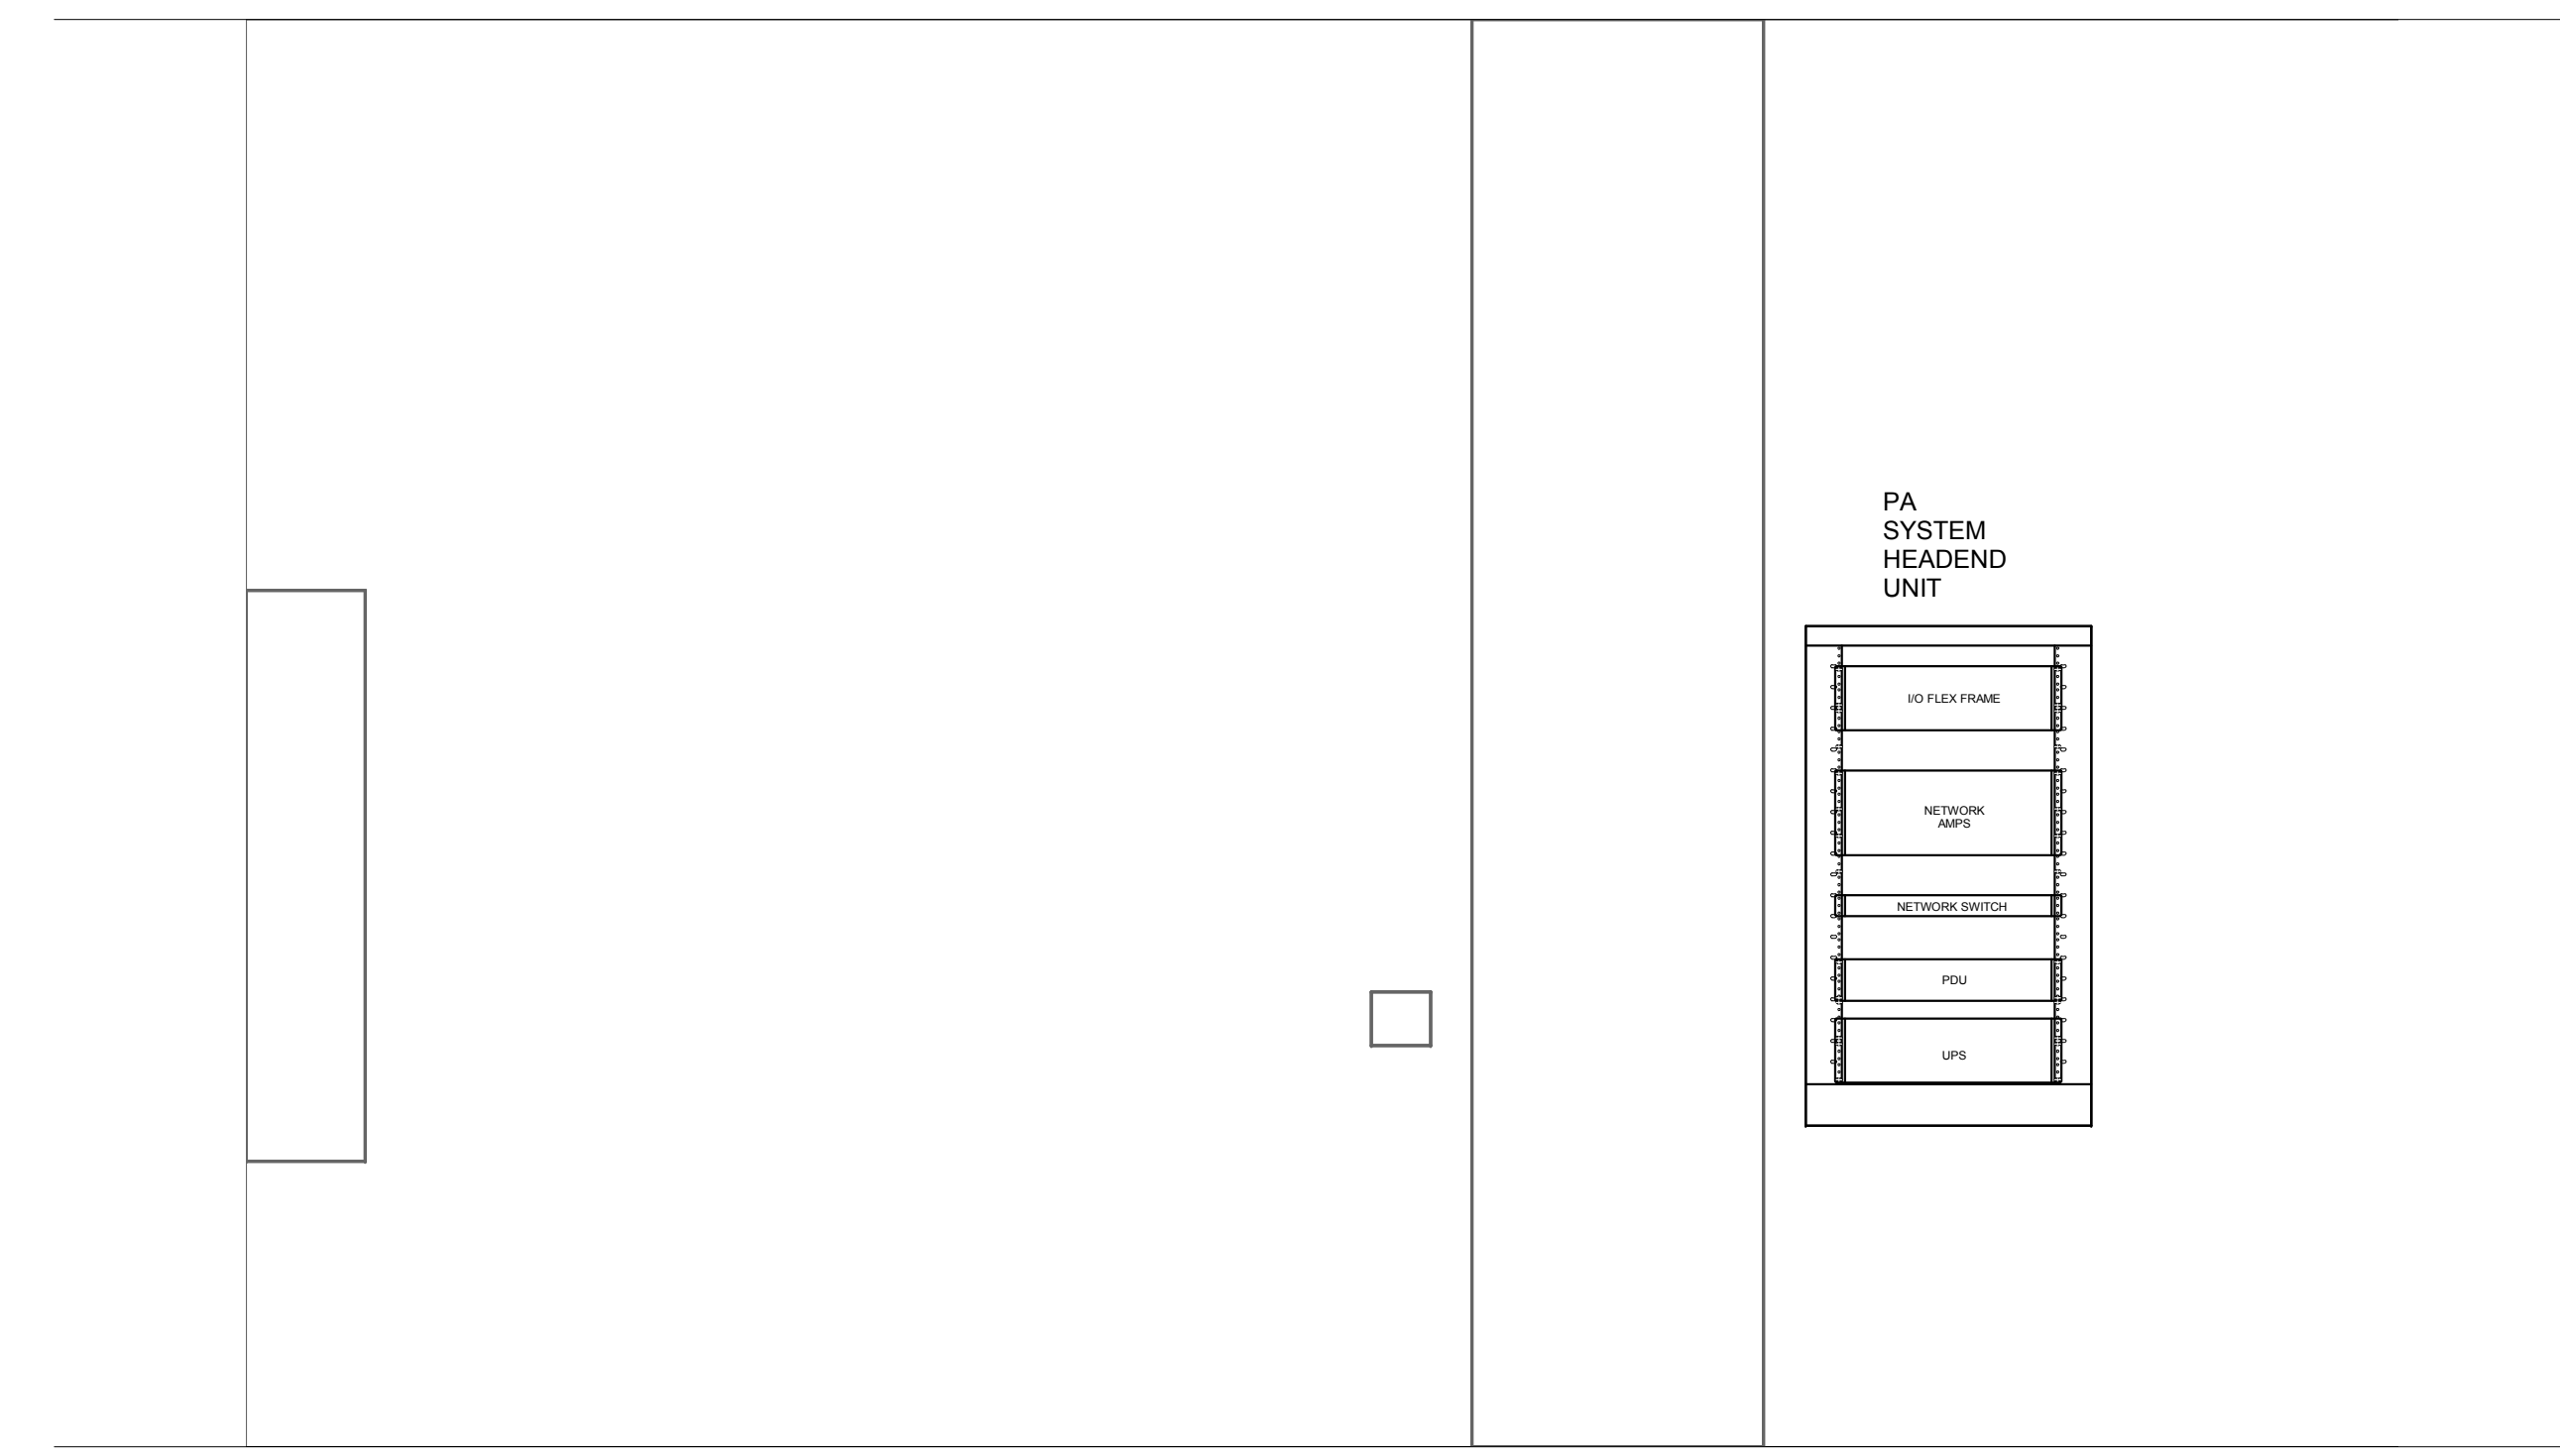

⑤ BLDG 3 - BASEMENT - BASEMENT 1 - EAST ELEVATION
3/4" = 1'-0"

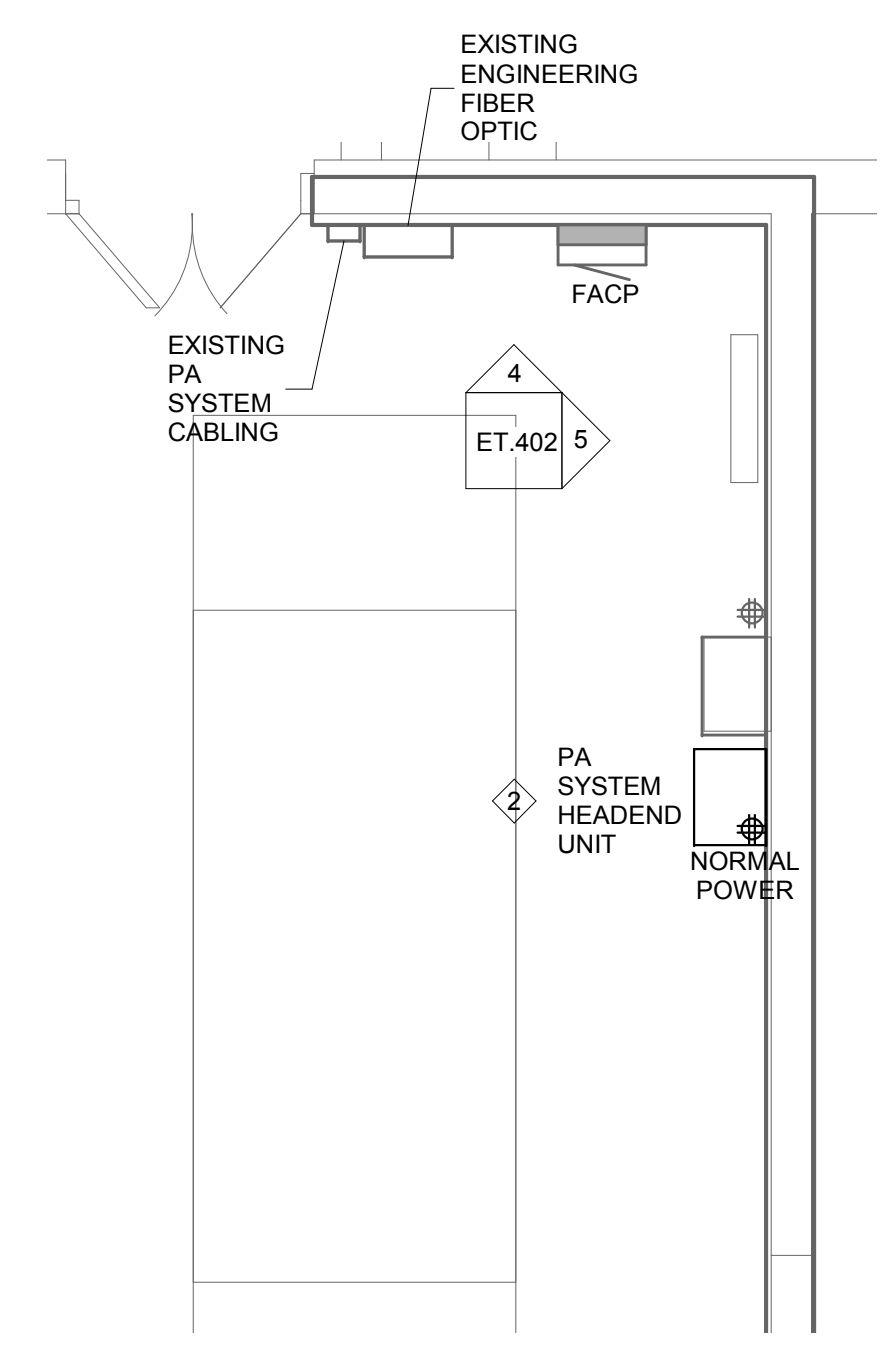

③ ENLARGED ROOM - BUILDING 3 - PA SYSTEM HEADEND UNIT
1/4" = 1'-0"

1/24/2019 12:11:17 PM
C:\Revit\Projects\VA ST CLOUD\PA\ENR\ENR_PAGIN02_Bldg_R12.dwg

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)
DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD
ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com
 AE PROJECT NUMBER: Project Number

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR	DATE:
APPROVED: CHIEF OF STAFF	DATE:
APPROVED: HEALTH CARE SYSTEM DIRECTOR	DATE:

DRAWING TITLE ENLARGED COMMUNICATION ROOM PLANS		PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM	
DATE:		PROJECT NO.:	
BUILDING NO.:	CHECKED BY:	DRAWN:	ISSUE DATE:
	CP	CG	1/24/19
LOCATION VA MEDICAL CENTER ST. CLOUD, MN 56303		DRAWING NO. ET.402	


VA U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

GENERAL NOTES:


- A. PROVIDE CONNECTION TO CRITICAL POWER WITHIN ROOM.
- B. PROVIDE QUAD RECEPTACLE WITHIN EACH EQUIPMENT CABINET (ENCLOSURE). SEE 27 11 00 FOR REQUIREMENTS.
- C. PROVIDE FIBER OPTIC CONNECTORS (ST/LC) REQUIRED BETWEEN EXISTING FIBER PATCH BOX AND PUBLIC ADDRESS SYSTEM HEADEND EQUIPMENT.
- D. PROVIDE MINIMUM 3/4" ORANGE EMT BETWEEN EXISTING FIBER BOX AND PUBLIC ADDRESS SYSTEM EQUIPMENT.
- E. PROVIDE BLUE EMT BETWEEN PRE-WIRED (AND WIRED) PA CIRCUITS AND PUBLIC ADDRESS SYSTEM EQUIPMENT.
- F. FIELD VERIFY FINAL LOCATION OF PA SYSTEM HEADEND WITHIN ROOM PRIOR TO INSTALL.

KEY NOTES:


Ⓛ NOT USED.

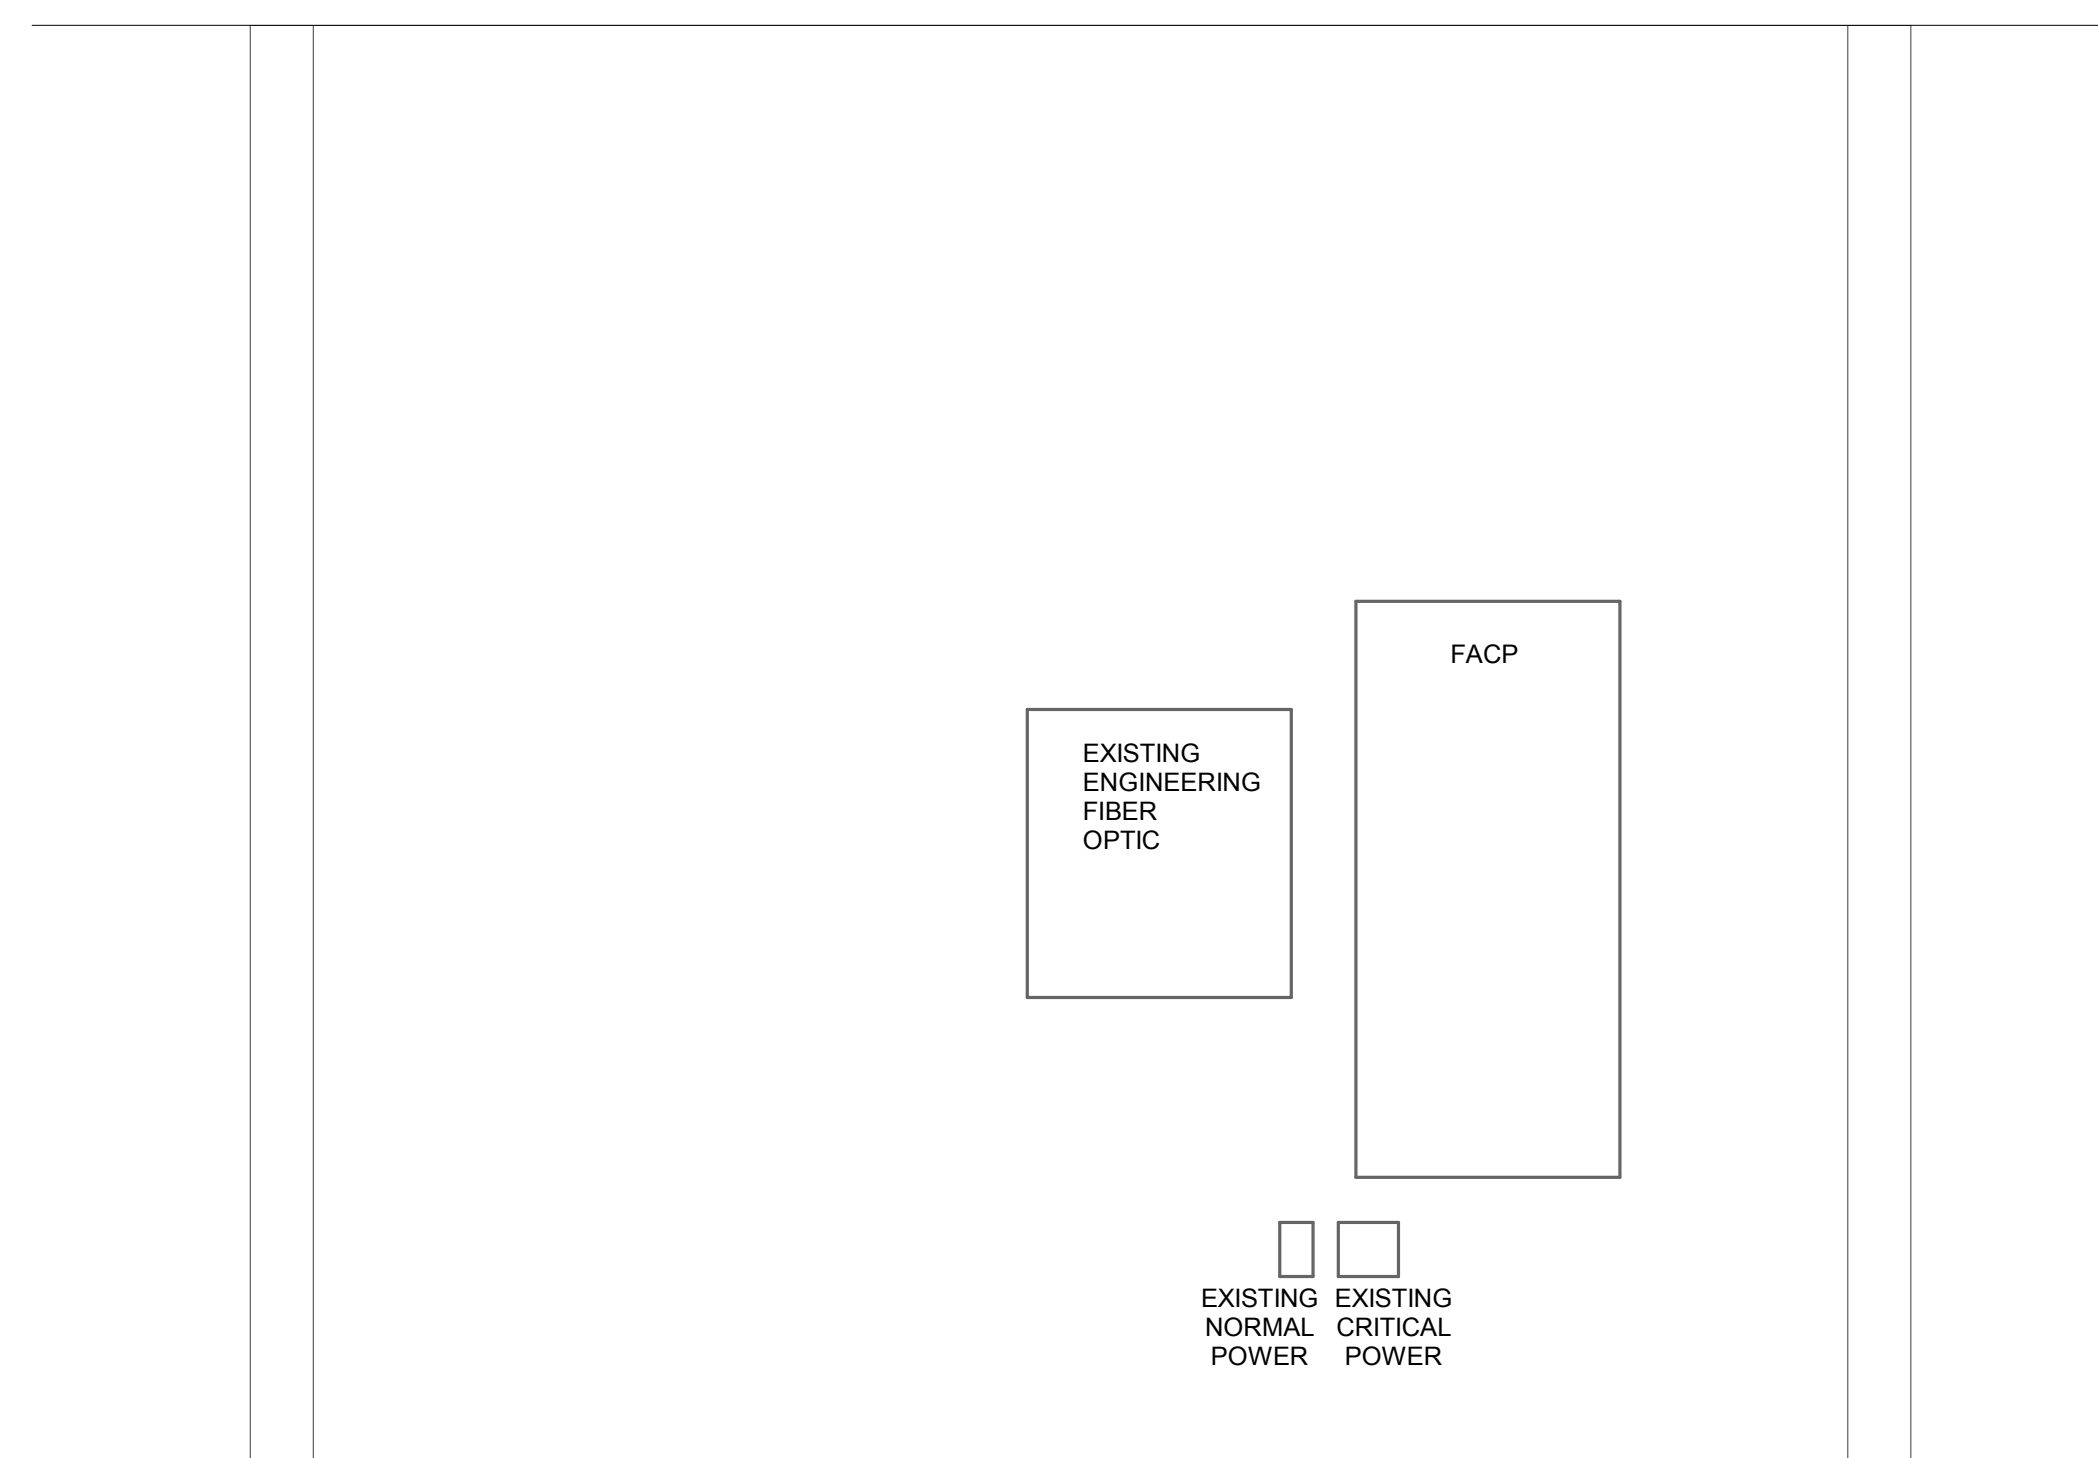


② BLDG 5 - FIRST FLOOR - SECURITY ROOM 117 - NORTH ELEVATION
3/4" = 1'-0"

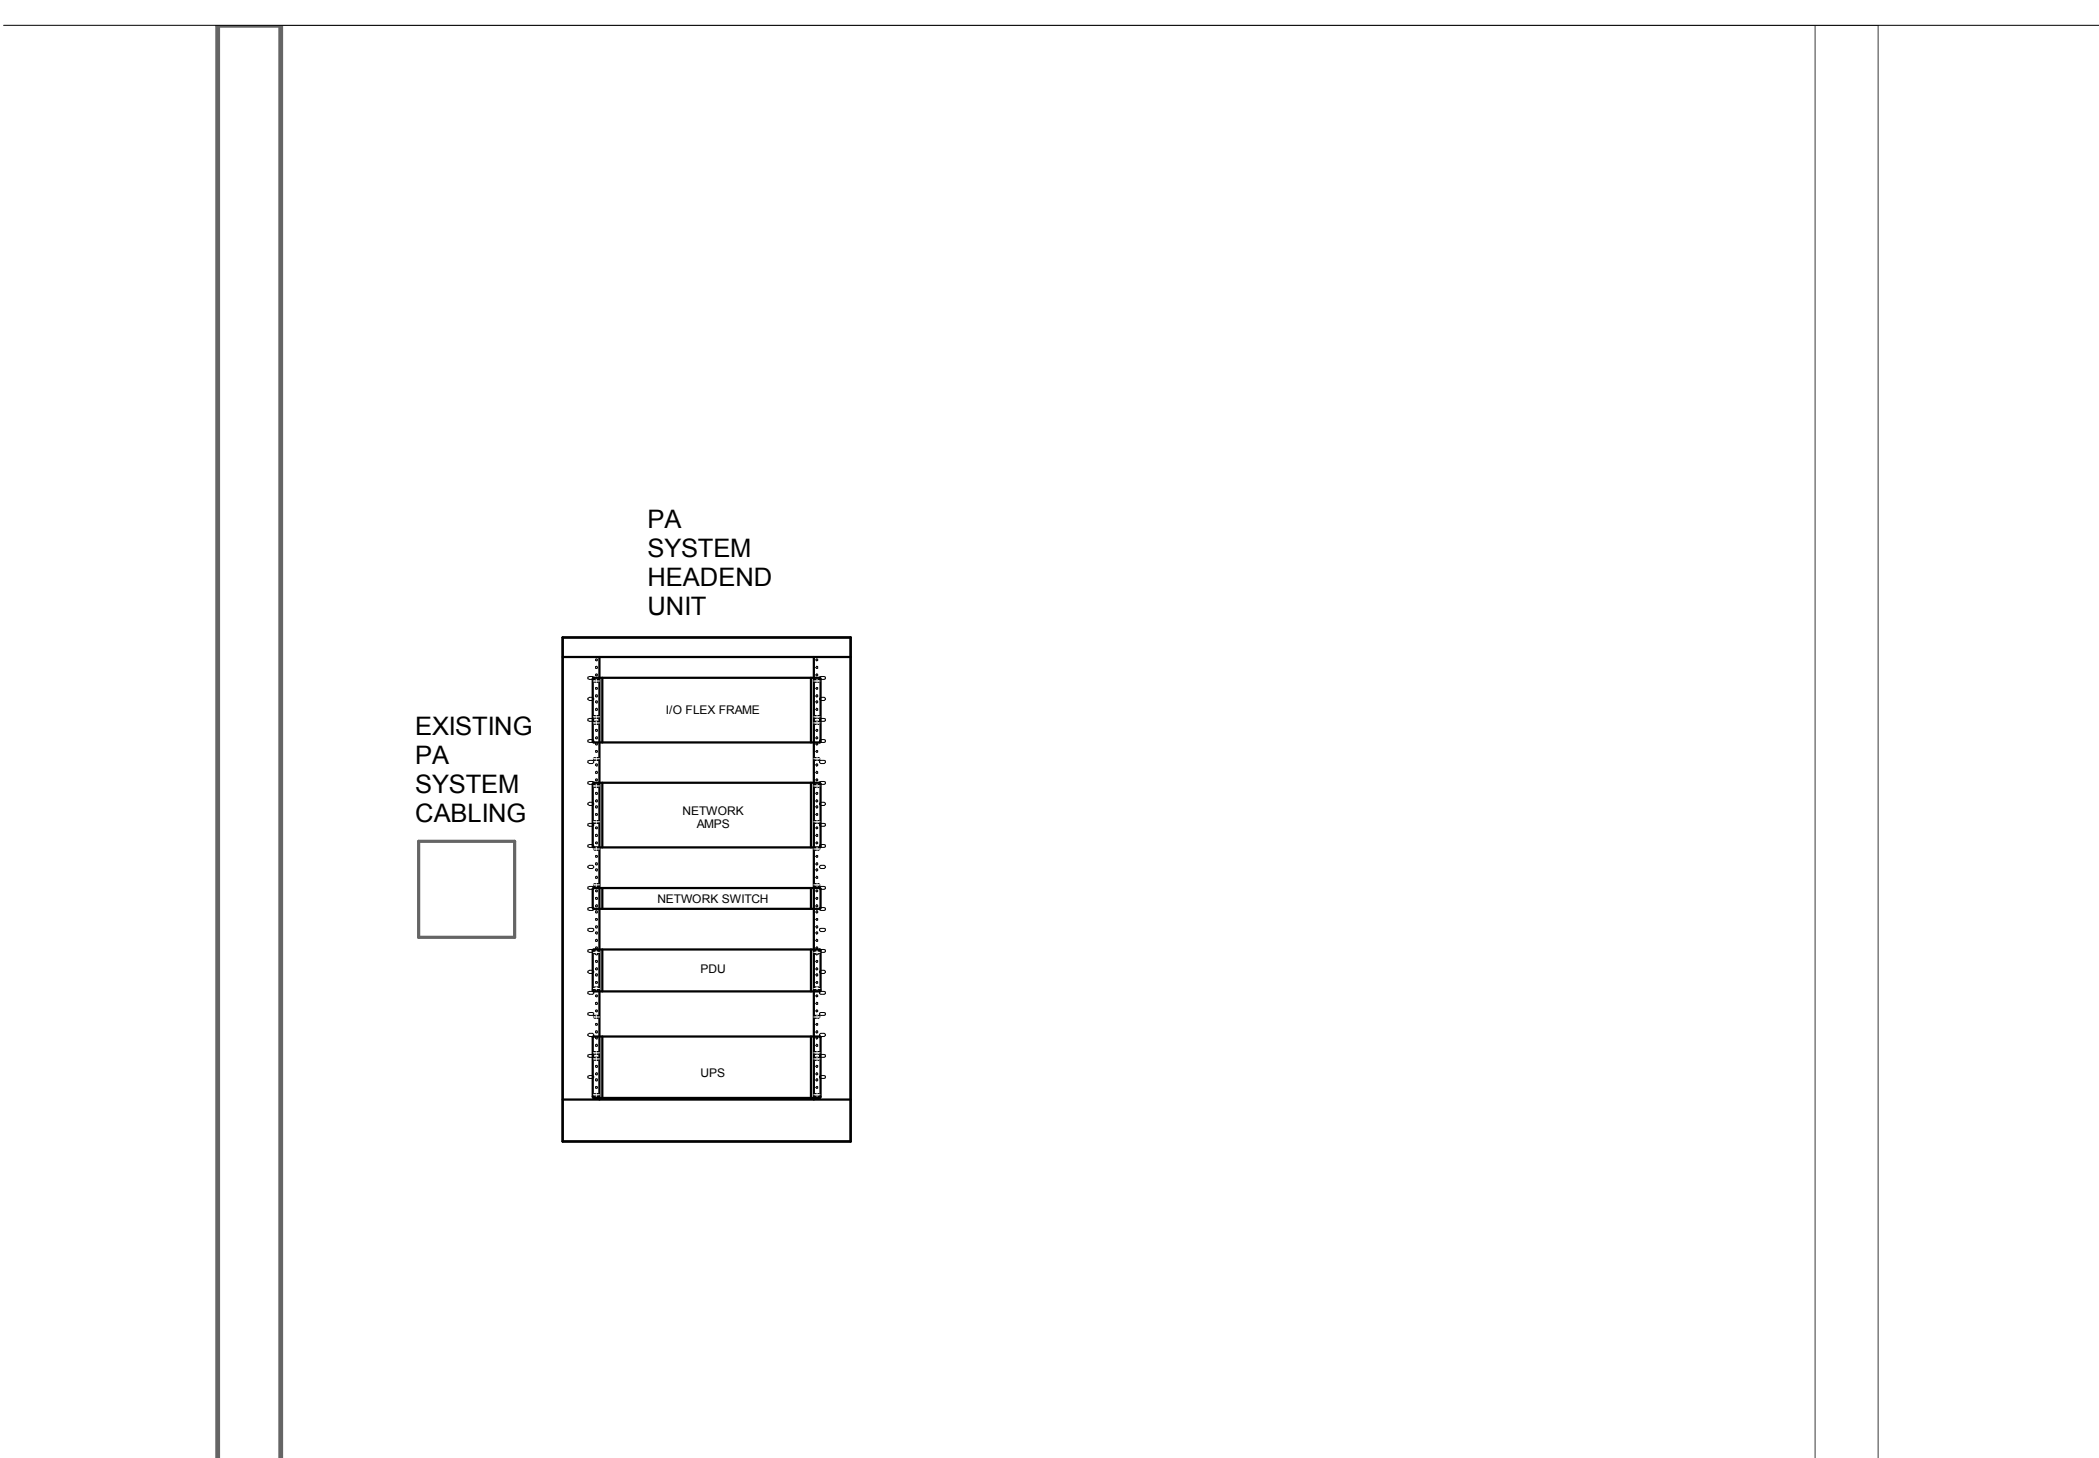


③ BLDG 5 - FIRST FLOOR - SECURITY ROOM 117 - SOUTH ELEVATION
3/4" = 1'-0"

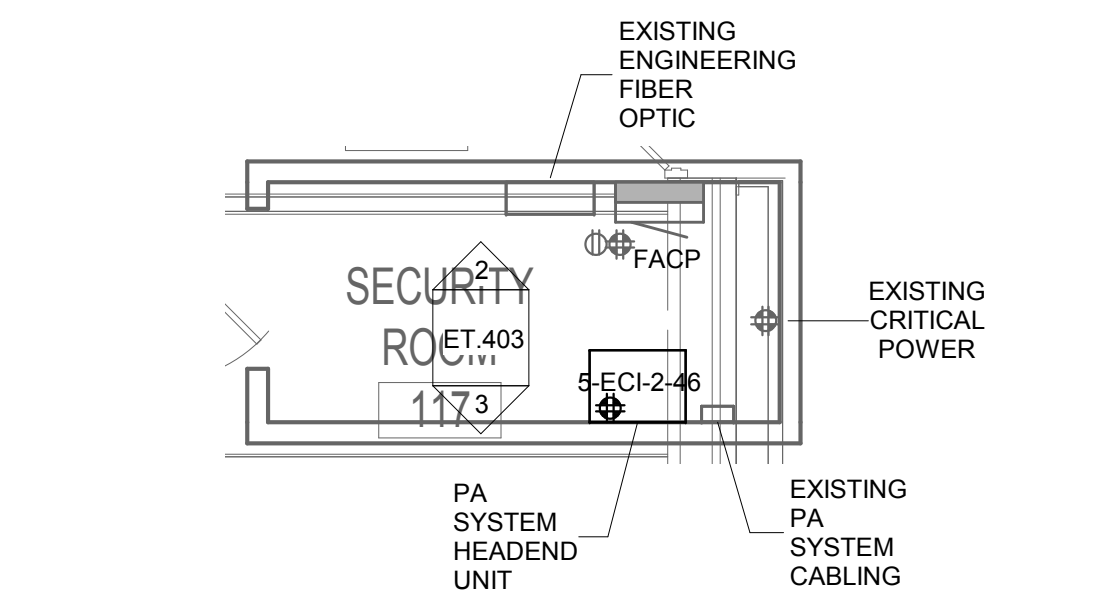


① ENLARGED ROOM - BUILDING 5 - PA SYSTEM HEADEND UNIT
1/4" = 1'-0"

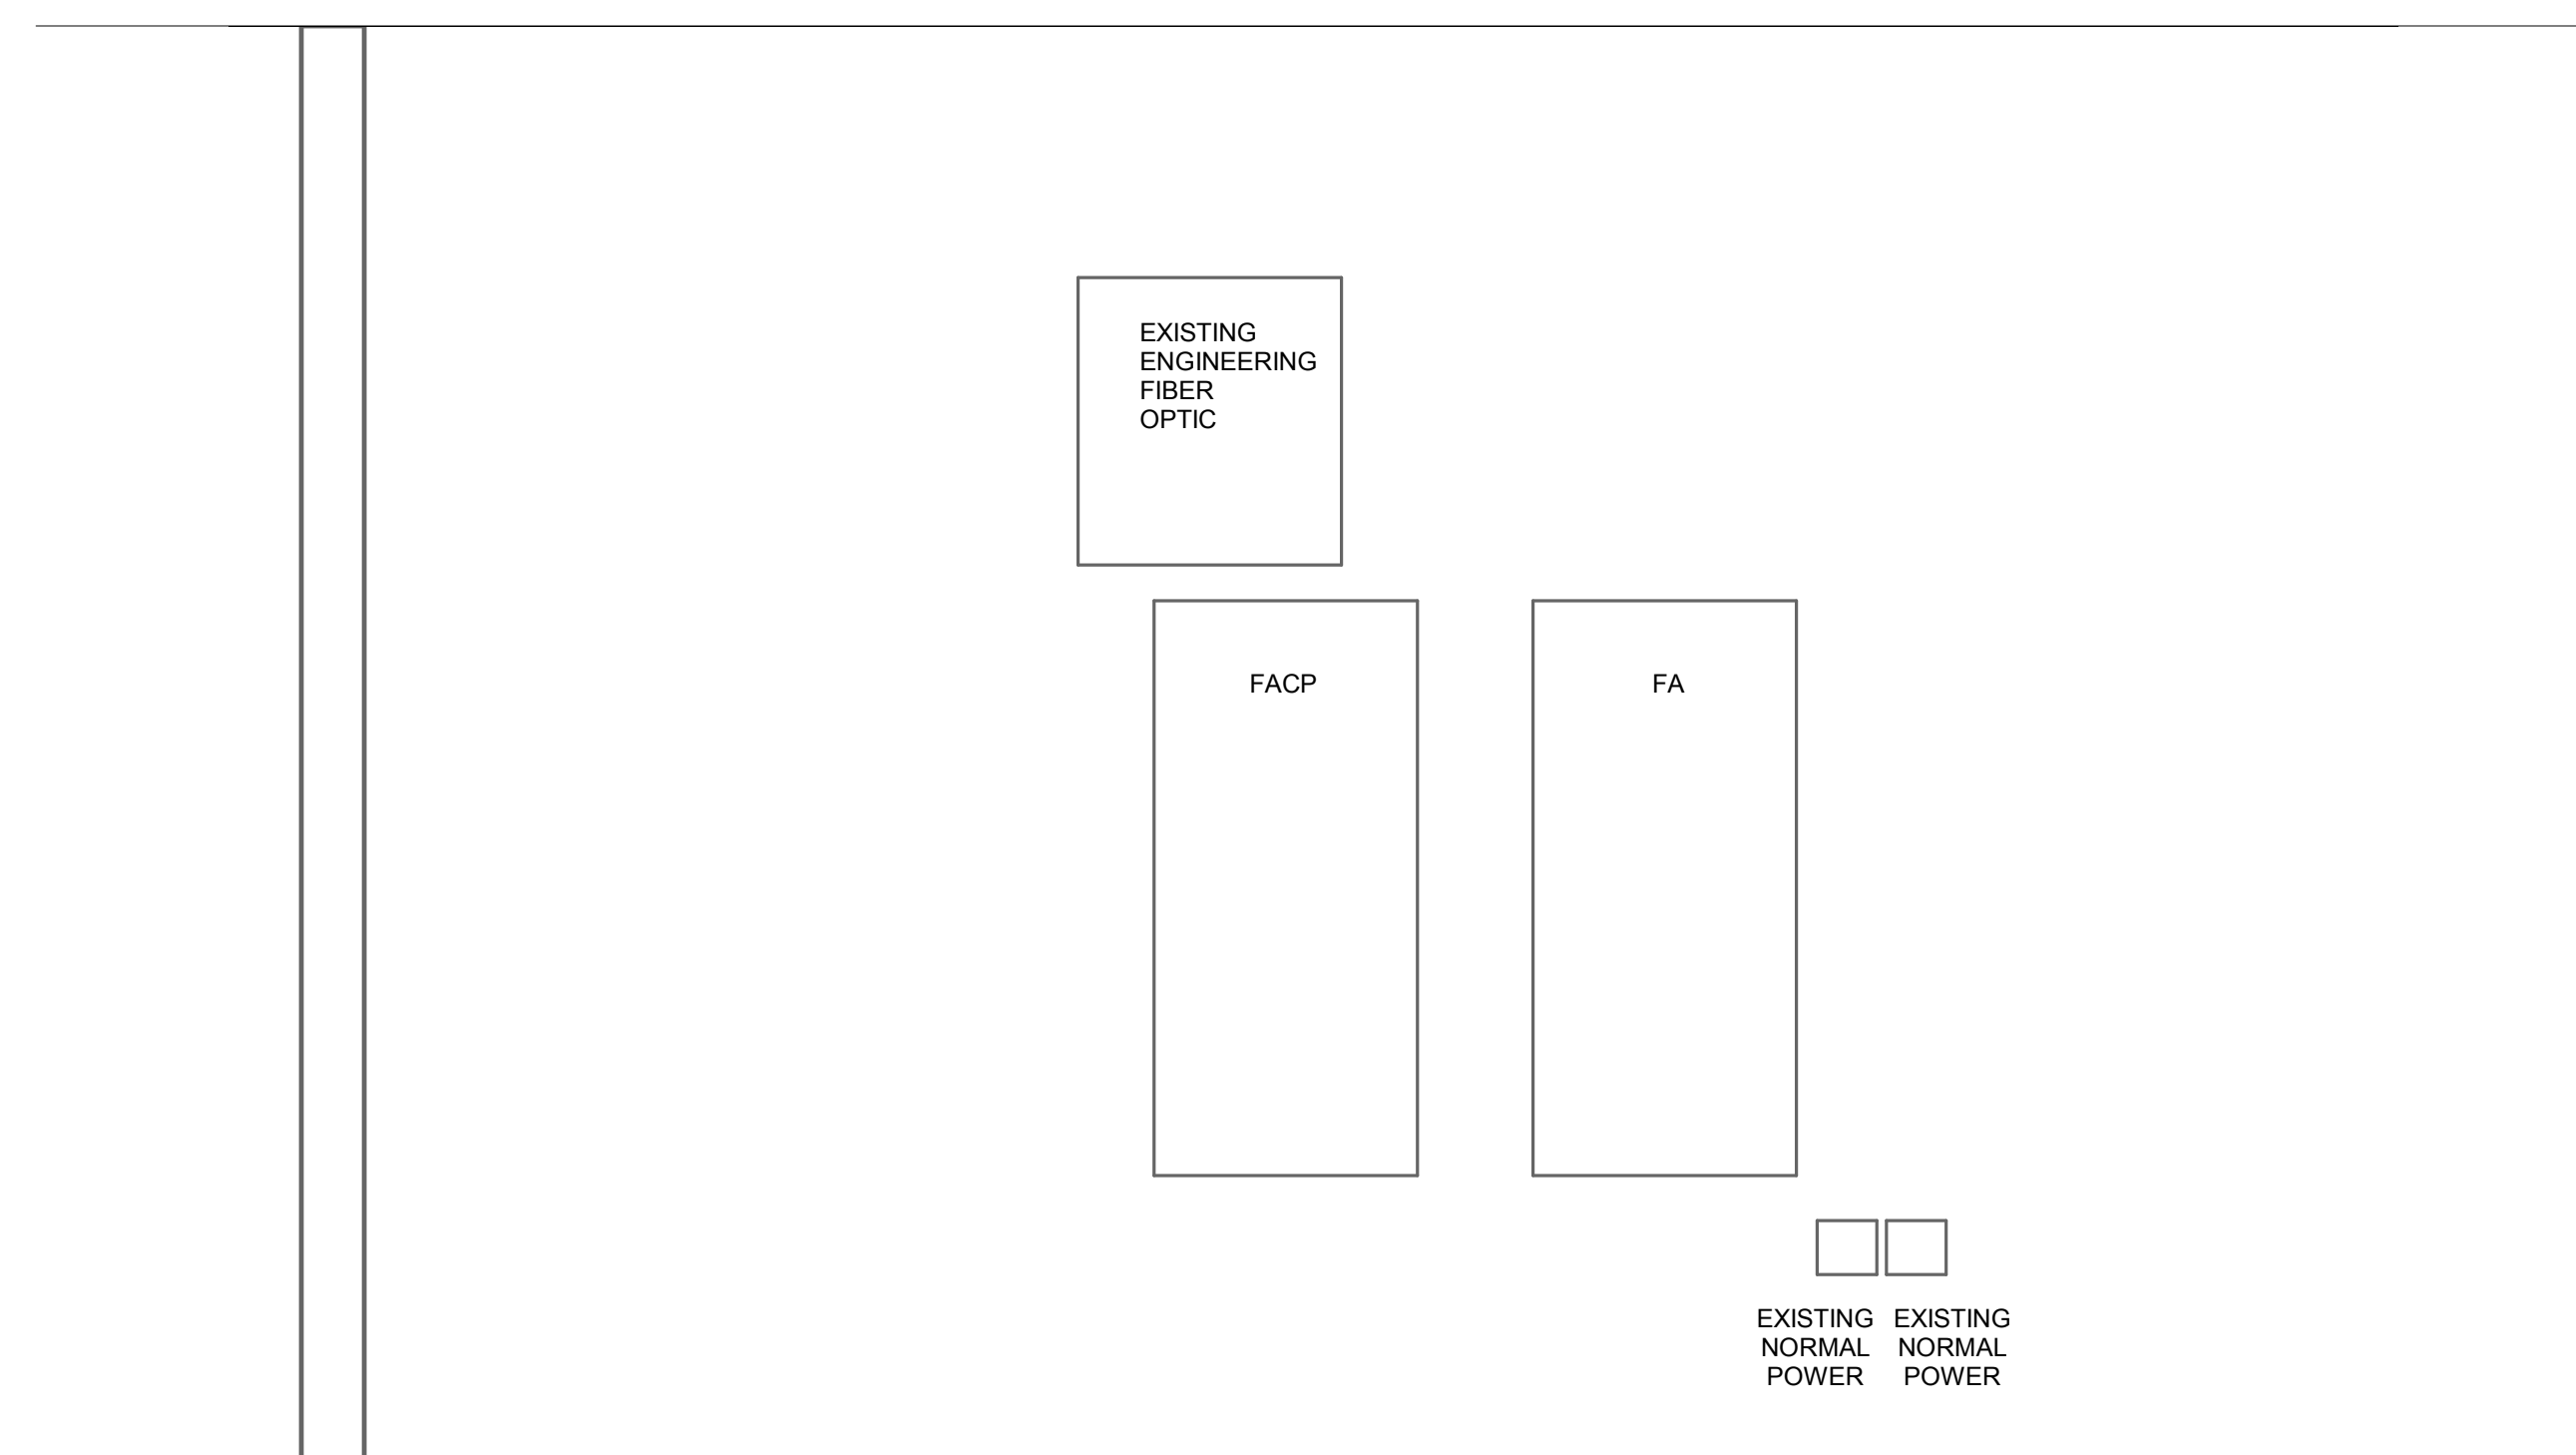

⑤ BLDG 7 - FIRST FLOOR - OFC 104 - WEST ELEVATION
3/4" = 1'-0"

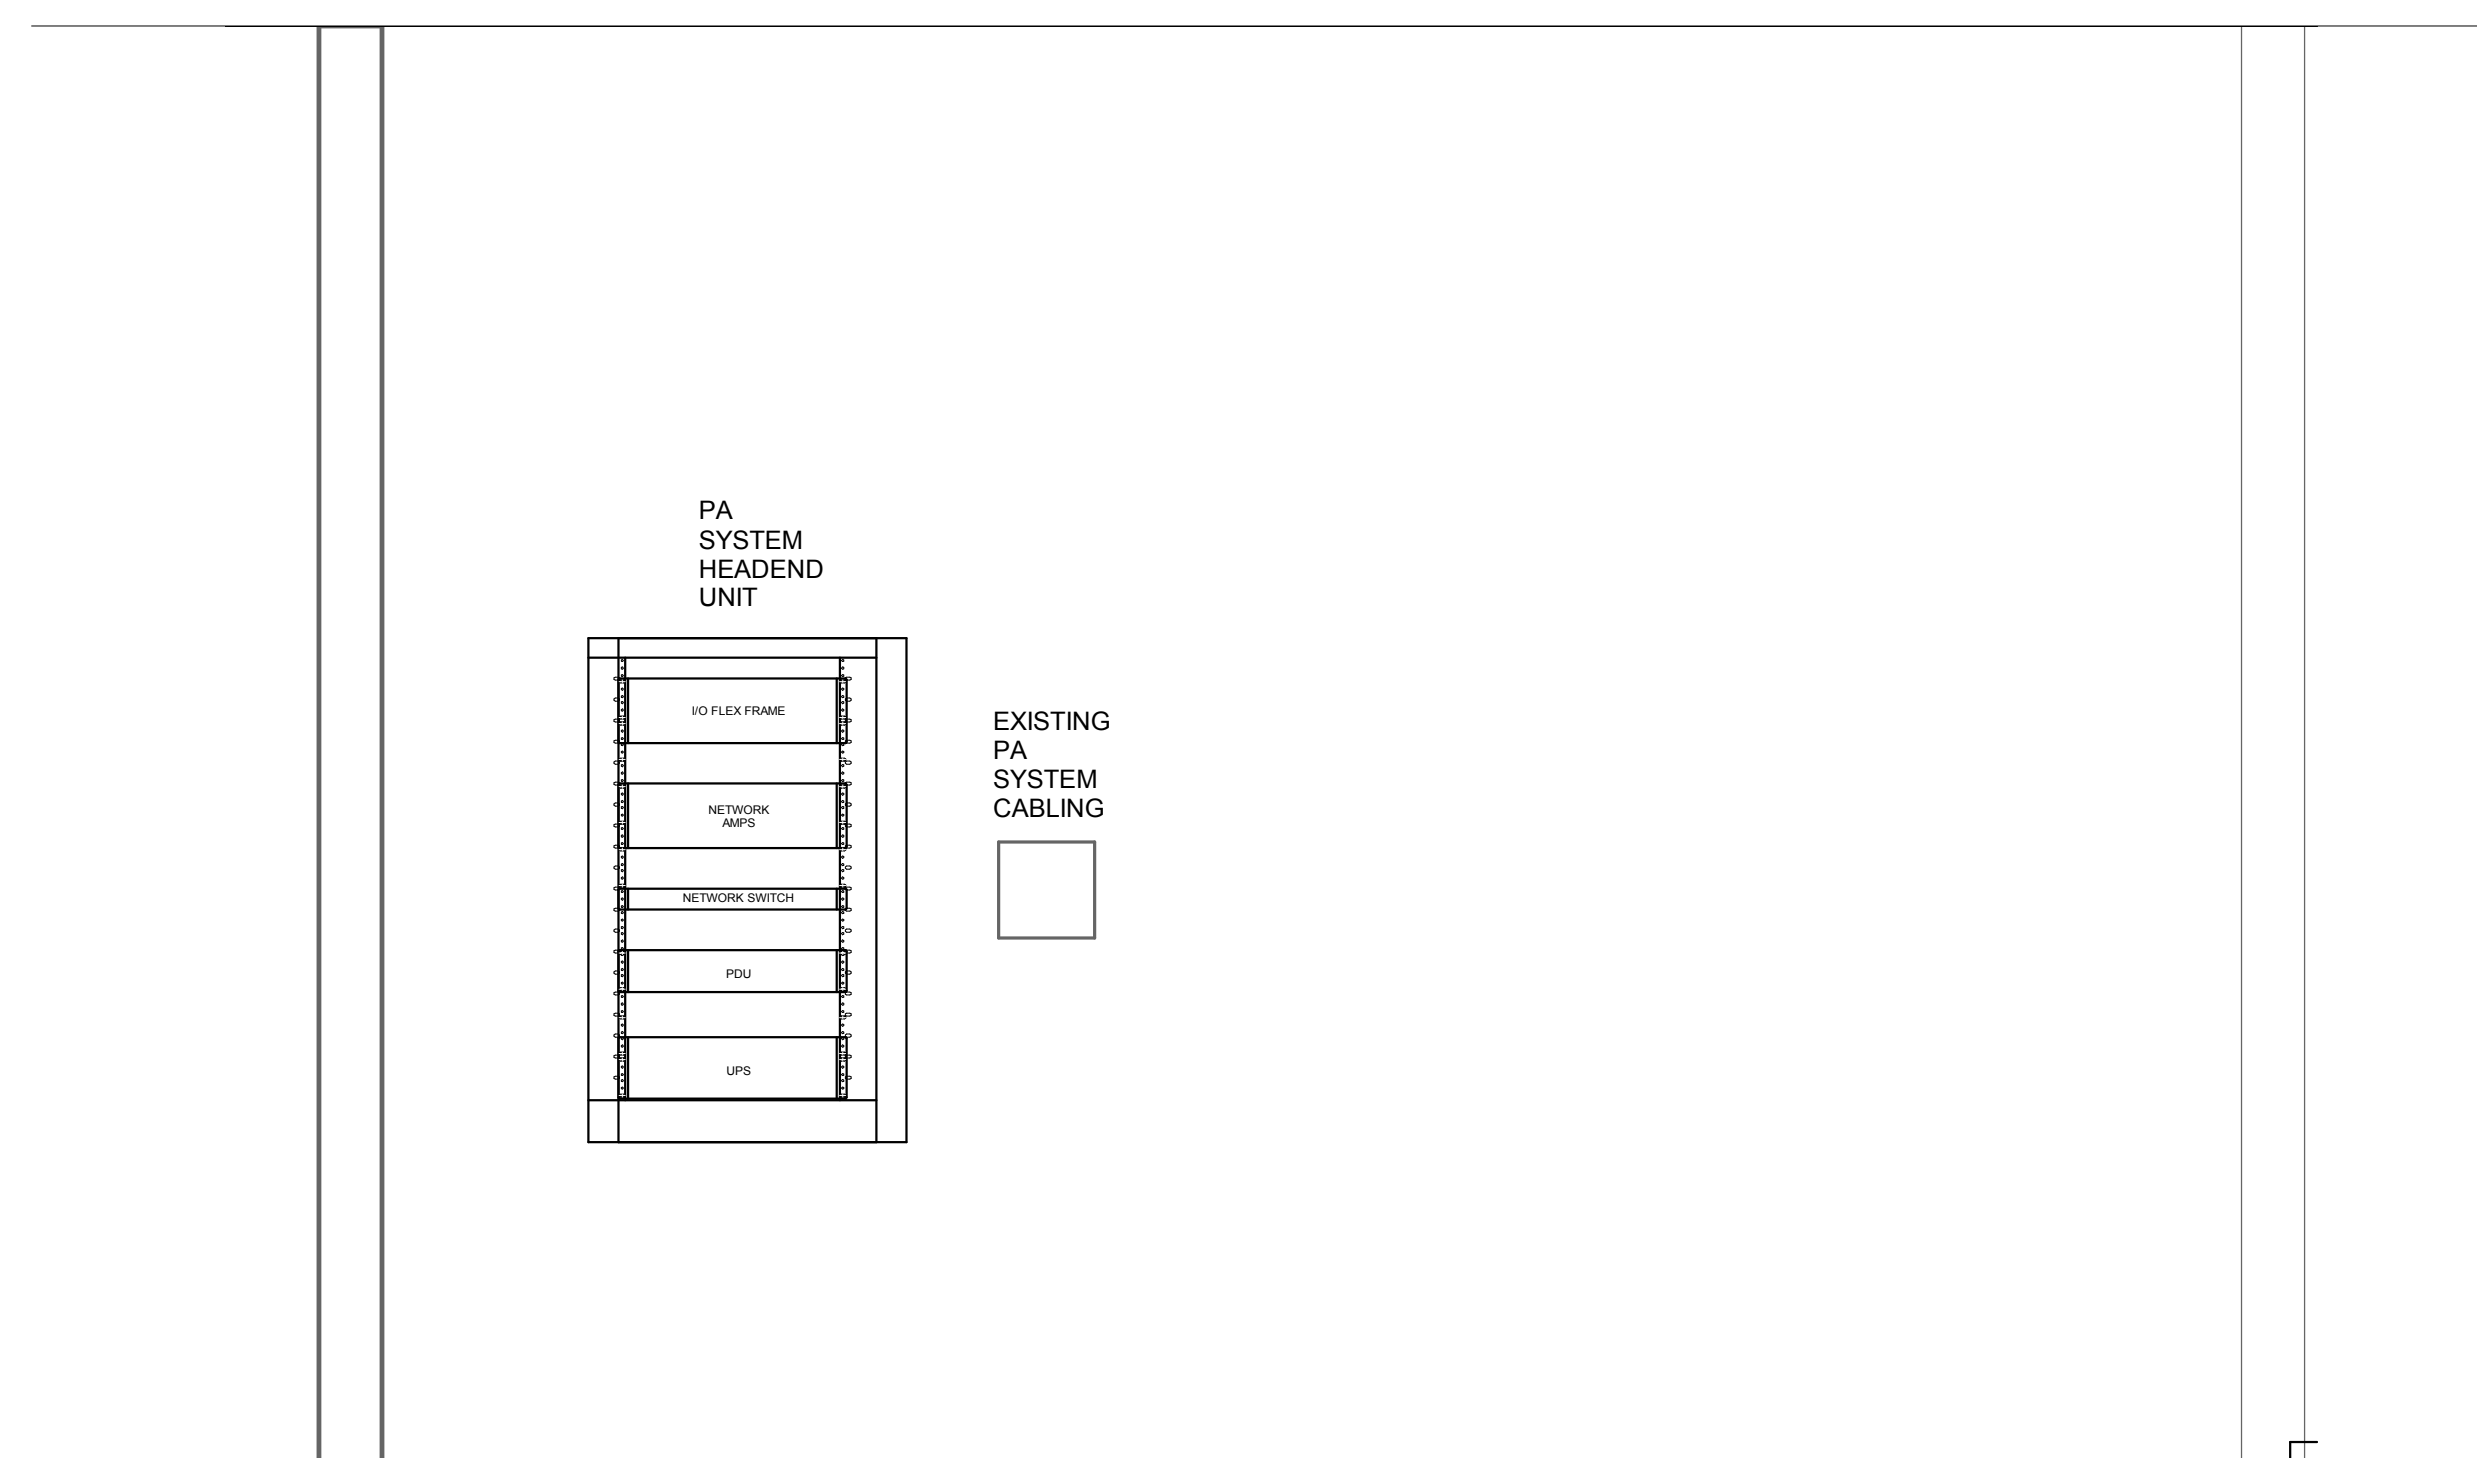

⑥ BLDG 7 - FIRST FLOOR - OFC 104 - NORTH ELEVATION
3/4" = 1'-0"

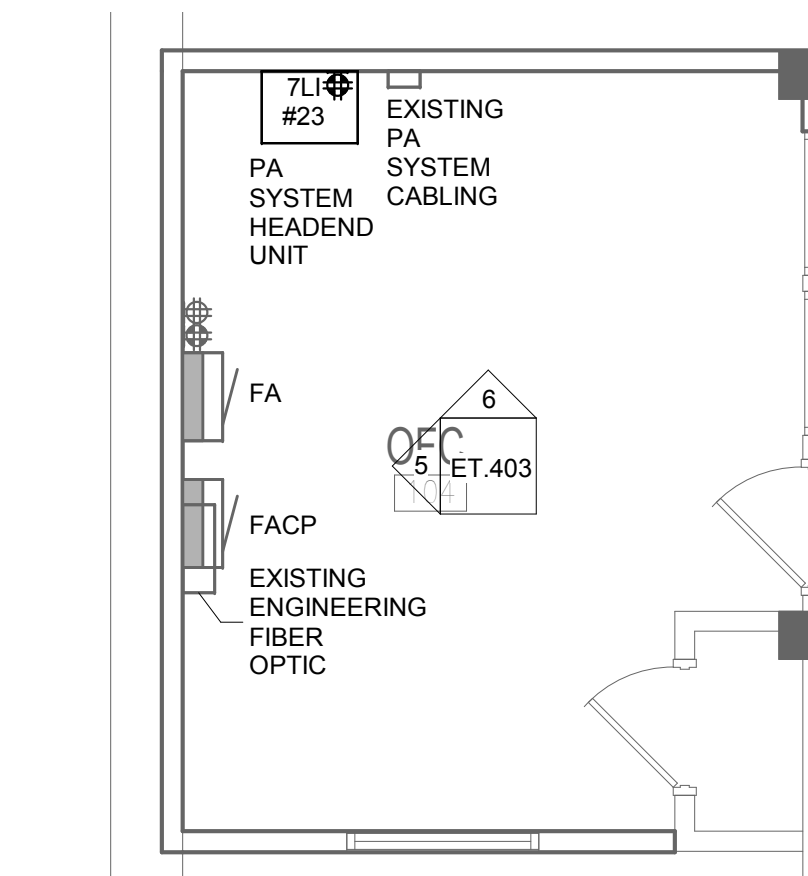

④ ENLARGED ROOM - BUILDING 7 - PA SYSTEM HEADEND UNIT
1/4" = 1'-0"

1/24/2019 11:21:18 PM

C:\Revit\Projects\VA ST CLOUD\PA\Bldg_5_Elec_R12.dwg

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)
DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD
ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilirod*
 Name: Chris M. Pilirod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR	DATE:
APPROVED: CHIEF OF STAFF	DATE:
APPROVED: HEALTH CARE SYSTEM DIRECTOR	DATE:

DRAWING TITLE ENLARGED COMMUNICATION ROOM PLANS			
PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM			
BUILDING NO.	CHECKED BY	DRAWN	ISSUE DATE
	CP	CG	1/24/19
LOCATION	DATE	DRAWING NO.	
VA MEDICAL CENTER ST. CLOUD, MN 56303		ET.403	

VA U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

A

B

C

D

E

F

A

B

C


D

E


F

- GENERAL NOTES:**
- A. PROVIDE CONNECTION TO CRITICAL POWER WITHIN ROOM, IF AVAILABLE.
 - B. PROVIDE QUAD RECEPTACLE WITHIN EACH EQUIPMENT CABINET (ENCLOSURE). SEE 27 11 00 FOR REQUIREMENTS.
 - C. PROVIDE FIBER OPTIC CONNECTORS (ST/LO) REQUIRED BETWEEN EXISTING FIBER PATCH BOX AND PUBLIC ADDRESS SYSTEM HEADEND EQUIPMENT.
 - D. PROVIDE MINIMUM 3/4" ORANGE EMT BETWEEN EXISTING FIBER BOX AND PUBLIC ADDRESS SYSTEM EQUIPMENT.
 - E. PROVIDE BLUE EMT BETWEEN PRE-WIRED (AND WIRED) PA CIRCUITS AND PUBLIC ADDRESS SYSTEM EQUIPMENT.
 - F. FIELD VERIFY FINAL LOCATION OF PA SYSTEM HEADEND WITHIN ROOM PRIOR TO INSTALL.


- KEY NOTES:**
- ① NOT USED.

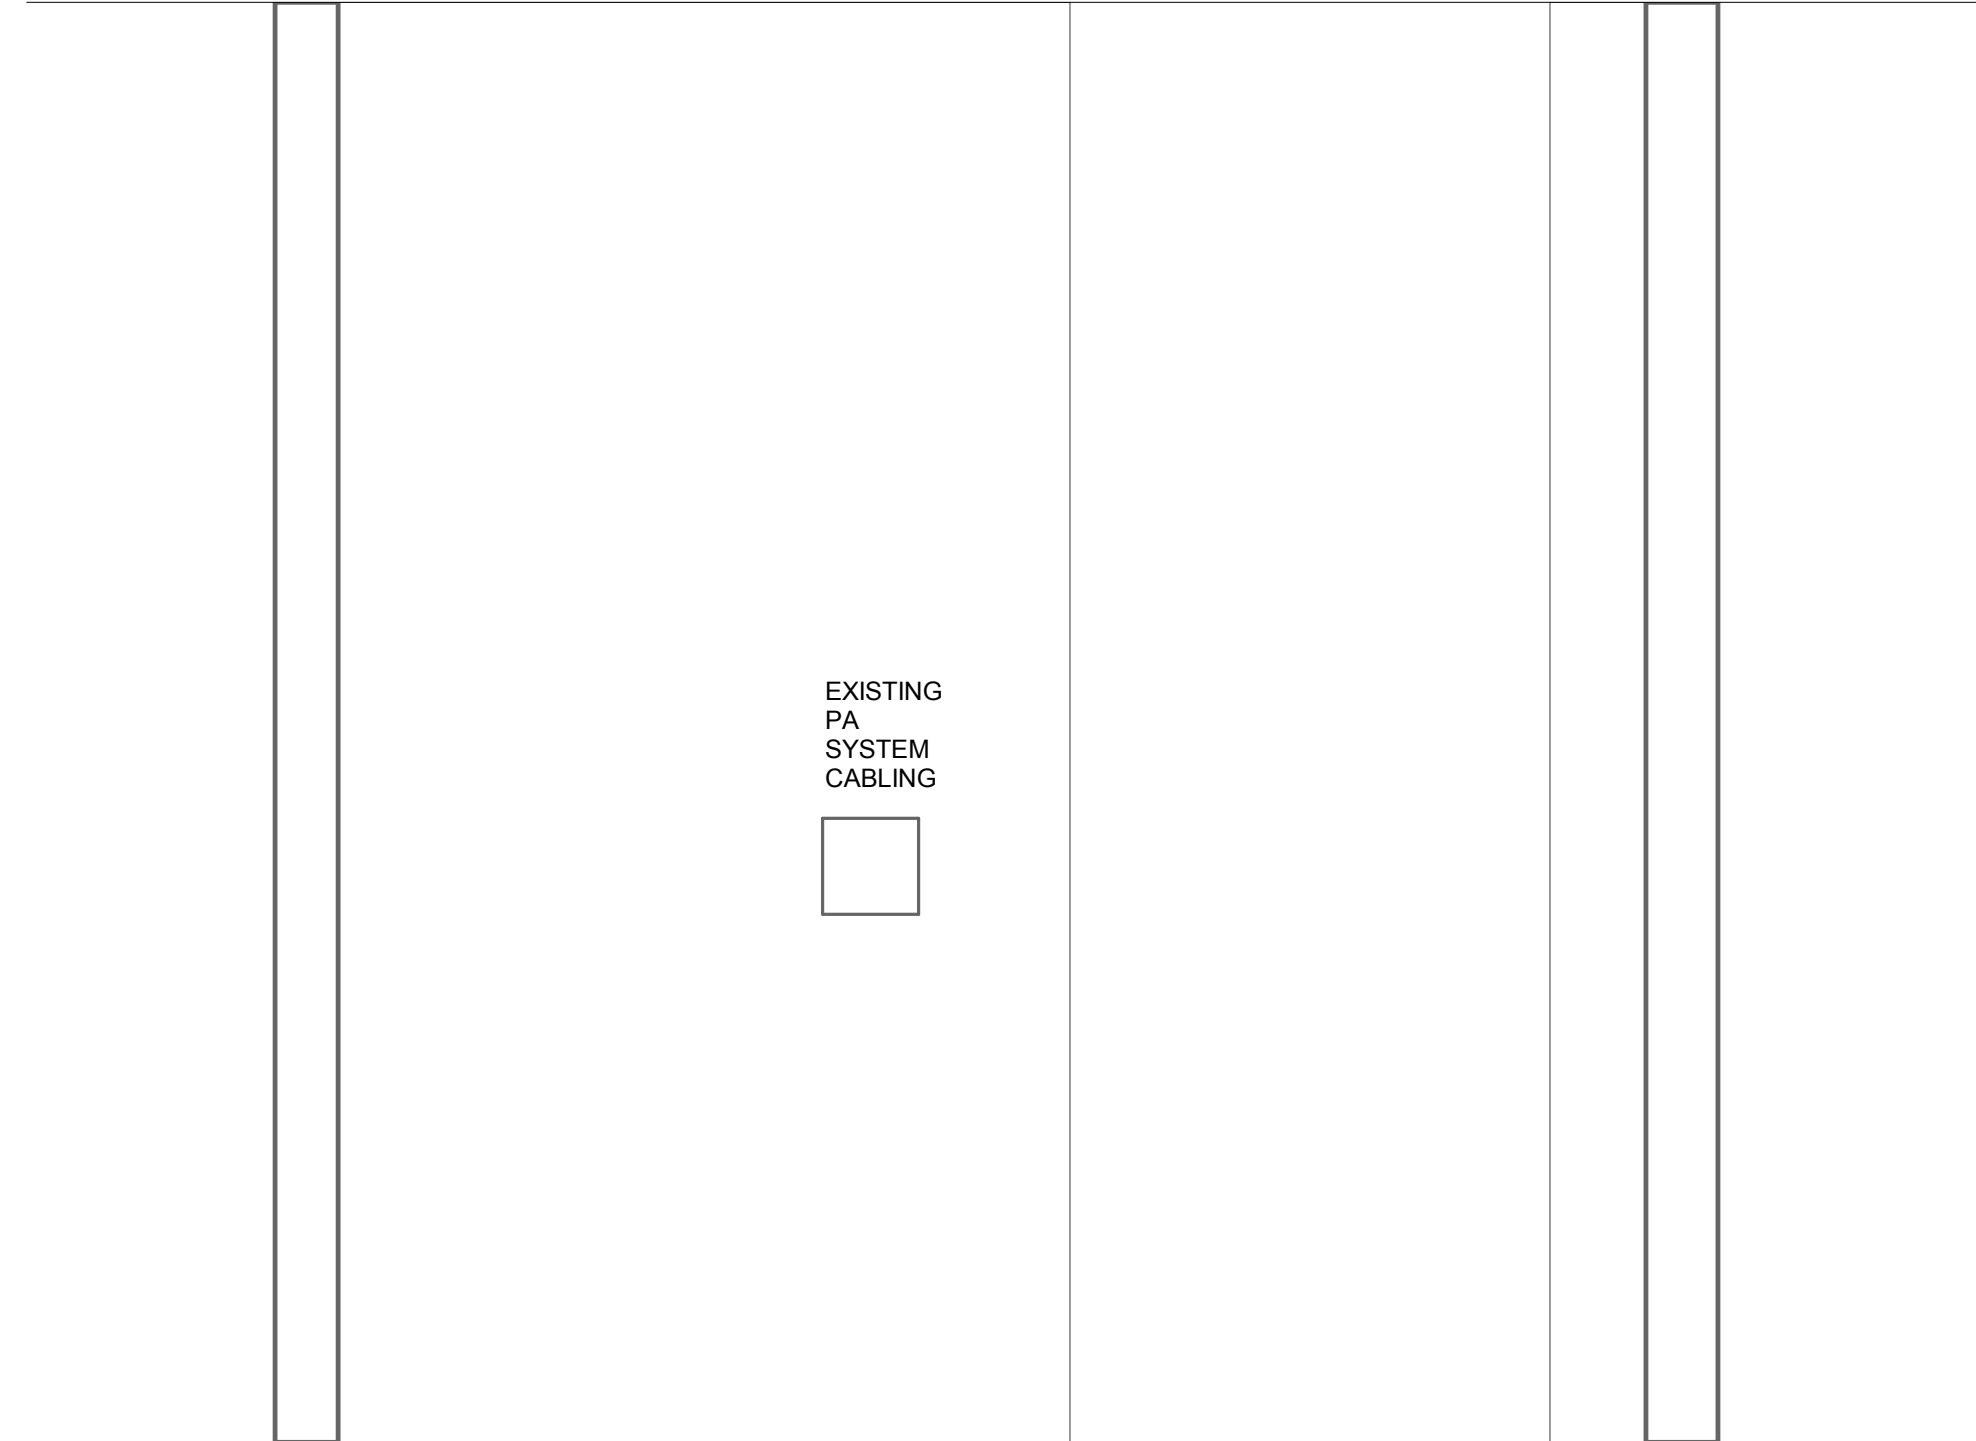


② BLDG 8 - BASEMENT - SERVICE ROOM 11 - NORTH ELEVATION
3/4" = 1'-0"

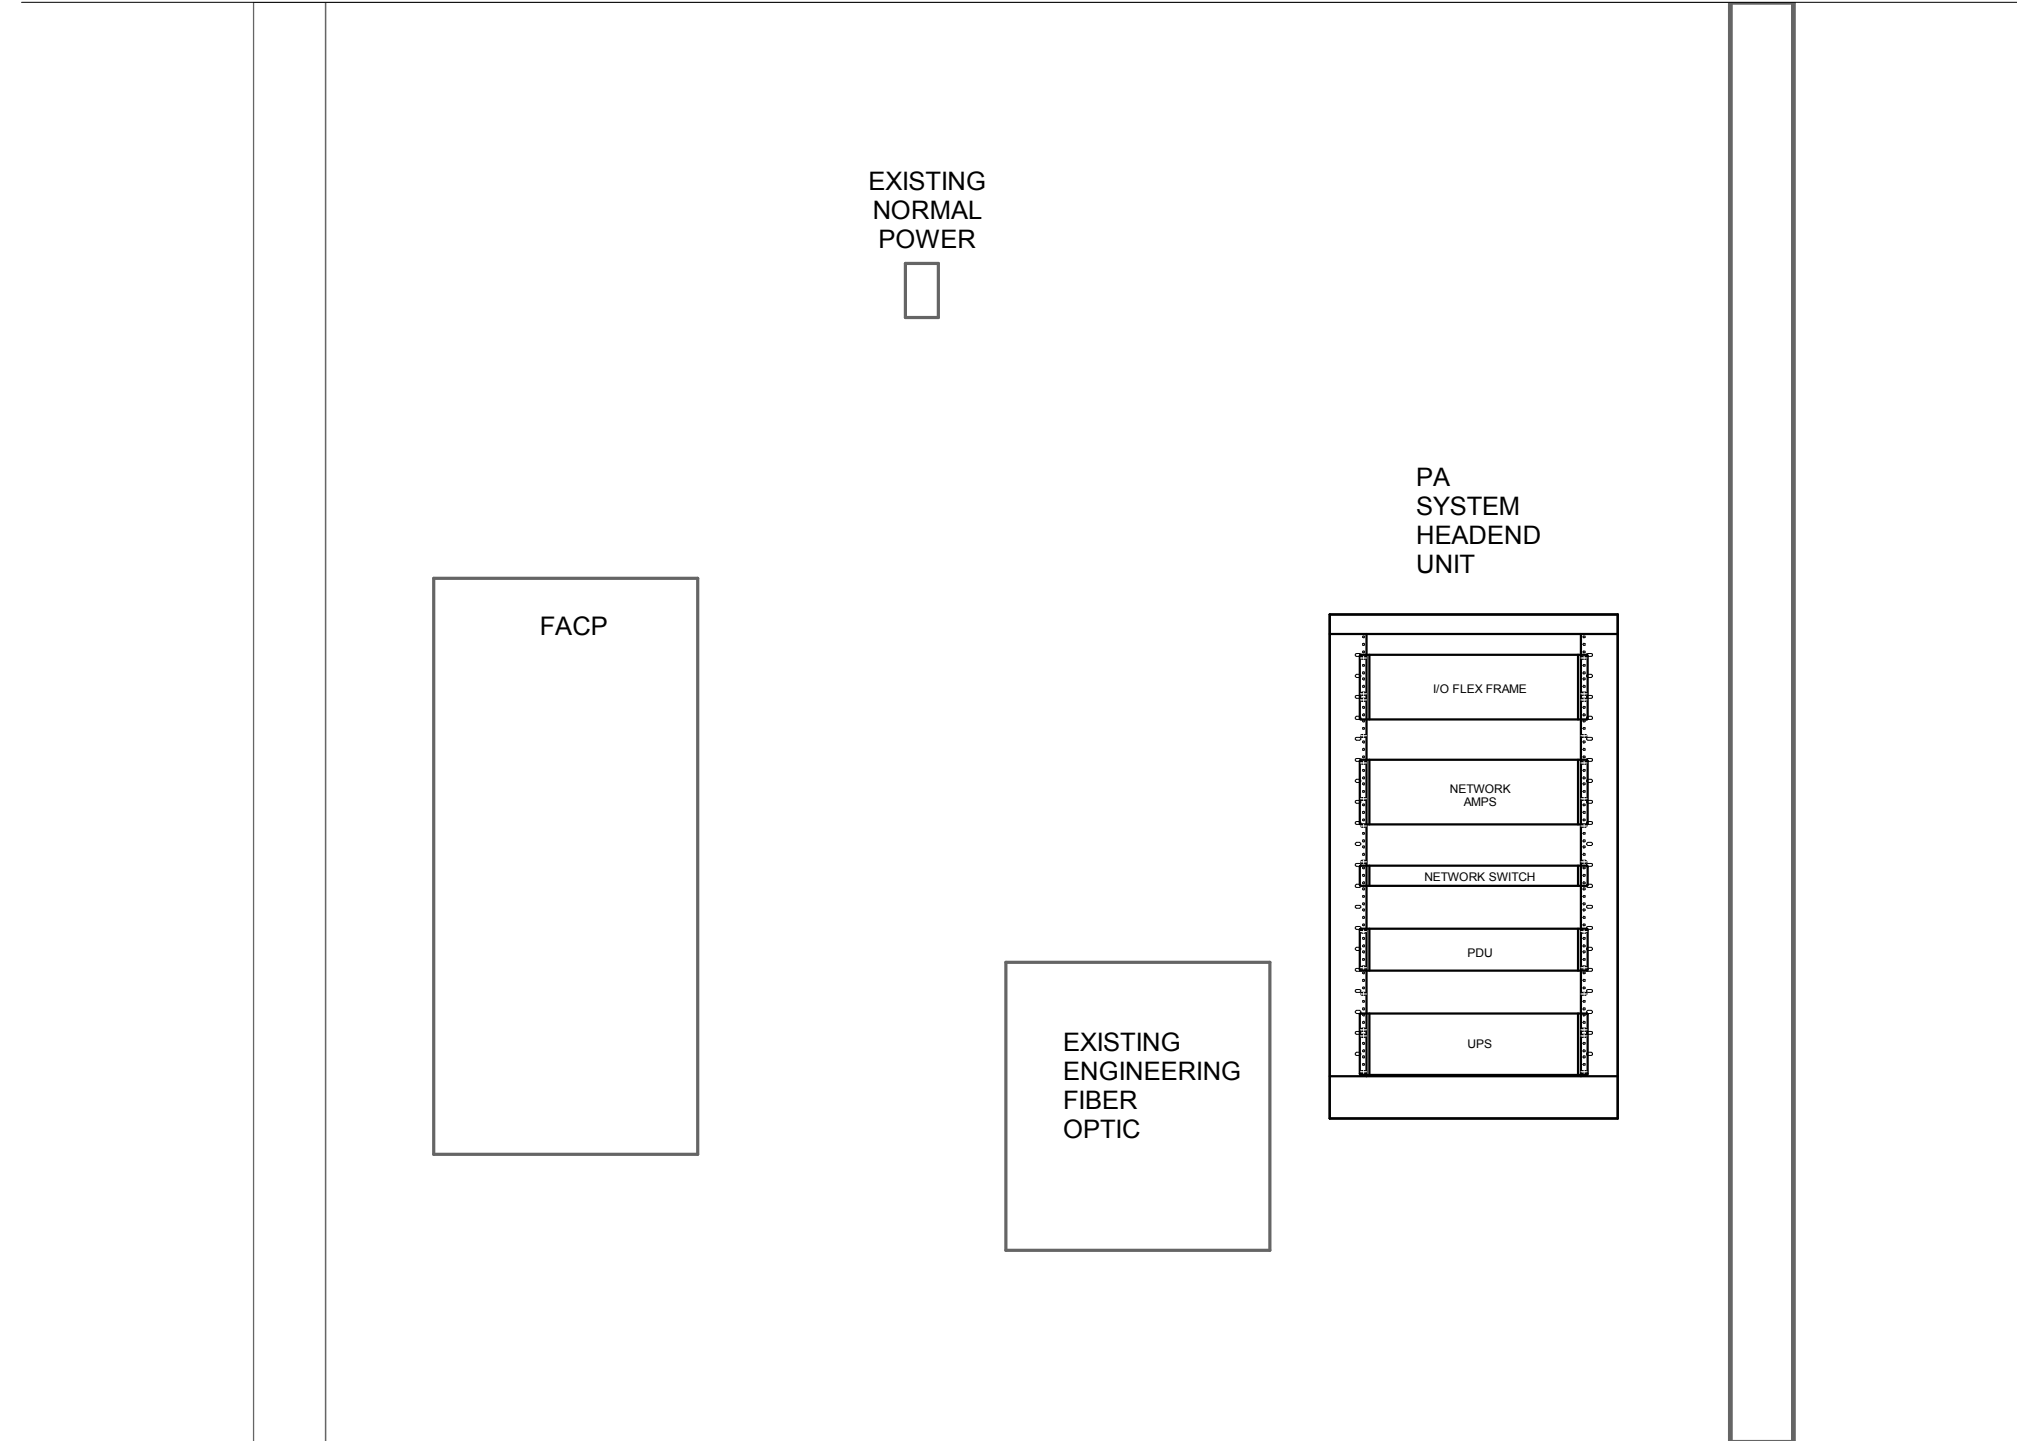


③ BLDG 8 - BASEMENT - SERVICE ROOM 11 - EAST ELEVATION
3/4" = 1'-0"

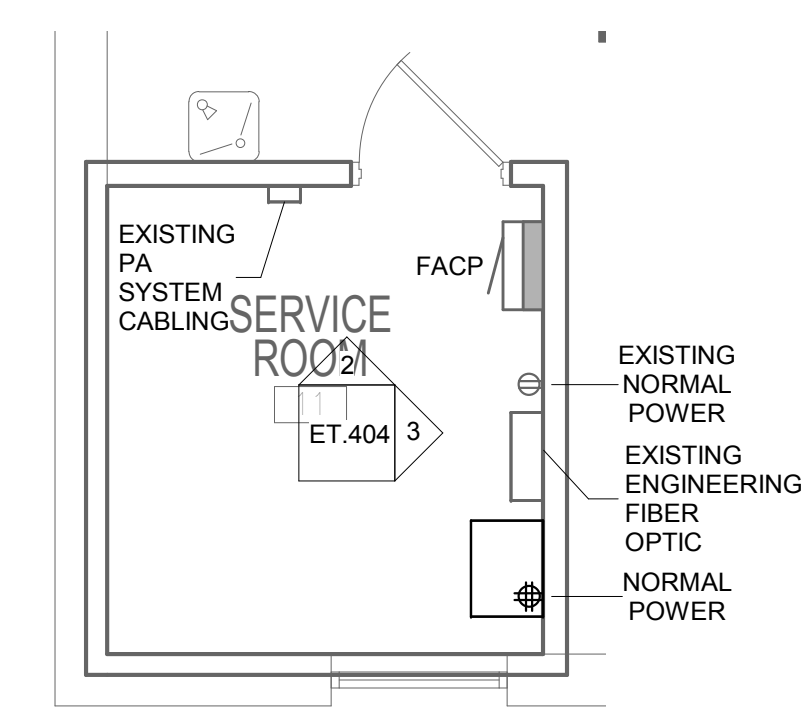

① ENLARGED ROOM - BUILDING 8 - PA SYSTEM HEADEND UNIT
1/4" = 1'-0"

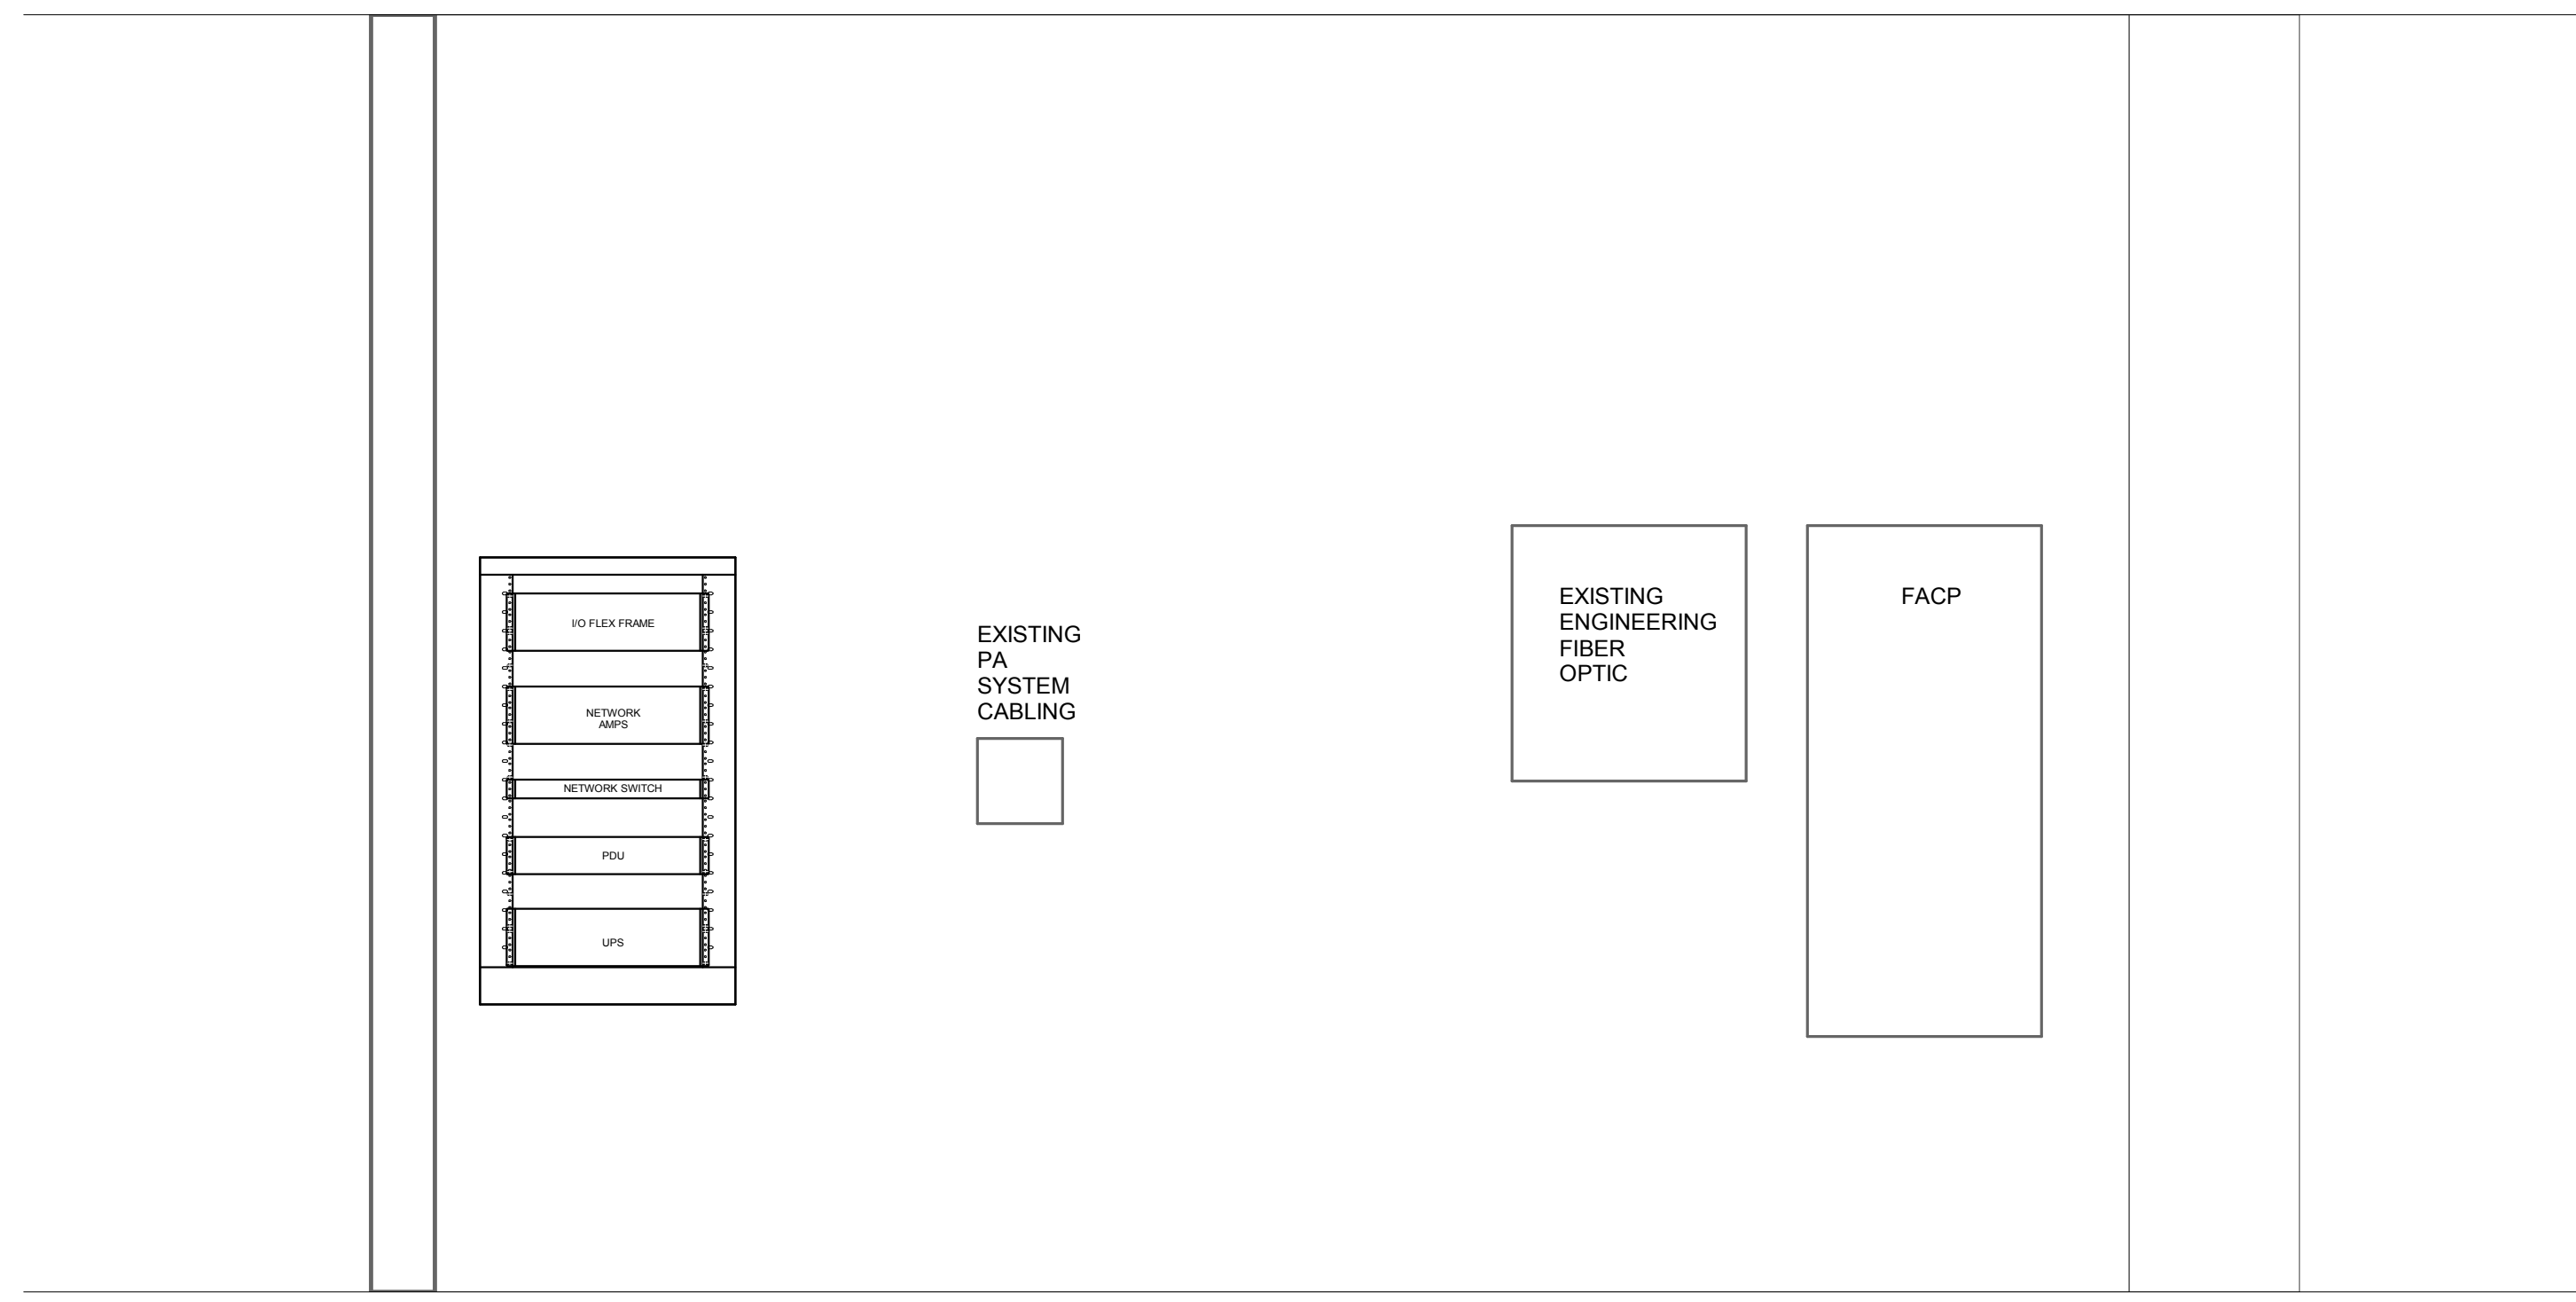

⑤ BLDG 9 - BASEMENT - ROOM 15 - NORTH ELEVATION
3/4" = 1'-0"

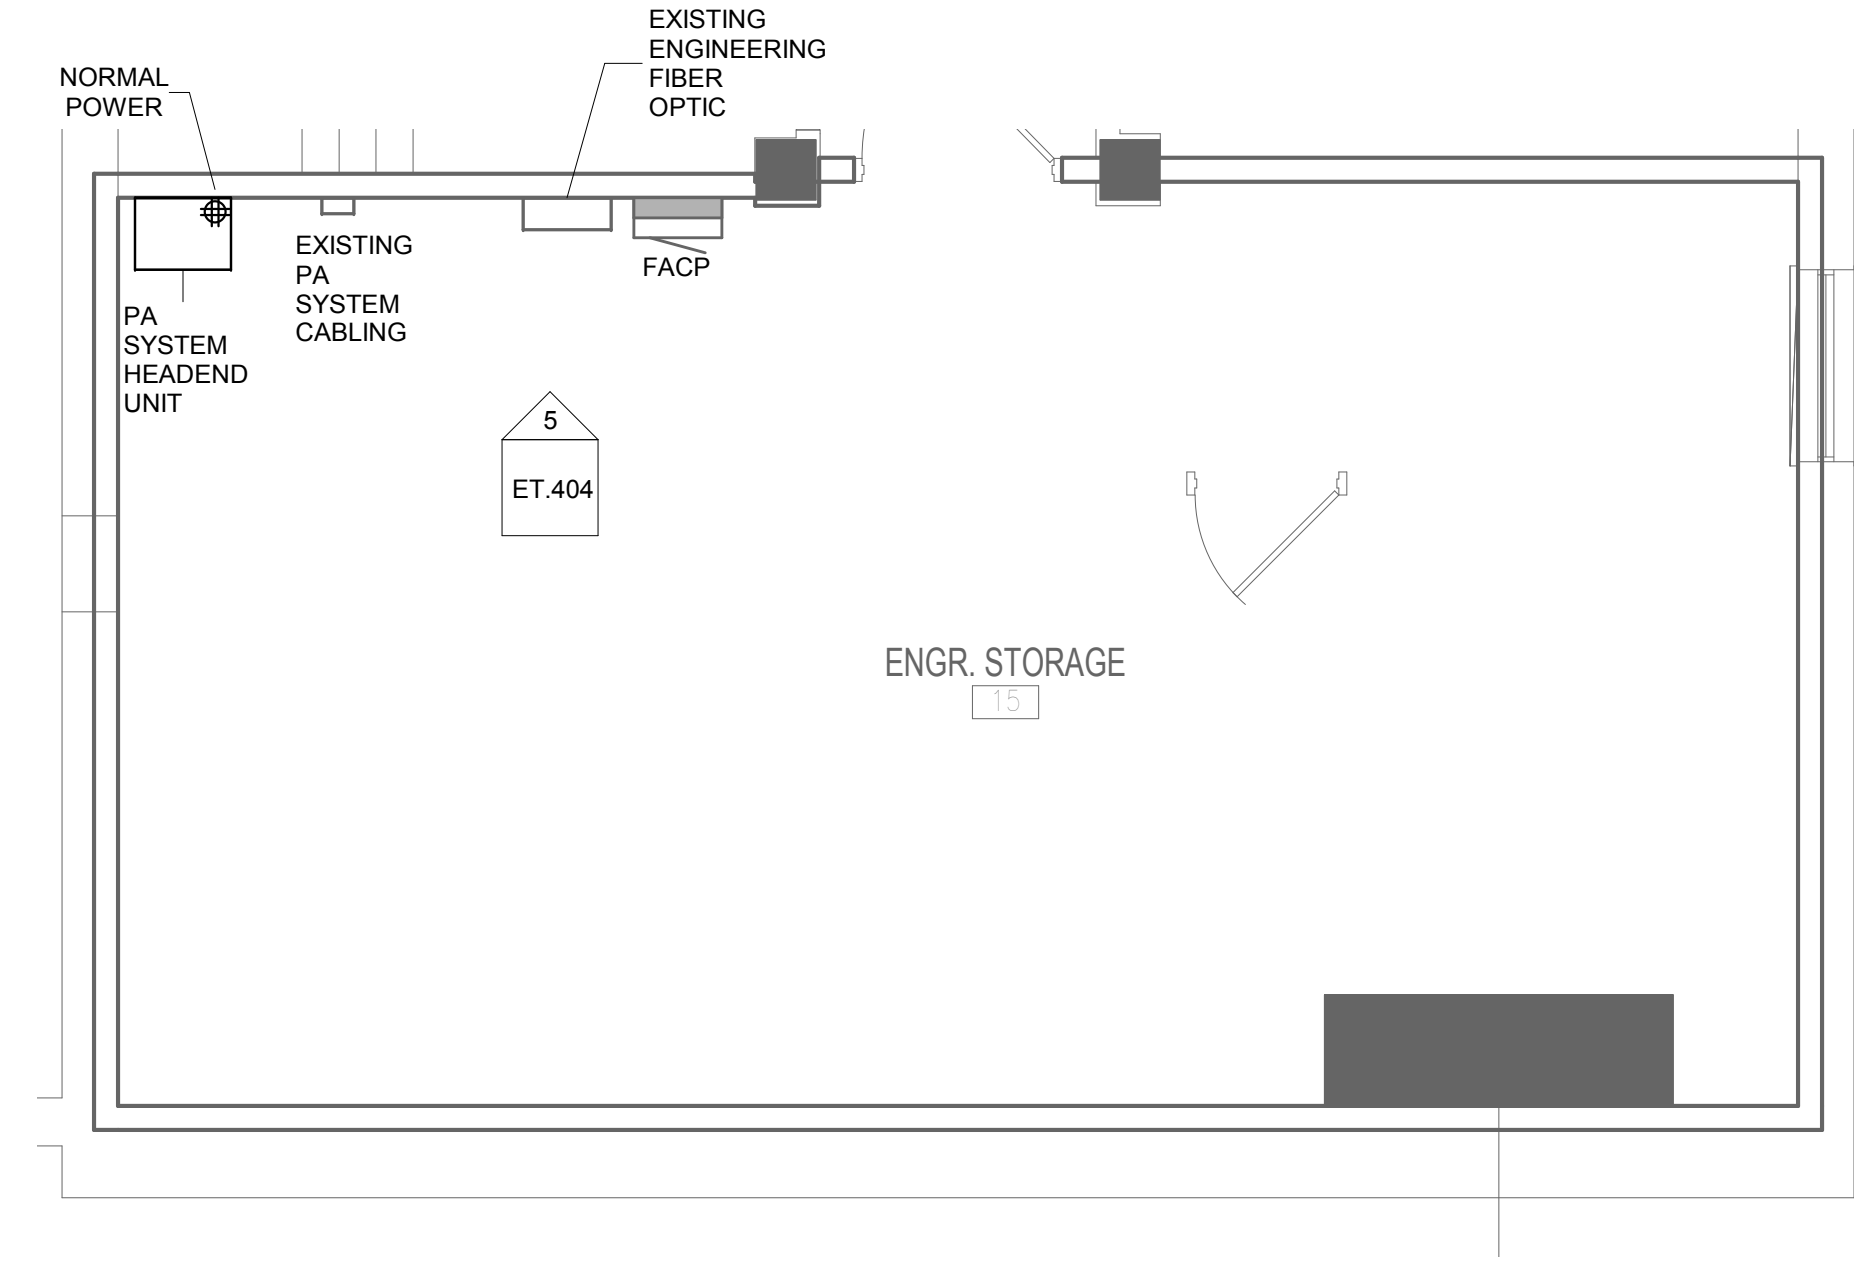

④ ENLARGED ROOM - BUILDING 9 - PA SYSTEM HEADEND UNIT
1/4" = 1'-0"

1/24/2019 11:21:19 PM
C:\Revit\Projects\VA ST CLOUD\PA\INGO_Elec_R1E_chp.rvt

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE ENLARGED COMMUNICATION ROOM PLANS	PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM
APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR	DATE:
APPROVED: CHIEF OF STAFF	DATE:
APPROVED: HEALTH CARE SYSTEM DIRECTOR	DATE:

BUILDING No.	CHECKED BY	DRAWN	ISSUE DATE
	CP	CG	1/24/19
LOCATION VA MEDICAL CENTER ST. CLOUD, MN 56303	DATE	DRAWING NO.	ET.404



VA
U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

GENERAL NOTES:

- A. PROVIDE CONNECTION TO CRITICAL POWER WITHIN ROOM, IF AVAILABLE.
- B. PROVIDE QUAD RECEPTACLE WITHIN EACH EQUIPMENT CABINET (ENCLOSURE). SEE 27 11 00 FOR REQUIREMENTS.
- C. PROVIDE FIBER OPTIC CONNECTORS (ST/LO) REQUIRED BETWEEN EXISTING FIBER PATCH BOX AND PUBLIC ADDRESS SYSTEM HEADEND EQUIPMENT.
- D. PROVIDE MINIMUM 3/4" ORANGE EMT BETWEEN EXISTING FIBER BOX AND PUBLIC ADDRESS SYSTEM EQUIPMENT.
- E. PROVIDE BLUE EMT BETWEEN PRE-WIRED (AND WIRED) PA CIRCUITS AND PUBLIC ADDRESS SYSTEM EQUIPMENT.
- F. FIELD VERIFY FINAL LOCATION OF PA SYSTEM HEADEND WITHIN ROOM PRIOR TO INSTALL.



KEY NOTES:

- ① NOT USED.

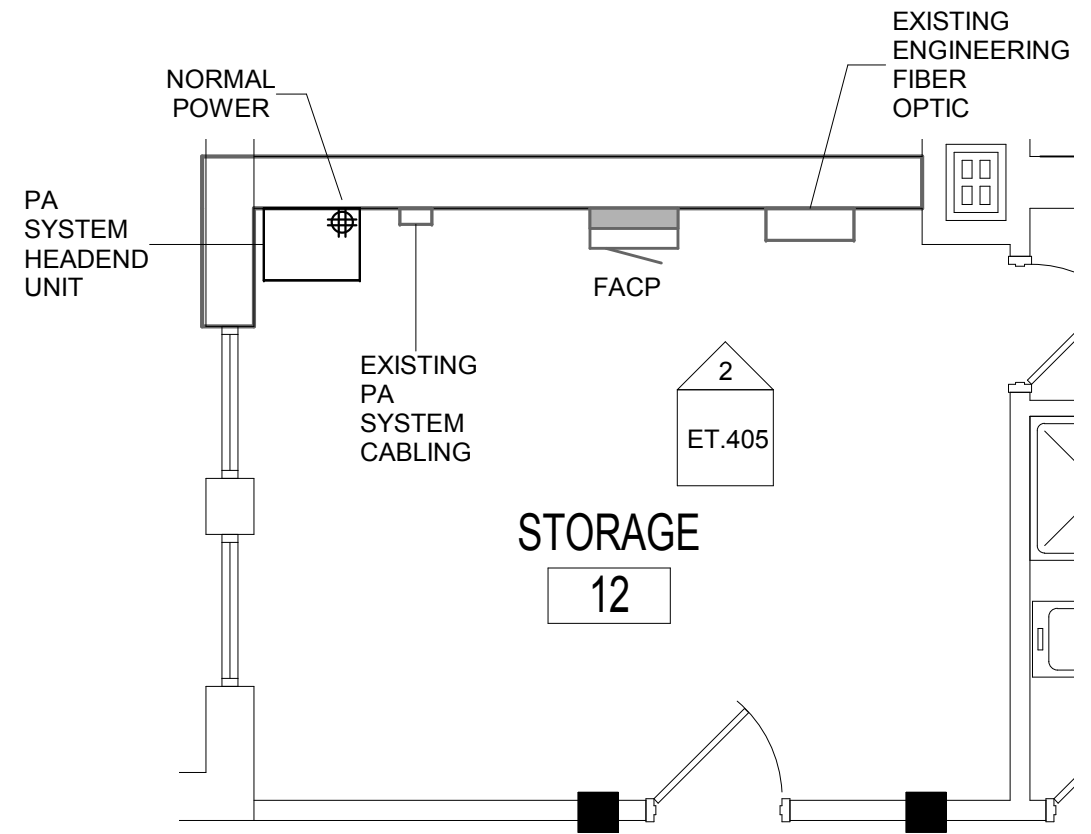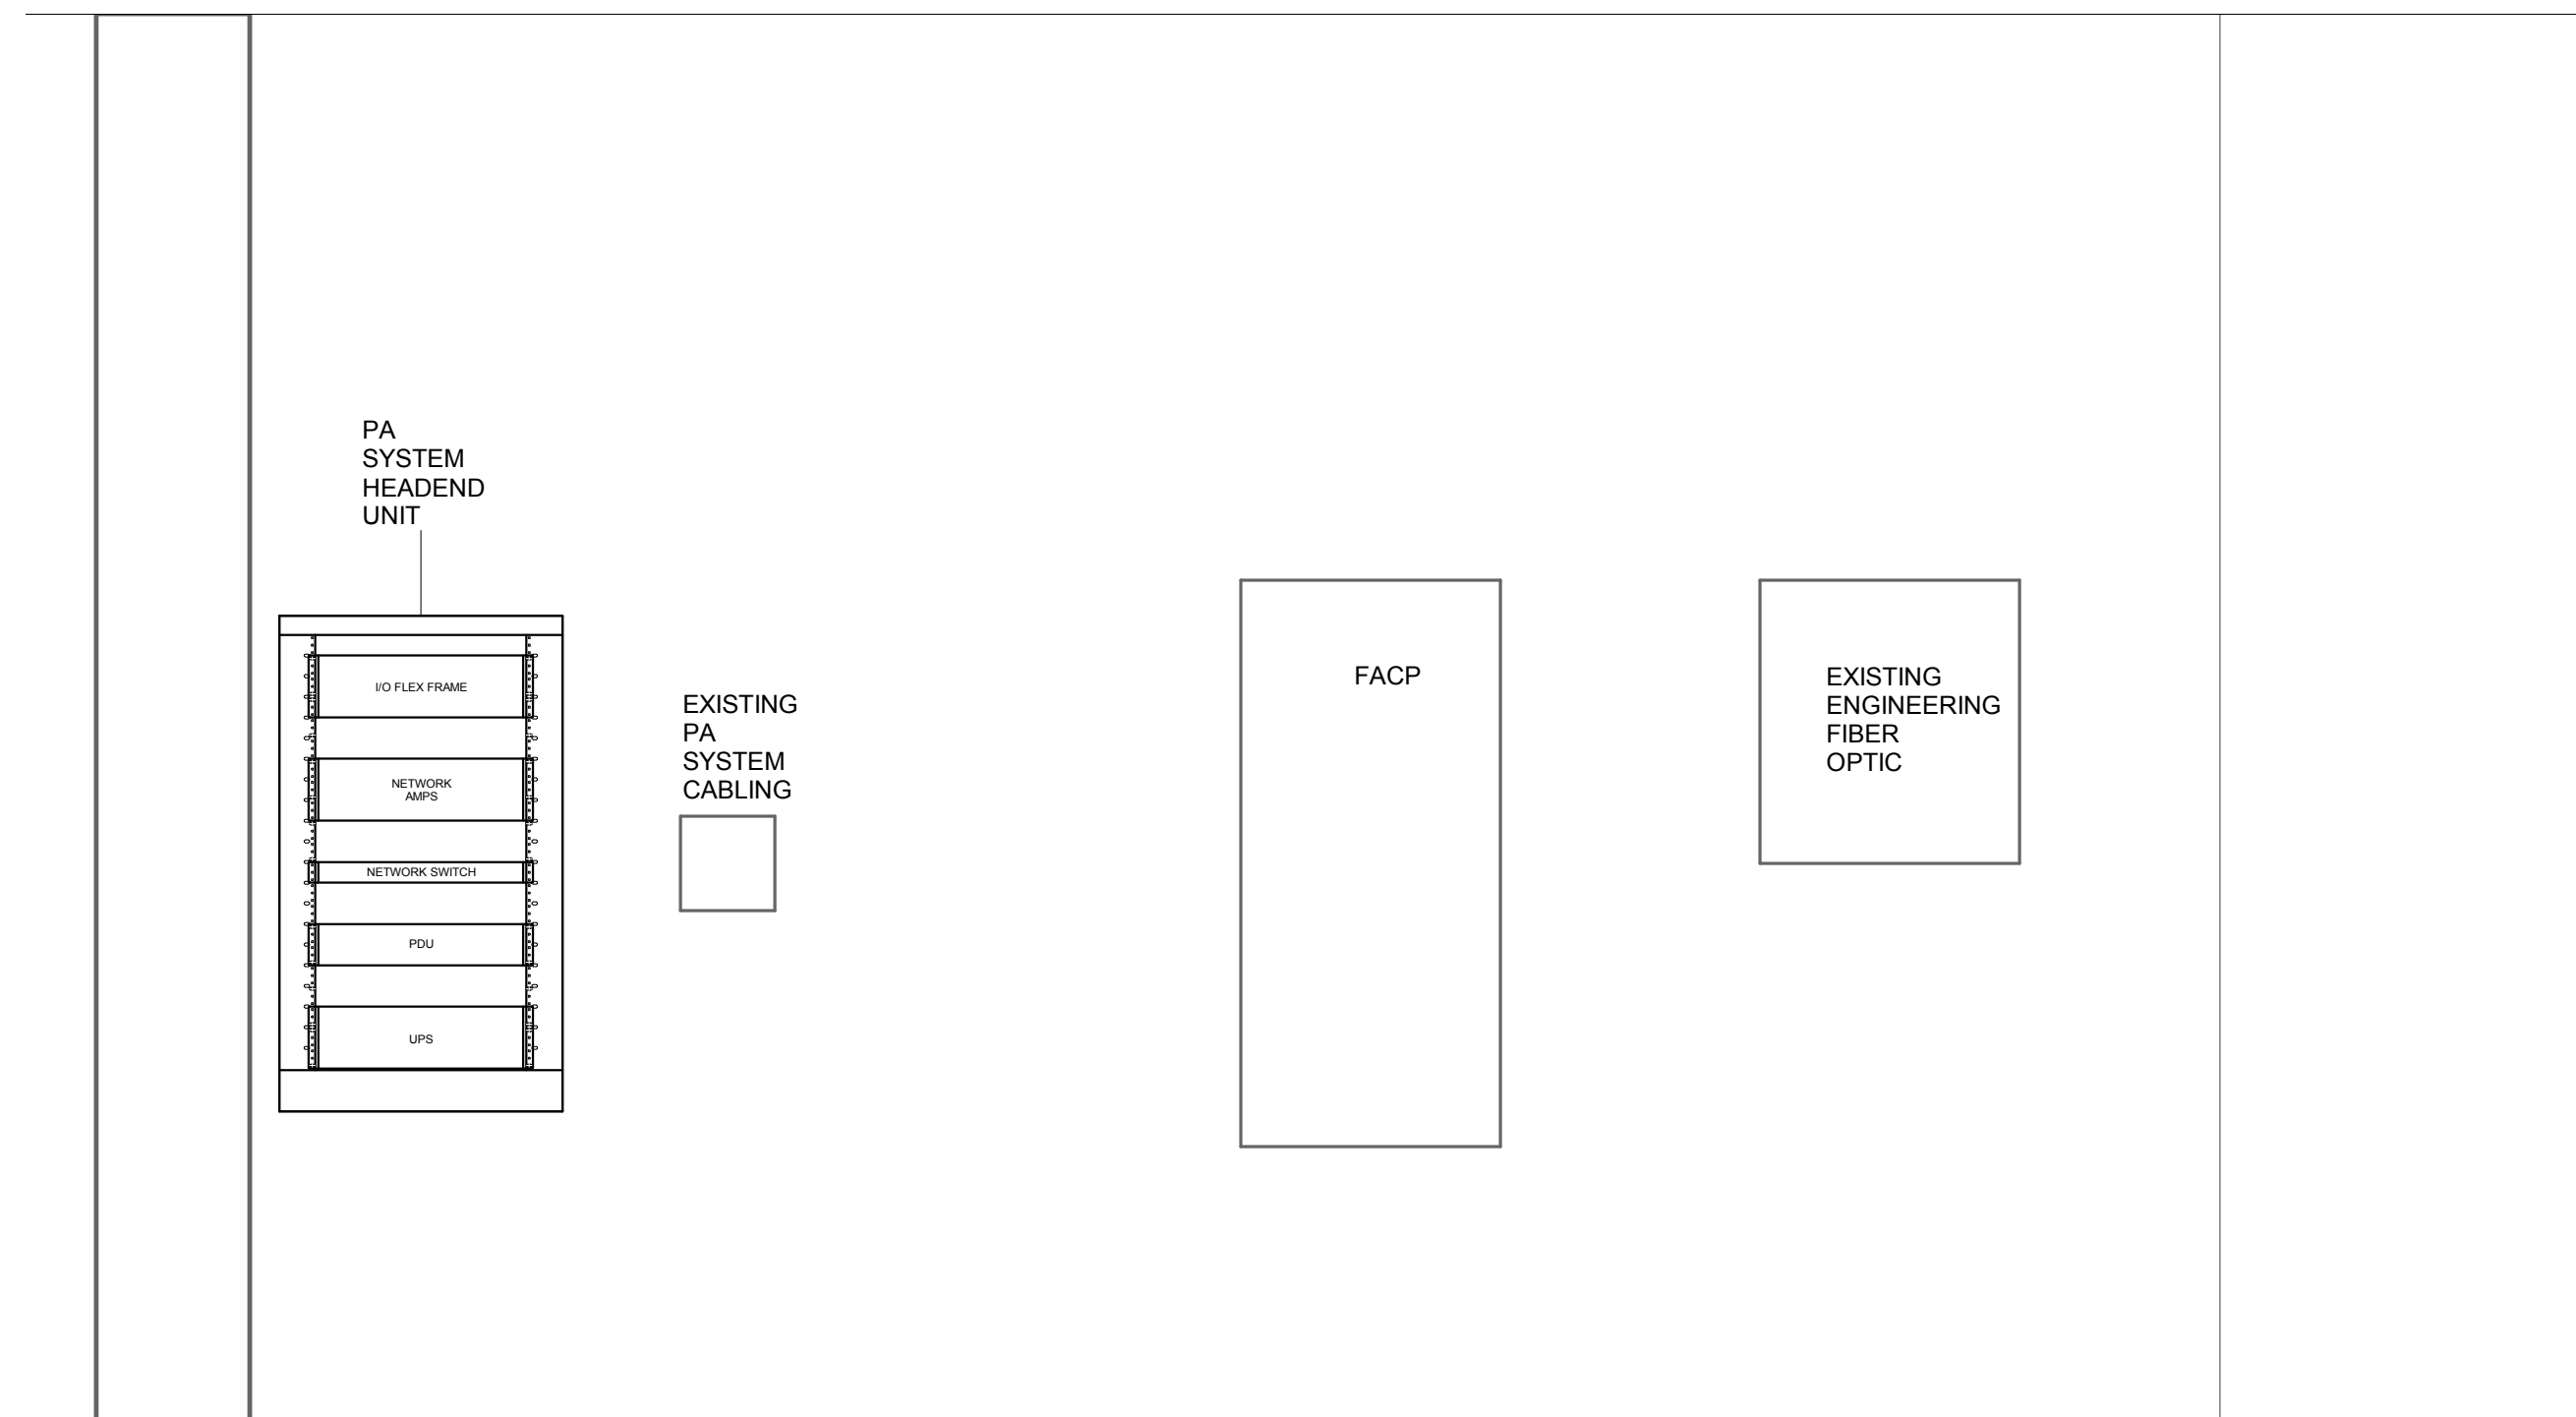


① ENLARGED ROOM - BUILDING 10 - PA SYSTEM HEADEND UNIT
1/4" = 1'-0"

② BLDG 10 - BASEMENT - STORAGE 12 - NORTH ELEVATION
3/4" = 1'-0"

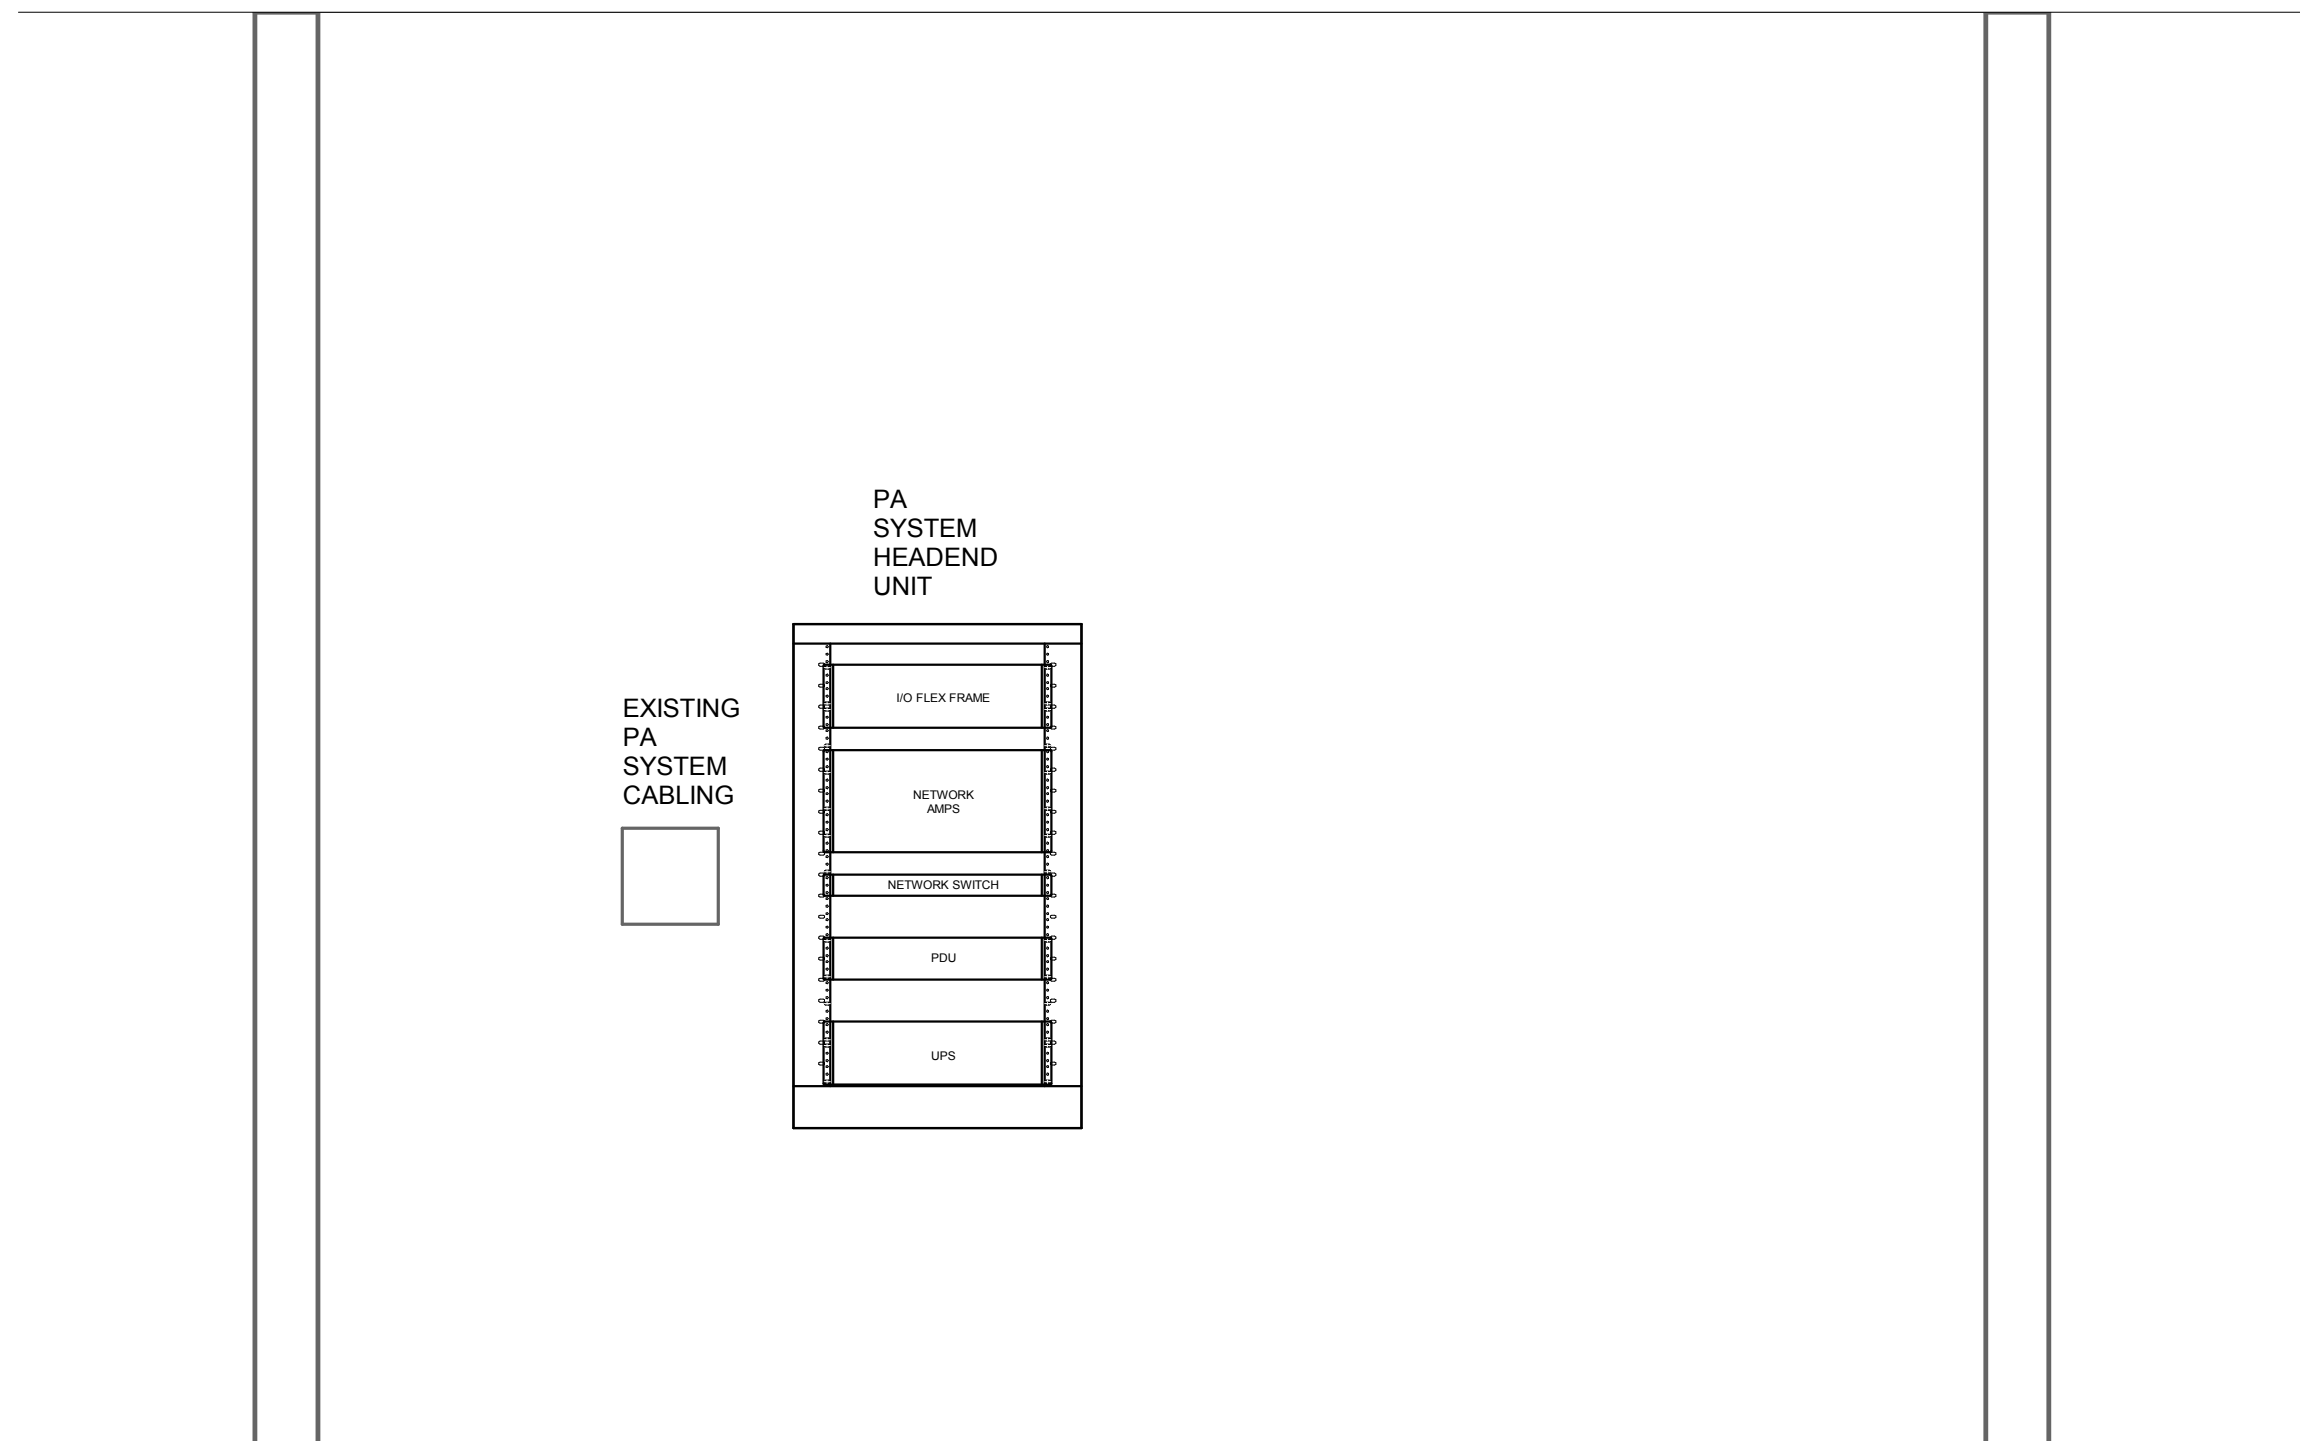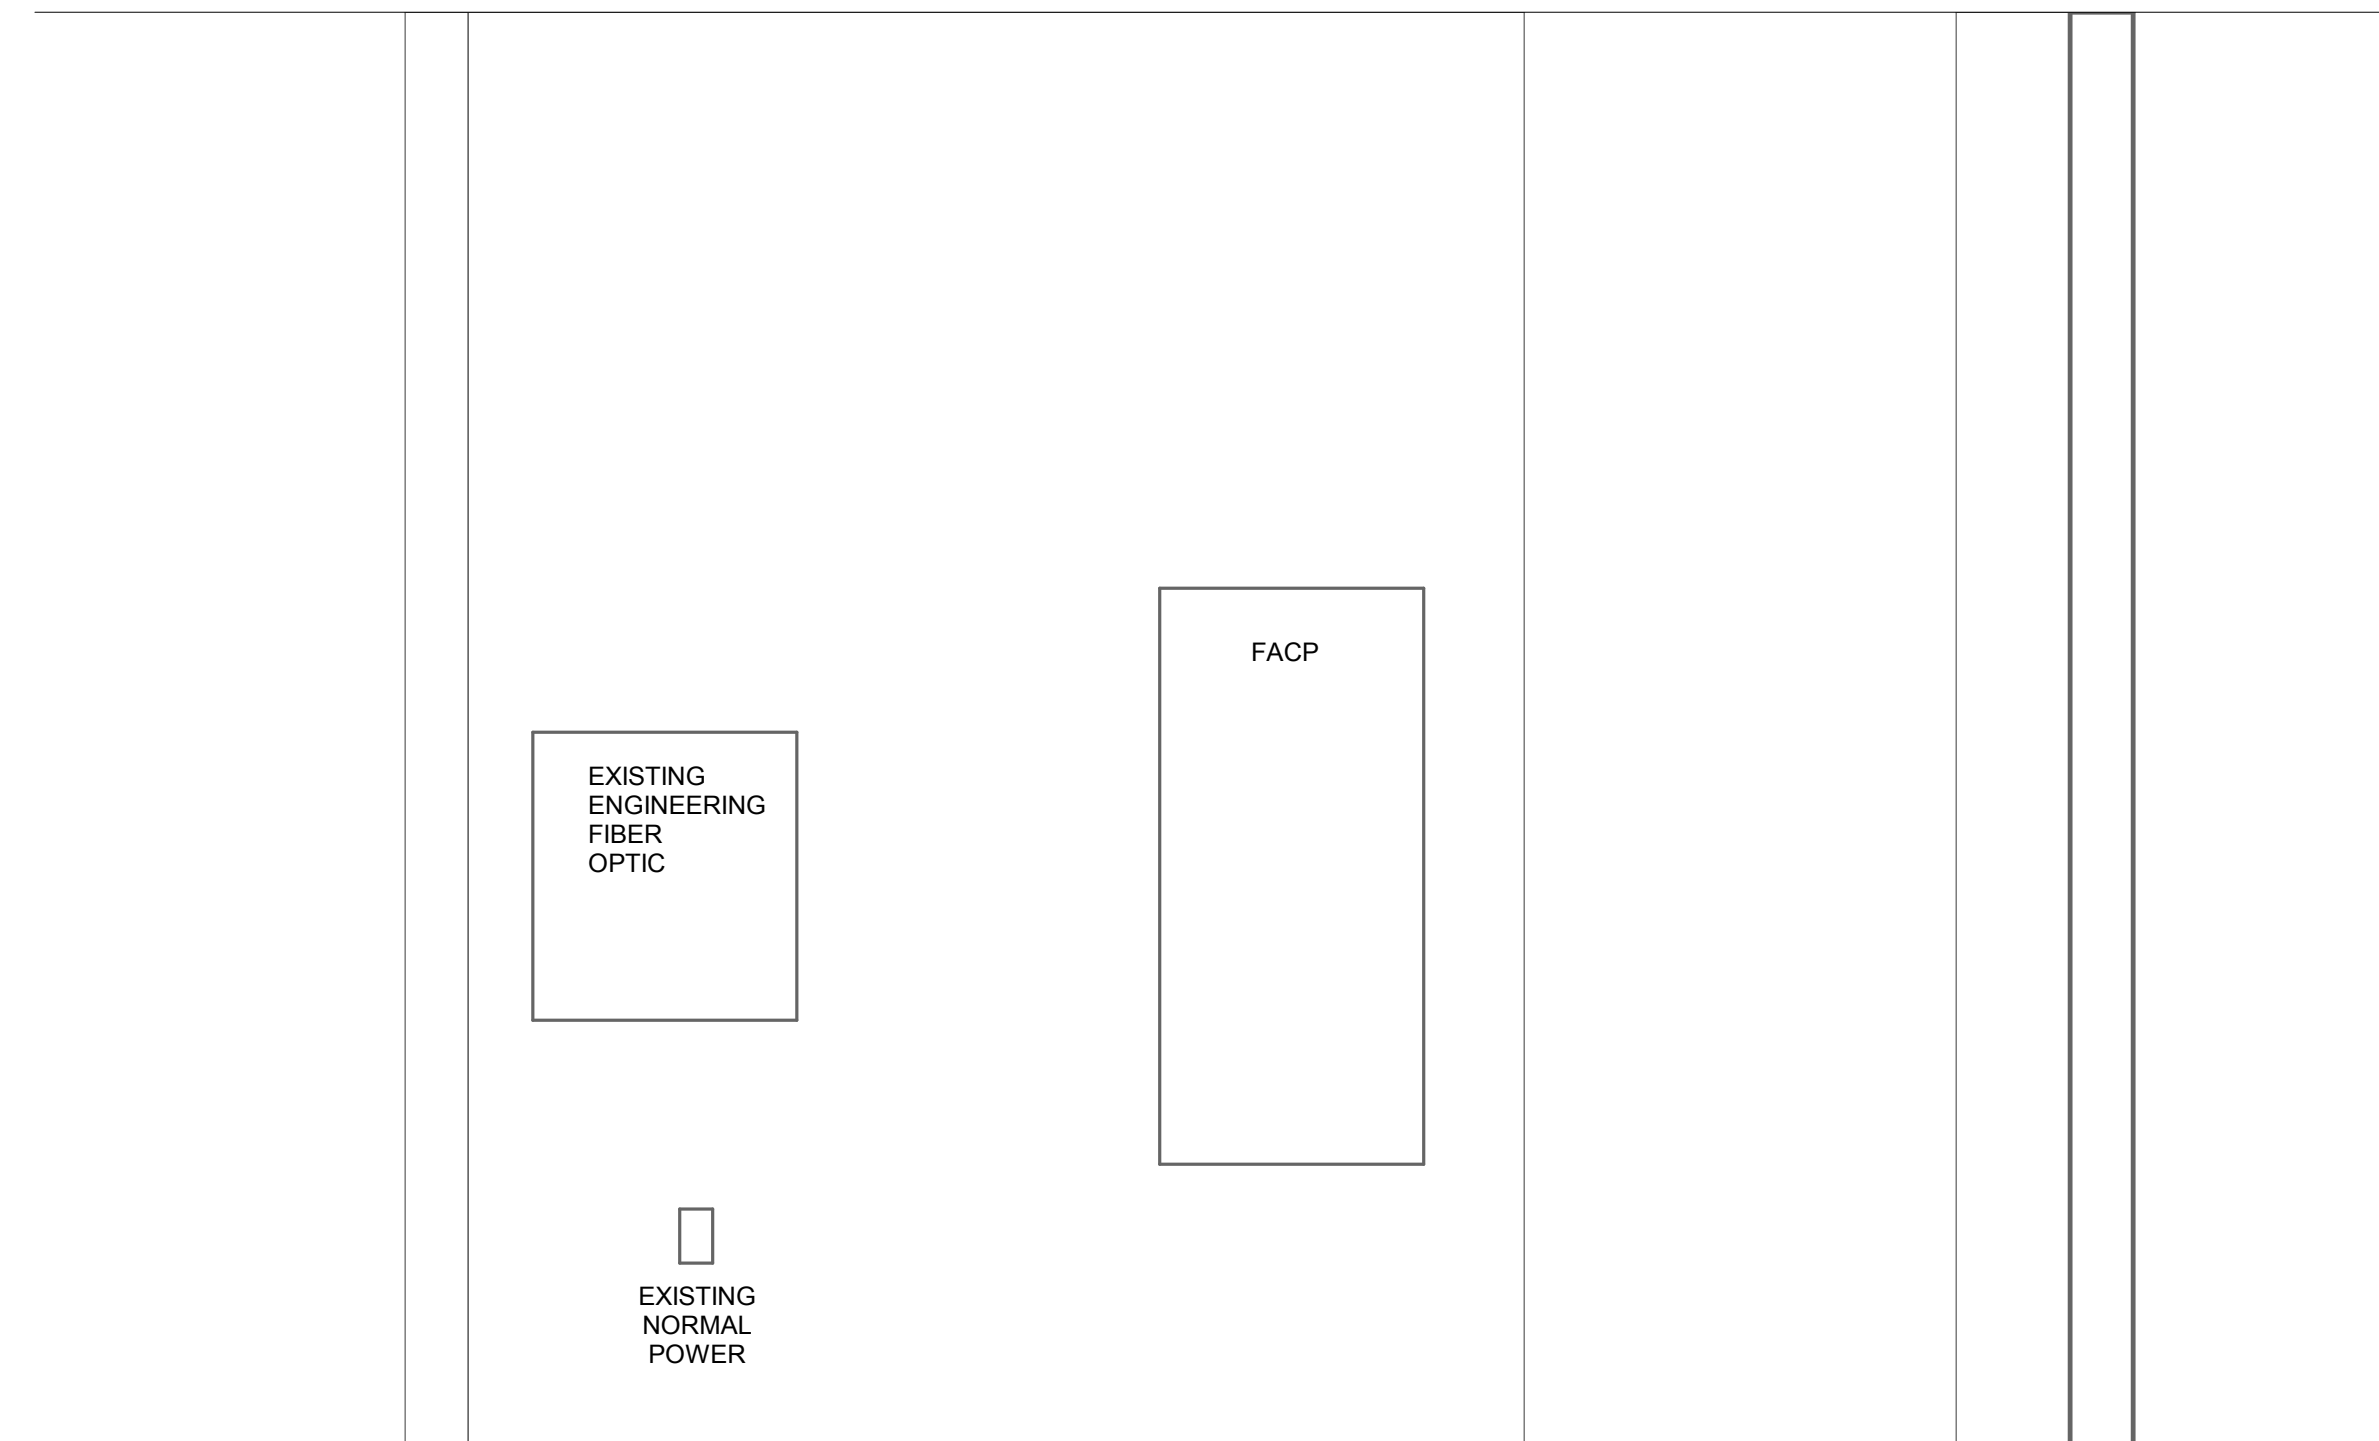

④ BLDG 28 - BASEMENT - ELEC 72B - NORTH ELEVATION
3/4" = 1'-0"

⑤ BLDG 28 - BASEMENT - ELEC 72B - SOUTH ELEVATION
3/4" = 1'-0"

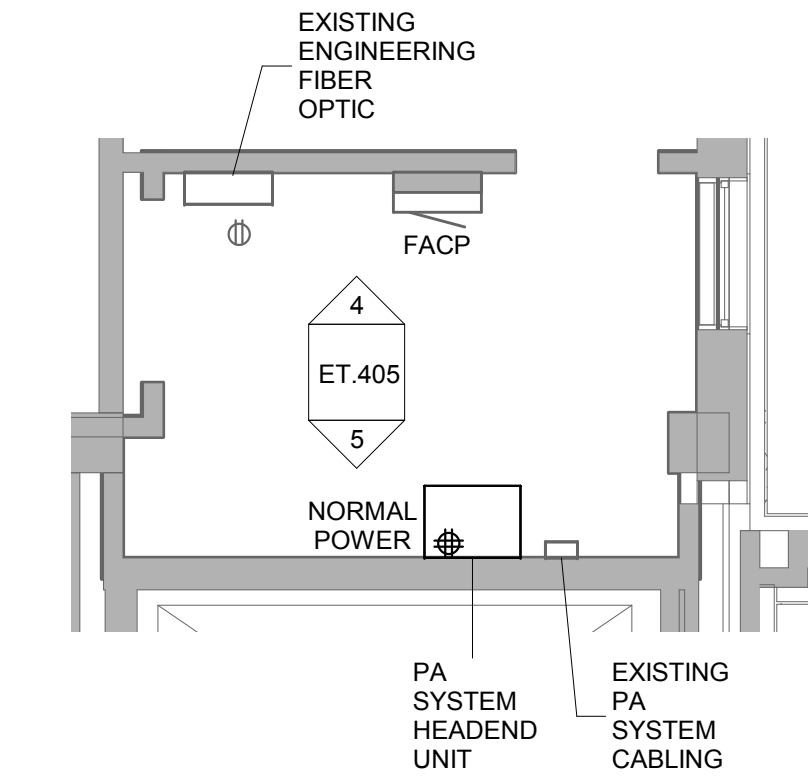

③ ENLARGED ROOM - BUILDING 28 - PA SYSTEM HEADEND UNIT
1/4" = 1'-0"

1/24/2019 11:21:19 PM
C:\Revit\Projects\VA ST CLOUD\FACING_Elec_R12_cmg.rvt

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)
DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD
ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE ENLARGED COMMUNICATION ROOM PLANS
APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
DATE:
APPROVED: CHIEF OF STAFF
DATE:
APPROVED: HEALTH CARE SYSTEM DIRECTOR
DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM	FLUT SCALE
PROJECT NO.	
BUILDING No.	CHECKED BY CP
	DRAWN CG
	ISSUE DATE 1/24/19
LOCATION VA MEDICAL CENTER ST. CLOUD, MN 56303	DRAWING NO. ET.405

VA U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

A

B

C


D

E


F

- GENERAL NOTES:**
- A. PROVIDE CONNECTION TO CRITICAL POWER WITHIN ROOM, IF AVAILABLE.
 - B. PROVIDE QUAD RECEPTACLE WITHIN EACH EQUIPMENT CABINET (ENCLOSURE). SEE 27 11 00 FOR REQUIREMENTS.
 - C. PROVIDE FIBER OPTIC CONNECTORS (ST/LO) REQUIRED BETWEEN EXISTING FIBER PATCH BOX AND PUBLIC ADDRESS SYSTEM HEADEND EQUIPMENT.
 - D. PROVIDE MINIMUM 3/4" ORANGE EMT BETWEEN EXISTING FIBER BOX AND PUBLIC ADDRESS SYSTEM EQUIPMENT.
 - E. PROVIDE BLUE EMT BETWEEN PRE-WIRED (AND WIRED) PA CIRCUITS AND PUBLIC ADDRESS SYSTEM EQUIPMENT.
 - F. FIELD VERIFY FINAL LOCATION OF PA SYSTEM HEADEND WITHIN ROOM PRIOR TO INSTALL.


- KEY NOTES:**
- ◇ NOT USED.

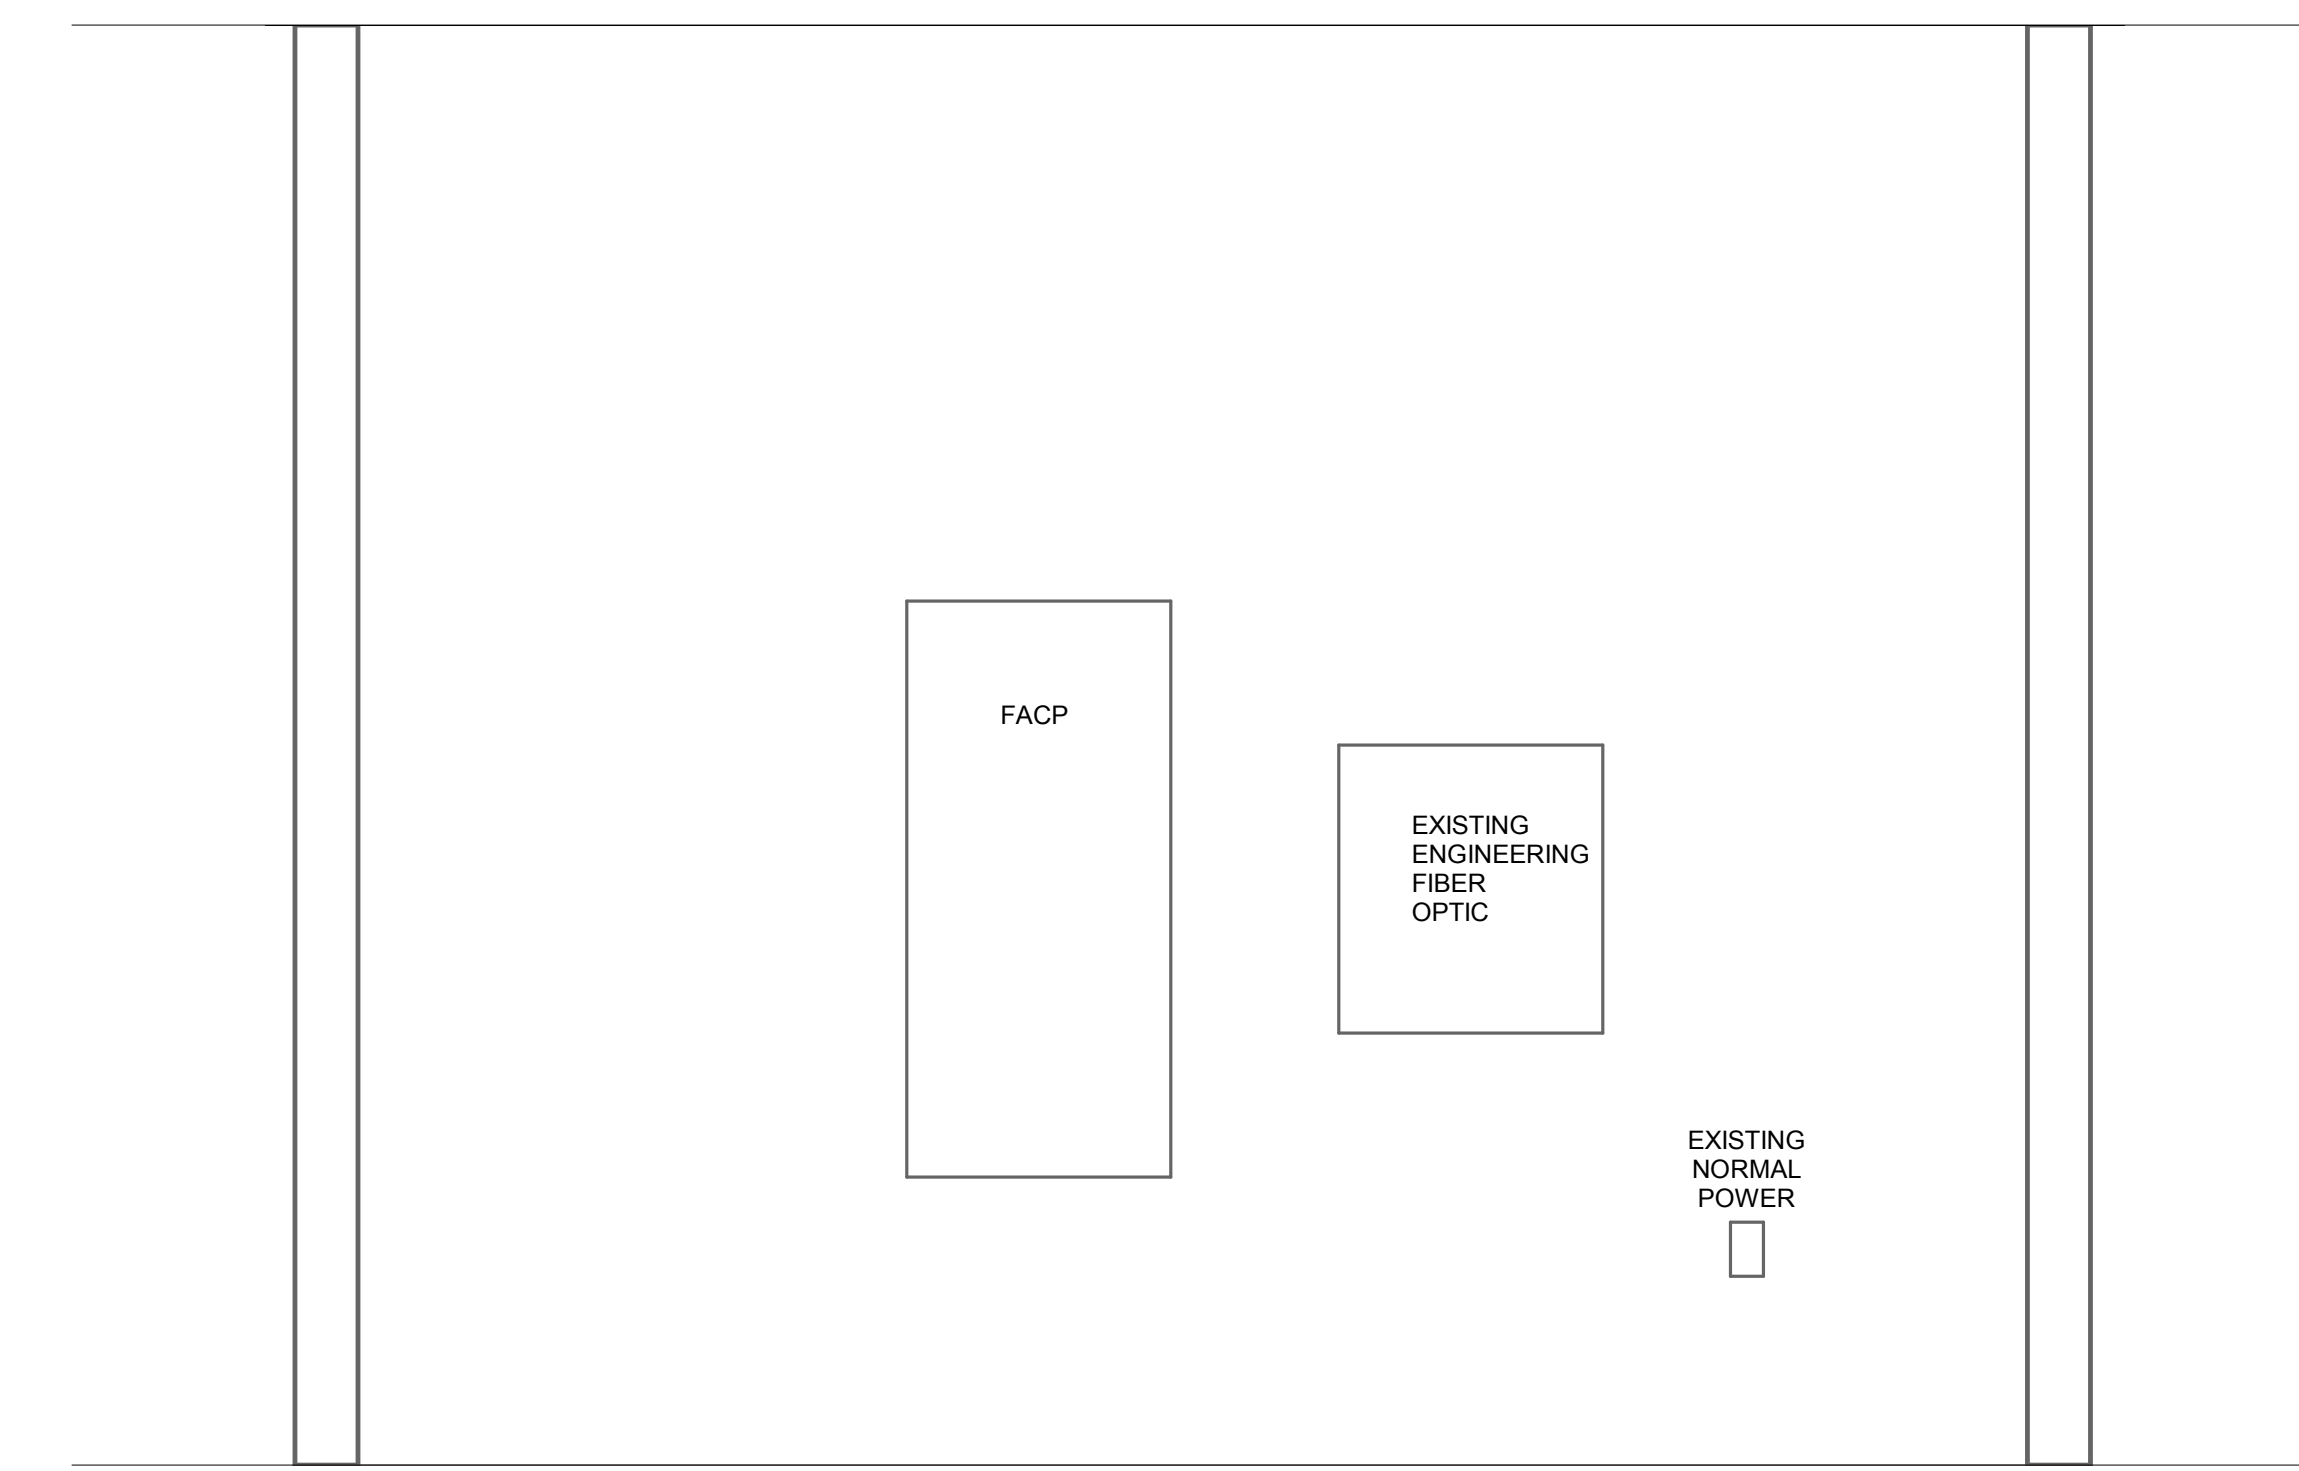


2 BLDG 29 - FIRST FLOOR - STORAGE C02A - NORTH ELEVATION
3/4" = 1'-0"

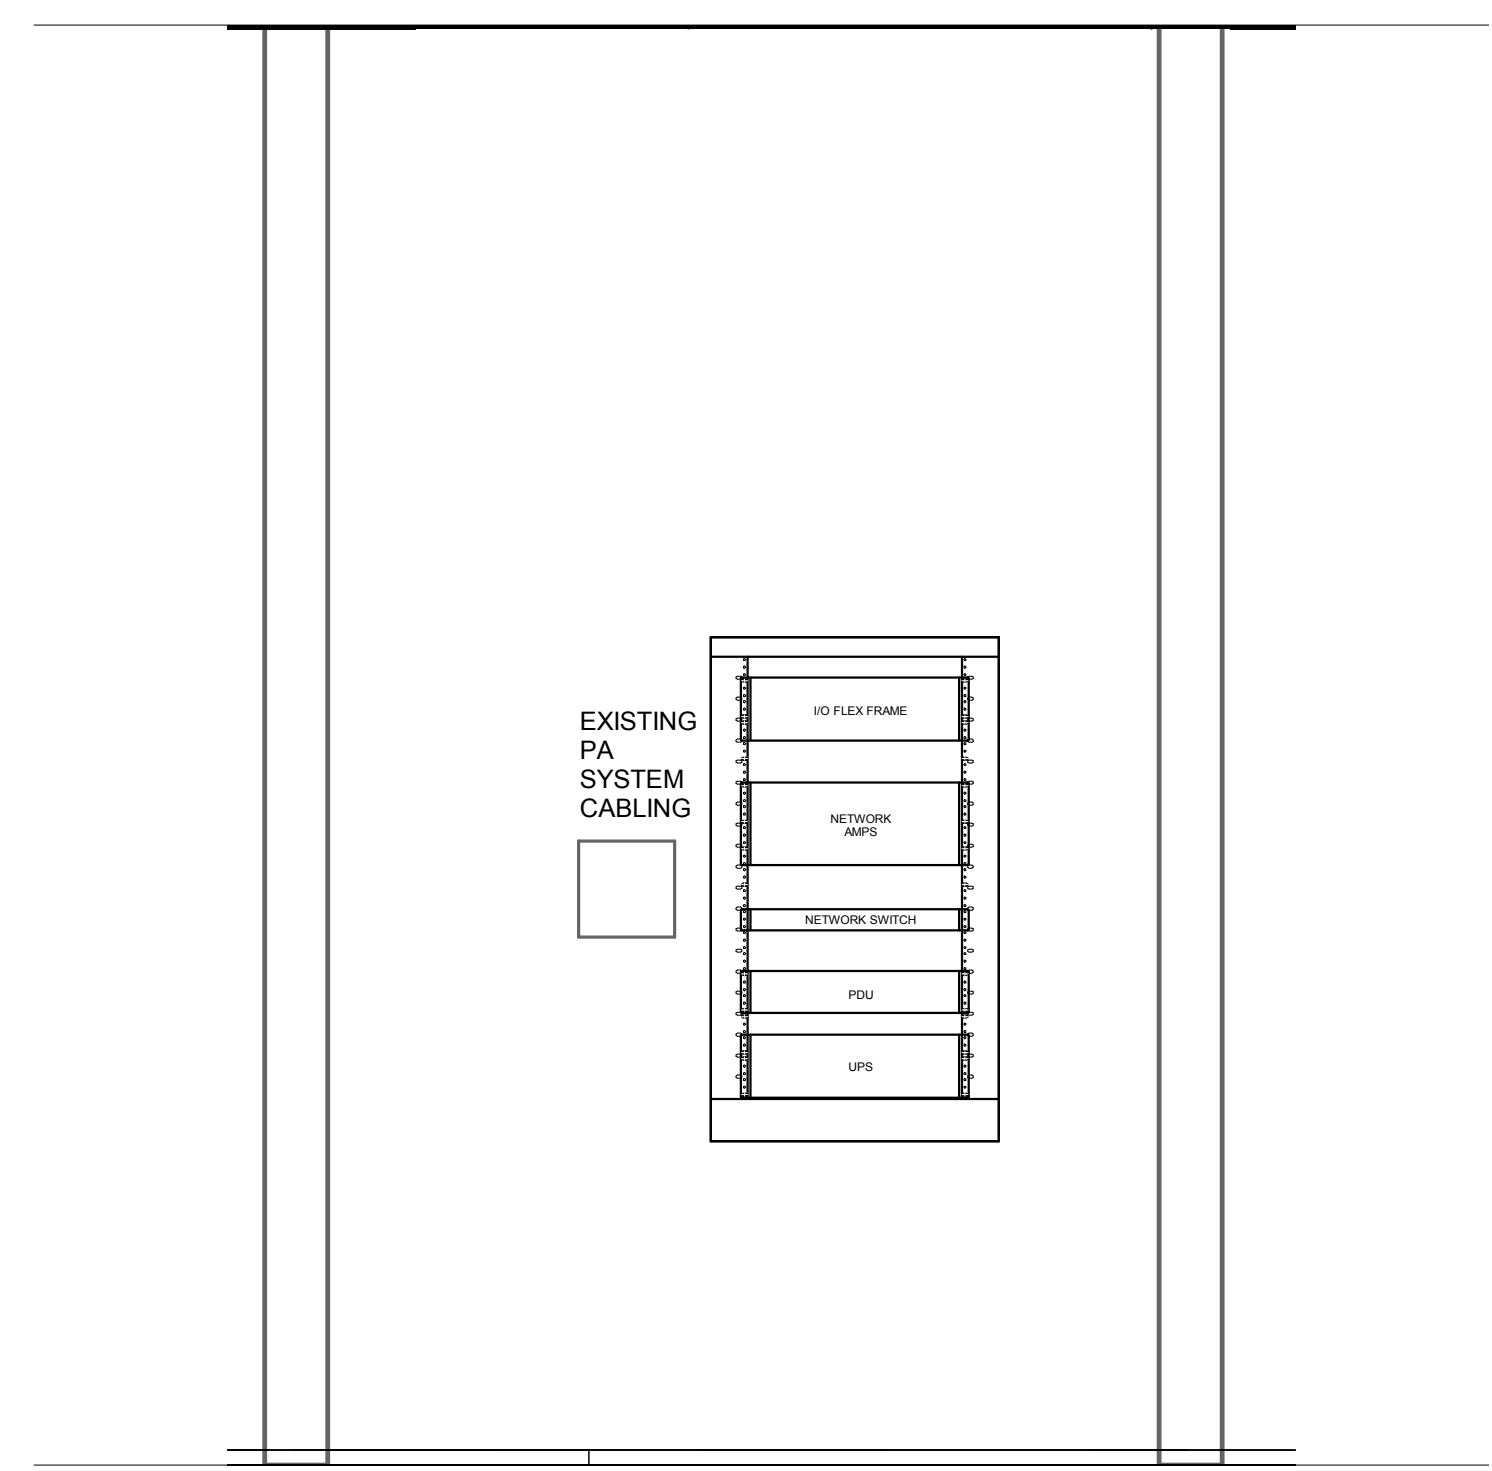


3 BLDG 29 - FIRST FLOOR - STORAGE C02A - EAST ELEVATION
3/4" = 1'-0"

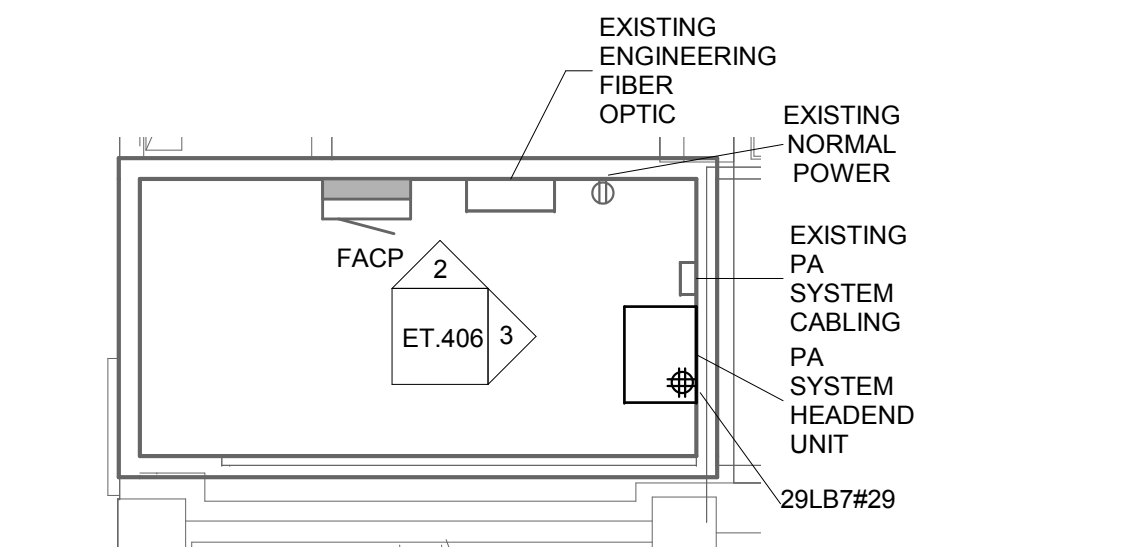


1 ENLARGED ROOM - BUILDING 29 - PA SYSTEM HEADEND UNIT
1/4" = 1'-0"

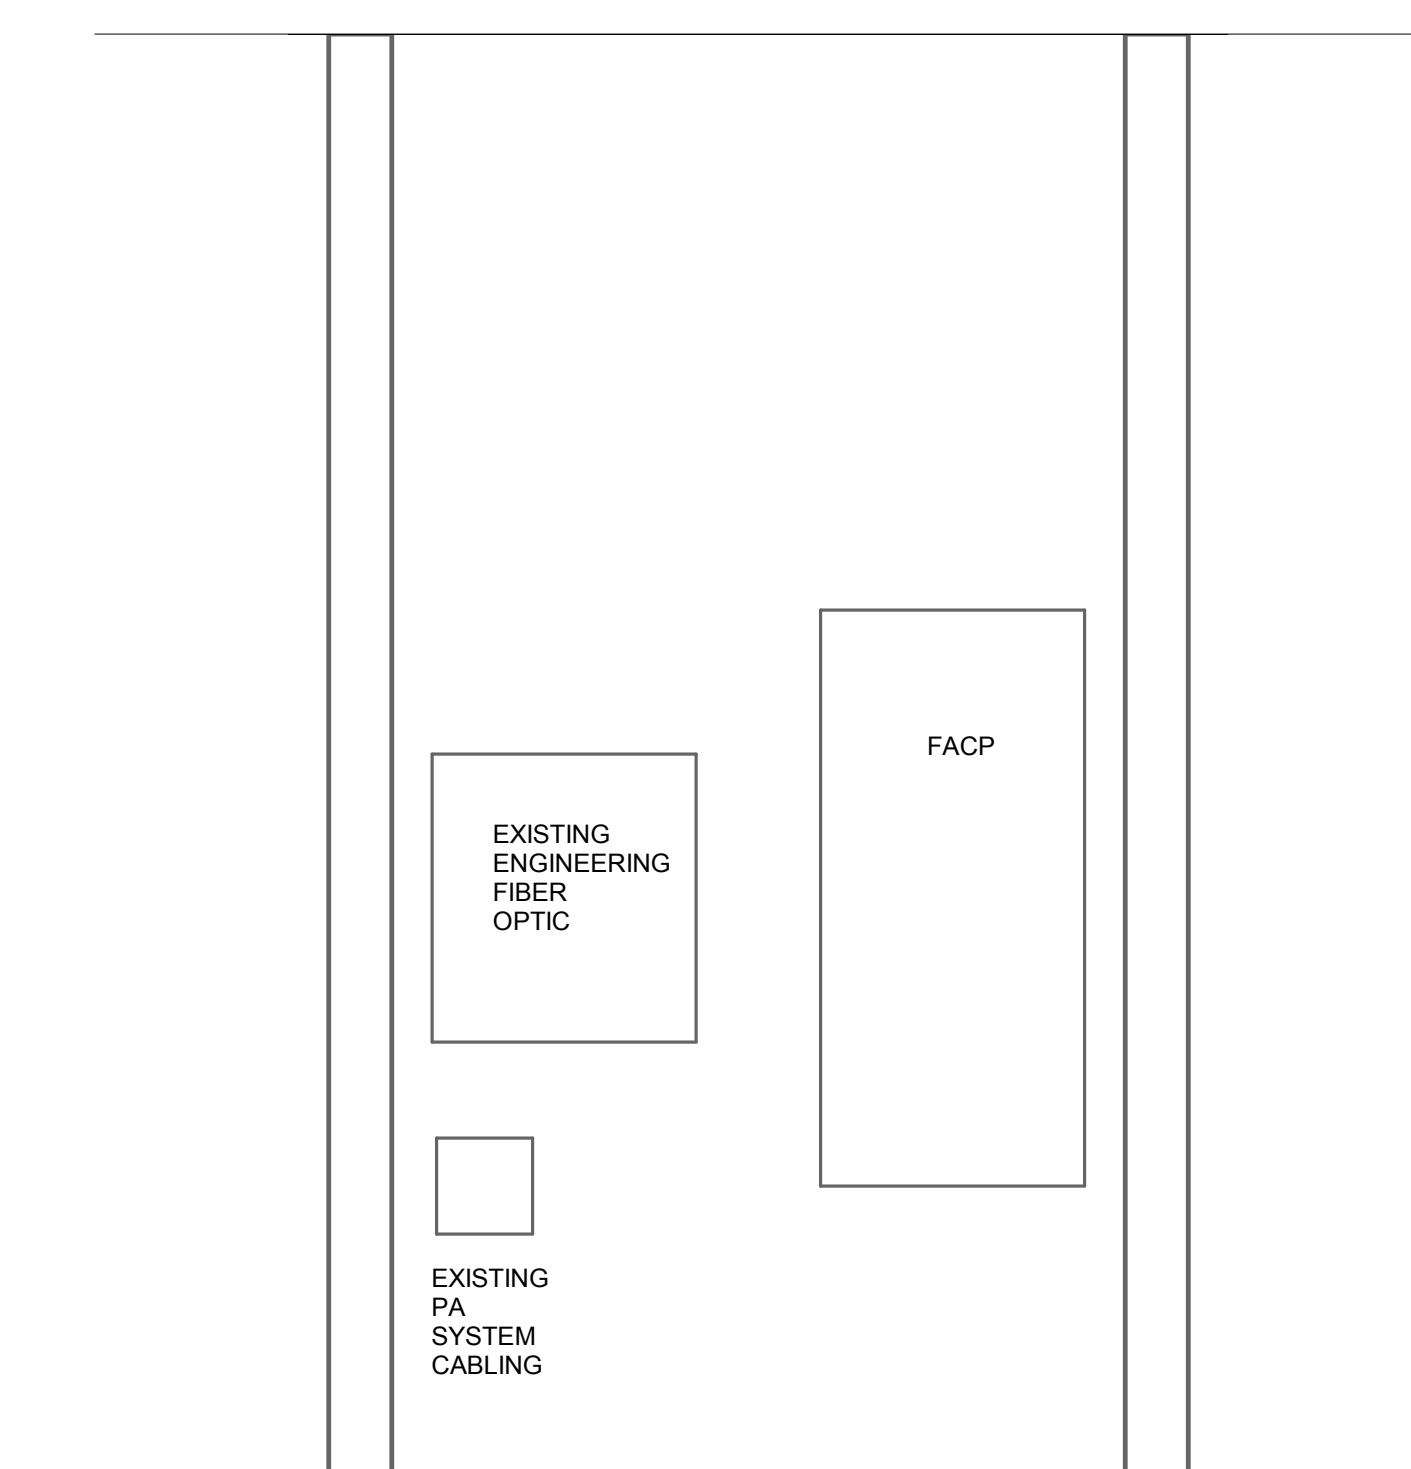

5 BLDG 48 - BASEMENT - FA 10 - WEST ELEVATION
3/4" = 1'-0"

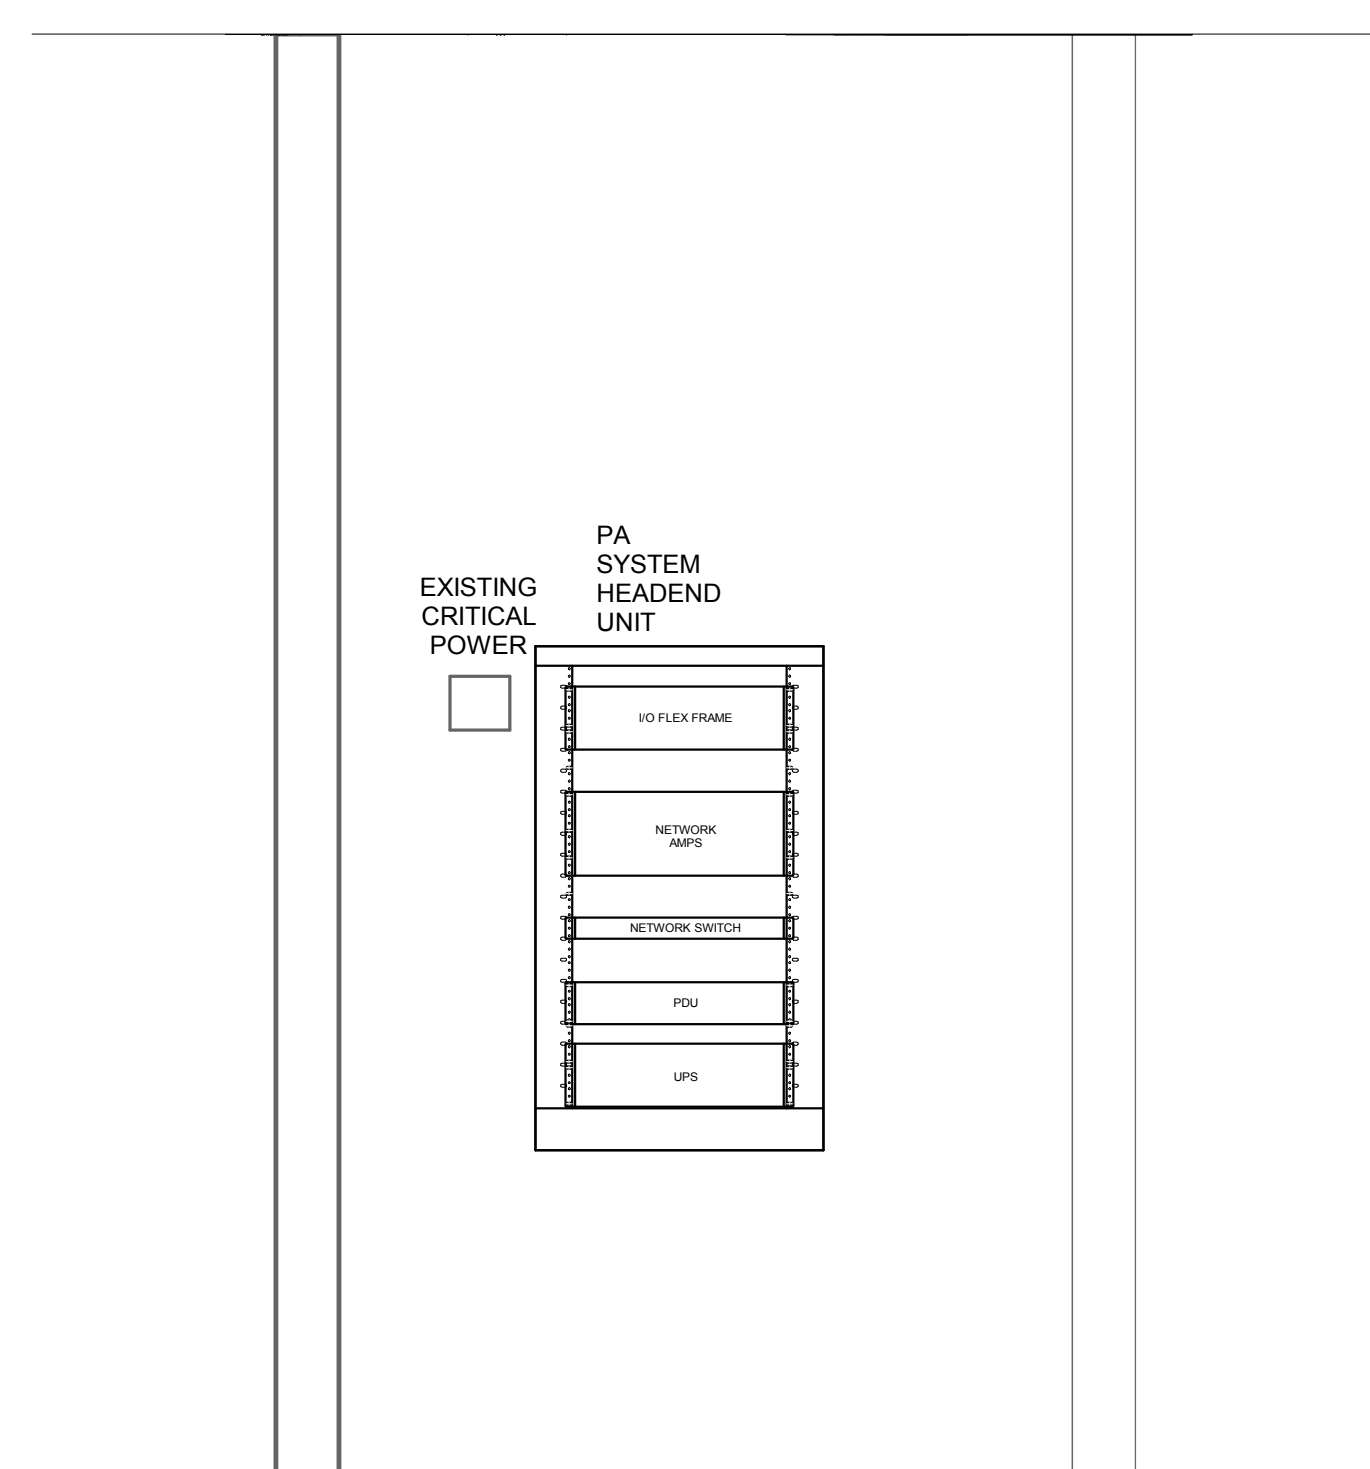

6 BLDG 48 - BASEMENT - FA 10 - EAST ELEVATION
3/4" = 1'-0"

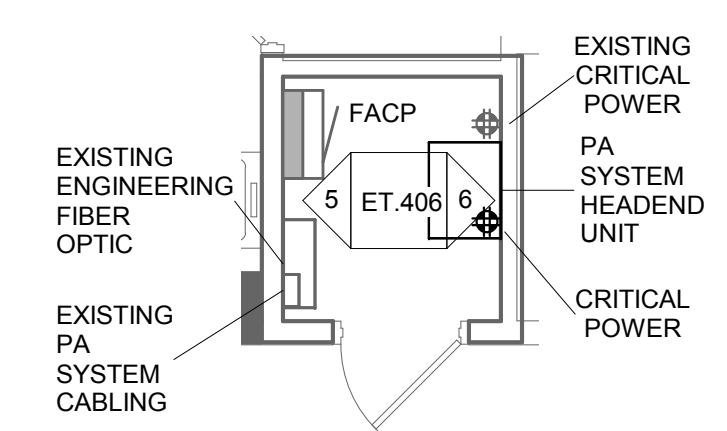

4 ENLARGED ROOM - BUILDING 48 - PA SYSTEM HEADEND UNIT
1/4" = 1'-0"

C:\Revit\Projects\VA ST CLOUD\PAGE\Bldg_Elec_R1E_cmg.rvt 1/24/2019 1:21:21 PM

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE
ENLARGED COMMUNICATION ROOM PLANS
 APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
 DATE:
 APPROVED: CHIEF OF STAFF
 DATE:
 APPROVED: HEALTH CARE SYSTEM DIRECTOR
 DATE:

PROJECT TITLE
UPGRADE PUBLIC ADDRESS SYSTEM
 BUILDING NO.:
 CHECKED BY: CP
 DRAWN: CG
 ISSUE DATE: 1/24/19
 LOCATION: VA MEDICAL CENTER ST. CLOUD, MN 56303
 DRAWING NO.: **ET.406**



VA
U.S. Department of Veterans Affairs
 Veterans Health Administration
 St. Cloud VA Health Care System

GENERAL NOTES:

- PROVIDE CONNECTION TO CRITICAL POWER WITHIN ROOM, IF AVAILABLE.
- PROVIDE QUAD RECEPTACLE WITHIN EACH EQUIPMENT CABINET (ENCLOSURE). SEE 27 11 00 FOR REQUIREMENTS.
- PROVIDE FIBER OPTIC CONNECTORS (ST/LO) REQUIRED BETWEEN EXISTING FIBER PATCH BOX AND PUBLIC ADDRESS SYSTEM HEADEND EQUIPMENT.
- PROVIDE MINIMUM 3/4" ORANGE EMT BETWEEN EXISTING FIBER BOX AND PUBLIC ADDRESS SYSTEM EQUIPMENT.
- PROVIDE BLUE EMT BETWEEN PRE-WIRED (AND WIRED) PA CIRCUITS AND PUBLIC ADDRESS SYSTEM EQUIPMENT.
- FIELD VERIFY FINAL LOCATION OF PA SYSTEM HEADEND WITHIN ROOM PRIOR TO INSTALL.




KEY NOTES:

1 NOT USED.

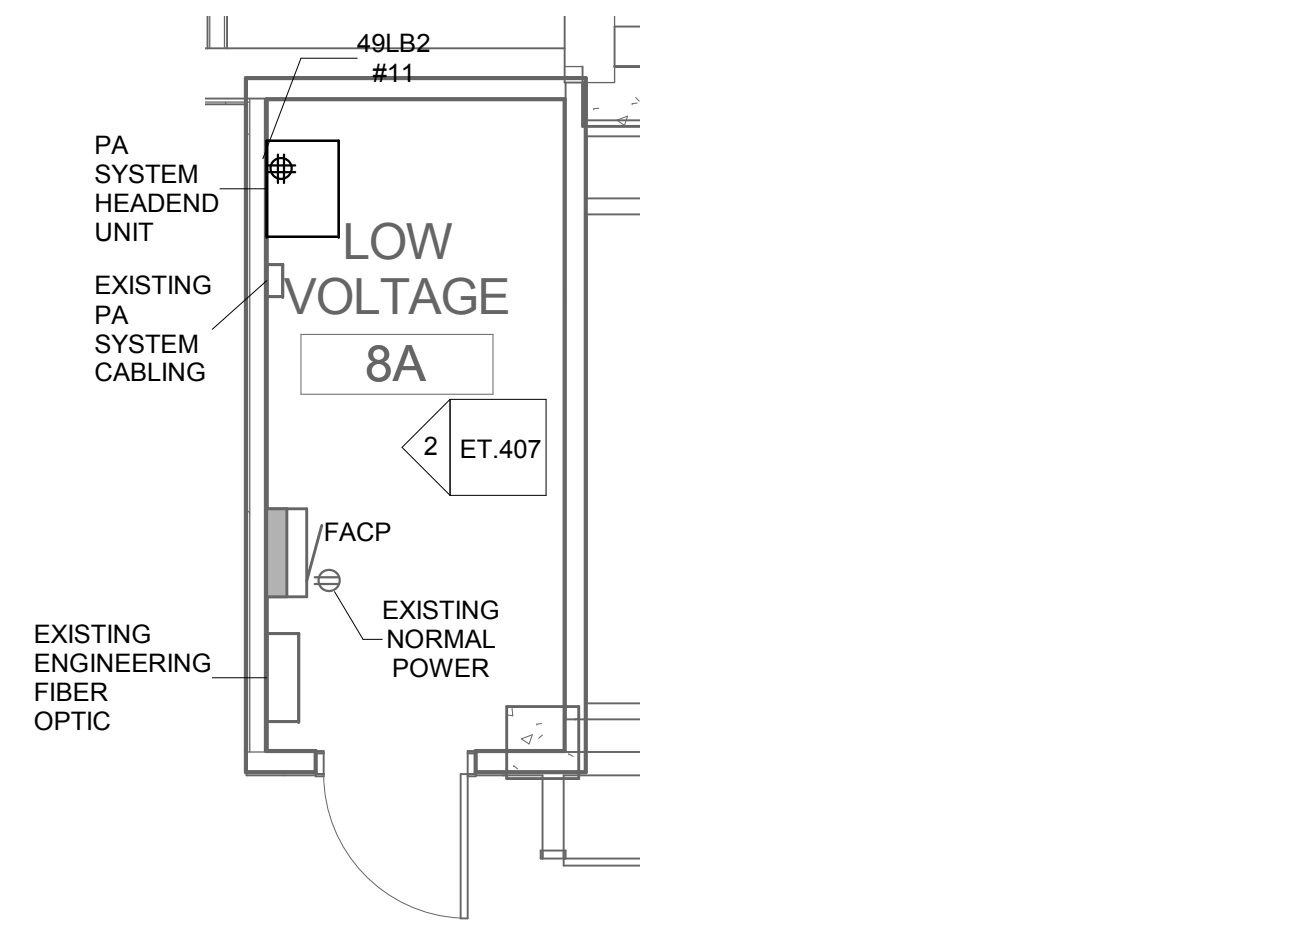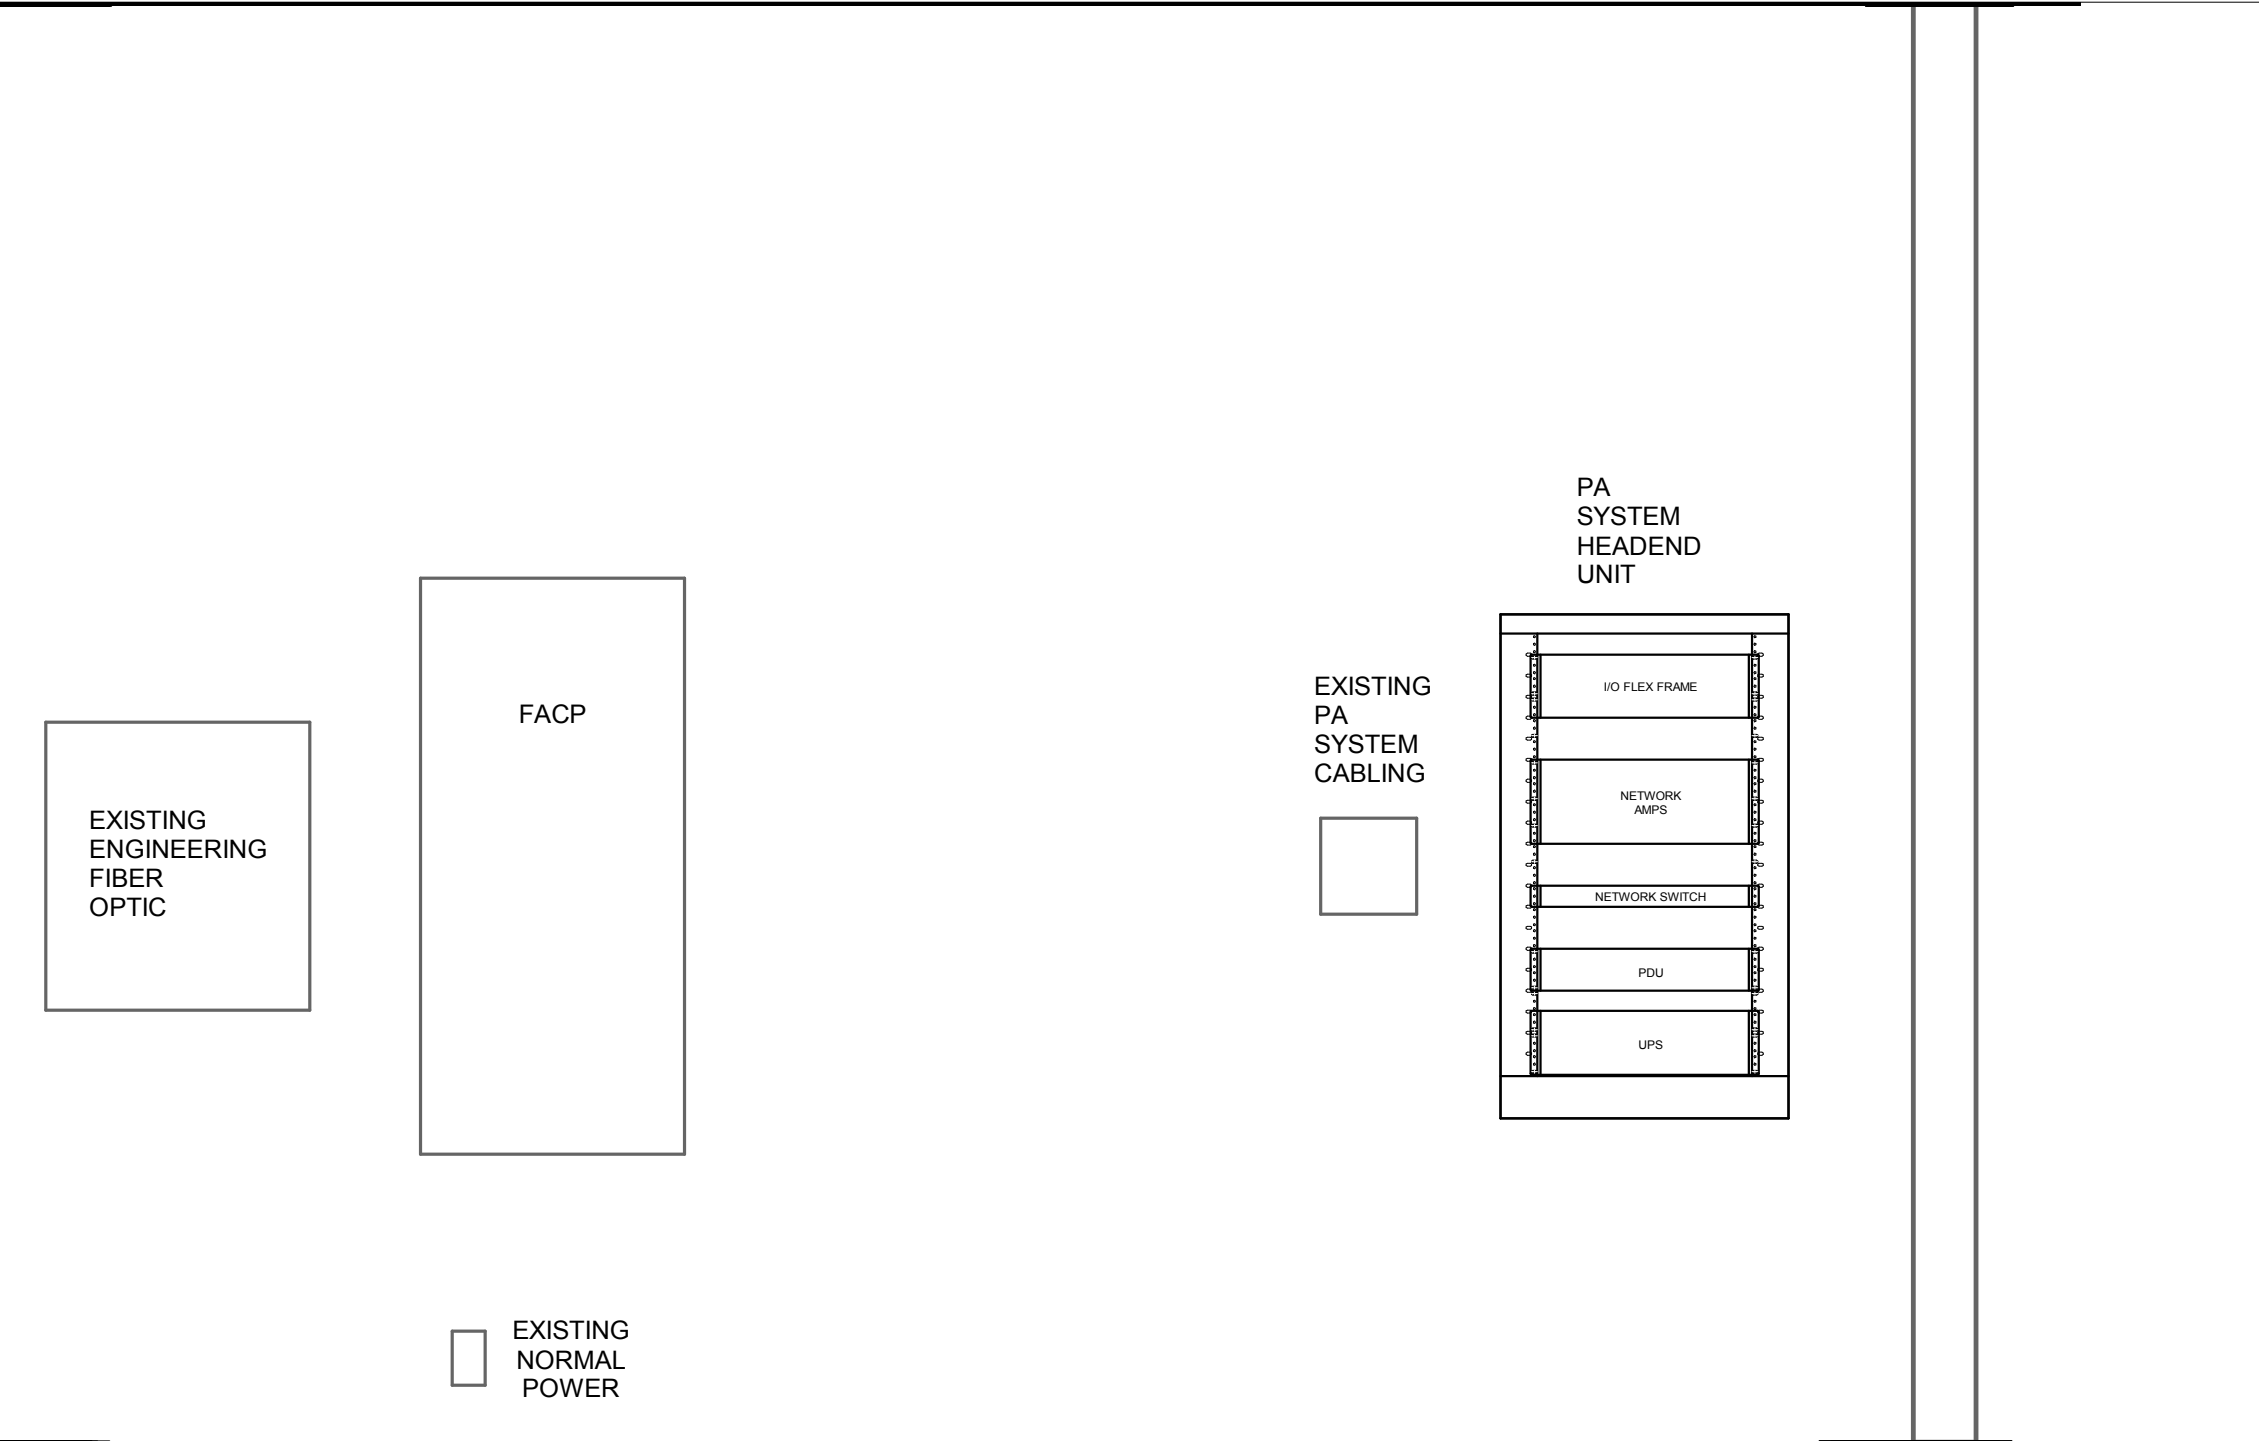

1 ENLARGED ROOM - BUILDING 49 - PA SYSTEM HEADEND UNIT
1/4" = 1'-0"

2 BLDG 49 - BASEMENT - LOW VOLTAGE 8A - WEST ELEVATION
3/4" = 1'-0"

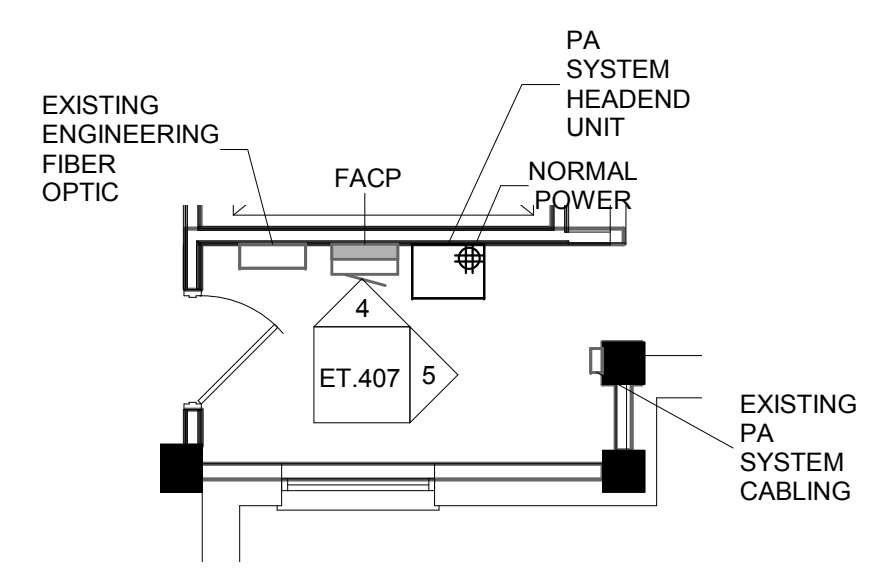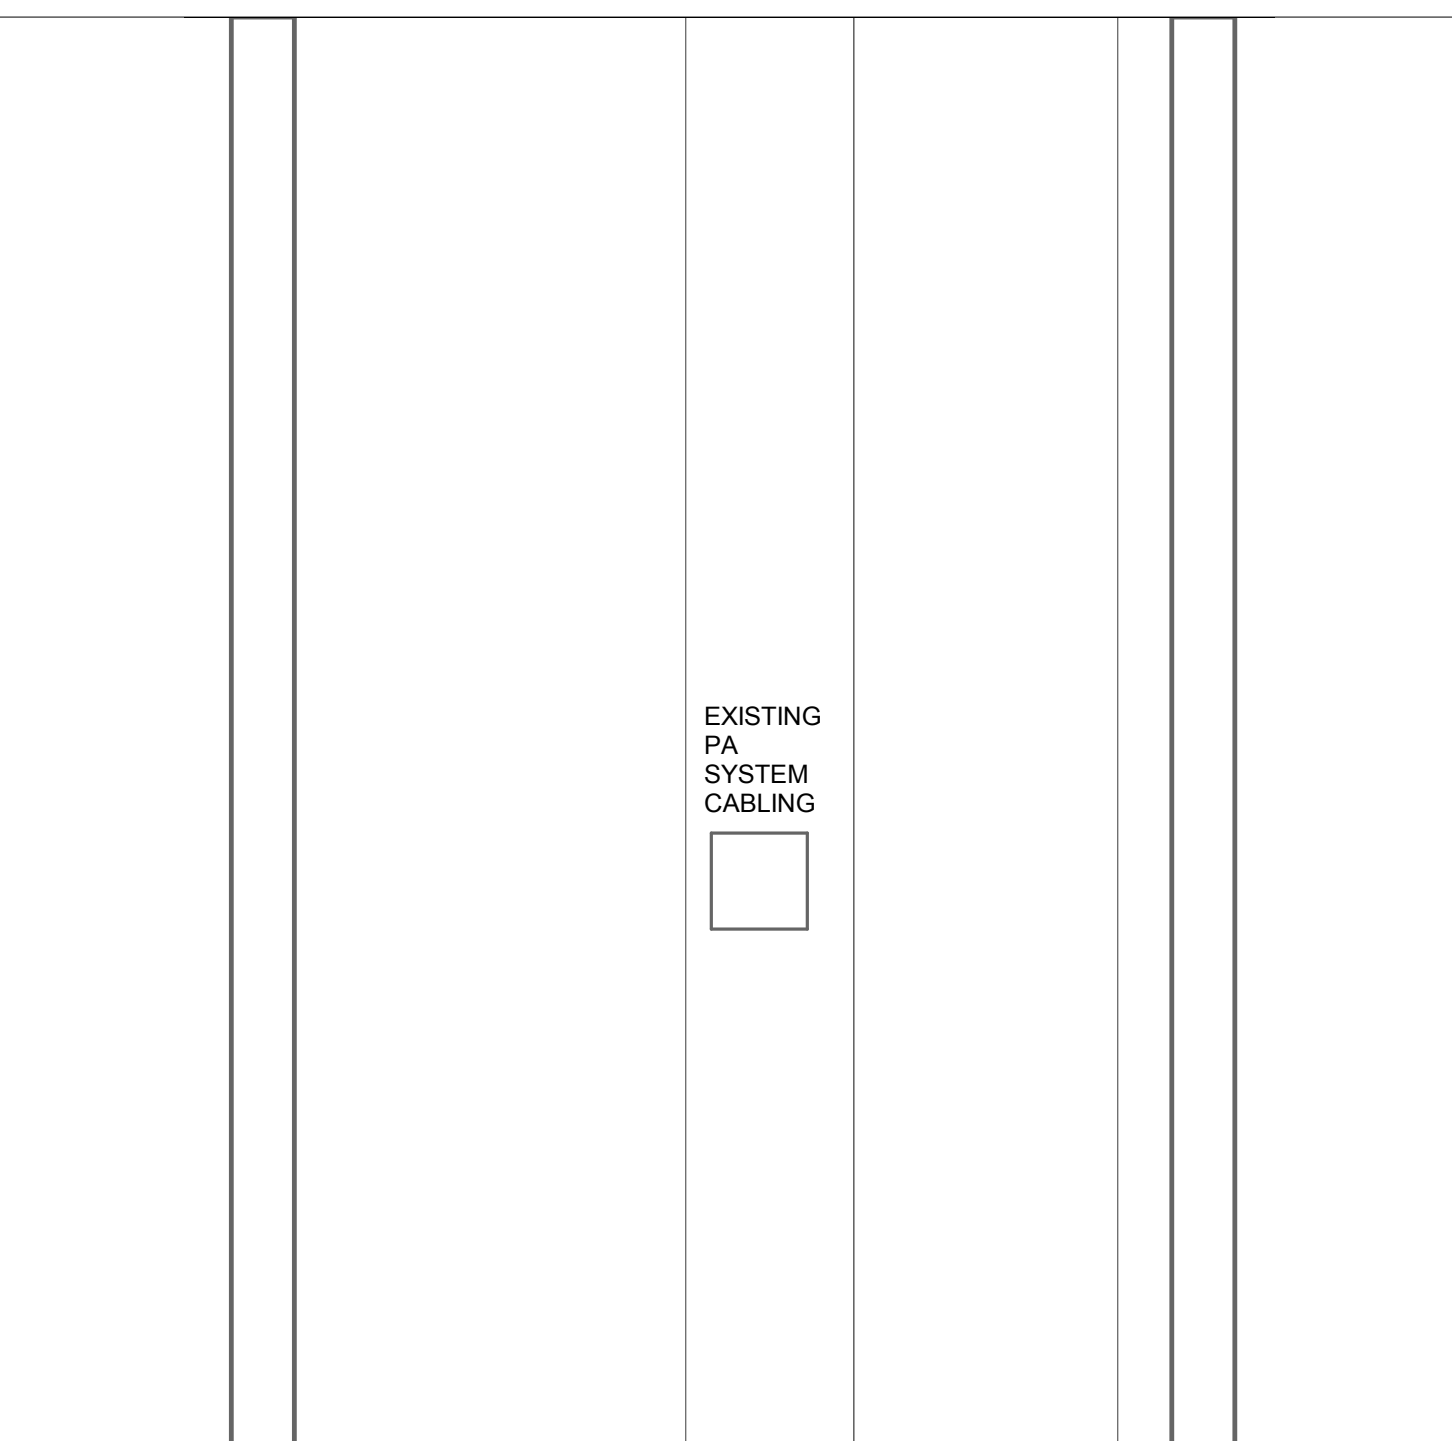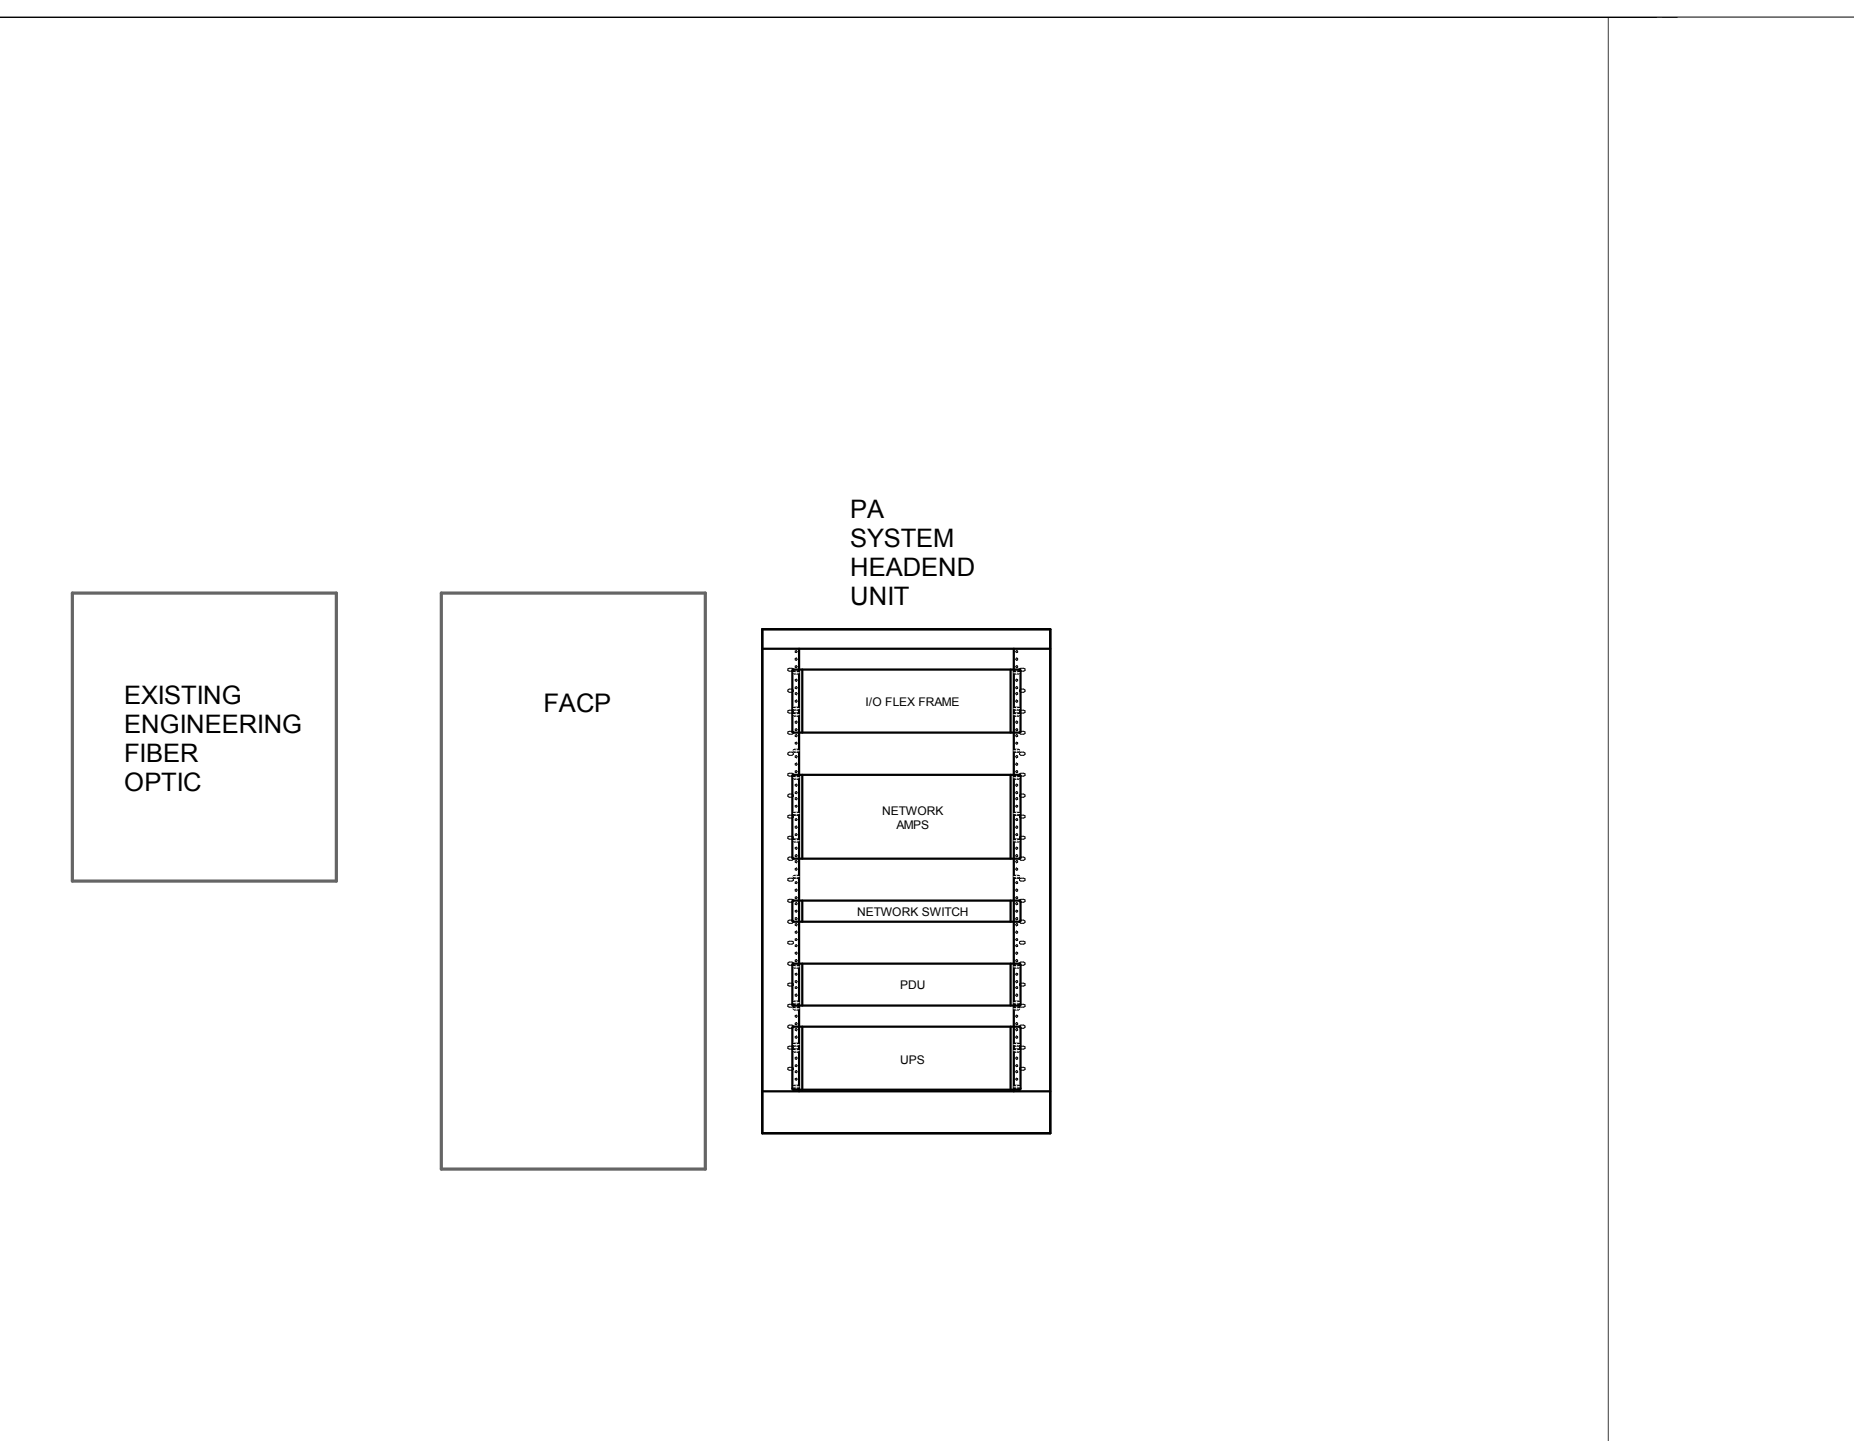

3 ENLARGED ROOM - BUILDING 50 - PA SYSTEM HEADEND UNIT
3/16" = 1'-0"

4 BLDG 50 - BASEMENT - ELEC RM 23A - WEST ELEVATION
3/4" = 1'-0"

5 BLDG 50 - BASEMENT - ELEC RM 23A - NORTH ELEVATION
3/4" = 1'-0"

C:\Revit\Projects\VA ST CLOUD\PAINGE_Elec_R1E_chgs.rvt 1/24/2019 11:21:22 PM

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)

DUNHAM
 50 South Sixth Street / Suite 1100
 Minneapolis, Minnesota 55402-1540
 Phone: 612-465-7550 Fax: 612-465-7551
 Web: dunhaminc.com
 mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD

ANDERSON ENGINEERING
 ENGINEERING • ARCHITECTURE • LAND SURVEYING
 ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
 Anderson Engineering of Minnesota, LLC
 13605 1st Avenue North
 Suite 100
 Plymouth, MN 55441
 763-412-4000 (o) 763-412-4090 (f)
 www.ae-mn.com

STAMP
 I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
 Signature: *Chris M. Pilliod*
 Name: Chris M. Pilliod, P.E.
 Date: 1/24/19
 Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:


DRAWING TITLE ENLARGED COMMUNICATION ROOM PLANS	APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
DATE:	DATE:
APPROVED: CHIEF OF STAFF	DATE:
APPROVED: HEALTH CARE SYSTEM DIRECTOR	DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM	PROJECT NO.:
BUILDING No.:	CHECKED BY: CP
DATE:	DRAWN: CG
LOCATION VA MEDICAL CENTER ST. CLOUD, MN 56303	ISSUE DATE 1/24/19 DRAWING NO. ET.407

VA **U.S. Department of Veterans Affairs**
 Veterans Health Administration
 St. Cloud VA Health Care System

- GENERAL NOTES:**
- A. PROVIDE CONNECTION TO CRITICAL POWER WITHIN ROOM, IF AVAILABLE.
 - B. PROVIDE QUAD RECEPTACLE WITHIN EACH EQUIPMENT CABINET (ENCLOSURE). SEE 27 11 00 FOR REQUIREMENTS.
 - C. PROVIDE FIBER OPTIC CONNECTORS (ST/LO) REQUIRED BETWEEN EXISTING FIBER PATCH BOX AND PUBLIC ADDRESS SYSTEM HEADEND EQUIPMENT.
 - D. PROVIDE MINIMUM 3/4" ORANGE EMT BETWEEN EXISTING FIBER BOX AND PUBLIC ADDRESS SYSTEM EQUIPMENT.
 - E. PROVIDE BLUE EMT BETWEEN PRE-WIRED (AND WIRED) PA CIRCUITS AND PUBLIC ADDRESS SYSTEM EQUIPMENT.
 - F. FIELD VERIFY FINAL LOCATION OF PA SYSTEM HEADEND WITHIN ROOM PRIOR TO INSTALL.


- KEY NOTES:**
- 1 NOT USED.

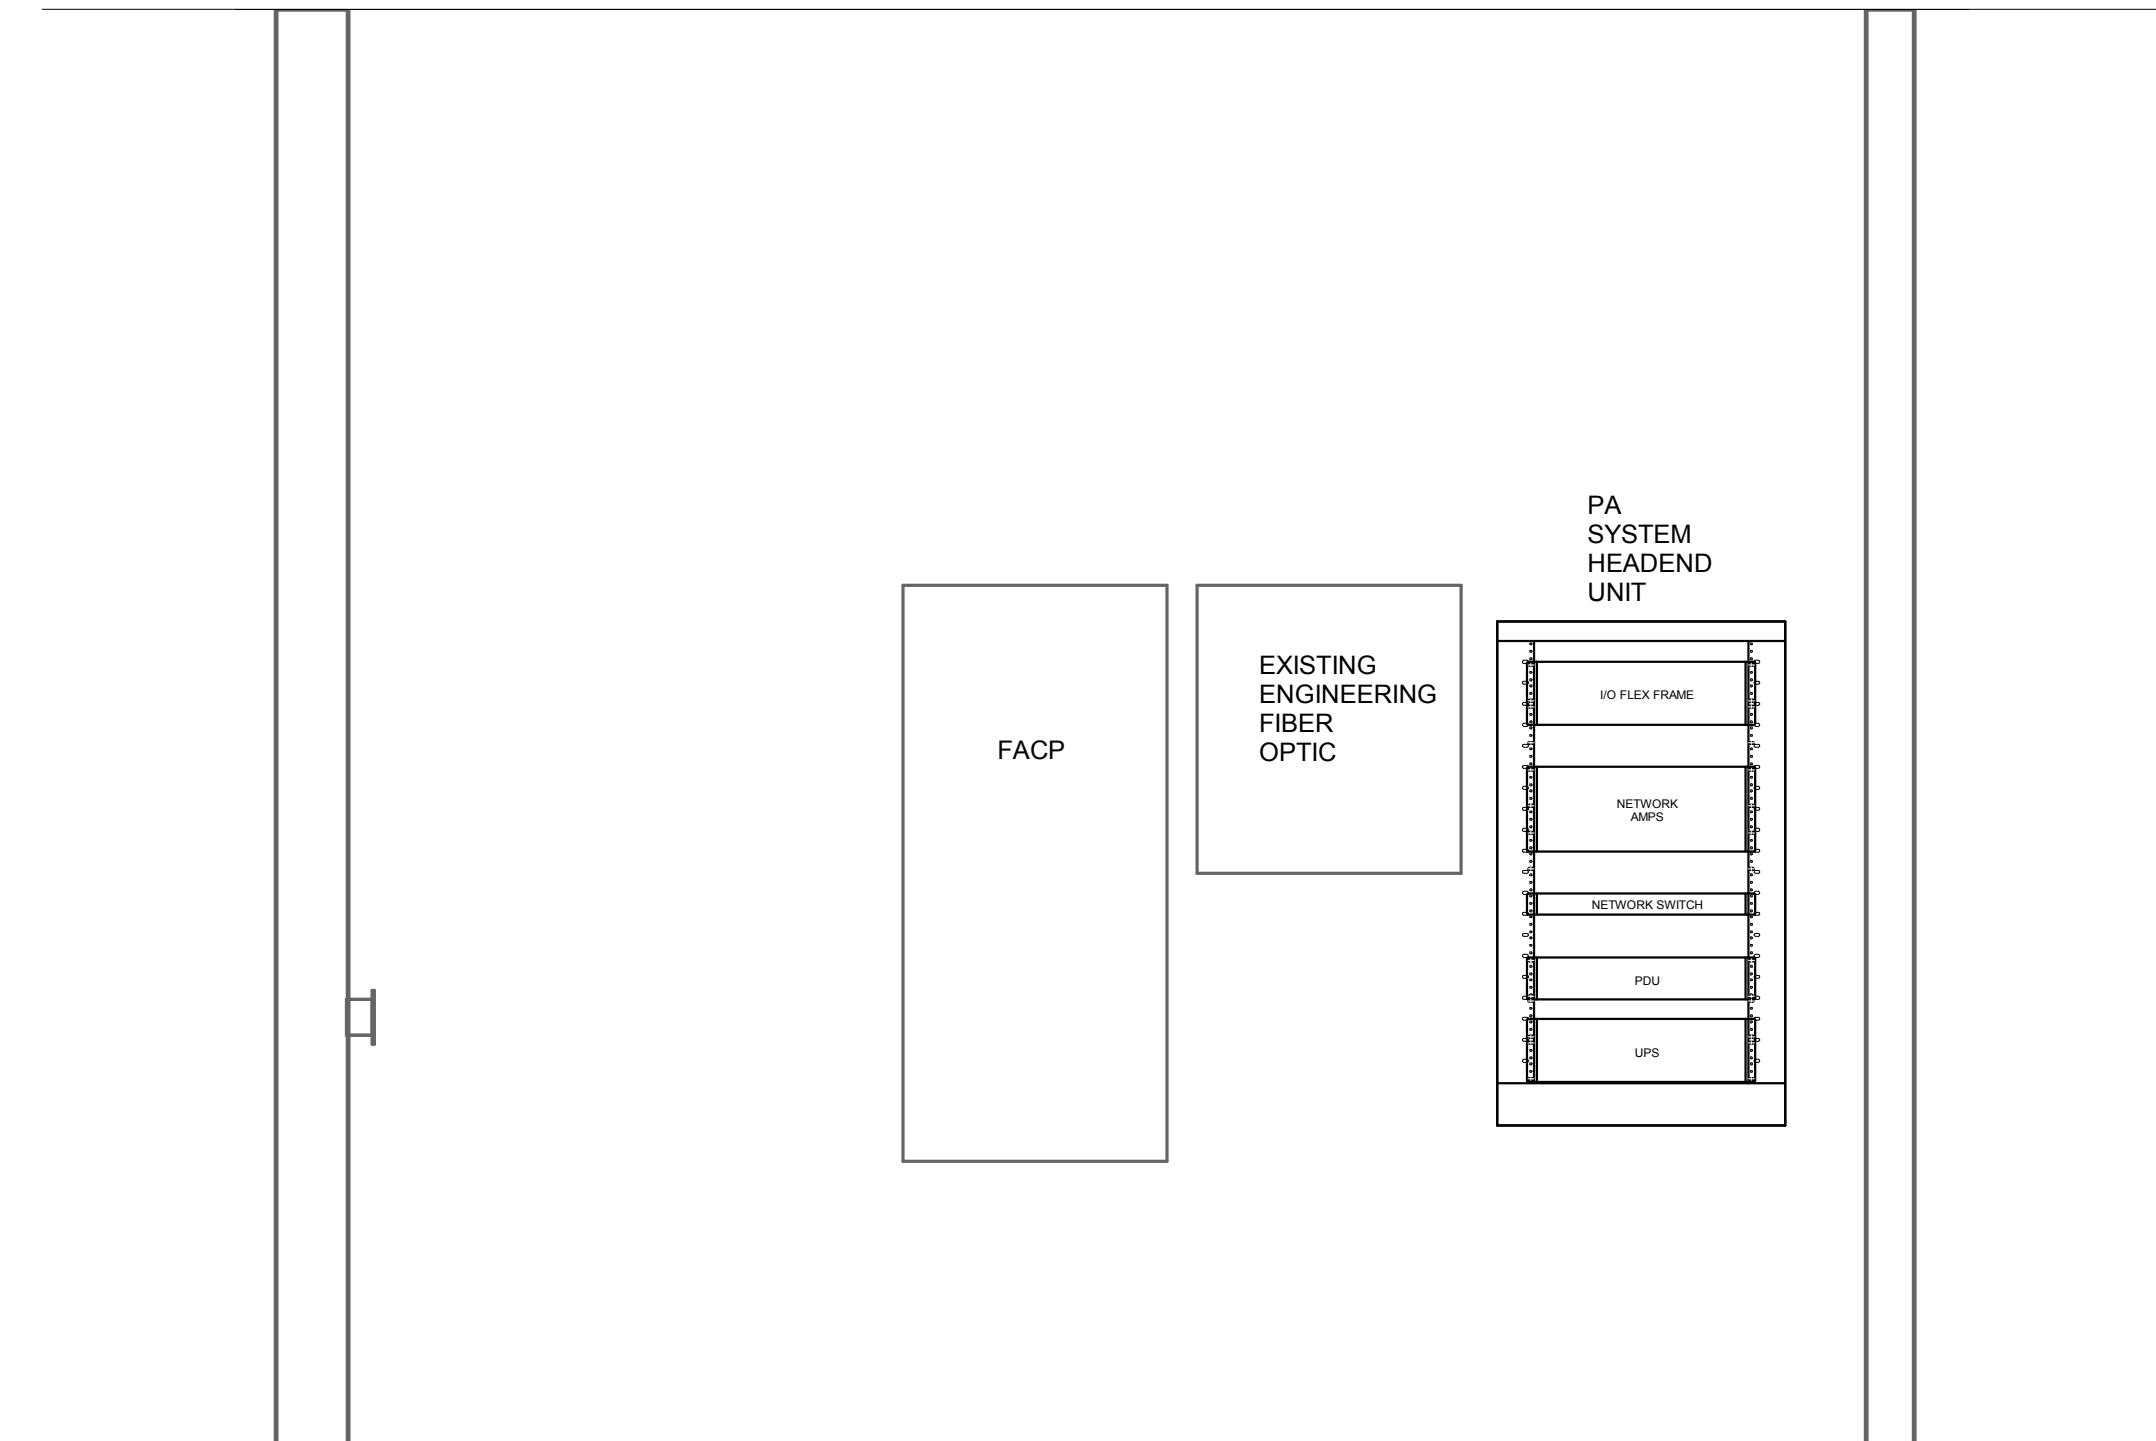


2 BLDG 51 - BASEMENT - STORAGE 22 - NORTH ELEVATION
3/4" = 1'-0"




3 BLDG 51 - BASEMENT - STORAGE 22 - SOUTH ELEVATION
3/4" = 1'-0"

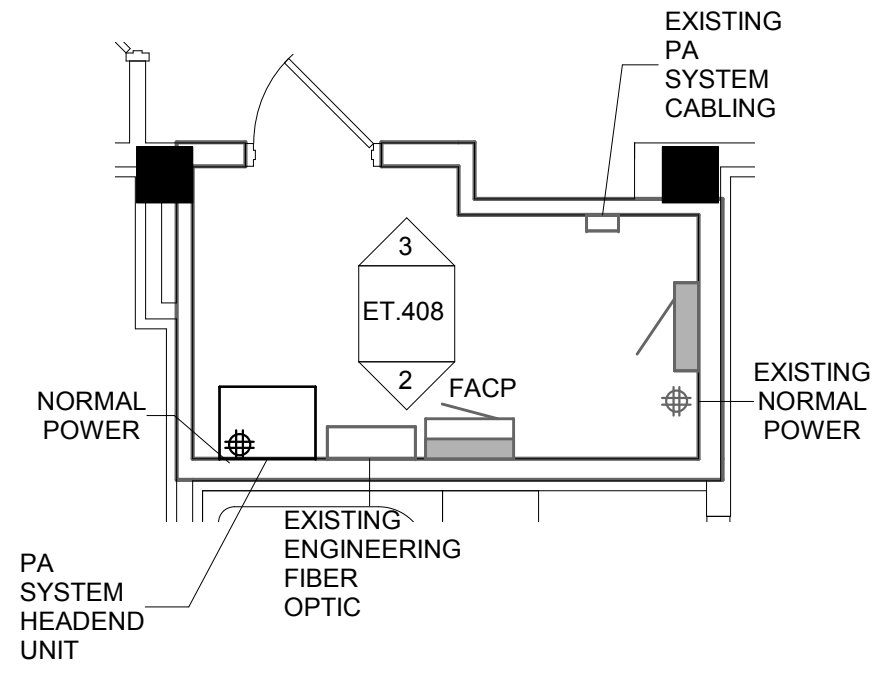

1 ENLARGED ROOM - BUILDING 51 - PA SYSTEM HEADEND UNIT
1/4" = 1'-0"

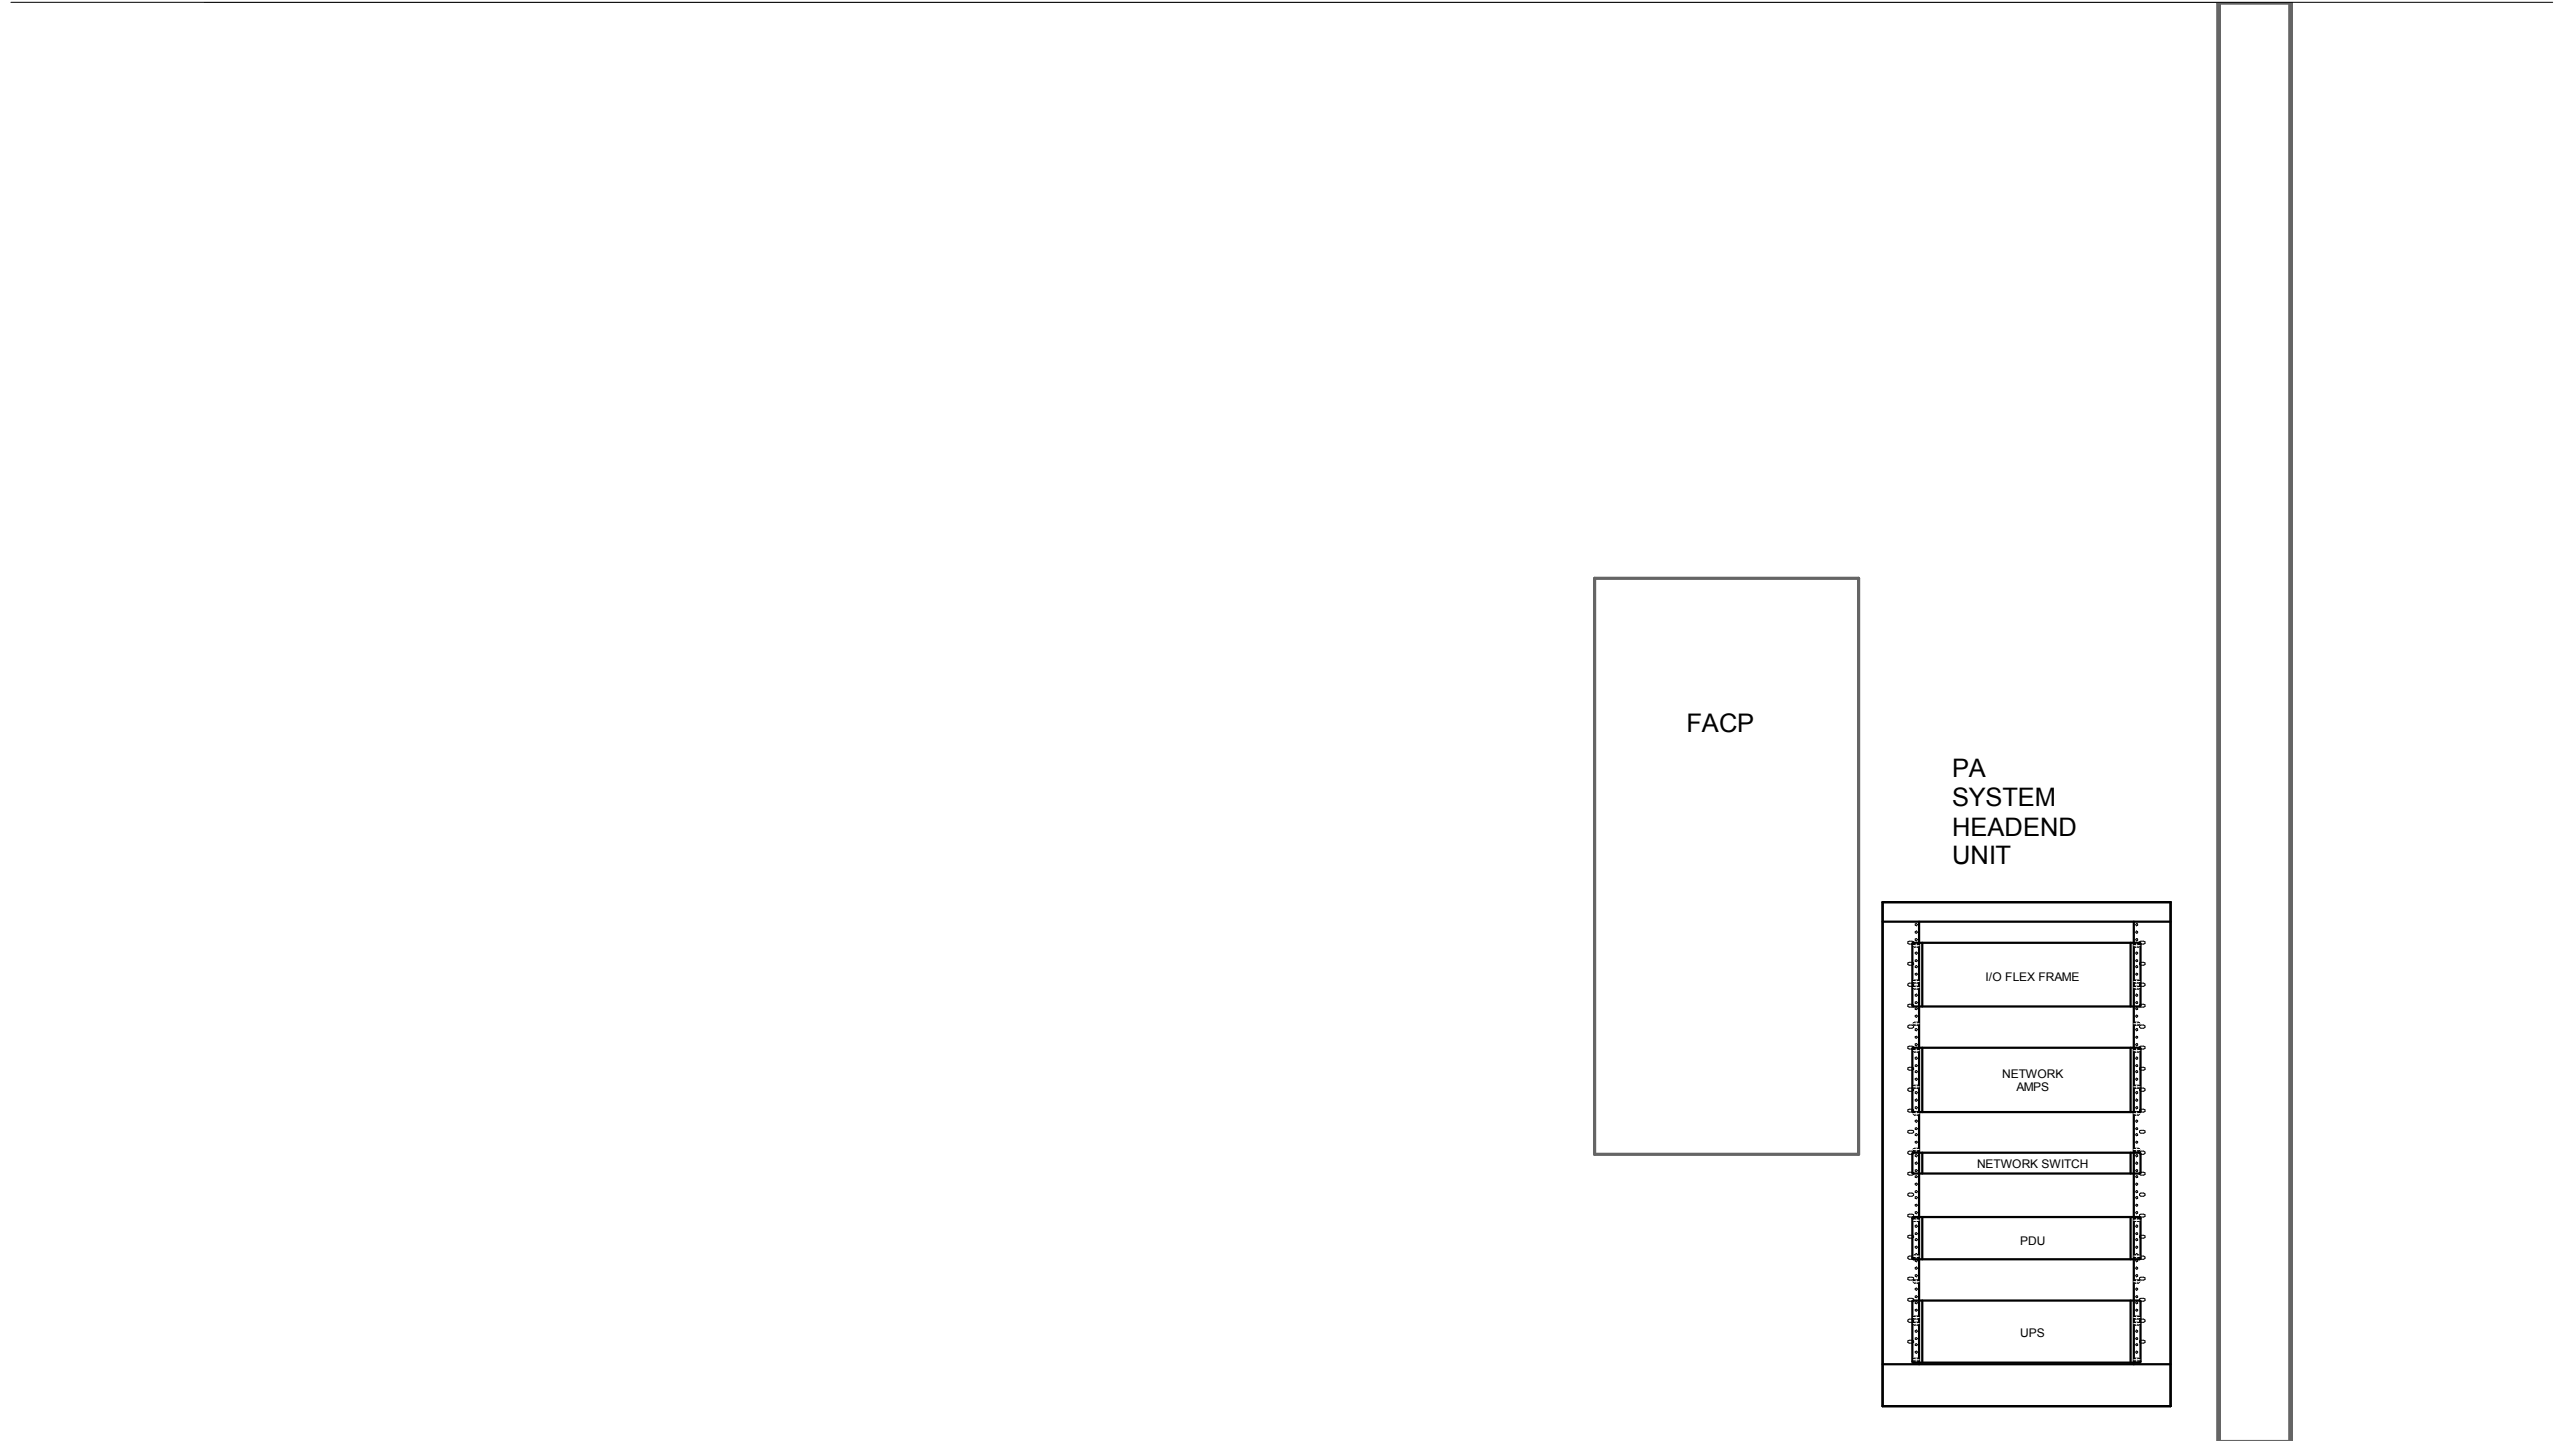

5 BLDG 115 - FIRST FLOOR - ELEC RM 160 - SOUTH ELEVATION
3/4" = 1'-0"

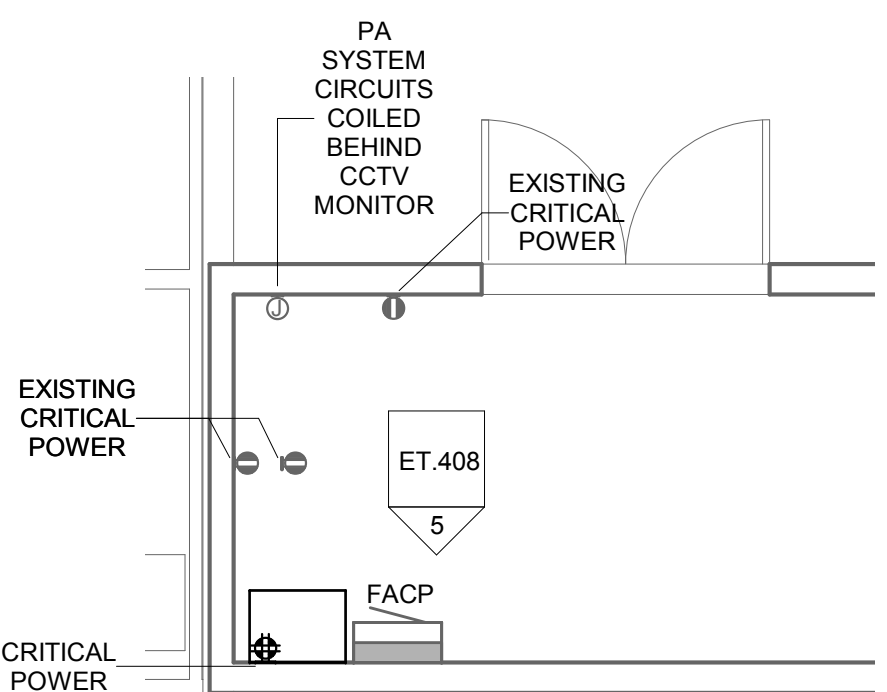

4 ENLARGED ROOM - BUILDING 115 - PA SYSTEM HEADEND UNIT
1/4" = 1'-0"

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)
DUNHAM
50 South Sixth Street / Suite 1100
Minneapolis, Minnesota 55402-1540
Phone: 612-465-7550 Fax: 612-465-7551
Web: dunhaminc.com
mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD
ANDERSON ENGINEERING
ENGINEERING • ARCHITECTURE • LAND SURVEYING
ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
Anderson Engineering of Minnesota, LLC
13605 1st Avenue North
Suite 100
Plymouth, MN 55441
763-412-4000 (o) 763-412-4090 (f)
www.ae-mn.com

STAMP
I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
Signature: *Chris M. Pilliod*
Name: Chris M. Pilliod, P.E.
Date: 1/24/19
Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE ENLARGED COMMUNICATION ROOM PLANS
APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR
DATE:
APPROVED: CHIEF OF STAFF
DATE:
APPROVED: HEALTH CARE SYSTEM DIRECTOR
DATE:

PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM	FLUT SCALE
PROJECT NO.	
BUILDING No.	CHECKED BY CP
ISSUE DATE 1/24/19	DRAWN CG
LOCATION VA MEDICAL CENTER ST. CLOUD, MN 56303	DRAWING NO. ET.408




1/24/2019 11:27:25 PM


C:\Revit\Projects\VA ST CLOUD\FACING_Bldg_ETL2_chp.rvt

- GENERAL NOTES:**
- A. PROVIDE CONNECTION TO CRITICAL POWER WITHIN ROOM.
 - B. PROVIDE QUAD RECEPTACLE WITHIN EACH EQUIPMENT CABINET (ENCLOSURE). SEE 27 11 00 FOR REQUIREMENTS.
 - C. PROVIDE FIBER OPTIC CONNECTORS (ST/LC) REQUIRED BETWEEN EXISTING FIBER PATCH BOX AND PUBLIC ADDRESS SYSTEM HEADEND EQUIPMENT.
 - D. PROVIDE MINIMUM 3/4" ORANGE EMT BETWEEN EXISTING FIBER BOX AND PUBLIC ADDRESS SYSTEM EQUIPMENT.
 - E. PROVIDE BLUE EMT BETWEEN PRE-WIRED (AND WIRED) PA CIRCUITS AND PUBLIC ADDRESS SYSTEM EQUIPMENT.
 - F. FIELD VERIFY FINAL LOCATION OF PA SYSTEM HEADEND WITHIN ROOM PRIOR TO INSTALL.


- KEY NOTES:**
- ① NOT USED.

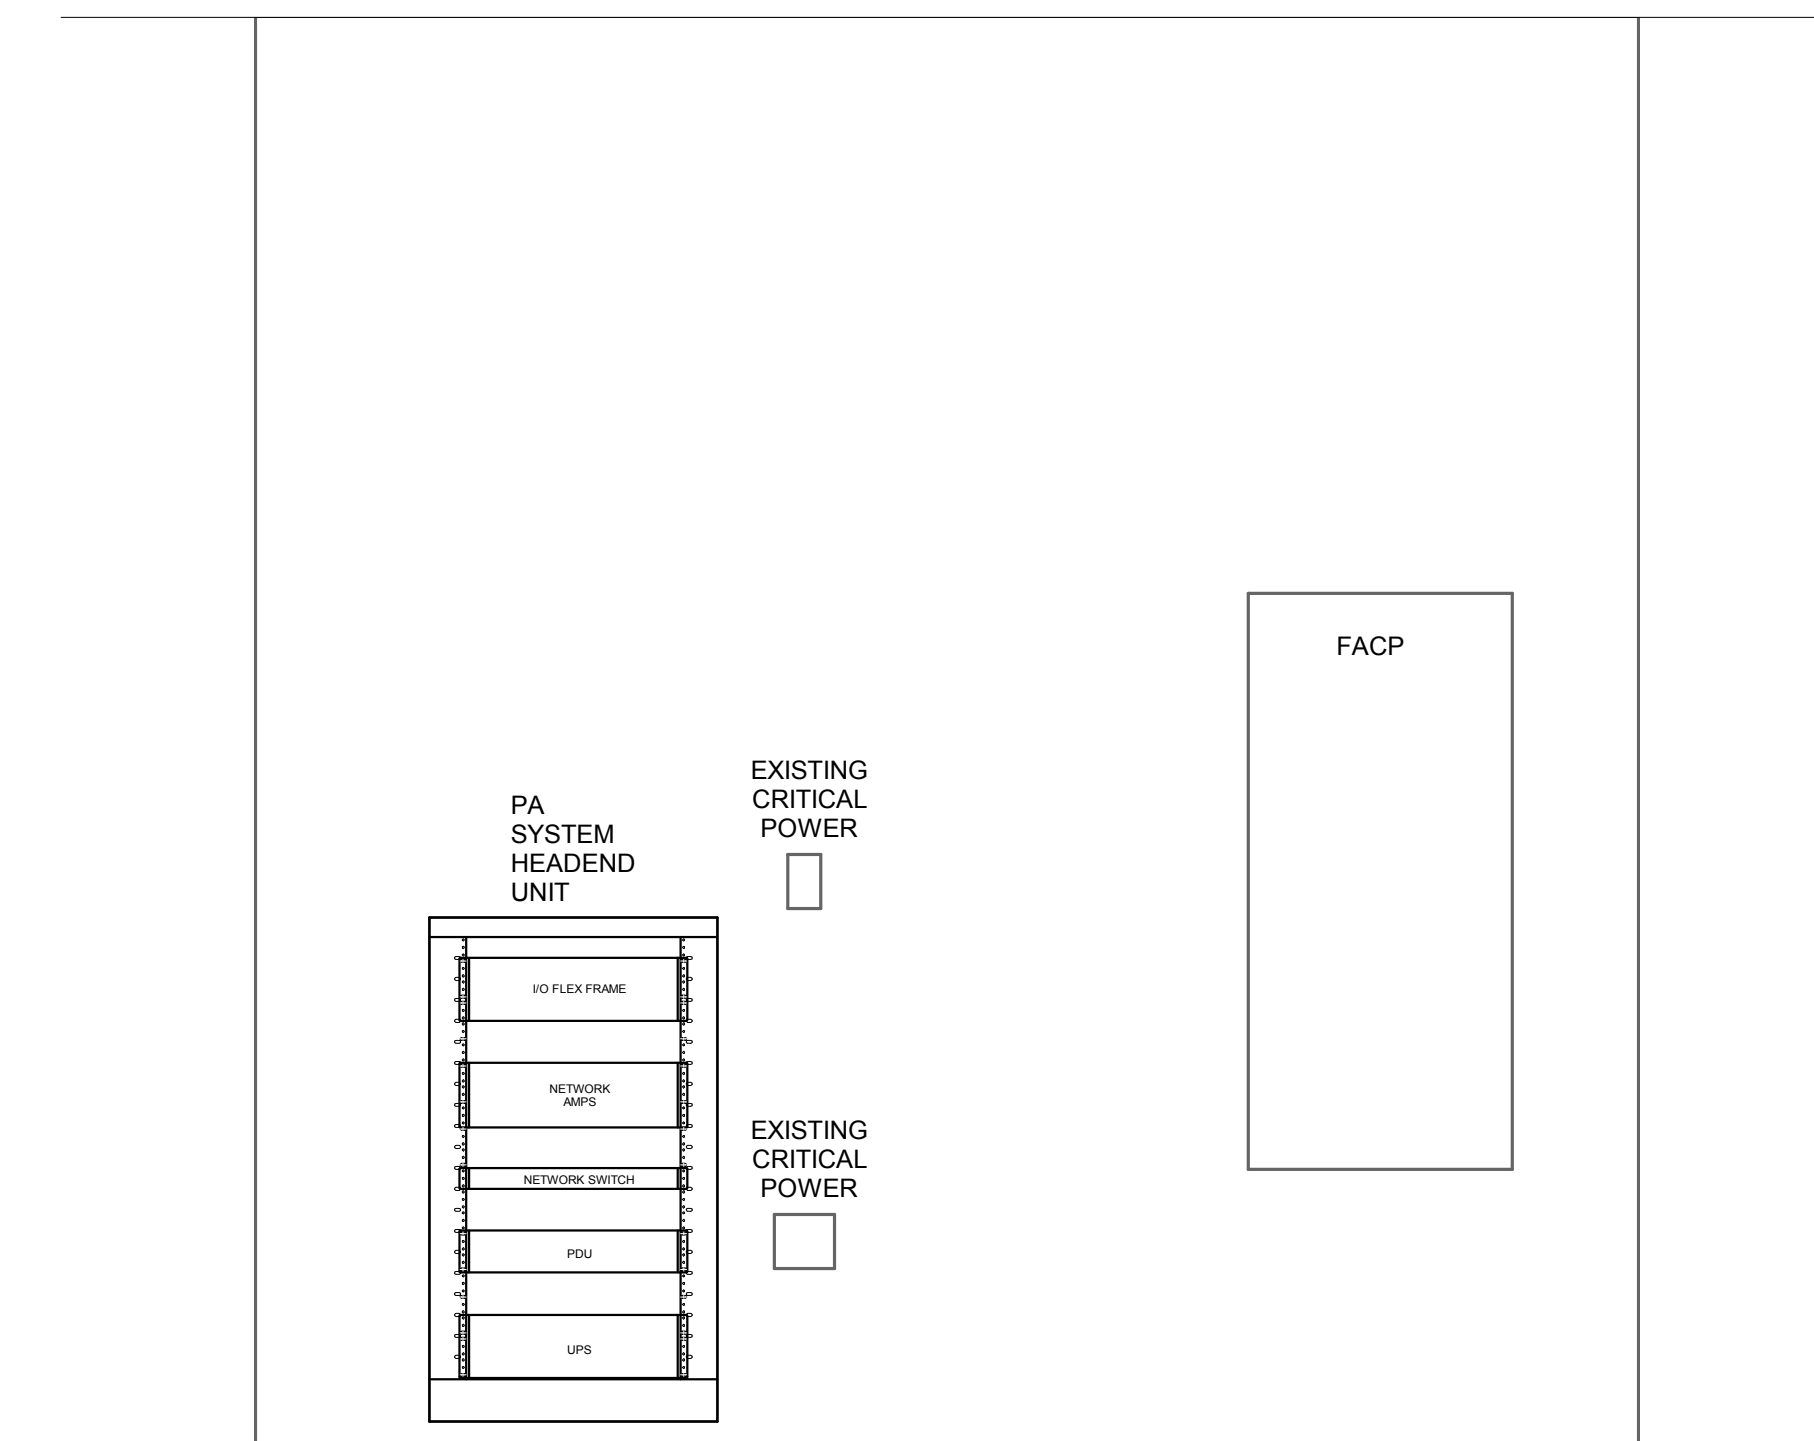

② BLDG 116 - FIRST FLOOR - WEST ELEVATION
3/4" = 1'-0"

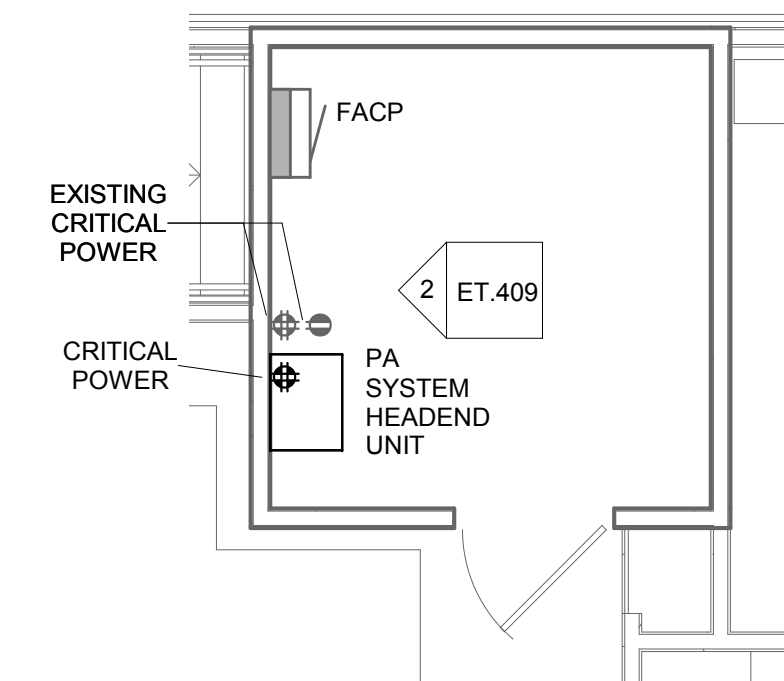


① ENLARGED ROOM - BUILDING 116 - PA SYSTEM HEADEND UNIT
1/4" = 1'-0"

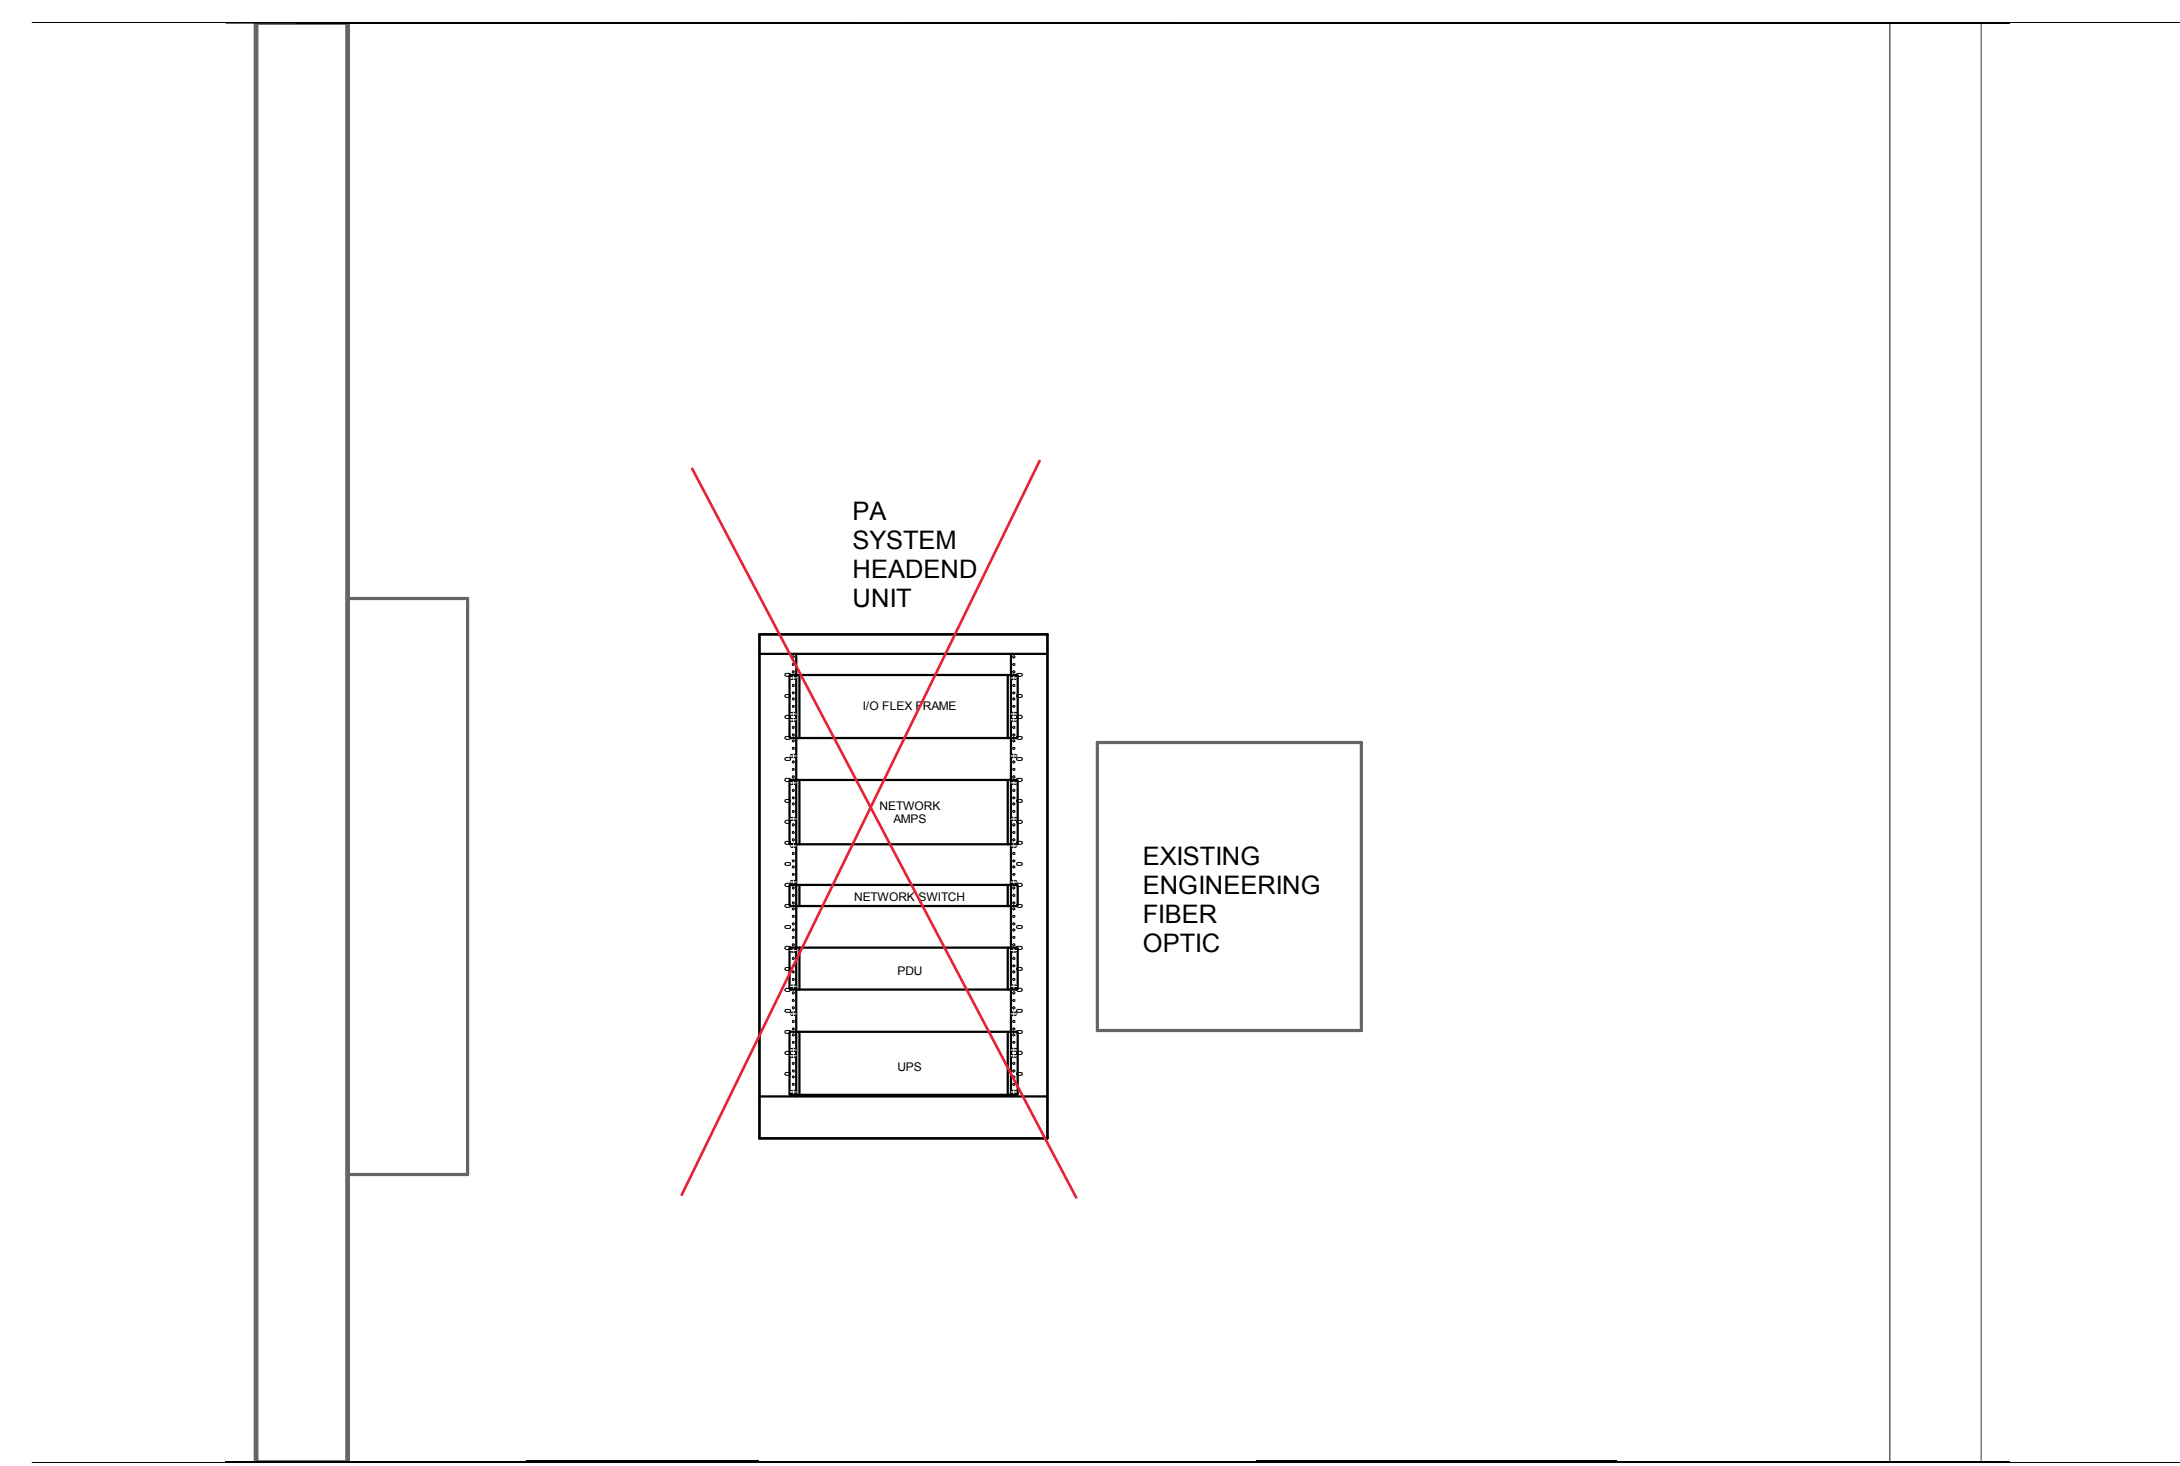

④ BLDG 118 - BASEMENT - EAST ELEVATION
3/4" = 1'-0"

EXISTING PA SYSTEM COMPONENTS TO REMAIN, PROVIDE AND INSTALL NEW AC QUAD RECEPTACLE, AC OUTLET STRIPS, AC POWER LINE SURGE PROTECTOR AND FILTER, AND UPS PER SPECIFICATION 27 11 00

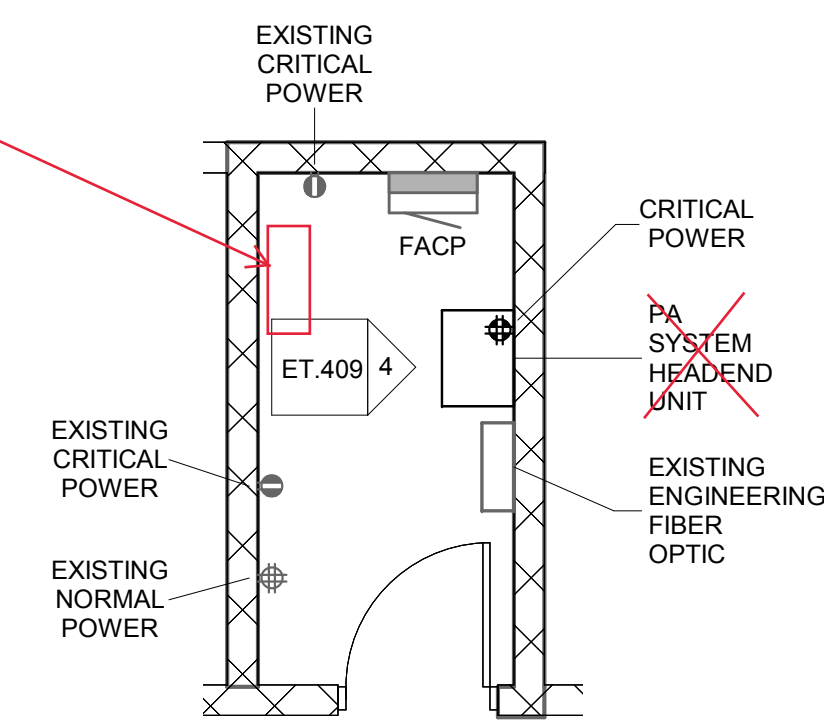

③ ENLARGED ROOM - BUILDING 118 - PA SYSTEM HEADEND UNIT
1/4" = 1'-0"

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)
DUNHAM
50 South Sixth Street / Suite 1100
Minneapolis, Minnesota 55402-1540
Phone: 612-465-7550 Fax: 612-465-7551
Web: dunhaminc.com
mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD
ANDERSON ENGINEERING
ENGINEERING • ARCHITECTURE • LAND SURVEYING
ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
Anderson Engineering of Minnesota, LLC
13605 1st Avenue North
Suite 100
Plymouth, MN 55441
763-412-4000 (o) 763-412-4090 (f)
www.ae-mn.com

STAMP
I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
Signature: *Chris M. Pilioud*
Name: Chris M. Pilioud, P.E.
Date: 1/24/19
Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE ENLARGED COMMUNICATION ROOM PLANS	PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM
APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR	DATE:
APPROVED: CHIEF OF STAFF	DATE:
APPROVED: HEALTH CARE SYSTEM DIRECTOR	DATE:

BUILDING NO.	CHECKED BY	DRAWN	ISSUE DATE
	CP	CG	1/24/19
LOCATION VA MEDICAL CENTER ST. CLOUD, MN 56303	DATE	DRAWING NO.	ET.409




U.S. Department of Veterans Affairs
Veterans Health Administration
St. Cloud VA Health Care System

GENERAL NOTES:

- DEMOLITION, INSTALLATION AND TESTING SHALL BE DONE IN ACCORDANCE WITH SPECIFICATIONS.
- PROVIDE QUAD RECEPTACLE WITHIN EACH EQUIPMENT CABINET (ENCLOSURE). SEE 27 11 00 FOR REQUIREMENTS.
- PROVIDE FIBER OPTIC CONNECTORS (STLC) REQUIRED BETWEEN EXISTING FIBER PATCH BOX AND PUBLIC ADDRESS SYSTEM HEADEND EQUIPMENT.
- PROVIDE MINIMUM 3/4" ORANGE EMT BETWEEN EXISTING FIBER BOX AND PUBLIC ADDRESS SYSTEM EQUIPMENT.
- PROVIDE BLUE EMT BETWEEN PRE-WIRED (AND WIRED) PA CIRCUITS AND PUBLIC ADDRESS SYSTEM EQUIPMENT.

KEY NOTES:

- PROVIDE CONNECTION FROM CISCO UNIFIED CALL MANAGER-EXTEND FROM FIRST FLOOR DATA CENTER 146 LOCATED WITHIN RACK IN THE NORTH-CENTER PART OF THE ROOM. EXISTING PA HEAD END IS ALREADY CONNECTED TO THE CISCO UNIFIED CALL MANAGER. NEW CONNECTION NOT REQUIRED.

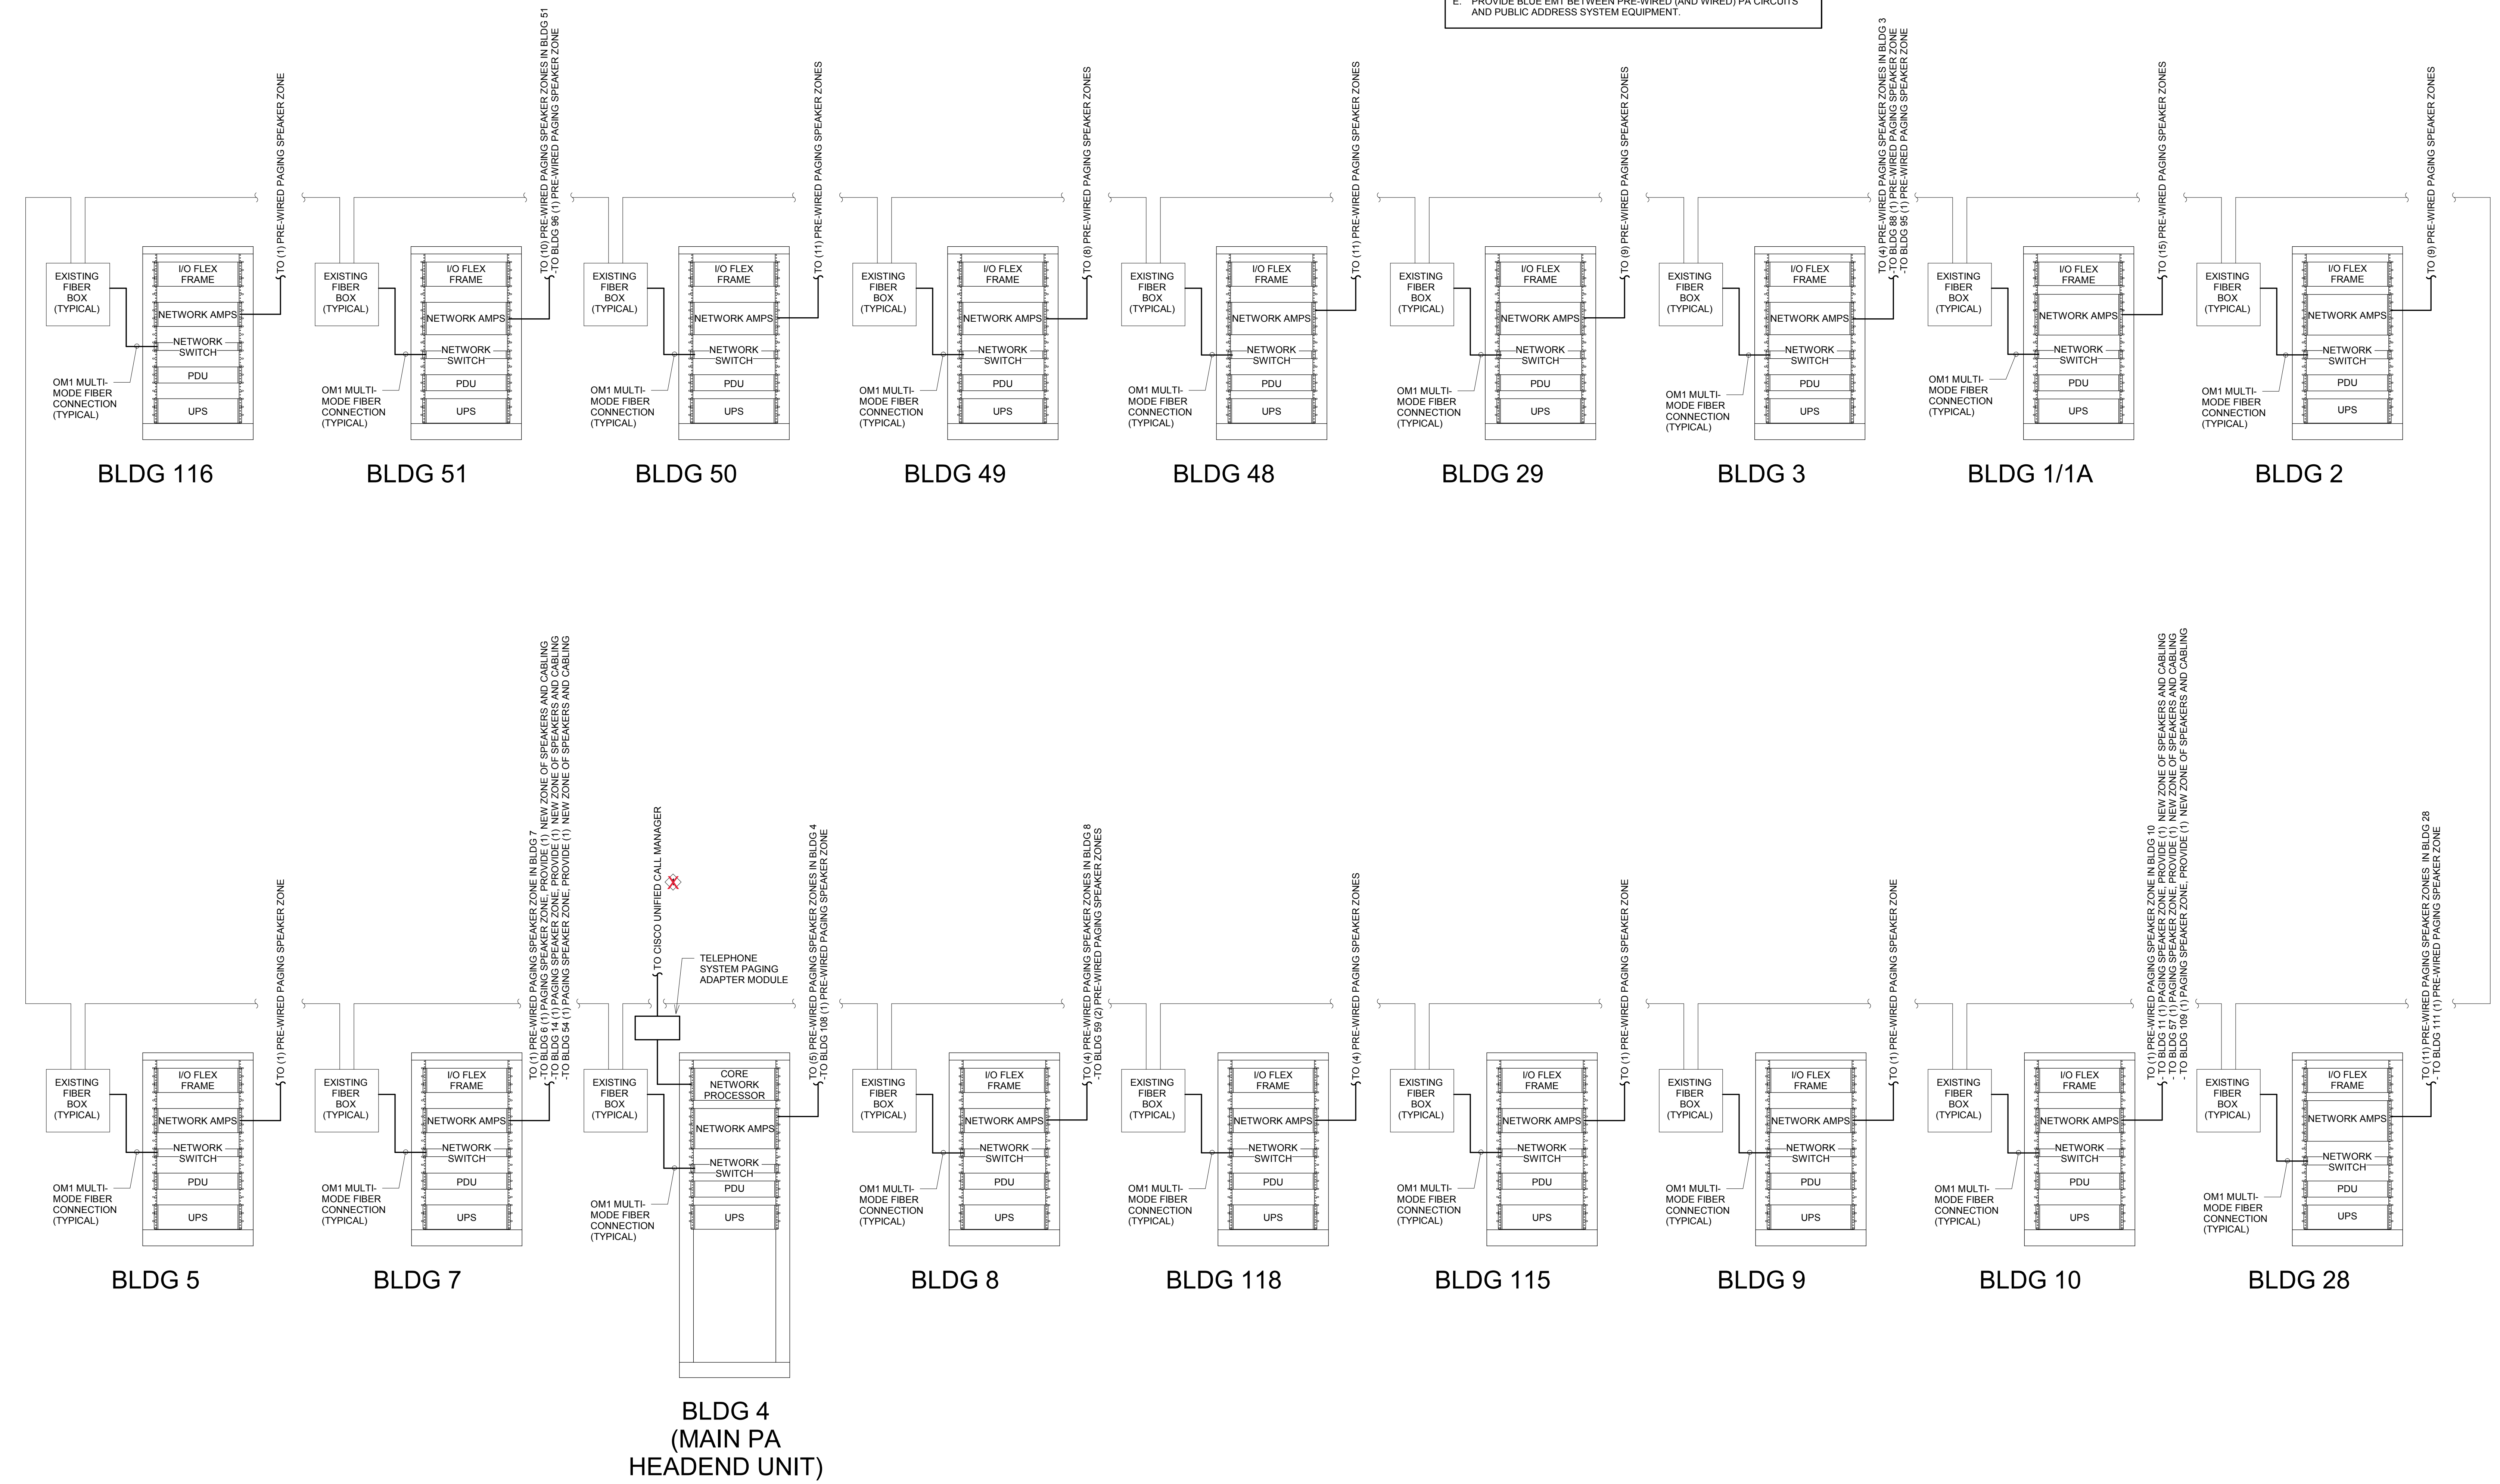

1 PUBLIC ADDRESS NETWORK RISER DIAGRAM
1/8" = 1'-0"

Revisions:	Date:

CONSULTANT
DUNHAM ASSOCIATES (0419950-001-00)
DUNHAM
50 South Sixth Street / Suite 1100
Minneapolis, Minnesota 55402-1540
Phone: 612-465-7550 Fax: 612-465-7551
www.dunhaminc.com
mechanical • electrical consulting engineering

ARCHITECT/ENGINEER OF RECORD
ANDERSON ENGINEERING
ENGINEERING • ARCHITECTURE • LAND SURVEYING
ENVIRONMENTAL SERVICES • LANDSCAPE ARCHITECTURE
Anderson Engineering of Minnesota, LLC
13605 1st Avenue North
Suite 100
Plymouth, MN 55441
763-412-4000 (o) 763-412-4090 (f)
www.ae-mn.com
AE PROJECT NUMBER: Project Number

STAMP
I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the Laws of the state of Minnesota.
Signature: *Chris M. Pilliod*
Name: Chris M. Pilliod, P.E.
Date: 1/24/19
Registration Number: 50826

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INFECTION CONTROL NURSE	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR FMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DATE:	DATE:
DATE:	DATE:
DATE:	DATE:
DATE:	DATE:

DRAWING TITLE PUBLIC ADDRESS NETWORK RISER		PROJECT TITLE UPGRADE PUBLIC ADDRESS SYSTEM	
APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR	DATE:	BUILDING No.	CHECKED BY CP CG
APPROVED: CHIEF OF STAFF	DATE:	DRAWN	ISSUE DATE 1/24/19
APPROVED: HEALTH CARE SYSTEM DIRECTOR	DATE:	LOCATION VA MEDICAL CENTER ST. CLOUD, MN 56303	DRAWING NO. ET.501

VA
U.S. Department of Veterans Affairs
Veterans Health Administration
St. Cloud VA Health Care System