

- FLOOR PLAN NOTES:**
- DO NOT SCALE DRAWINGS - USE DIMENSIONS AND NOTES ONLY.
 - VERIFY ANY EXISTING CONSTRUCTION, CONFIGURATION AND DIMENSIONS. CONTRACTOR TO CONFIRM ALL DIMENSIONS AGAINST ACTUAL SITE CONDITIONS.
 - CONFLICT OR DISCREPANCIES IN DIMENSIONS OR ELEVATIONS SHALL BE RESOLVED WITH THE ARCHITECT PRIOR TO PROCEEDING WITH THE WORK OR PROCUREMENT OF MATERIALS.
 - GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR DISTRIBUTION OF COMPLETE SETS OF CONTRACT DOCUMENTS (DRAWINGS & SPECIFICATIONS) TO ALL TRADES. EACH TRADE SHALL REVIEW ALL CONTRACT DOCUMENTS SO AS TO BE AWARE OF ALL ITEMS OF WORK AFFECTING THEIR RESPECTIVE TRADE. NO CLAIMS FOR "EXTRAS" WILL BE HONORED DUE TO FAILURE TO REVIEW COMPLETE SET OF DOCUMENTS.
 - EXCESS DOORS SHALL NOT LOCK AGAINST THE DIRECTION OF EGRESS TRAVEL.
 - ALL NEW WOOD FRAMING, SHEATHING, BLOCKING, ETC., SHALL BE FIRE RETARDANT TREATED. PROVIDE FIRE RETARDANT TREATED WOOD BLOCKING AT WALL AND CEILING FRAMING FOR ANCHORAGE OF ELEMENTS TO BE FASTENED OVER FINISHED SURFACES INCLUDING, BUT NOT LIMITED TO: WALL BUMPERS, HANDRAILS, GRAB BARS, WOOD TRIM, TOILET ACCESSORIES, AND WALL MOUNTED EQUIPMENT.
 - INTERIOR DIMENSIONS ARE GIVEN TO THE FINISHED FACE OF WALL CONSTRUCTION, UNLESS NOTED OTHERWISE.
 - PROVIDE CONTROL JOINTS IN GYPSUM BOARD AT SPACING NOT EXCEEDING 30' O.C. AT LONG STRAIGHT RUNS OF WALL OR SOFFIT. IN FIRE RATED PARTITIONS, PROVIDE FIRE RATED CONTROL JOINTS. DO NOT ALLOW BRACING TO SPAN ACROSS CONTROL JOINTS. CONTROL JOINTS SHALL CONSIST OF DOUBLE STUDS OR DOUBLE FURRING CHANNELS AS PROVIDED BY CONTRACTOR.
 - GENERAL CONTRACTOR MUST KEEP THE APPROVED SET OF BID DOCUMENTS ON SITE AT ALL TIMES.
 - REFER TO PLAN FOR FIRE EXTINGUISHER CABINET (FEC) LOCATIONS. SEMI-RECESSED FIRE EXTINGUISHER CABINET AS NOTED IN SPECIFICATIONS. OWNER TO PROVIDE ADDITIONAL FIRE EXTINGUISHER CABINETS (FEC) AS PER FIRE MARSHAL'S REQUEST. COORDINATE ALL LOCATIONS WITH ARCHITECT PRIOR TO INSTALLATION.
 - REPAIR EXISTING SURFACES TO REMAIN AS NEEDED DUE TO THE DEMOLITION OR THE REMOVAL OF CONSTRUCTION. REFER TO DEMOLITION PACKAGE.
 - REPAIR HOLES IN EXISTING PARTITIONS TO REMAIN WHERE PARTITION MOUNTED ITEMS HAVE BEEN REMOVED.
 - EXISTING WOOD TO BE REFINISHED SHALL BE STRIPPED AND PREPARED FOR NEW FINISH. PATCH AND REPAIR EXISTING UNDERLAYMENT WHERE REQUIRED TO ACCOMMODATE NEW FINISH.
 - PATCH AND REPAIR ALL EXISTING FINISHED FLOOR FLOORS AS REQUIRED PRIOR TO REFINISHING.
 - PATCH AND REPAIR ALL EXISTING DOOR FRAMES AS NEEDED.
 - REFERENCE FINISH SHEET FOR FINISH INFORMATION.
 - MAINTAIN CURRENT AND ACCURATE FIELD DRAWINGS OF AS-BUILT CONDITIONS.
 - INFECTION PREVENTION MEASURES NEED TO BE IN PLACE DURING ALL CONSTRUCTION PHASES INCLUDING DEMOLITION. RE: SPEC.
 - ALL PARTITION TYPES TO BE P1 UNLESS OTHERWISE NOTED ON PLANS.
 - CONTRACTOR TO PREP WINDOW FOR REINSTALLATION OF STAIN GLASS WINDOW. COORDINATE WITH STAIN GLASS CONTRACTOR.
 - SEE D103 FOR EXTENT OF CONSTRUCTION WALL.
 - PATCH AND REPAIR ROOF AS NECESSARY WHERE MEP ITEMS ARE BEING REMOVED AND RELOCATED (RE: MEP DWGS).
 - PATCH AND REPAIR ROOF AND PARAPET WHERE EXISTING ROOF ACCESS LADDER IS BEING REMOVED.


NOTE: SEAL ALL PENETRATION AT 3RD FLOOR SLAB AND 4TH FLOOR SLAB, IN ALL SHAFT WALLS.

NOTE TO CONTRACTOR:

CONTRACTOR TO KEEP FIRE RATINGS IN TACT AT ALL TIMES DURING CONSTRUCTION BY PROVIDING ONE OF THE FOLLOWING SAFETY OPTIONS:

- ONE - LEAVE THE EXISTING SPRINKLER SYSTEM OPERATIONAL IN THE RENOVATED AREA AND PROVIDE UPRIGHT SPRINKLER HEADS ON THE EXISTING PIPE TO PROVIDE COVERAGE IN THE AREA OF WORK PER NFPA 13 DURING CONSTRUCTION. THIS WILL LIKELY INVOLVE MOVING SPRINKLERS TO WITHIN 12 INCHES OF THE DECK ABOVE. AFTER THE NEW SPRINKLER PIPING IS INSTALLED TESTED AND APPROVED, THE SPRINKLERS AT THE DECK LEVEL AND THE EXISTING PIPING SHALL BE REMOVED.
- TWO - CONTRACTOR MAY SHUTDOWN THE EXISTING SPRINKLER SYSTEM IN THE AREA OF WORK PROVIDED THAT THE CONTRACTOR INSTALL A 1-HOUR FIRE-RESISTANCE RATED SEPARATION BETWEEN EVERY OCCUPIED SPACE ADJACENT TO THE CONSTRUCTION AREA. CONTRACTOR SHALL COORDINATE WITH THE VETERANS ADMINISTRATION, THE CONTRACTING OFFICER, AND THE A/E. ALL FIRE-RESISTANCE RATED SEPARATIONS SHALL COMPLY WITH NFPA 101 AND UL LISTINGS.

THE SPRINKLER MAIN LOCATED IN THE CORRIDOR IS REQUIRED TO REMAIN ACTIVE DURING BUSINESS HOURS FOR THE DURATION OF THE CONSTRUCTION PERIOD IN ORDER TO SUPPLY THE SPRINKLERS IN THE RESPIRATORY CARE PORTION OF THE FLOOR NOTED AS OUT OF CONTRACT ON THE PLAN. THE CONTRACTOR IS PERMITTED TO TAKE THE SPRINKLER MAIN TEMPORARILY OUT OF SERVICE AFTER HOURS TO ALLOW THE REMOVAL OF THE DEMOLISHED SPRINKLER BRANCH PIPING AND FOR RE-CONNECTION OF THE NEW SPRINKLER BRANCH PIPING. CONTRACTOR SHALL PROVIDE A FIRE WATCH DURING THE TIME THE SPRINKLER SYSTEM IS TAKEN OUT OF SERVICE. THE TIMING AND DURATION OF THE SPRINKLER SYSTEM SHUTDOWN SHALL BE COORDINATED WITH AND APPROVED BY THE VA AND AUTHORITY HAVING JURISDICTION.

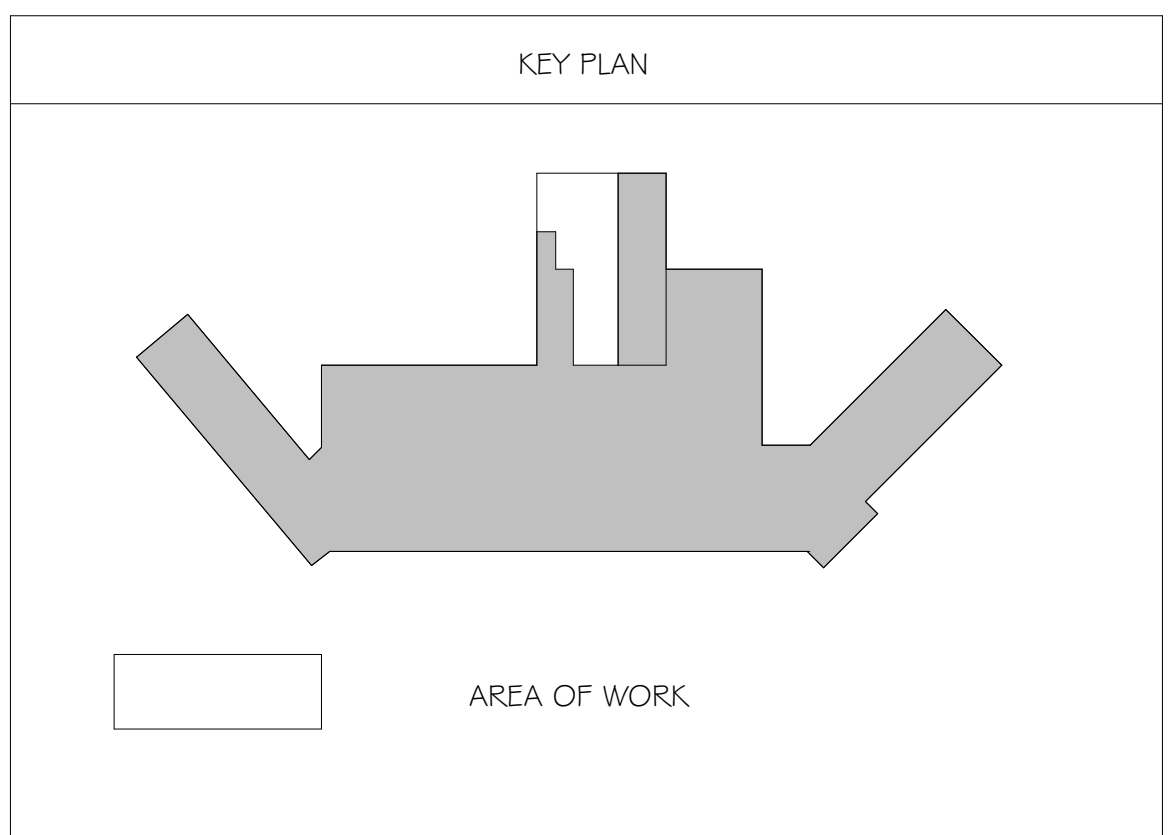


THIRD FLOOR PLAN
1/8" = 1'-0"

ENGINEERS/CONSULTANTS:

WOOLPERT, INC.
343 FOUNTAINS PARKWAY
SUITE 100
FAIRVIEW HEIGHTS, IL 62208
314-436-0865
314-436-0884 fax

SCI ENGINEERING, INC
130 POINT WEST BLVD.
ST. CHARLES, MO 63301
636-949-8200
636-949-8269 fax

FINAL SUBMITTAL
FOR CONSTRUCTION

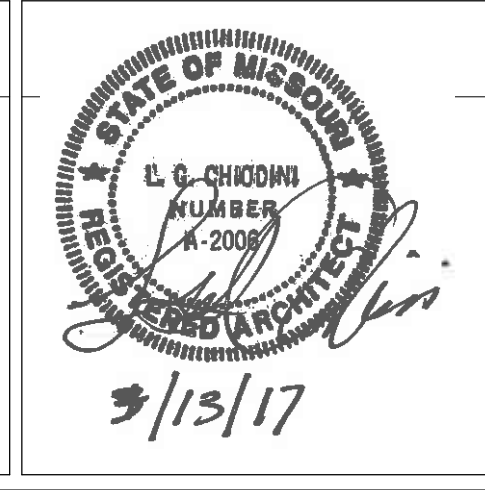

ARCHITECT:

Chiodini
ARCHITECTS
Architecture / Interior Design / Graphics
1401 S. Brentwood Blvd. / Suite 575 / St. Louis, Missouri 63144
314-725-5588 / arch@chiodini.com

Drawing Title
THIRD FLOOR PLAN

Approved: Project Director
Approver

Project Title
VA HEALTH CARE SYSTEM

Location
VAS 438-16-104 BLDG. 5 CHAPEL
SIOUX FALLS, SD 57105

Project Number
438-16-104 2016.052

Building Number
5

Drawing Number
A103

Date
2017.03.13


Checked
RLK

Drawn
C.J.N.

Owner
Department of Veterans Affairs

3/13/2017 3:51:38 PM
C:\Users\newcomer\Documents\Revit_2016\2016.052_VA Sioux Falls Chapel_1\newcomer.rvt

- FLOOR PLAN NOTES:**
- DO NOT SCALE DRAWINGS - USE DIMENSIONS AND NOTES ONLY.
 - FIELD VERIFY ANY EXISTING CONSTRUCTION, CONFIGURATION AND DIMENSIONS.
 - CONTRACTOR TO VERIFY ALL DIMENSIONS AGAINST ACTUAL SITE CONDITIONS. ANY CONFLICT OR DISCREPANCIES IN DIMENSIONS OR ELEVATIONS SHALL BE RESOLVED WITH THE ARCHITECT PRIOR TO PROCEEDING WITH THE WORK OR PROCUREMENT OF MATERIALS.
 - GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR DISTRIBUTION OF COMPLETE SETS OF CONTRACT DOCUMENTS (DRAWINGS & SPECIFICATIONS) TO ALL TRADES. EACH TRADE SHALL REVIEW ALL CONTRACT DOCUMENTS SO AS TO BE AWARE OF ALL ITEMS OF WORK AFFECTING THEIR RESPECTIVE TRADE. NO CLAIMS FOR 'EXTRAS' WILL BE HONORED DUE TO FAILURE TO REVIEW COMPLETE SET OF DOCUMENTS.
 - EGRESS DOORS SHALL NOT LOCK AGAINST THE DIRECTION OF EGRESS TRAVEL.
 - ALL NEW WOOD FRAMING, SHEATHING, BLOCKING, ETC., SHALL BE FIRE RETARDANT TREATED. PROVIDE FIRE RETARDANT TREATED WOOD BLOCKING AT WALL AND CEILING FRAMING FOR ANCHORAGE OF ELEMENTS TO BE FASTENED OVER FINISHED SURFACES INCLUDING, BUT NOT LIMITED TO: WALL BUMPERS, HANDRAILS, GRAB BARS, WOOD TRIM, TOILET ACCESSORIES, AND WALL MOUNTED EQUIPMENT.
 - INTERIOR DIMENSIONS ARE GIVEN TO THE FINISHED FACE OF WALL CONSTRUCTION, UNLESS NOTED OTHERWISE.
 - PROVIDE CONTROL JOINTS IN GYPSUM BOARD AT SPACING NOT EXCEEDING 30'-0" O.C. AT LONG STRAIGHT RUNS OF WALL OR CEILING. IN FIRE RATED PARTITIONS, PROVIDE FIRE RATED CONTROL JOINTS. DO NOT ALLOW BRACING TO SPAN ACROSS CONTROL JOINTS. CONTROL JOINTS SHALL CONSIST OF DOUBLE STUDS OR DOUBLE FLOORING CHANNELS AS PROVIDED BY CONTRACTOR.
 - GENERAL CONTRACTOR MUST KEEP THE APPROVED SET OF BID DOCUMENTS ON SITE AT ALL TIMES.
 - REFER TO PLAN FOR FIRE EXTINGUISHER CABINET (FEC) LOCATIONS. SEMI-RECESSED FIRE EXTINGUISHER CABINET AS NOTED IN SPECIFICATIONS. OWNER TO PROVIDE ADDITIONAL FIRE EXTINGUISHER CABINETS (FEC) AS PER FIRE MARSHAL'S REQUEST. COORDINATE ALL LOCATIONS WITH ARCHITECT PRIOR TO INSTALLATION.
 - REPAIR EXISTING SURFACES TO REMAIN AS NEEDED DUE TO THE DEMOLITION OR THE REMOVAL OF CONSTRUCTION. REFER TO DEMOLITION PACKAGE.
 - REPAIR HOLES IN EXISTING PARTITIONS TO REMAIN WHERE PARTITION MOUNTED ITEMS HAVE BEEN REMOVED.
 - EXISTING WOOD TO BE REFINISHED SHALL BE STRIPPED AND PREPARED FOR NEW FINISH.
 - PATCH AND REPAIR EXISTING UNDERLAYMENT WHERE REQUIRED TO ACCOMMODATE NEW FINISH.
 - PATCH AND REPAIR ALL EXISTING FINISHED WOOD FLOORS AS REQUIRED PRIOR TO REFINISHING.
 - PATCH AND REPAIR ALL EXISTING DOOR FRAMES AS NEEDED.
 - REFERENCE FINISH SHEET FOR FINISH INFORMATION.
 - MAINTAIN CURRENT AND ACCURATE FIELD DRAWINGS OF AS-BUILT CONDITIONS.
 - INFECTION PREVENTION MEASURES NEED TO BE IN PLACE DURING ALL CONSTRUCTION PHASES INCLUDING DEMOLITION, RE-SETUP.
 - ALL PARTITION TYPES TO BE P.I. UNLESS OTHERWISE NOTED ON PLANS.
 - CONTRACTOR TO PREP WINDOW FOR RE-INSTALLATION OF STAIN GLASS WINDOW.
 - COORDINATE WITH STAIN GLASS CONTRACTOR.
 - SEE D103 FOR EXTENT OF CONSTRUCTION WALL.
 - PATCH AND REPAIR ROOF AS NECESSARY WHERE MEP ITEMS ARE BEING REMOVED AND RELOCATED (REF DWG(S)).
 - PATCH AND REPAIR ROOF AND PARAPET WHERE EXISTING ROOF ACCESS LADDER IS BEING REMOVED.

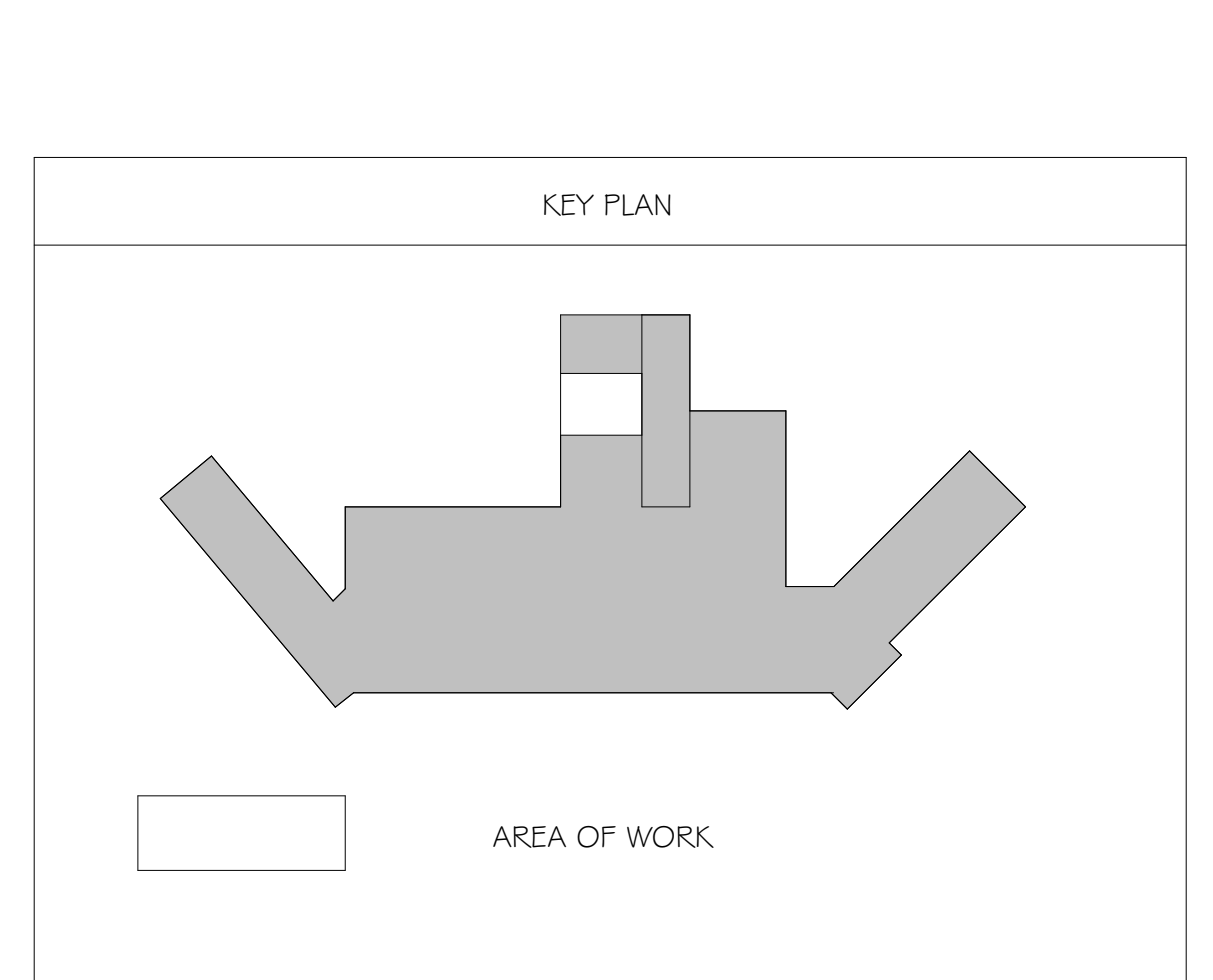

KEYED NOTES - 4TH FLOOR PLAN

NUMBER	KEYED NOTE
I	MEP WORK ON THIS FLOOR ONLY. PATCH AND REPAIR ALL WALLS AND FLOORS AS NECESSARY TO MAINTAIN FIRE RATINGS AND FINISH.

MEP NOTES

COORDINATE W/ MEP FOR ALL SAW CUT AND CORE DRILLING LOCATIONS THROUGH FLOOR AND SLAB ABOVE.

NOTE TO CONTRACTOR:

CONTRACTOR TO KEEP FIRE RATINGS IN TACT AT ALL TIMES DURING CONSTRUCTION BY PROVIDING ONE OF THE FOLLOWING SAFETY OPTIONS:

ONE - LEAVE THE EXISTING SPRINKLER SYSTEM OPERATIONAL IN THE RENOVATED AREA AND PROVIDE UPRIGHT SPRINKLER HEADS ON THE EXISTING PIPE TO PROVIDE COVERAGE IN THE AREA OF WORK PER NFPA 13 DURING CONSTRUCTION. THIS WILL LIKELY INVOLVE MOVING SPRINKLERS TO WITHIN 12 INCHES OF THE DECK ABOVE. AFTER THE NEW SPRINKLER PIPING IS INSTALLED TESTED AND APPROVED, THE SPRINKLERS AT THE DECK LEVEL AND THE EXISTING PIPING SHALL BE REMOVED.

OR

TWO - CONTRACTOR MAY SHUTDOWN THE EXISTING SPRINKLER SYSTEM IN THE AREA OF WORK PROVIDED THAT THE CONTRACTOR INSTALL A 1-HOUR FIRE-RESISTANCE RATED SEPARATION BETWEEN EVERY OCCUPIED SPACE ADJACENT TO THE CONSTRUCTION AREA. CONTRACTOR SHALL COORDINATE WITH THE VETERANS ADMINISTRATION, THE CONTRACTING OFFICER, AND THE A.E. ALL FIRE-RESISTANCE RATED SEPARATIONS SHALL COMPLY WITH NFPA 101 AND UL LISTINGS.

THE SPRINKLER MAIN LOCATED IN THE CORRIDOR IS REQUIRED TO REMAIN ACTIVE DURING BUSINESS HOURS FOR THE DURATION OF THE CONSTRUCTION PERIOD IN ORDER TO SUPPLY THE SPRINKLERS IN THE RESPIRATORY CARE PORTION OF THE FLOOR NOTED AS OUT OF CONTRACT ON THE PLANS. THE CONTRACTOR IS PERMITTED TO TAKE THE SPRINKLER MAIN TEMPORARILY OUT OF SERVICE AFTER HOURS TO ALLOW THE REMOVAL OF THE DEMOLISHED SPRINKLER BRANCH PIPING AND FOR RE-CONNECTION OF THE NEW SPRINKLER BRANCH PIPING. CONTRACTOR SHALL PROVIDE A FIRE WATCH DURING THE TIME THE SPRINKLER SYSTEM IS TAKEN OUT OF SERVICE. THE TIMING AND DURATION OF THE SPRINKLER SYSTEM SHUTDOWN SHALL BE COORDINATED WITH AND APPROVED BY THE VA AND AUTHORITY HAVING JURISDICTION.



FOURTH FLOOR PLAN
 1/8" = 1'-0"

Revisions:


Number	Description	Date

ENGINEERS/CONSULTANTS:

WOOLPERT, INC.
 343 FOUNTAINS PARKWAY
 SUITE 100
 FAIRVIEW HEIGHTS, IL 62208
 314-436-0865
 314-436-0884 fax

SCI ENGINEERING, INC
 130 POINT WEST BLVD.
 ST. CHARLES, MO 63301
 636-949-8200
 636-949-8269 fax

FINAL SUBMITTAL FOR CONSTRUCTION

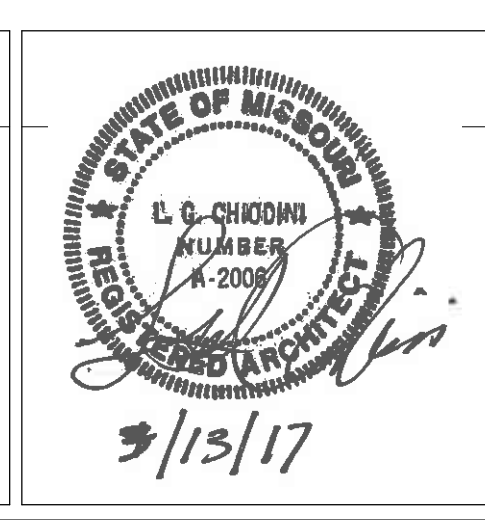

ARCHITECT:

Chiodini ARCHITECTS
 Architecture / Interior Design / Graphics
 1401 S. Brentwood Blvd. / Suite 575 / St. Louis, Missouri 63144
 314-725-5088 / arch@chiodini.com

THE ARCHITECT EXPRESSLY RESERVES HIS COMMON LAW AND STATUTORY LAW COPYRIGHTS AND OTHER PROPERTY RIGHTS FOR THESE ARCHITECTURAL WORKS AND TECHNICAL DOCUMENTS AND ANY DERIVATIVES THEREOF. THESE DRAWINGS AND DOCUMENTS ARE NOT TO BE REPRODUCED, CHANGED OR COPIED IN ANY MANNER WITHOUT THE EXPRESS WRITTEN CONSENT OF L.S. CHIODINI ARCHITECTS. FOR ANY USE WITHOUT FIRST OBTAINING THE EXPRESS WRITTEN CONSENT OF L.S. CHIODINI ARCHITECTS, YOU ARE NOT TO BE ASSIGNED TO ANY PARTY WITHOUT FIRST OBTAINING L.S. ARCHITECTS' WRITTEN PERMISSION AND CONSENT.

© COPYRIGHT PENDING

Drawing Title
FOURTH FLOOR PLAN

Approved: Project Director
 Approver

Project Title
VA HEALTH CARE SYSTEM

Project Number
 438-16-104 2016.052

Building Number
 5

Drawing Number
A104

Location
 VAS 438-16-104 BLDG. 5 CHAPEL
 SIOUX FALLS, SD 57105

Date
 2017.03.13



Checked
 RLK

Drawn
 C.J.N.

Owner
Department of Veterans Affairs

FLOOR PLAN NOTES:

- A. DO NOT SCALE DRAWINGS - USE DIMENSIONS AND NOTES ONLY.
- B. FIELD VERIFY ANY EXISTING CONSTRUCTION, CONFIGURATION AND DIMENSIONS. CONTRACTOR TO CONFIRM ALL DIMENSIONS AGAINST ACTUAL SITE CONDITIONS.
- C. ANY CONFLICT OR DISCREPANCIES IN DIMENSIONS OR ELEVATIONS SHALL BE RESOLVED WITH THE ARCHITECT PRIOR TO PROCEEDING WITH THE WORK OR PROCUREMENT OF MATERIALS. GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR DISTRIBUTION OF COMPLETE SETS OF CONTRACT DOCUMENTS (DRAWINGS & SPECIFICATIONS) TO ALL TRADES. EACH TRADE SHALL REVIEW ALL CONTRACT DOCUMENTS SO AS TO BE AWARE OF ALL ITEMS OF WORK AFFECTING THEIR RESPECTIVE TRADE. NO CLAIMS FOR "EXTRAS" WILL BE HONORED DUE TO FAILURE TO REVIEW COMPLETE SET OF DOCUMENTS.
- D. EGRESS DOORS SHALL NOT LOCK AGAINST THE DIRECTION OF EGRESS TRAVEL.
- E. ALL NEW WOOD FRAMING, SHEATHING, BLOCKING, ETC., SHALL BE FIRE RETARDANT TREATED. PROVIDE FIRE RETARDANT TREATED WOOD BLOCKING AT WALL AND CEILING FRAMING FOR ANCHORAGE OF ELEMENTS TO BE FASTENED OVER FINISHED SURFACES INCLUDING, BUT NOT LIMITED TO, WALL BUMPERS, HANDRAILS, GRAB BARS, WOOD TRIM, TOILET ACCESSORIES, AND WALL MOUNTED EQUIPMENT.
- F. INTERIOR DIMENSIONS ARE GIVEN TO THE FINISHED FACE OF WALL CONSTRUCTION, UNLESS NOTED OTHERWISE.
- G. PROVIDE CONTROL JOINTS IN GYPSUM BOARD AT SPACING NOT EXCEEDING 30'-0" O.C. AT LONG STRAIGHT RUNS OF WALL OR SCOTCH. IN FIRE RATED PARTITIONS, PROVIDE FIRE RATED CONTROL JOINTS. DO NOT ALLOW BRACING TO SPAN ACROSS CONTROL JOINTS. CONTROL JOINTS SHALL CONSIST OF DOUBLE STUDS OR DOUBLE FURRING CHANNELS AS PROVIDED BY CONTRACTOR.
- H. GENERAL CONTRACTOR MUST KEEP THE APPROVED SET OF BID DOCUMENTS ON SITE AT ALL TIMES.
- I. REFER TO PLAN FOR FIRE EXTINGUISHER CABINET (FEC) LOCATIONS. SEMI-RECESSED FIRE EXTINGUISHER CABINETS (FEC) AS PER FIRE MARSHAL'S REQUEST. OWNER TO PROVIDE ADDITIONAL LOCATIONS WITH ARCHITECT PRIOR TO INSTALLATION.
- J. REPAIR EXISTING SURFACES TO REMAIN AS NEEDED DUE TO THE DEMOLITION OR THE REMOVAL OF CONSTRUCTION. REFER TO DEMOLITION PACKAGE.
- K. REPAIR HOLES IN EXISTING PARTITIONS TO REMAIN WHERE PARTITION MOUNTED ITEMS HAVE BEEN REMOVED.
- L. EXISTING WOOD TO BE REFINISHED SHALL BE STRIPPED AND PREPARED FOR NEW FINISH. PATCH AND REPAIR EXISTING UNDERLAYMENT WHERE REQUIRED TO ACCOMMODATE NEW FINISH.
- M. PATCH AND REPAIR ALL EXISTING FINISHED WOOD FLOORS AS REQUIRED PRIOR TO REFINISHING.
- N. REFERENCE FINISH SHEET FOR FINISH INFORMATION.
- O. MAINTAIN CURRENT AND ACCURATE FIELD DRAWINGS OF AS-BUILT CONDITIONS.
- P. INFECTION PREVENTION MEASURES NEED TO BE IN PLACE DURING ALL CONSTRUCTION PHASES INCLUDING DEMOLITION. RE: SPEC.
- Q. ALL PARTITION TYPES TO BE P1 UNLESS OTHERWISE NOTED ON PLANS.
- R. CONTRACTOR TO PREP WINDOW FOR RE-INSTALLATION OF STAIN GLASS WINDOW. COORDINATE WITH STAIN GLASS CONTRACTOR.
- S. SEE D103 FOR EXTENT OF CONSTRUCTION WALL.
- T. PATCH AND REPAIR ROOF AS NECESSARY WHERE MEP ITEMS ARE BEING REMOVED AND RELOCATED (RE: MEP DWGS).
- U. PATCH AND REPAIR ROOF AND PARAPET WHERE EXISTING ROOF ACCESS LADDER IS BEING REMOVED.

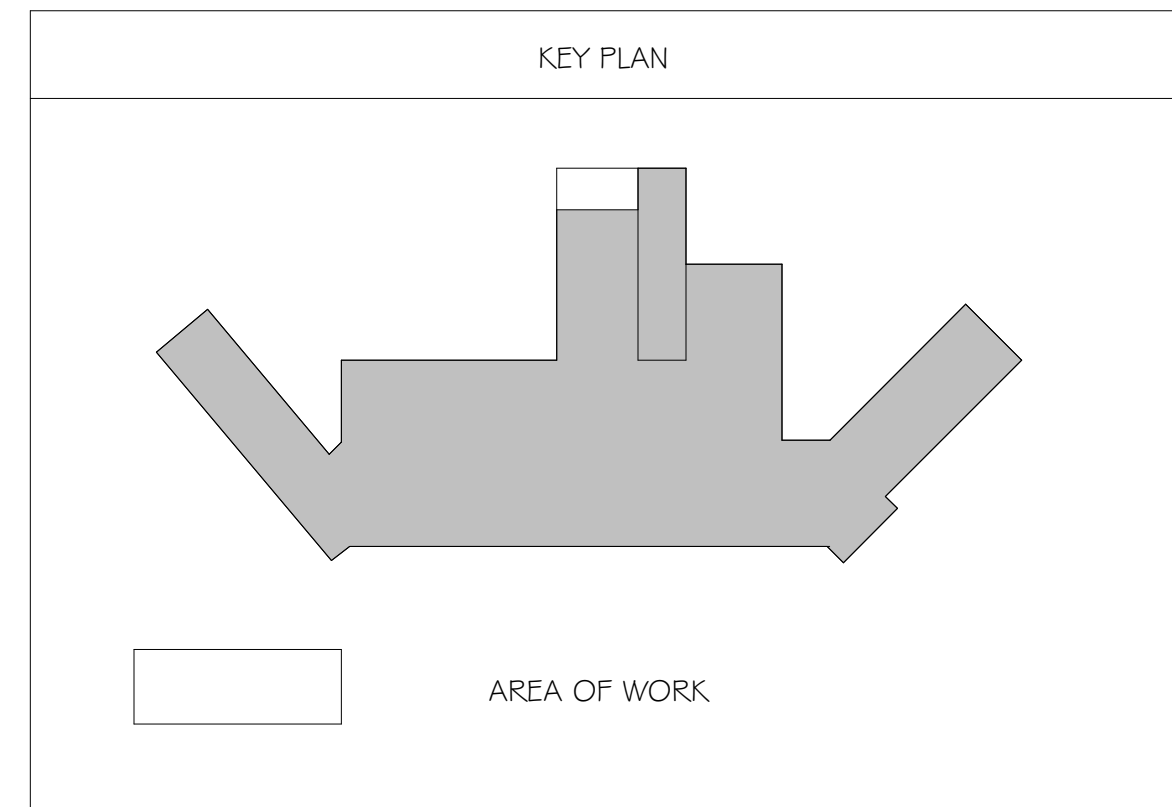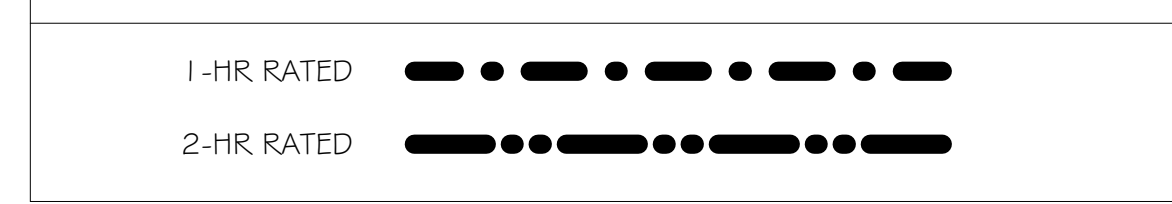

KEYED NOTES - 5TH FLOOR PLAN

NUMBER	KEYED NOTE
1	EXISTING AND NEW MECHANICAL EQUIPMENT AND UTILITIES.
2	CONTRACTOR TO SEAL ALL EXISTING AND NEW FLOOR PENETRATIONS W/ FIRE RATED CAULK.
3	CONTRACTOR TO SEAL PERIMETER OF ROOM @ SLAB TO WALL CONDITION.
4	ALL MECHANICAL/UTILITY PENETRATIONS THROUGH 5TH FLOOR SLAB TO BE CALKED AT PERIMETER OF PENETRATION AND TO RECEIVE A CURB TO ENCASE OPENINGS.
5	CURBS SHOWN ON PLANS SHOULD BE COORDINATED IN FIELD W/ ALL UTILITIES COORDINATED IN FIELD W/ ALL UTILITIES IN SPACE. CURBS SHOULD NOT BLOCK THE FLOOR OF WATER TO EXISTING FLOOR DRAIN.
7	PATCH CONCRETE FLOOR AND ROOF DECK AS REQUIRED FROM REMOVAL OF MECHANICAL EQUIPMENT.


NOTE TO CONTRACTOR:

CONTRACTOR TO KEEP FIRE RATINGS IN TACT AT ALL TIMES DURING CONSTRUCTION BY PROVIDING ONE OF THE FOLLOWING SAFETY OPTIONS:



ONE - LEAVE THE EXISTING SPRINKLER SYSTEM OPERATIONAL IN THE RENOVATED AREA AND PROVIDE UPRIGHT SPRINKLER HEADS ON THE EXISTING PIPE TO PROVIDE COVERAGE IN THE AREA OF WORK PER NFPA 13 DURING CONSTRUCTION. THIS WILL INVOLVE MOVING SPRINKLERS TO WITHIN 12 INCHES OF THE DECK ABOVE. AFTER THE NEW SPRINKLER PIPING IS INSTALLED, TESTED AND APPROVED, THE SPRINKLERS AT THE DECK LEVEL AND THE EXISTING PIPING SHALL BE REMOVED.

TWO - CONTRACTOR MAY SHUTDOWN THE EXISTING SPRINKLER SYSTEM IN THE AREA OF WORK PROVIDED THAT THE CONTRACTOR INSTALL A 1-HOUR FIRE-RESISTANCE RATED SEPARATION BETWEEN EVERY OCCUPIED SPACE ADJACENT TO THE CONSTRUCTION AREA. CONTRACTOR SHALL COORDINATE WITH THE VETERANS ADMINISTRATION, THE CONTRACTING OFFICER, AND THE A.E. ALL FIRE-RESISTANCE RATED SEPARATIONS SHALL COMPLY WITH NFPA 101 AND UL LISTINGS.

THE SPRINKLER MAIN LOCATED IN THE CORRIDOR IS REQUIRED TO REMAIN ACTIVE DURING BUSINESS HOURS FOR THE DURATION OF THE CONSTRUCTION PERIOD IN ORDER TO SUPPLY THE SPRINKLERS IN THE RESPIRATORY CARE PORTION OF THE FLOOR INDICATED AS OUT OF CONTRACT ON THE PLAN. THE CONTRACTOR IS PERMITTED TO TAKE THE SPRINKLER MAIN TEMPORARILY OUT OF SERVICE AFTER HOURS TO ALLOW THE REMOVAL OF THE DEMOLISHED SPRINKLER BRANCH PIPING AND FOR RE-CONNECTION OF THE NEW SPRINKLER BRANCH PIPING. CONTRACTOR SHALL PROVIDE A FIRE WATCH DURING THE TIME THE SPRINKLER SYSTEM IS TAKEN OUT OF SERVICE. THE TIMING AND DURATION OF THE SPRINKLER SYSTEM SHUTDOWN SHALL BE COORDINATED WITH AND APPROVED BY THE VA AND AUTHORITY HAVING JURISDICTION.

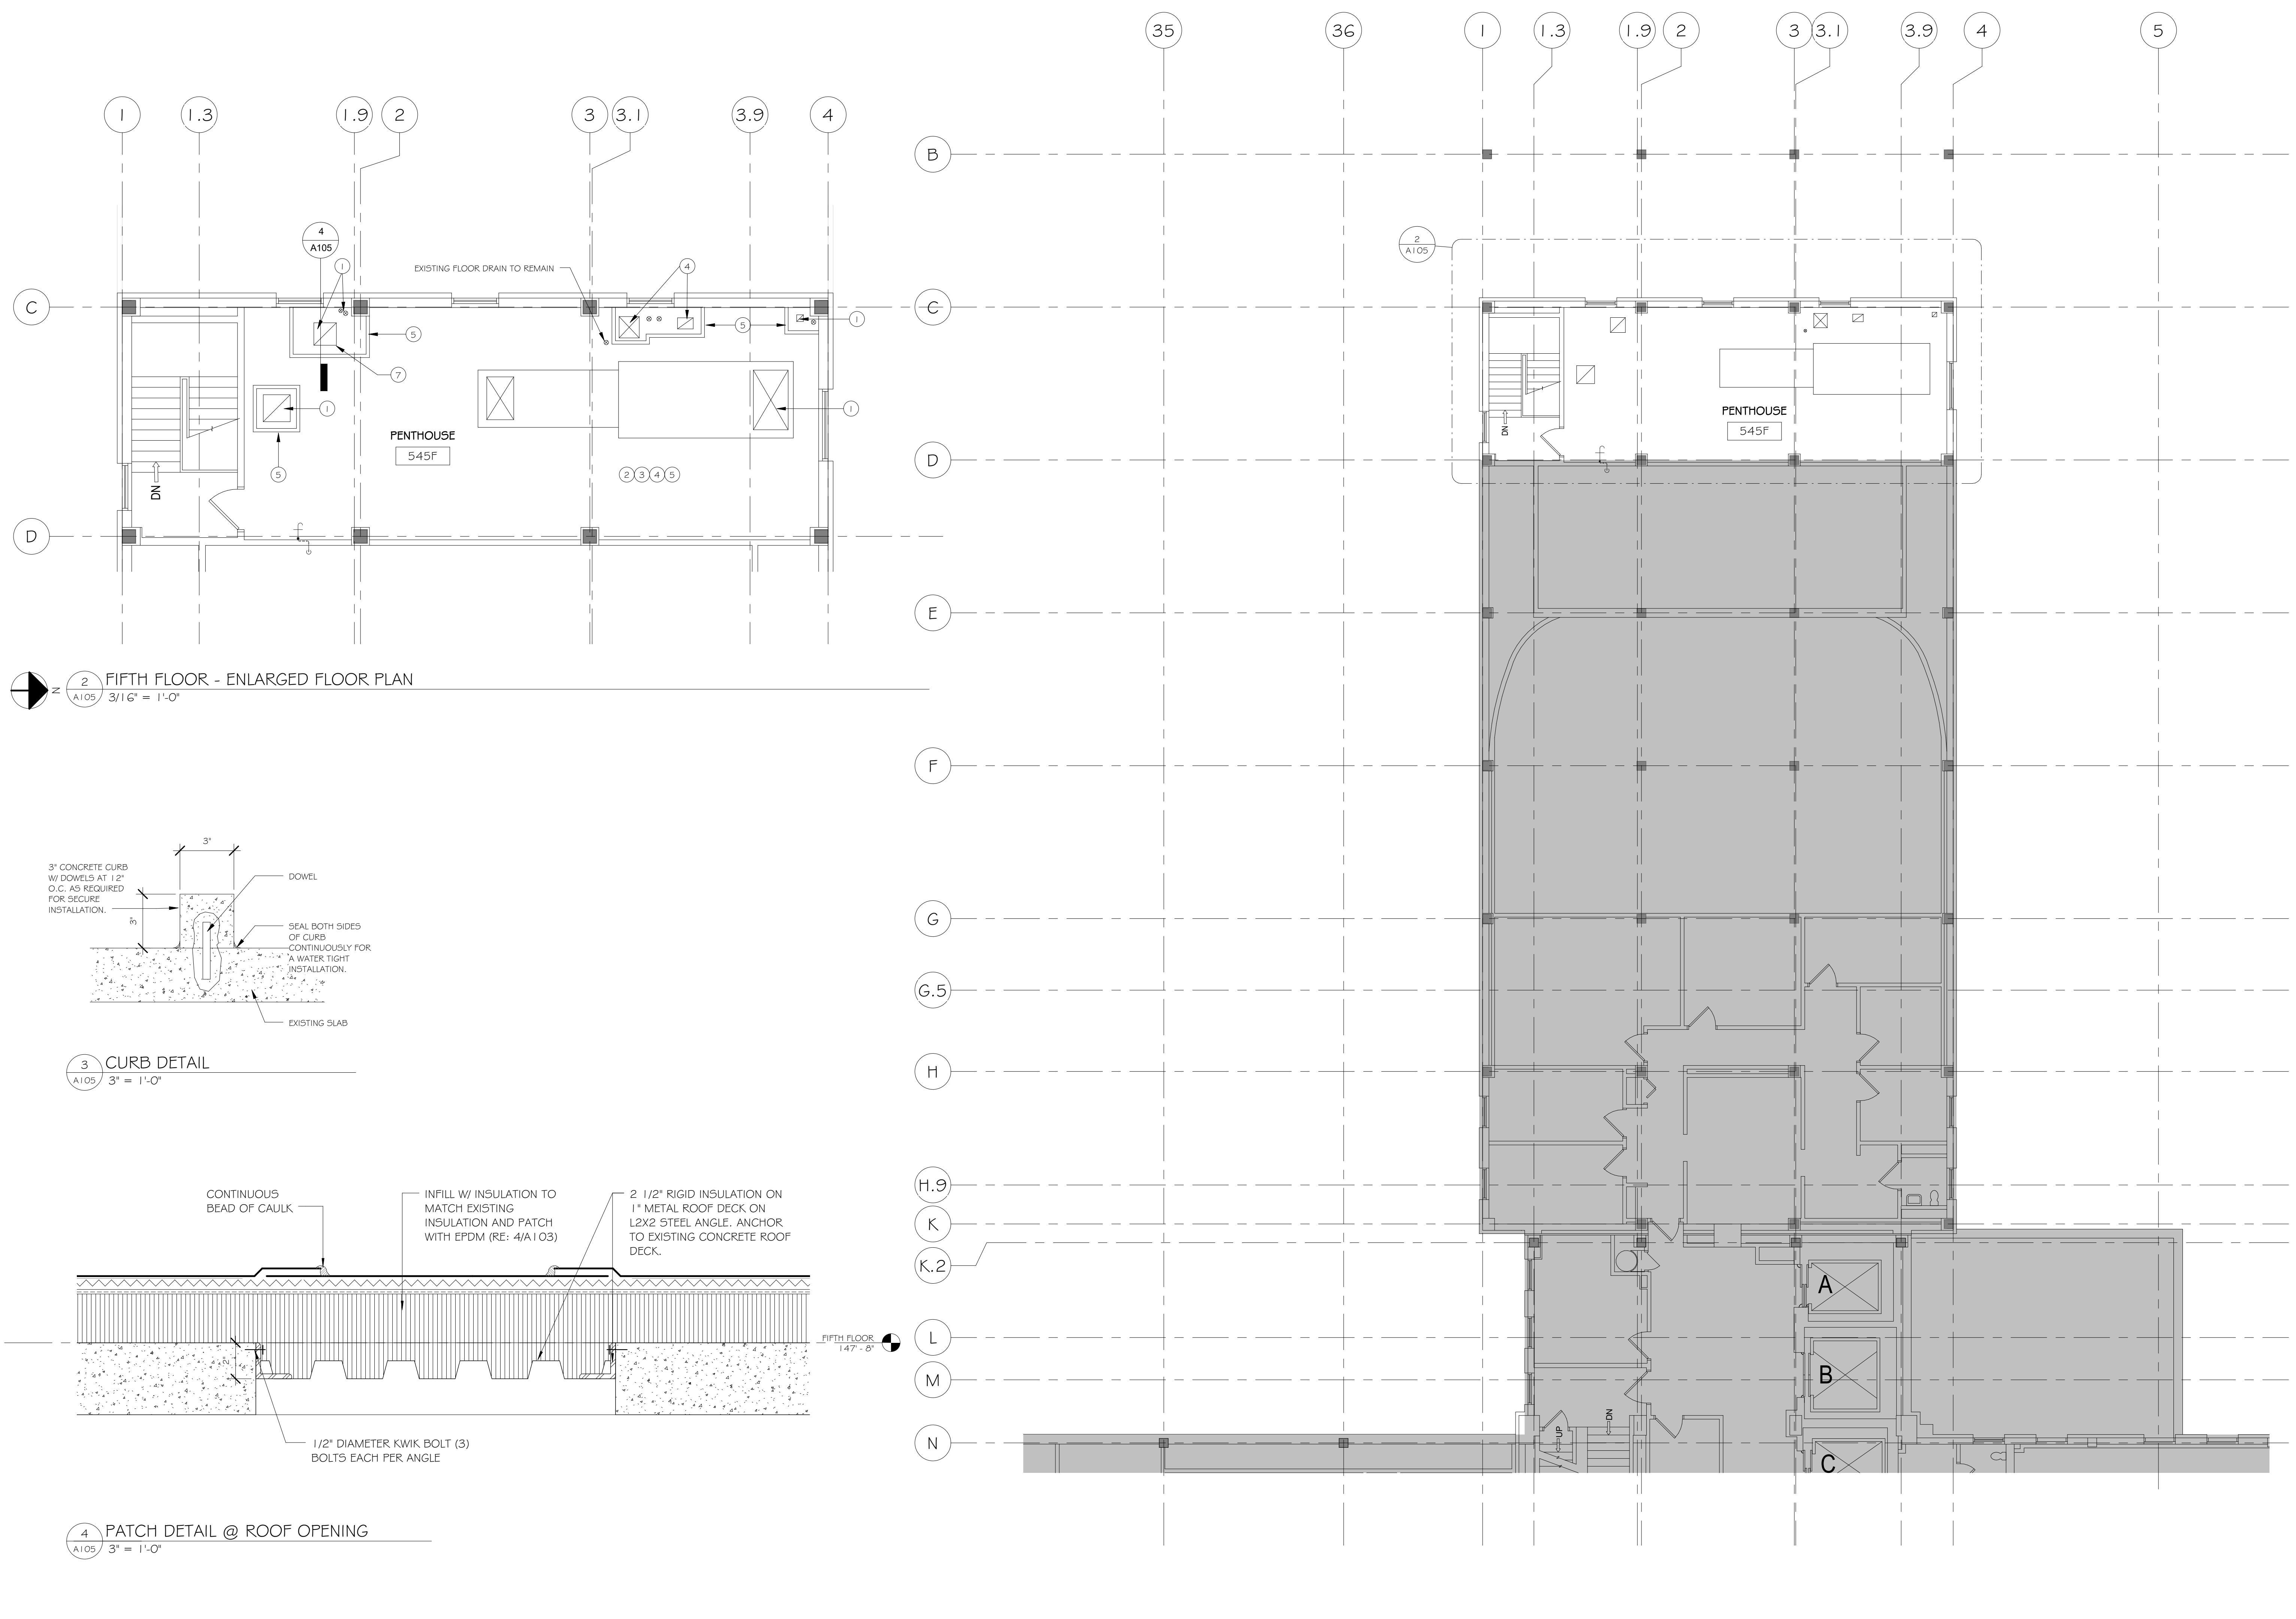

2 FIFTH FLOOR - ENLARGED FLOOR PLAN
 A105 3/16" = 1'-0"

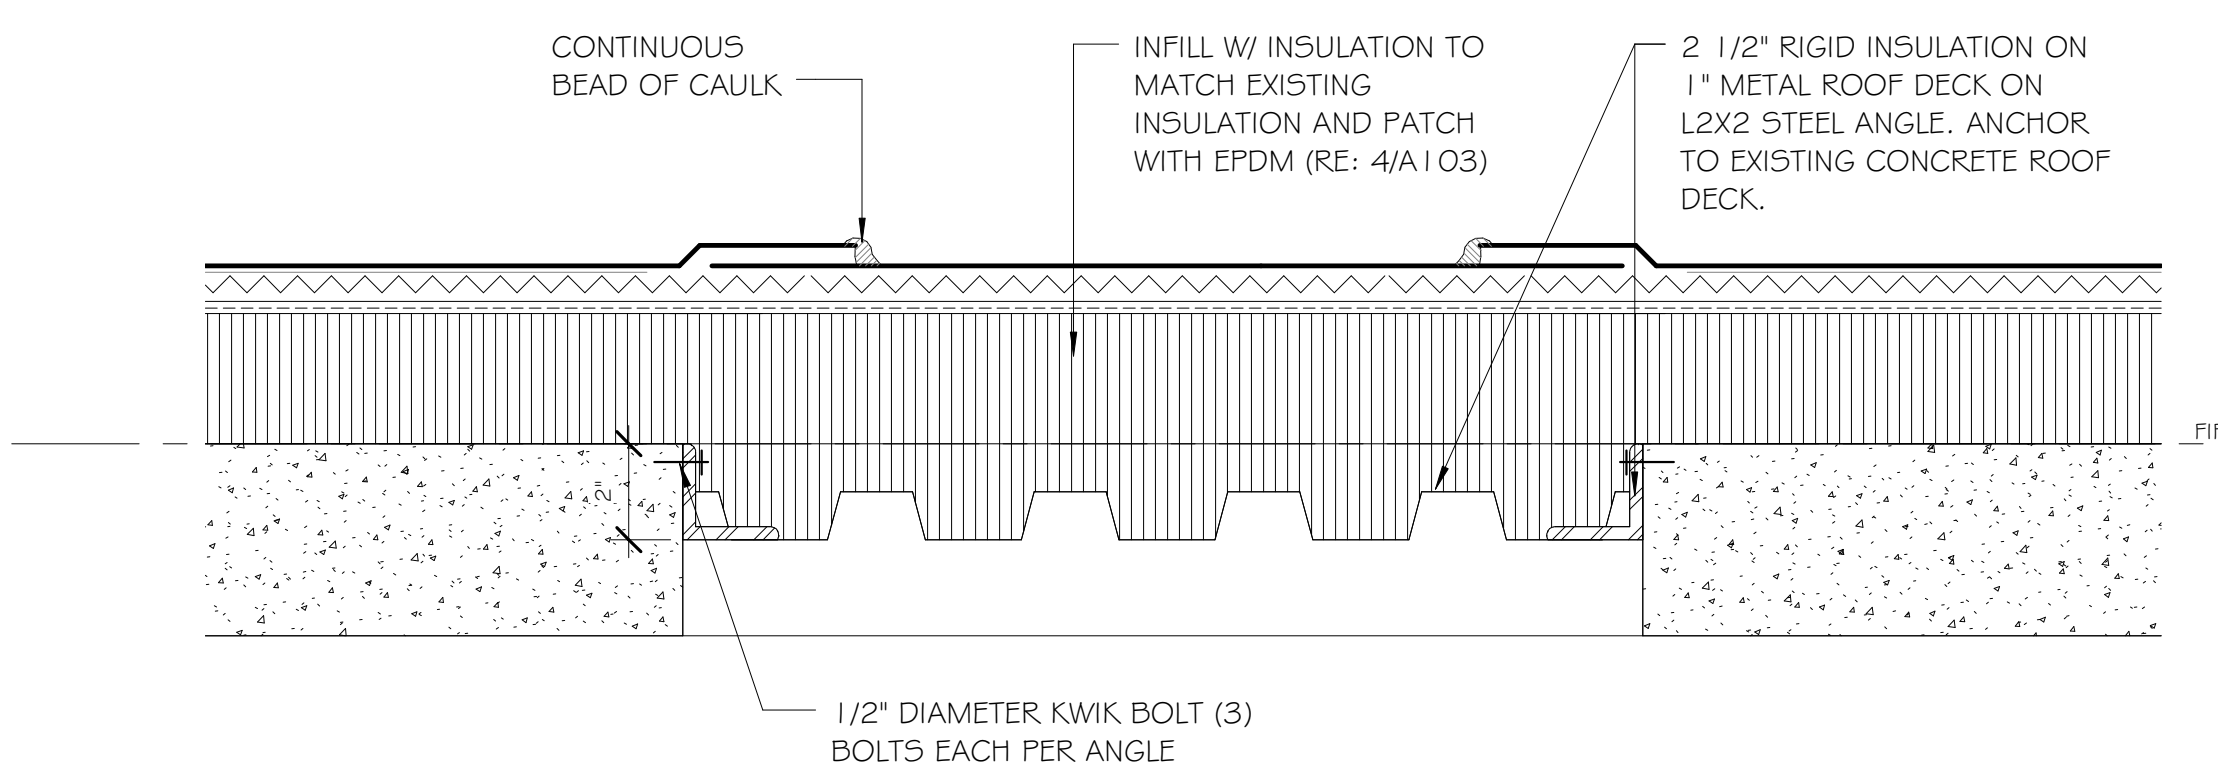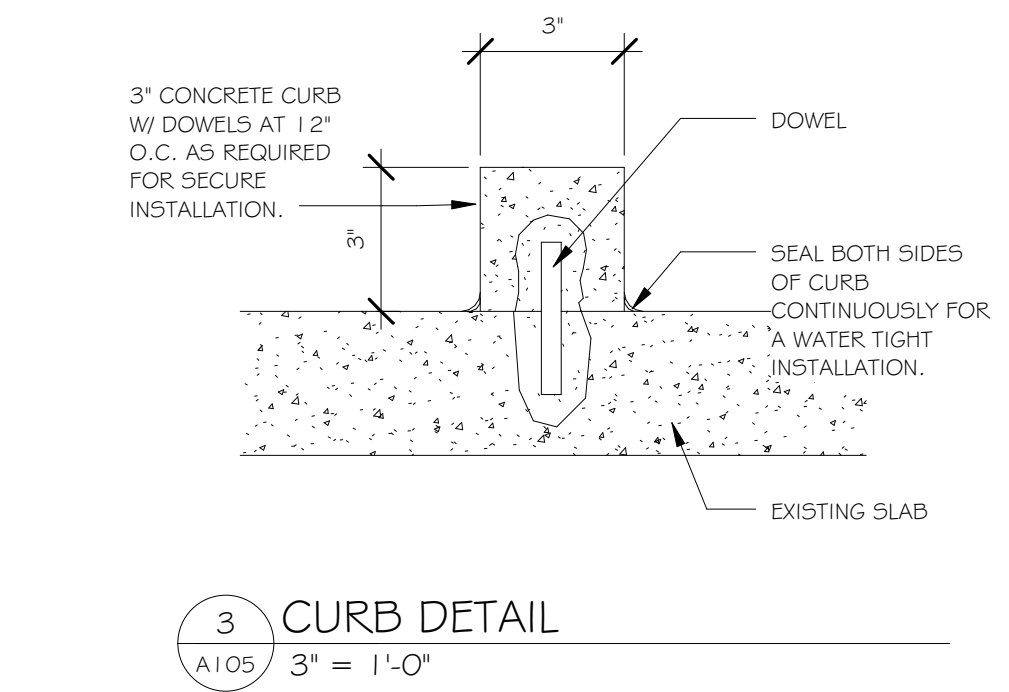


1 FIFTH FLOOR PLAN
 A105 1/8" = 1'-0"

ENGINEERS/CONSULTANTS:

WOOLPERT, INC. 343 FOUNTAINS PARKWAY SUITE 100 FAIRVIEW HEIGHTS, IL 62208 314-436-0865 314-436-0884 fax	SCI ENGINEERING, INC 130 POINT WEST BLVD. ST. CHARLES, MO 63301 636-949-8200 636-949-8269 fax
--	---

FINAL SUBMITTAL FOR CONSTRUCTION

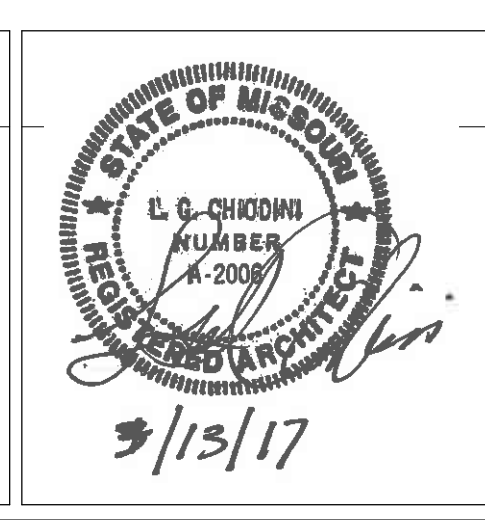

ARCHITECT:

Chiodini ARCHITECTS

Architecture / Interior Design / Graphics
 1401 S. Brentwood Blvd. / Suite 575 / St. Louis, Missouri 63144
 314-725-5088 / arch@chiodini.com

THE ARCHITECT EXPRESSLY RESERVES HIS/HER/CORPORATE AND STATUTORY AND COPYRIGHTS AND OTHER PROPERTY RIGHTS FOR THESE ARCHITECTURAL DRAWINGS AND TECHNICAL DOCUMENTS AND ANY DERIVATIVES THEREOF. THESE DRAWINGS AND DOCUMENTS ARE NOT TO BE REPRODUCED, CHANGED OR COPIED IN ANY MANNER WITHOUT THE EXPRESS WRITTEN CONSENT OF L.G. CHIODINI ARCHITECTS. NOR ARE THEY TO BE ASSIGNED TO ANY PARTY WITHOUT THE WRITTEN PERMISSION AND CONSENT.

© COPYRIGHT PENDING

Drawing Title
FIFTH FLOOR PLAN

Approved: Project Director
 Approver

Project Title
VA HEALTH CARE SYSTEM

Location
 VAS 438-16-104 BLDG. 5 CHAPEL
 SIOUX FALLS, SD 57105

Date
 2017.03.13

Checked
 RLK

Drawn
 C.J.N.

Project Number
 438-16-104 2016.052

Building Number
 5

Drawing Number
A105

Owner
Department of Veterans Affairs

Scale: As indicated

three eighths inch = one foot
 one quarter inch = one foot
 one eighth inch = one foot
 one half inch = one foot
 three quarters inch = one foot
 one inch = one foot
 one and one half inches = one foot
 two inches = one foot
 three inches = one foot
 four inches = one foot
 five inches = one foot
 six inches = one foot
 seven inches = one foot
 eight inches = one foot
 nine inches = one foot
 ten inches = one foot
 eleven inches = one foot
 twelve inches = one foot
 thirteen inches = one foot
 fourteen inches = one foot
 fifteen inches = one foot
 sixteen inches = one foot
 C:\Users\cnewcomb\Documents\Revit_2016\2016.052_VA_Sioux Falls_Chapel_cnewcomb.rvt
 3/13/2017 4:15:38 PM
 VA FORM 08-6231

- FLOOR PLAN NOTES:**
- DO NOT SCALE DRAWINGS - USE DIMENSIONS AND NOTES ONLY.
 - FIELD VERIFY ANY EXISTING CONSTRUCTION, CONFIGURATION AND DIMENSIONS.
 - CONTRACTOR TO CONFIRM ALL DIMENSIONS AGAINST ACTUAL SITE CONDITIONS. ANY CONFLICT OR DISCREPANCIES IN DIMENSIONS OR ELEVATIONS SHALL BE RESOLVED WITH THE ARCHITECT PRIOR TO PROCEEDING WITH THE WORK OR PROCUREMENT OF MATERIALS.
 - GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR DISTRIBUTION OF COMPLETE SETS OF CONTRACT DOCUMENTS (DRAWINGS & SPECIFICATIONS) TO ALL TRADES. EACH TRADE SHALL REVIEW ALL CONTRACT DOCUMENTS SO AS TO BE AWARE OF ALL ITEMS OF WORK AFFECTING THEIR RESPECTIVE TRADE. NO CLAIMS FOR "SITKAS" WILL BE HONORED DUE TO FAILURE TO REVIEW COMPLETE SET OF DOCUMENTS.
 - EGRESS DOORS SHALL NOT LOCK AGAINST THE DIRECTION OF EGRESS TRAVEL.
 - ALL NEW WOOD FRAMING, SHEATHING, BLOCKING, ETC., SHALL BE FIRE RETARDANT TREATED. PROVIDE FIRE RETARDANT TREATED WOOD BLOCKING AT WALL AND CEILING FRAMING FOR ANCHORAGE OF ELEMENTS TO BE FASTENED OVER FINISHED SURFACES INCLUDING, BUT NOT LIMITED TO: WALL BUMPERS, HANDRAILS, GRAB BARS, WOOD TRIM, TOILET ACCESSORIES, AND WALL MOUNTED EQUIPMENT.
 - INTERIOR DIMENSIONS ARE GIVEN TO THE FINISHED FACE OF WALL CONSTRUCTION, UNLESS NOTED OTHERWISE.
 - PROVIDE CONTROL JOINTS IN GYPSUM BOARD AT SPACING NOT EXCEEDING 30'-0" O.C. AT LONG STRAIGHT RUNS OF WALL OR SOFFIT. IN FIRE RATED PARTITIONS, PROVIDE FIRE RATED CONTROL JOINTS. DO NOT ALLOW BRACING TO SPAN ACROSS CONTROL JOINTS. CONTROL JOINTS SHALL CONSIST OF DOUBLE STUDS OR DOUBLE FLURRING CHANNELS AS PROVIDED BY CONTRACTOR.
 - GENERAL CONTRACTOR MUST KEEP THE APPROVED SET OF BID DOCUMENTS ON SITE AT ALL TIMES.
 - REFER TO PLAN FOR FIRE EXTINGUISHER CABINET (FEC) LOCATIONS. SEMI-RECESSED FIRE EXTINGUISHER CABINET AS NOTED IN SPECIFICATIONS. OWNER TO PROVIDE ADDITIONAL FIRE EXTINGUISHER CABINETS (FEC) AS PER FIRE MARSHAL'S REQUEST. COORDINATE ALL LOCATIONS WITH ARCHITECT PRIOR TO INSTALLATION.
 - REPAIR EXISTING SURFACES TO REMAIN AS NEEDED DUE TO THE DEMOLITION OR THE REMOVAL OF CONSTRUCTION. REFER TO DEMOLITION PACKAGE.
 - REPAIR HOLES IN EXISTING PARTITIONS TO REMAIN WHERE PARTITION MOUNTED ITEMS HAVE BEEN REMOVED.
 - EXISTING WOOD TO BE REFINISHED SHALL BE STRIPPED AND PREPARED FOR NEW FINISH.
 - PATCH AND REPAIR EXISTING UNDERLAYMENT WHERE REQUIRED TO ACCOMMODATE NEW FINISH.
 - PATCH AND REPAIR ALL EXISTING FINISHED WOOD FLOORS AS REQUIRED PRIOR TO REFINISHING.
 - PATCH AND REPAIR ALL EXISTING DOOR FRAMES AS NEEDED.
 - REFERENCE FINISH SHEET FOR FINISH INFORMATION.
 - MAINTAIN CURRENT AND ACCURATE FIELD DRAWINGS OF AS-BUILT CONDITIONS.
 - INFECTION PREVENTION MEASURES NEED TO BE IN PLACE DURING ALL CONSTRUCTION PHASES INCLUDING DEMOLITION. RE: SPC.
 - ALL PARTITION TYPES TO BE F1 UNLESS OTHERWISE NOTED ON PLANS.
 - CONTRACTOR TO PREP WINDOW FOR RE-INSTALLATION OF STAIN GLASS WINDOW. COORDINATE WITH STAIN GLASS CONTRACTOR.
 - SEE D103 FOR SITES OF CONSTRUCTION WALL.
 - PATCH AND REPAIR ROOF AS NECESSARY WHERE MEP ITEMS ARE BEING REMOVED AND RELOCATED (RE: MEP DWGS).
 - PATCH AND REPAIR ROOF AND PARAPET WHERE EXISTING ROOF ACCESS LADDER IS BEING REMOVED.



- NUMBER KEYED NOTE**
- CONTRACTOR SHALL REMOVE AND STORE EXISTING LOCKERS. CONTRACTOR TO REPAIR AND RESTORE ANY BROKEN OR DAMAGED ITEMS ON EXISTING LOCKERS PRIOR TO RE-INSTALLING.
 - CONTRACTOR TO PROVIDE AND INSTALL NEW FULLY RECESSED FIRE EXTINGUISHER CABINET. RE: SPECIFICATIONS.
 - CONTRACTOR SHALL PROVIDE AND INSTALL PL-1 CLOSET SHELF AND ROD.
 - CONTRACTOR SHALL PATCH AND REPAIR WALLS AS NEEDED. WHERE EXISTING TERRAZZO IS BEING REMOVED, CONTRACTOR TO PATCH AND FILL FLOOR WHERE EXISTING TERRAZZO IS BEING REMOVED. FINISH FLOOR TO BE LEVEL WITH EXISTING CONCRETE FLOOR SLAB.
 - CONTRACTOR SHALL PROVIDE AND INSTALL NEW MED GAS SHUT OFF. RE: PLUMBING DWGS
 - CONTRACTOR SHALL PROVIDE AND INSTALL PLASTIC BRADLEY MODEL 961 BABY CHANGING STATION.
 - CONTRACTOR TO PROVIDE NEW SHELVING FOR AV EQUIPMENT. PROVIDE (2) 2" GROMMETS AT THE BACK OF EACH SHELF. COORDINATE WITH VA.
 - CONTRACTOR SHALL INSTALL OWNER PROVIDED AUTOMATIC PAPER TOWEL DISPENSER.
 - CONTRACTOR SHALL PROVIDE AND INSTALL GLASS MIRROR WITH STAINLESS STEEL ANGLE FRAME. MODEL B-290 2436.
 - CONTRACTOR SHALL INSTALL OWNER PROVIDED AUTOMATIC SOAP DISPENSER.
 - CONTRACTOR SHALL PROVIDE AND INSTALL STAINLESS STEEL HORIZONTAL GRAB BAR (36"). MODEL B-680X36".
 - CONTRACTOR SHALL PROVIDE AND INSTALL STAINLESS STEEL VERTICAL GRAB BAR (18"). MODEL B-680X18".
 - CONTRACTOR SHALL PROVIDE AND INSTALL STAINLESS STEEL HORIZONTAL GRAB BAR (42") MODEL B-680X42".
 - CONTRACTOR SHALL INSTALL OWNER PROVIDED SURFACE MOUNTED MULTI ROLL TOILET TISSUE DISPENSER.
 - CONTRACTOR SHALL INSTALL OWNER PROVIDED UTILITY HOOK.
 - CONTRACTOR SHALL PROVIDE AND INSTALL NEW SEMI-RECESSED FIRE EXTINGUISHER CABINET. RE: SPECIFICATIONS.
 - OPEN SPACE FOR OWNER OXYGEN TANKS UNDER UPPER CABINETS. SEE ELEVATIONS FOR EXTENTS OF CLEARANCE.
 - CONTRACTOR SHALL PATCH BRICK WHERE MECHANICAL LOUVER IS REMOVED RE: BASS50 FOR THE DETAIL. BRICK AND MORTAR TO MATCH EXISTING COLOR AND PATTERN. RE: SPECIFICATION.
 - CONTRACTOR SHALL INSTALL EXISTING RESTORED/REPAIRED AND CLEANED STAINED GLASS WINDOWS (3 THIS).
 - CONTRACTOR SHALL PROVIDE AND INSTALL WS-2.
 - OWNER PROVIDED AND INSTALLED FURNITURE.
 - OWNER PROVIDED AND INSTALLED PRINTER.
 - CONTRACTOR SHALL PROVIDE AND INSTALL WS-1.
 - CONTRACTOR SHALL PROVIDE AND INSTALL BLOCKING FOR CONTRACTOR INSTALLED EXISTING SMART BOARD TV INSTALLATION.
 - NEW ROOF ACCESS LADDER.
 - CONTRACTOR SHALL INSTALL EXISTING RESTORED/REPAIRED AND CLEANED CHRISTIAN BASED STAINED GLASS WINDOWS (3 THIS).
 - CONTRACTOR SHALL PATCH AND REPAIR OPENING. CONTRACTOR TO PROVIDE AND INSTALL NEW WINDOW TO MATCH EXISTING WINDOW SYSTEMS IN BUILDING. NEW WINDOW SHALL RECEIVE WS-1.
 - NEW ROOF TOP UNIT RE: MECHANICAL DRAWINGS.
 - CONTRACTOR SHALL PROVIDE AND INSTALL NEW WS-3.
 - 2X2 MOPSINK AND MOP RACK (RE: PLUMBING DWGS).
 - CONTRACTOR TO PROVIDE BLOCKING IN WALL FOR FUTURE SMART BOARD INSTALLATION.
 - PROVIDE BACKING IN WALL FOR TV.
 - EXISTING FLOOR DRAIN. SEE PLUMBING DWGS.
 - EXISTING DRINKING FOUNTAIN TO REMAIN. CONTRACTOR TO COVER AND PROTECT DURING CONSTRUCTION.
 - NEW ACTUATOR BUTTON TO MATCH EXISTING ASSEMBLY.
 - BRONCHOSCOPE CABINET COORDINATE FINAL LOCATION W/ OWNER. (BY OWNER).


NOTE TO CONTRACTOR:

CONTRACTOR TO KEEP FIRE RATINGS IN TACT AT ALL TIMES DURING CONSTRUCTION BY PROVIDING ONE OF THE FOLLOWING SAFETY OPTIONS:


ONE - LEAVE THE EXISTING SPRINKLER SYSTEM OPERATIONAL IN THE RENOVATED AREA AND PROVIDE UPRIGHT SPRINKLER HEADS ON THE EXISTING PIPE TO PROVIDE COVERAGE IN THE AREA OF WORK PER NFPA 13B DURING CONSTRUCTION. THIS WILL INVOLVE MOVING SPRINKLERS TO WITHIN 12 INCHES OF THE DECK ABOVE. AFTER THE NEW SPRINKLER PIPING IS INSTALLED TESTED AND APPROVED, THE SPRINKLERS AT THE DECK LEVEL AND THE EXISTING FIRING SHALL BE REMOVED.

TWO - CONTRACTOR MAY SHUTDOWN THE EXISTING SPRINKLER SYSTEM IN THE AREA OF WORK PROVIDED THAT THE CONTRACTOR INSTALL A 1-HOUR FIRE-RESISTANCE RATED SEPARATION BETWEEN OCCUPIED SPACE ADJACENT TO THE CONSTRUCTION AREA. CONTRACTOR SHALL COORDINATE WITH THE VETERANS ADMINISTRATION, THE CONTRACTING OFFICER, AND THE A/E. ALL FIRE-RESISTANCE RATED SEPARATIONS SHALL COMPLY WITH NFPA 101 AND UL LISTINGS.


THE SPRINKLER MAIN LOCATED IN THE CORRIDOR IS REQUIRED TO REMAIN ACTIVE DURING BUSINESS HOURS FOR THE DURATION OF THE CONSTRUCTION PERIOD IN ORDER TO SUPPLY THE SPRINKLERS IN THE RESPIRATORY CARE PORTION OF THE FLOOR NOTED AS OUT OF CONTRACT ON THE PLAN. THE CONTRACTOR IS PERMITTED TO TAKE THE SPRINKLER MAIN TEMPORARILY OUT OF SERVICE AFTER HOURS TO ALLOW THE REMOVAL OF THE DEMOLISHED SPRINKLER BRANCH PIPING AND FOR RE-CONNECTION OF THE NEW SPRINKLER BRANCH PIPING. CONTRACTOR SHALL PROVIDE A FIRE WATCH DURING THE TIME THE SPRINKLER SYSTEM IS TAKEN OUT OF SERVICE. THE TIMING AND DURATION OF THE SPRINKLER SYSTEM SHUTDOWN SHALL BE COORDINATED WITH AND APPROVED BY THE VA AND AUTHORITY HAVING JURISDICTION.

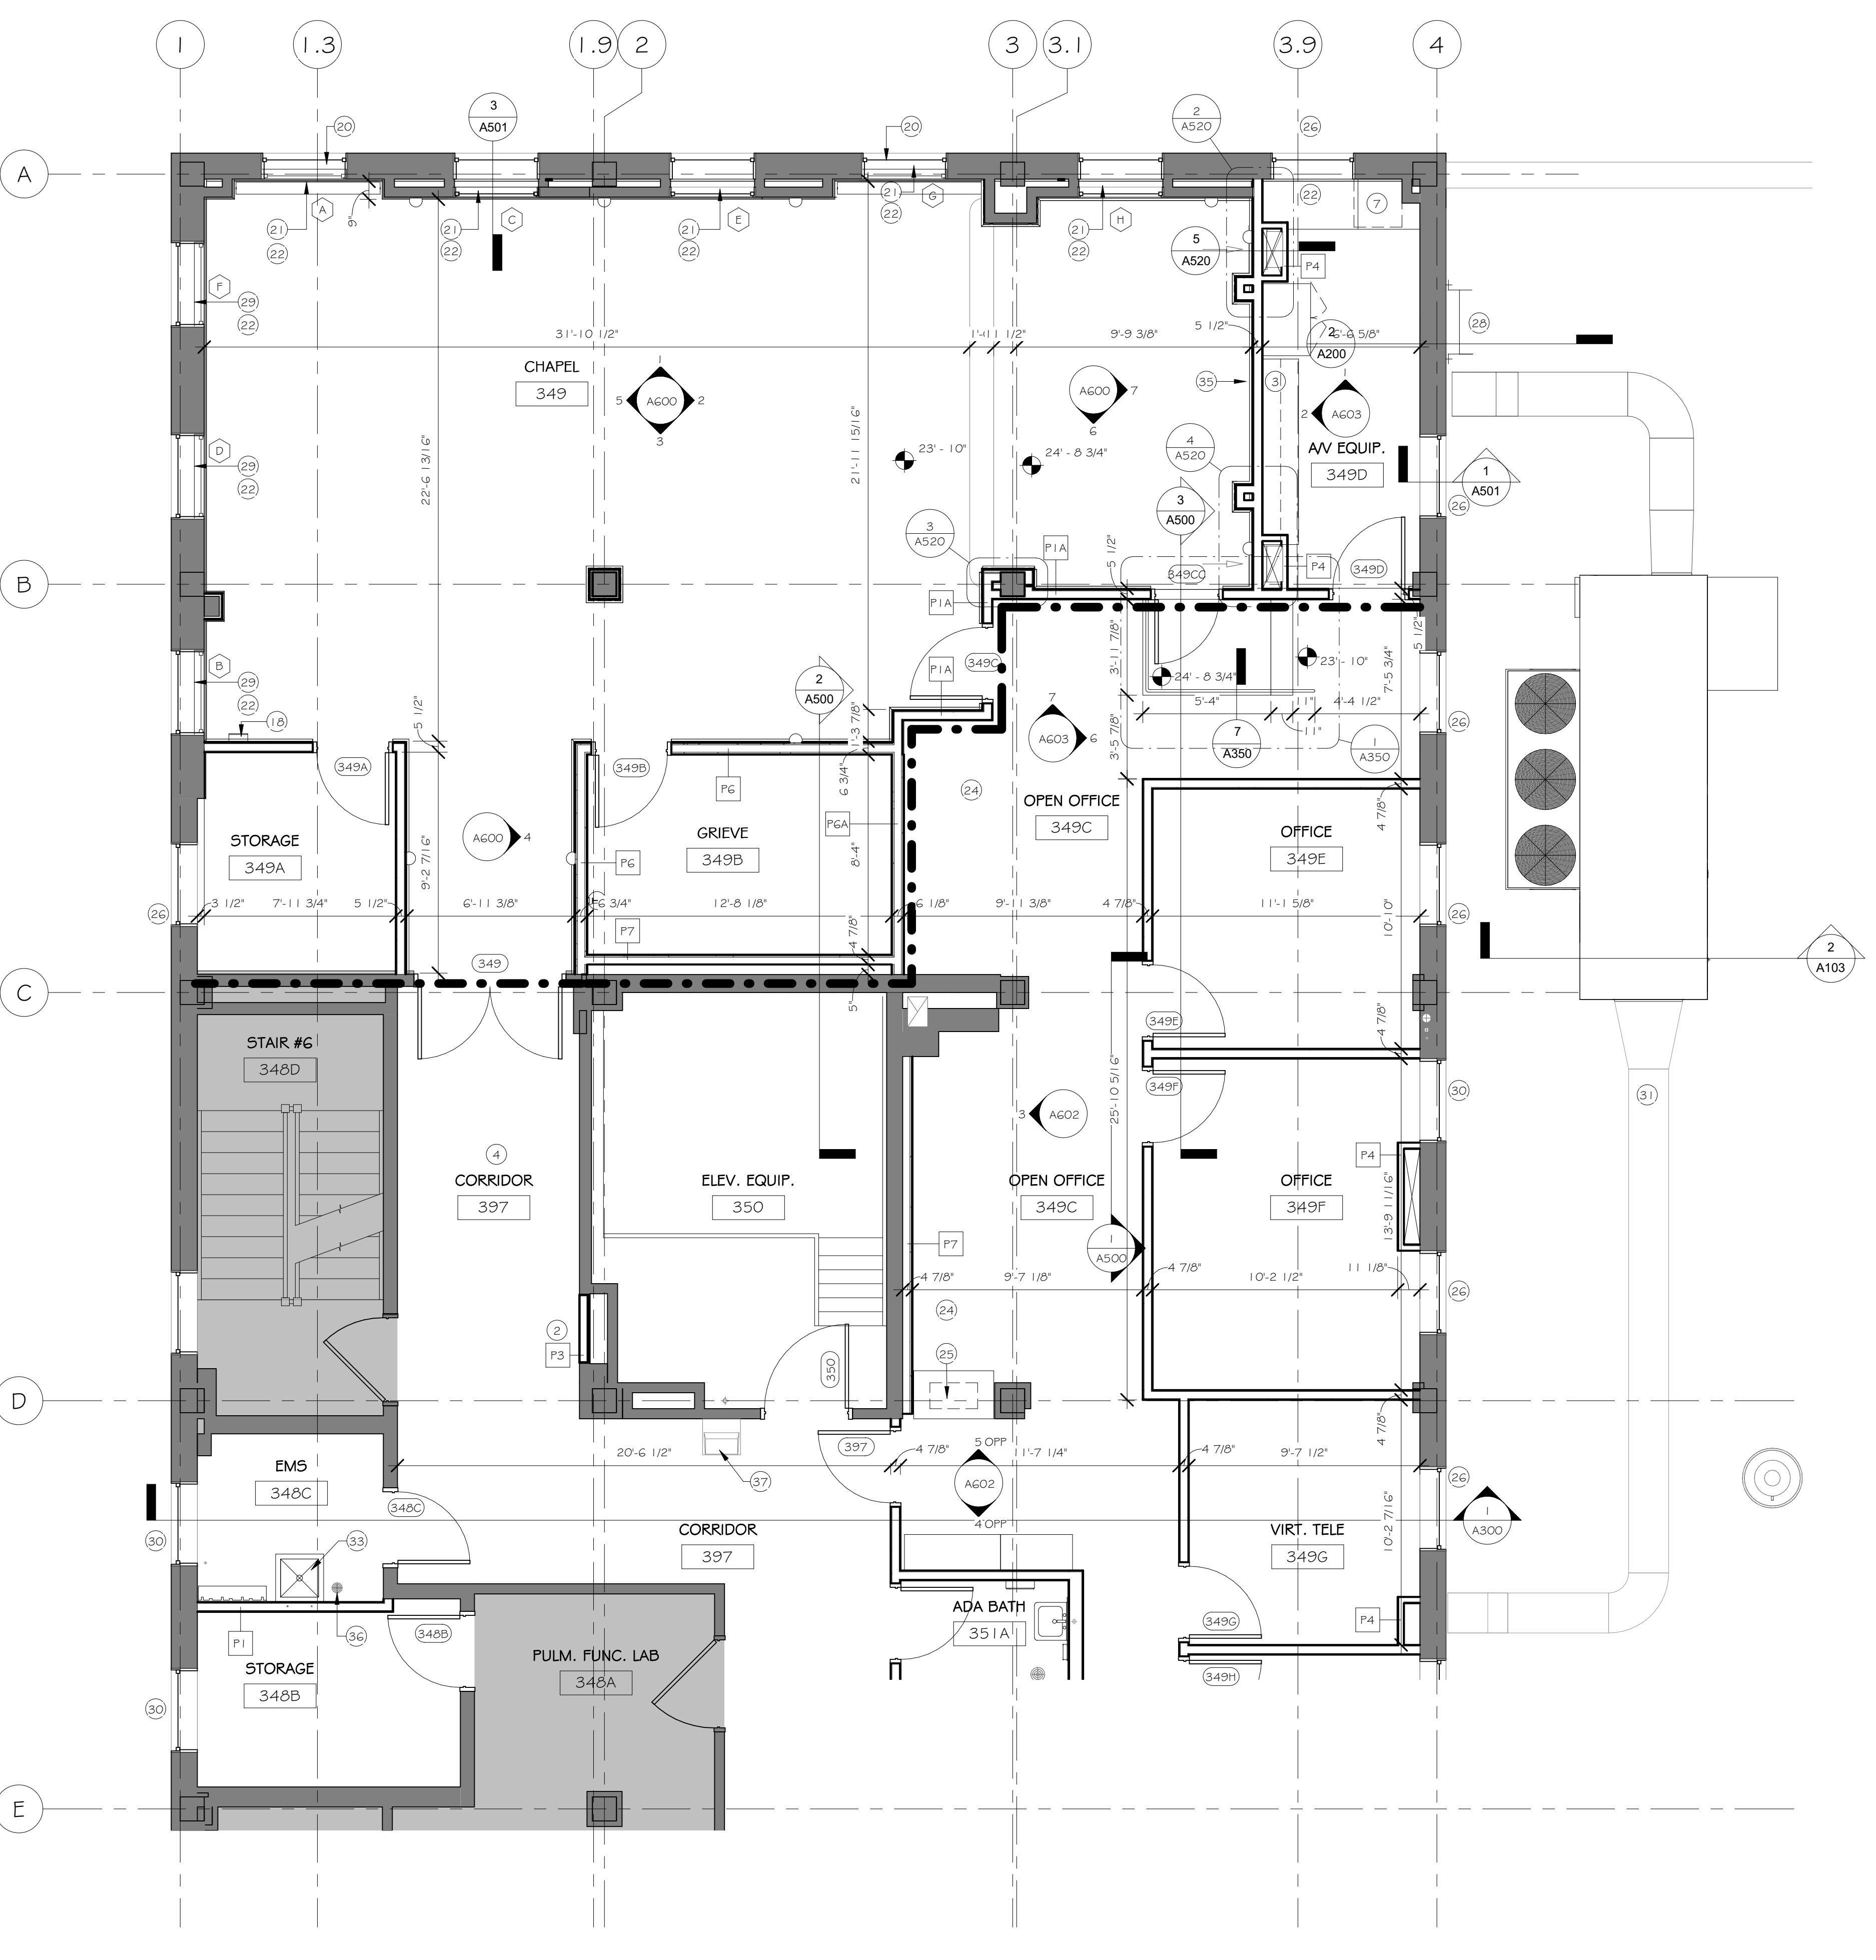

1 A - THIRD FLOOR - ENLARGED FLOOR PLAN - CHAPEL
 1/4" = 1'-0"

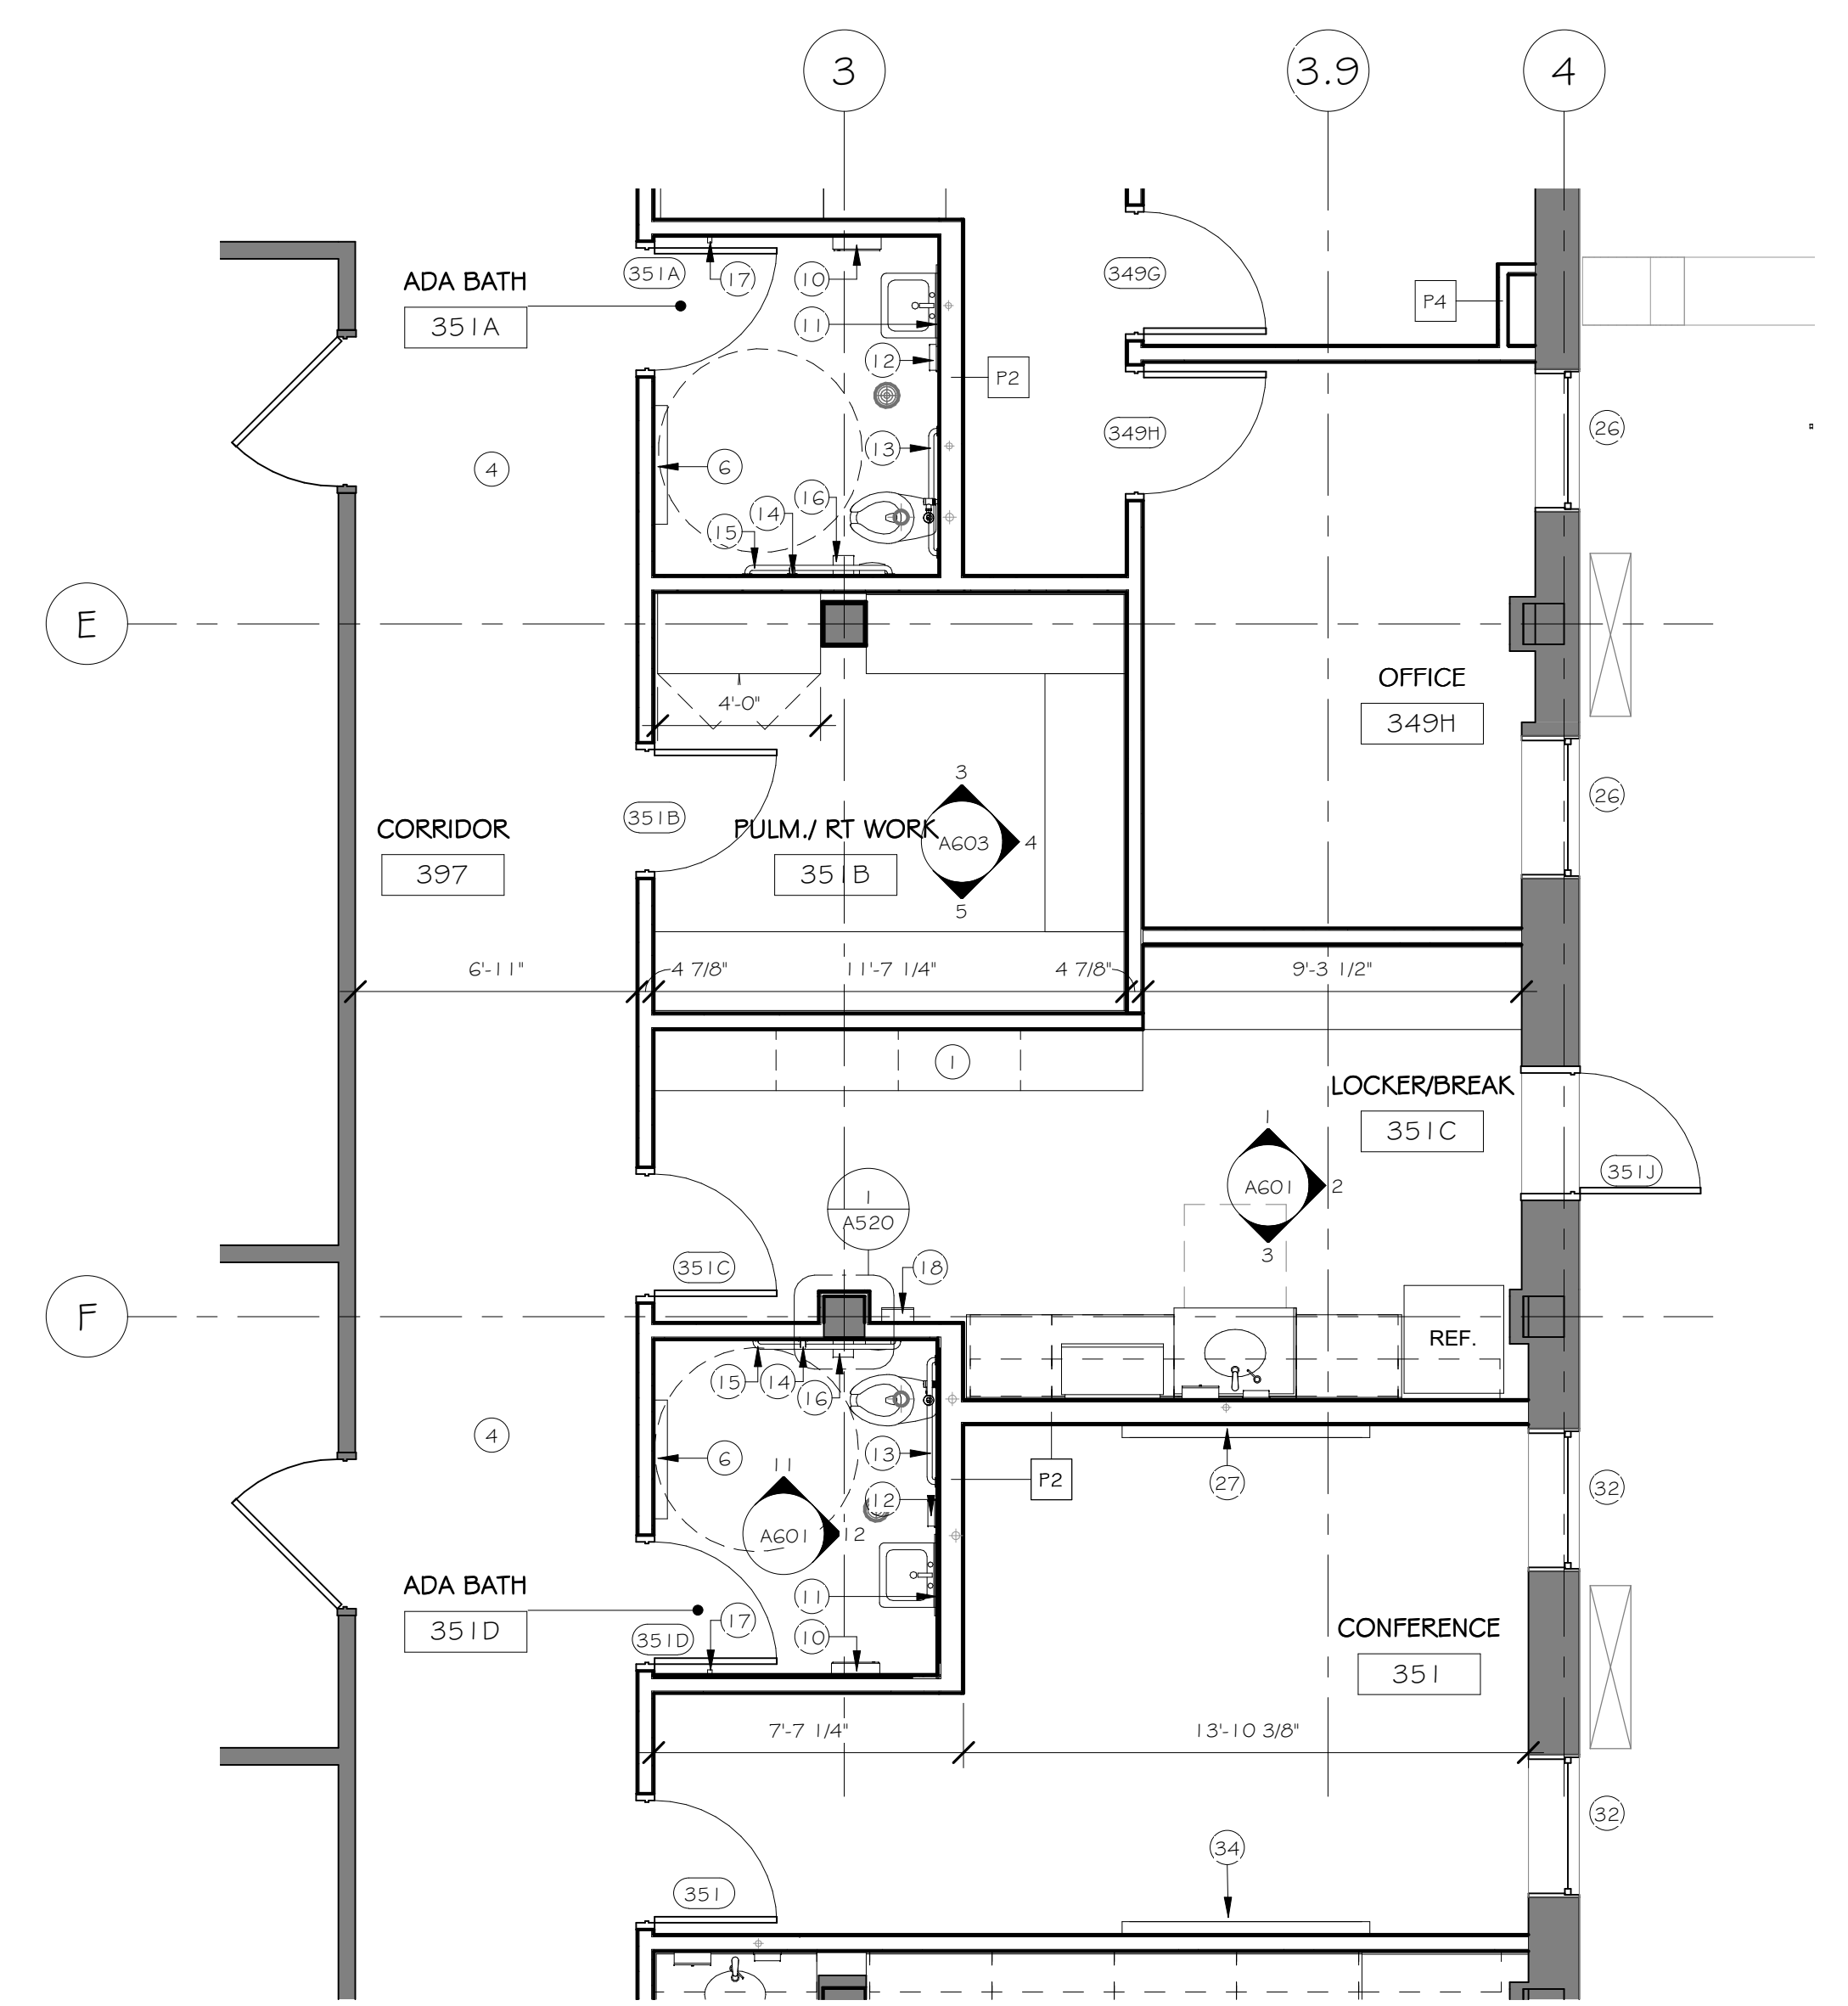

2 A - THIRD FLOOR - ENLARGED PLAN
 1/4" = 1'-0"

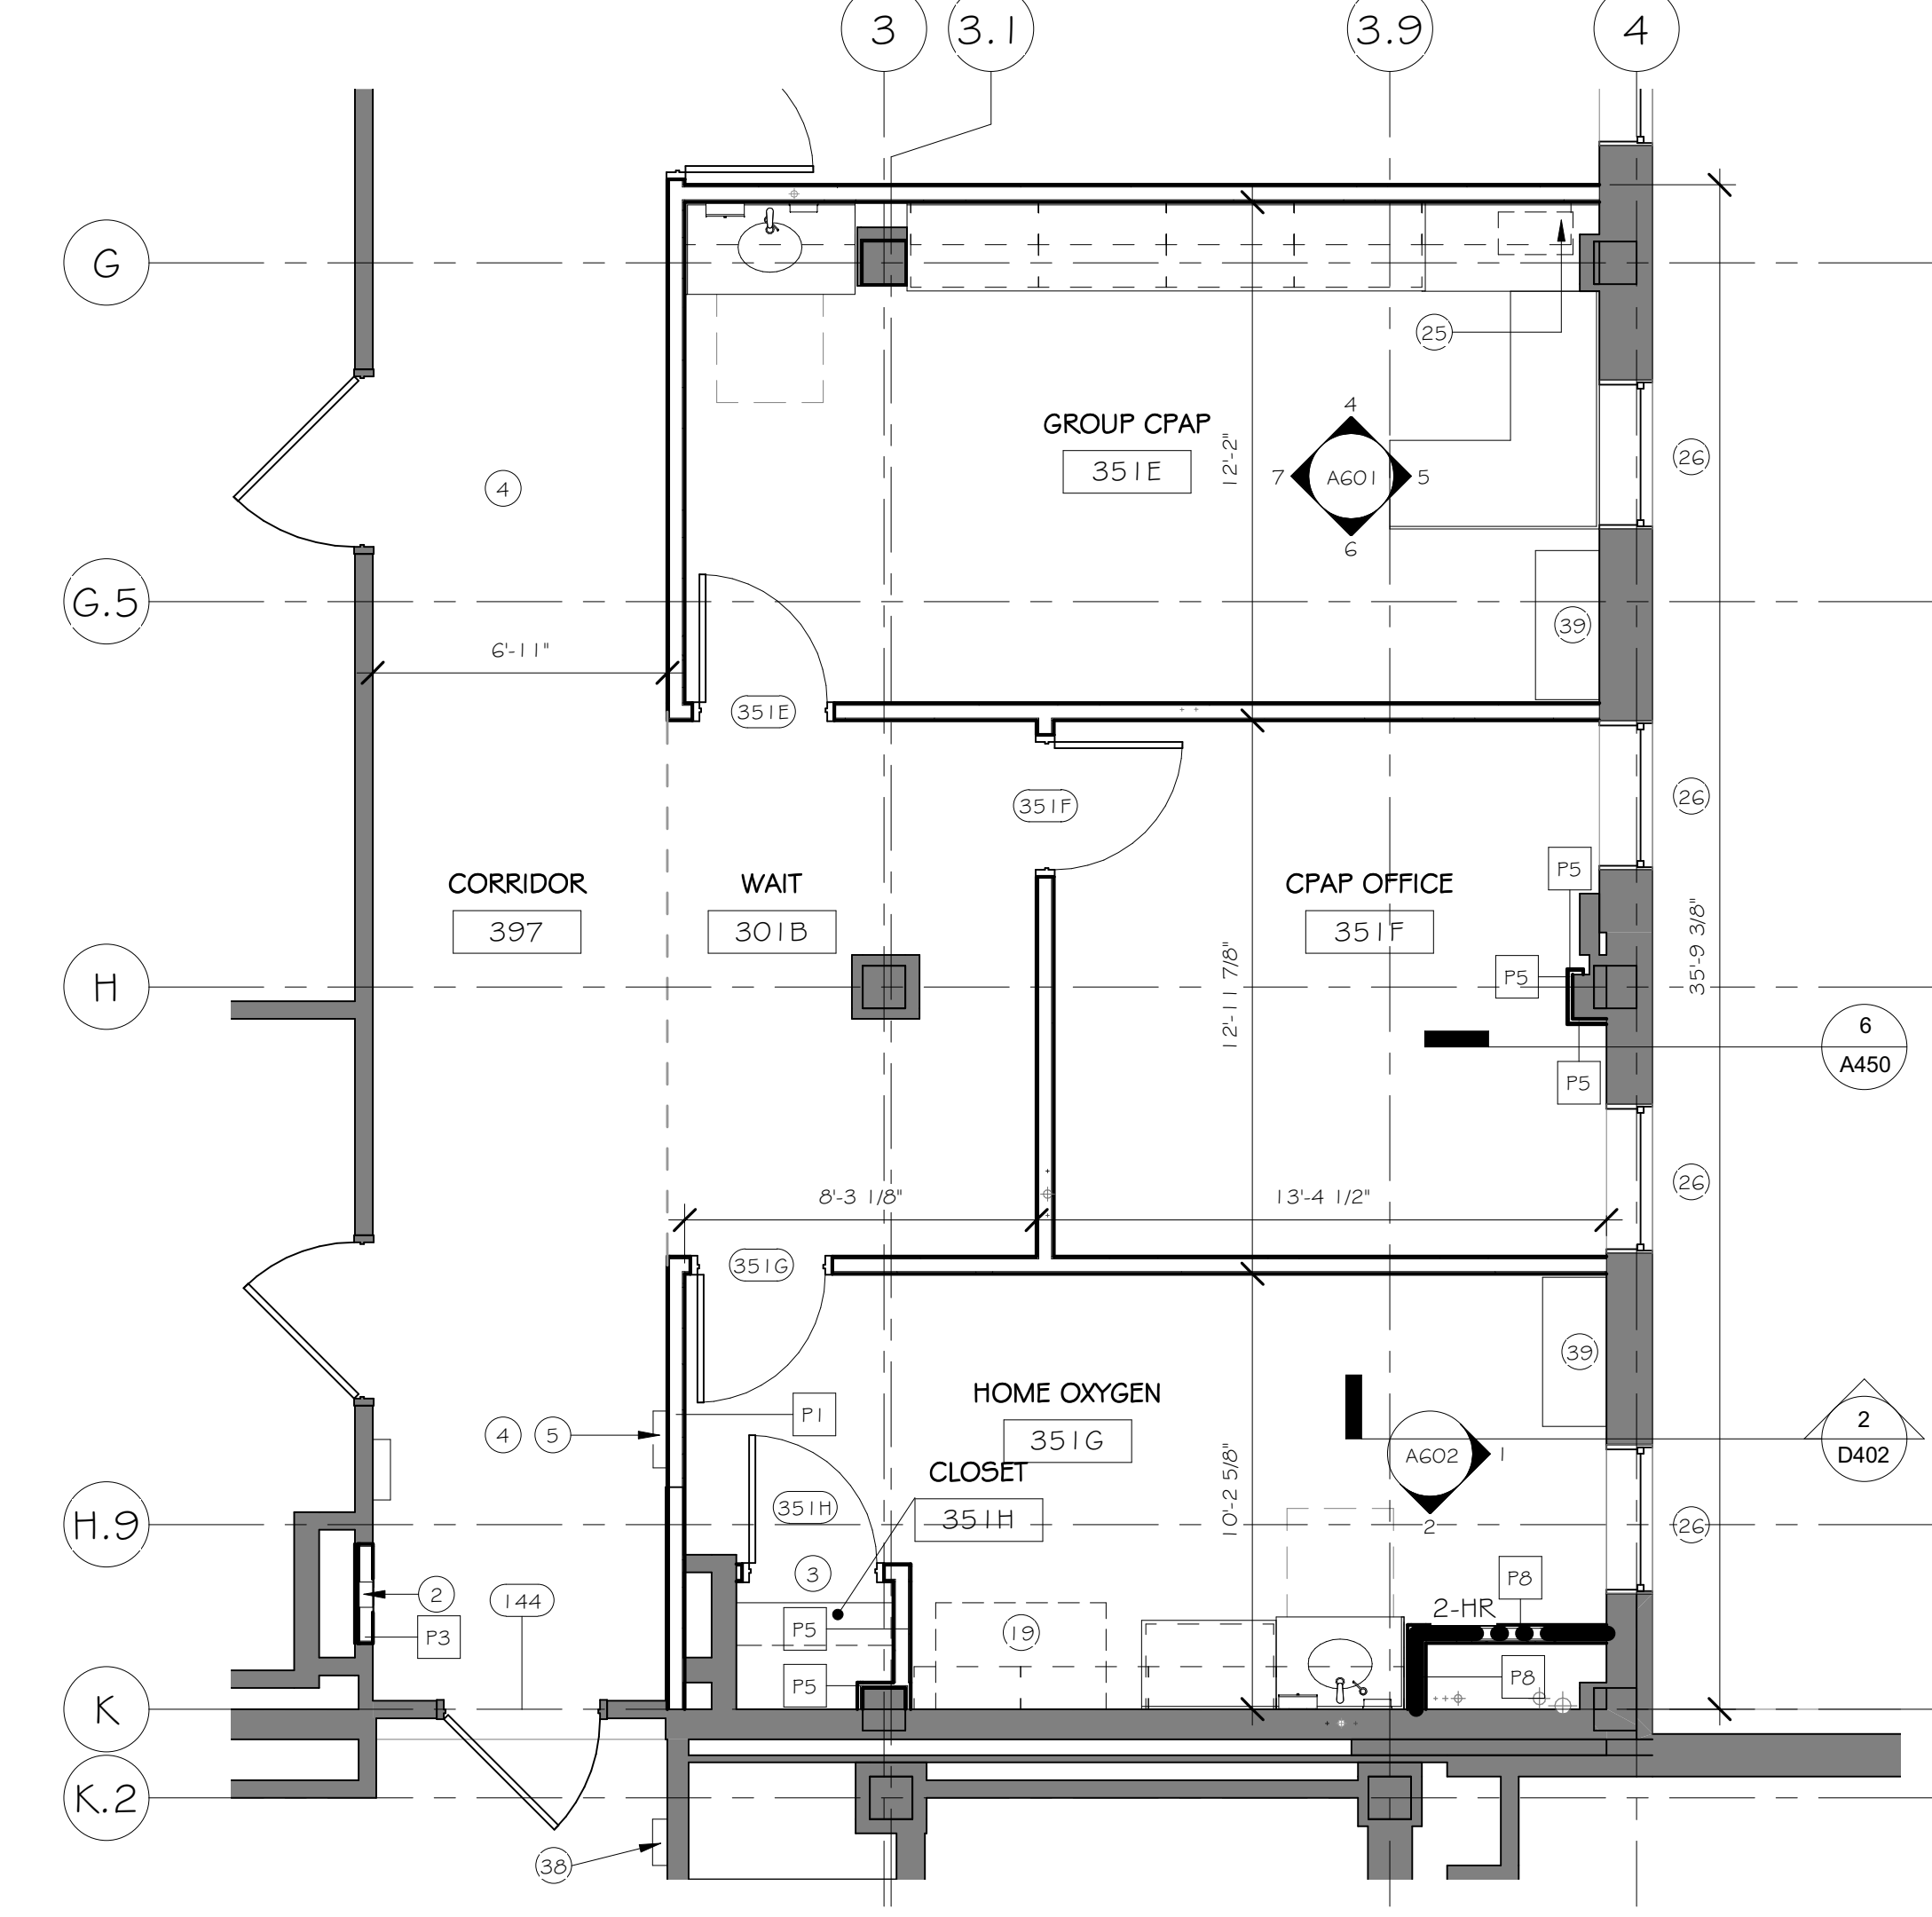

3 A - THIRD FLOOR - ENLARGED PLAN - EXAM ROOMS
 1/4" = 1'-0"

three eighths inch = one foot
 one and one half inches = one foot
 one inch = one foot
 three quarters inch = one foot
 one half inch = one foot
 one quarter inch = one foot
 one eighth inch = one foot

3/13/2017 3:51:43 PM
 C:\Users\newcomb\Documents\Ref_2018\2018.052_VA_Slow Falls_Chapel_01newcomb.rvt

Revisions:


Revisions:	Date

ENGINEERS/CONSULTANTS:

WOOLPERT, INC.
 343 FOUNTAINS PARKWAY
 SUITE 100
 FAIRVIEW HEIGHTS, IL 62208
 314-436-0865
 314-436-0884 fax

SCI ENGINEERING, INC
 130 POINT WEST BLVD.
 ST. CHARLES, MO 63301
 636-949-8200
 636-949-8269 fax

FINAL SUBMITTAL
 FOR CONSTRUCTION

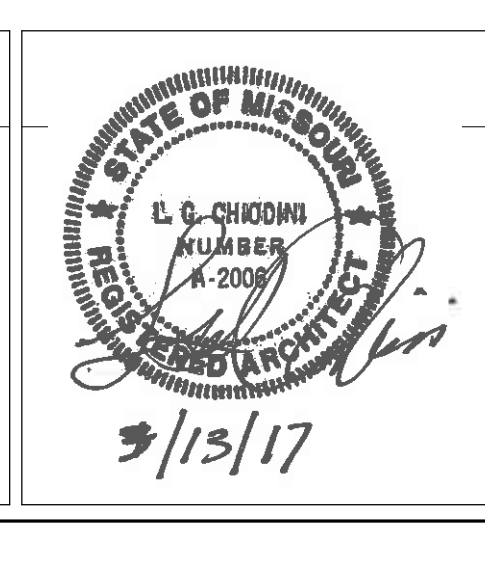

ARCHITECT:

Chiodini
 ARCHITECTS
 Architecture / Interior Design / Graphics
 1401 S. Brentwood Blvd. / Suite 575 / St. Louis, Missouri 63144
 314-725-5588 / arch@chiodini.com

Drawing Title
ENLARGED FLOOR PLANS

Approved: Project Director
 Approver

Project Title
VA HEALTH CARE SYSTEM

Location
 VA5 438-16-104 BLDG. 5 CHAPEL
 SIOUX FALLS, SD 57105

Date
 2017.03.13

Checked
 RLK

Drawn
 C.J.N

Project Number
 438-16-104 2016.052

Building Number
 5

Drawing Number
A120

Owner
 Department of Veterans Affairs

Scale: As indicated